Retrofit and New Construction Lighting Worksheet


First Energy,

Contrary Name

C

If "Content" is salested as the Peal Foliure Calegory, place order the lighting equipment details as a nation

permanent permanent Casamanage	* Industria a required Bold	Pro installation [Beloaki]			Post Installation (Saturalis)				Council Davig Leding (FRIN)
Line "Project Type Floor Sens Sens (day Sens (plant mans)	Tokedor ar Estarior Fabrus? "Estility/Lone Type (Angulusan (Angulusan manu)	** ** ** ** ** ** ** *	Marie Pereira Marie Mari	Ment Ment Fabors Category Ment Fabors Generalistics Fedora (Bury dram more) (Bury dram more)	(markine fide per Feel Walls from Semired Cell (makes) Federa per Fishere (makes E) Fisher	underd LD Uprage Questity of Peas Patron of Per Lance Foot Source Cut Street Fortier Lance Foot Source Cut Street Fortier Lance Foot Source 1 LD Uprage Question Lance Foot Source 1 LD Uprage Question Lance Foot Source Foot Source 1 LD Uprage Question Lance Foot Source F	Park Control Type (himp draw menn) Generated are included on (and MINE) (and MINE)	Spripment Full Calenthree Fater Fater Control County Count	Armed Group Sainty Said State Armed Side Savet Said Said Said Savet Said Said Said Said Savet Said Said Said Said Said Said Said Said
1 brish Grd later	Estation Purking Last Estation Purking Last Estation Purking Last	Unwild Universit (3 trincipt) 880 8826 (control Universit (3 trincipt) 58 880	Area Shide man Kiliy Undin	Street SEE februs celeiro kentili SEE februs. Pering Lag line Pub Manned See See SEE februs celeiro kentili SEE februs. Pering Lag line Pub Manned See See SEE februs celeiro kentili SEE februs.	COS for Factor 1 to Cupic Co C	60.00 1 50 100 100 100	good equipment frame blank 48.83 Provided Use Default Facility from USE Provided Use Order Facility from	MI 0-04 0-05 0-05 0-05 0-05 0-05 0-05 0-05	107,180.70 030 C750.50 M7.180.70 S.NA.70 030 C550.33 S.NA.7
2									
5									
1 1									
0									
id id									
3 u									
36 30									
25									
X X									
20 20 20 20 20 20 20 20 20 20 20 20 20 2									
30 30									
5 31									
×									
D H									
6									
44									
6 6									
e e									
6 0									
9									
8									
G G									
6 0									
66									
66 60									
10 70									
30 30 30									
N N									
30 30									
N									
D									
M 55									
D									
# E									
6 6									
16 16									
0 16									
100									
100									
is is									
10 10 10									
100									
100 100 100									
SM SM									
100									
130 130 130									
IS IS									
136 137									
108									
10									
100									
120									
100									
10									
Let									
12									
100									
100 100									
UE.									
10									
160									
100									
at a									
10									
100									
IX									
DX DX									
28									
us.									
10 10									
16									
100 100 100									
100									
100									
30									
28 28									
26									
36									
30 30									
34 38									
2									
3.0 3.0									
206 200 206									
28									
200 208									
200 200 20									
26									

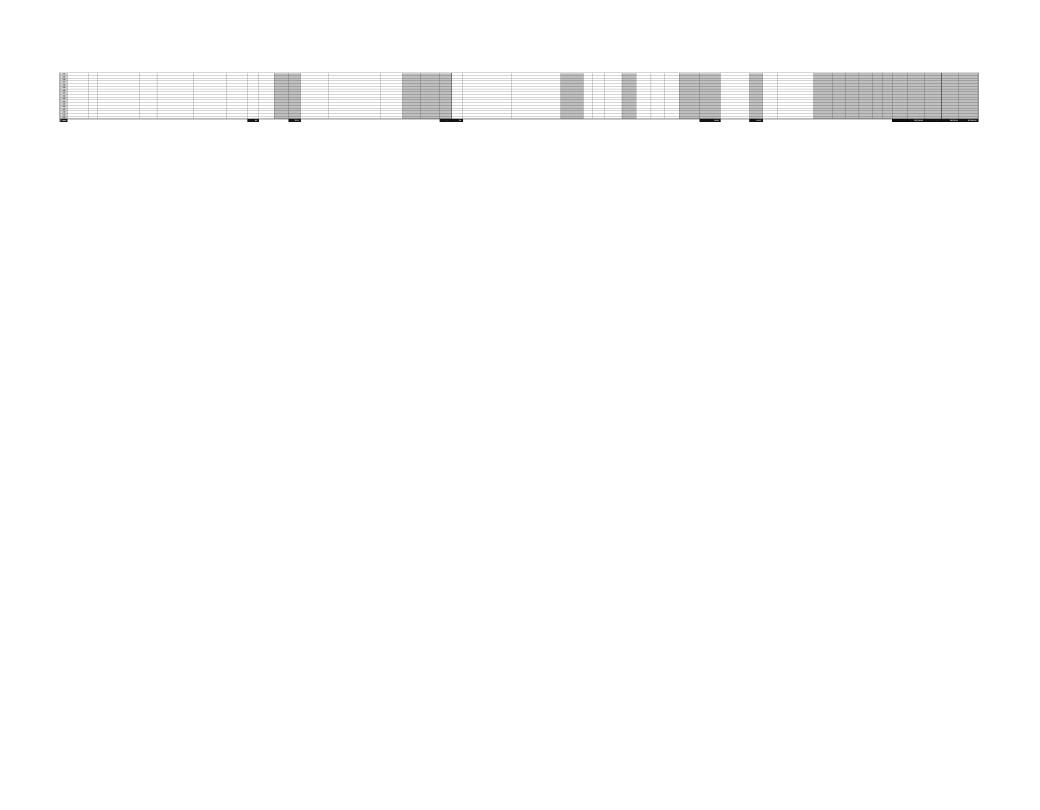

Project Estimated Summary

Lighting Incentive Program

Customer Name	Ohio Turnpike
Building Name	Toli Plaza #145
Building Address	State Route 57, Elyria

Estimated Annual Energy Savings (kWh)	207,545.45
Demand Reduction (kW _{Summer})	
Annual Operating Hours	3833
Total Calculated Project Incentive	\$8,278.24

Equipment Category	kW	kWh	Quantity	Incentive
Lighting Controls	-	-	0	\$0.00
Linear Fluorescent T8 & T5	-	-	0	\$0.00
Linear LED	-	-	0	\$0.00
Exit Signs	-	-	0	\$0.00
LED Fixtures External	-	-	0	\$0.00
LED Fixtures Internal	-	-	0	\$0.00
LED Lamps	-	-	0	\$0.00
LED Reach-in Refrigerator/Freezer Lighting	-	-	0	\$0.00
LED Channel Signage	-	-	0	\$0.00
Street and Area Lighting	-	207,545.45	54	\$8,278.24
Custom - Process Improvement	-	-	0	\$0.00

Sodexo, Inc. - 1 (866) 578-5220 | energysaveOH@sodexo.com

0.00	Deemed kW Savings
0.00	As Found kW Savings
0.00	Total kW Savings
207545.45	Deemed kWh Savings
207545.45	As Found kWh Savings
207545.45	Total kWh Savings
0.00	Non Prescriptive kWh Savings