

Prairie Township Board of Trustees

23 Maple Dr.
Columbus, Ohio 43228

Telephone (614) 878-3317 Fax (614) 878-0566

Steve Kennedy
Nicole Schlosser
Doug Stormont
Trustees
Tracy Hatmaker
Administrator
Lori Montag
Fiscal Officer

January 31, 2008

Public Utilities Commission of Ohio
Administration/Docketing
180 East Broad Street, 13th Floor
Columbus, Oh 43215-3793

Re: Case # 07-1112-WS-AIR
Ohio American Water Company

To Whom It May Concern:

Enclosed are the results from random hardness testing done in the Lake Darby system. These tests show Ohio American Water Company to be over the stipulated hardness range 6 days in January 2008. These stipulations require Ohio American to be within the stipulated hardness range 95% of the time. These tests prove Ohio American only met the stipulations 81% of the time for the month of January 2008.

Sincerely,
Steve Kennedy
Steve Kennedy
Prairie Township Trustee


This is to certify that the images appearing are an accurate and complete reproduction of a case file document delivered in the regular course of business
Technician SM Date Processed 2/1/08

RECEIVED-DOCKETING DIV
2008 FEB - 1 PM 12:56
PUCO

January-08	Date	Day	Conductivity Reading	Temp	Drops	Time	mg/l Hardness
	1	Tuesday	725	71.2	7	1:15am	119
	2	Wednesday	703	68	7	9:30pm	119
	3	Thursday	675	60	7	3:30pm	119
	4	Friday	690	58.8	7	9:30am	119
	5	Saturday	625	66.5	7	3:02pm	119
	6	Sunday	715	72.8	7	3:15pm	119
	7	Monday	694	72.8	9	6:31pm	153
	8	Tuesday	734	75	8	8:42pm	136
	9	Wednesday	742	74.6	8	8:51pm	136
	10	Thursday	754	74.4	8	9:05pm	136
	11	Friday	650	61.8	8	7:32pm	136
	12	Saturday	720	69	8	9:05pm	136
	13	Sunday	731	68	9	7:47pm	153
	14	Monday	672	63.6	11	9:41am	188
	15	Tuesday	728	65.1	8	2:10pm	136
	16	Wednesday	747	70.1	8	2:05pm	136
	17	Thursday	789	61.5	7	2:25pm	119
	18	Friday	728	69	8	7:31pm	136
	19	Saturday	745	70.8	7	3:02pm	119
	20	Sunday	653	59.5	11	6:33pm	188
	21	Monday	683	61.8	11	7:00am	188
	22	Tuesday	718	69	8	9:01pm	136
	23	Wednesday	680	63.8	8	9:01pm	136
	24	Thursday	677	63.5	8	2:45pm	136
	25	Friday	692	64.2	8	2:15pm	136
	26	Saturday	666	67.4	10	5:13pm	171
	27	Sunday	673	65.1	8	8:31pm	136
	28	Monday	679	64.2	8	9:22am	136
	29	Tuesday	652	68.7	8	3:03pm	136
	30	Wednesday	677	64	7	9:03pm	119
	31	Thursday	702	66	7	1:20pm	119
	*21	Monday	679	67.4	10	7:15pm	171

Second Test from 21*

January 2008 Lake Darby Random Testing Finish Water Hardness

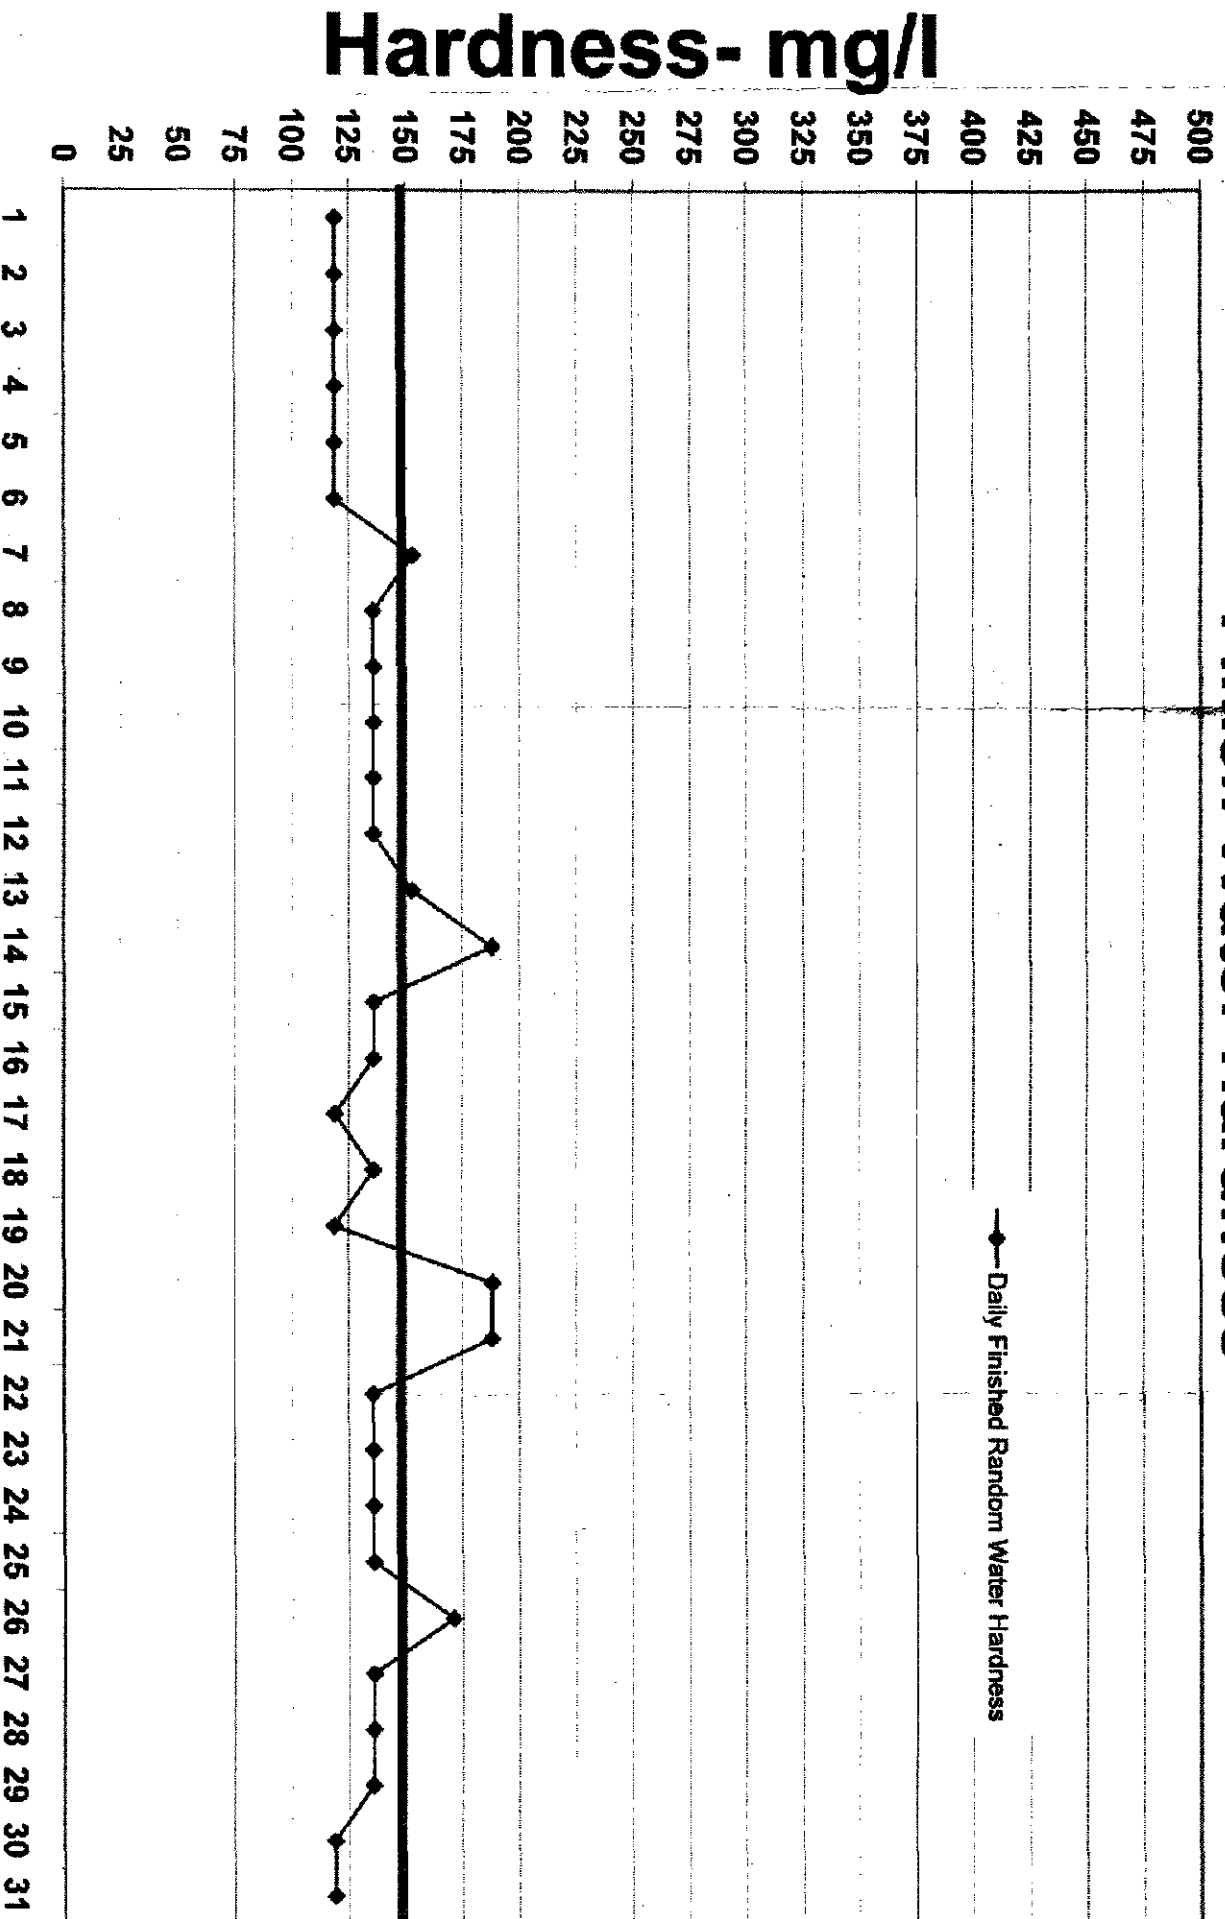

Date