



Public Utilities Commission

Application for Certification as an Eligible Ohio Renewable Energy Resource Generating Facility

Case No.: 10 – 0370 - EL-REN

A. Name of Renewable Generating Facility: Bridgewater Dairy Anaerobic Digester

The name specified will appear on the facility's certificate of eligibility issued by the Public Utilities Commission of Ohio.

Facility Location

Street Address: 14587 County Road 850

City: Montpelier State: Ohio Zip Code: 43543

Facility Latitude and Longitude

Latitude: 41.59007

Longitude: -84.611596

There are internet mapping tools available to determine your latitude and longitude, if you do not have this information.

If applicable, U.S. Department of Energy, Energy Information Administration Form EIA-860 Plant Name and Plant Code.

EIA-860 Plant Name: Weaver Bridgewater Dairy

EIA Plant Code: 56498

B. Name of the Facility Owner: Bridgewater Dairy, L.L.C.

Please note that the facility owner name listed will be the name that appears on the certificate. The address provided in this section is where the certificate will be sent.

If the facility has multiple owners, please provide the following information for each on additional sheets.

Applicant's Legal Name (First Name, MI, Last Name): Leon D. Weaver

Title: Owner

Organization: LD Weaver Trust

Street Address: 14587 County Road 850

City: Montpelier State: Ohio Zip Code: 43543

Country: USA

Phone: 419-485-8157 Fax: 419-485-2088 Email Address: nancy@bwdairy.com

Web Site Address (if applicable): www.bridgewaterdairy.com

Applicant's Legal Name (First Name, MI, Last Name): Chris C. Weaver

Title: Owner

Organization: CC Weaver Trust

Street Address: 14587 County Road 850

City: Montpelier State: Ohio Zip Code: 43543

Country: USA

Phone: 419-485-8157 Fax: 419-485-2088 Email Address: nancy@bwdairy.com

Web Site Address (if applicable): www.bridgewaterdairy.com

Applicant's Legal Name (First Name, MI, Last Name): Den Dulk

Title: Owner

Organization: Den Dulk Trust

Street Address: 4633 Wunsch Road

City: Ravenna State: Michigan Zip Code: 49451

Country: USA

Phone: Fax: Email Address:

Web Site Address (if applicable):

C. List name, address, telephone number and web site address under which Applicant will do business in Ohio.

Applicant's Legal Name (First Name, MI, Last Name): Leon D. Weaver

Title: Owner

Organization: Bridgewater Dairy L.L.C.

Street Address: 14587 County Road 850

City: Montpelier State: Ohio Zip Code: 43543

Country: USA

Phone: 419-485-8157 Fax: 419-485-2088 Email Address: nancy@bwdairy.com

Web Site Address (if applicable): www.bridgewaterdairy.com

D. Name of Generation Facility Operating Company: Bridgewater Dairy, L.L.C.

Applicant's Legal Name (First Name, MI, Last Name): Leon D. Weaver

Title: Owner

Organization: Bridgewater Dairy L.L.C.

Street Address: 14587 County Road 850

City: Montpelier State: Ohio Zip Code: 43543

Country: USA

Phone: 419-485-8157 Fax: 419-485-2088 Email Address: nancy@bwdairy.com

Web Site Address (if applicable): www.bridgewaterdairy.com

E. Contact person for regulatory or emergency matters

Legal Name of Contact Person (First Name, MI, Last Name): James, Walker

Title: Director, Power Delivery Engineering & Planning

Organization: Buckeye Power, Inc.

Street Address: 6677 Busch Blvd., P.O. Box 26036

City: Columbus State: Ohio Zip Code: 43226

Country: USA

Phone: 614-846-5757 Fax: 614-846-7108 Email Address: ljw@buckeyepower.com

Web Site Address (if applicable): www.buckeyepower.com

F. Certification Criteria 1: Deliverability of the Generation into Ohio

Ohio Revised Code (ORC) Sec. 4928.64(B)(3)

The facility must have an interconnection with an electric utility.

Check which of the following applies to your facility's location:

☒ The facility is located in Ohio.

☐ The facility is located in a state geographically contiguous to Ohio (Indiana, Kentucky, Michigan, Pennsylvania, or West Virginia).

☐ The facility is located in the following state:

If the renewable energy resource generation facility is not located in Ohio, Indiana, Kentucky, Michigan, Pennsylvania, or West Virginia, you are required to submit a study by one of the regional transmission organizations (RTO) operating in Ohio, either PJM or Midwest ISO, demonstrating that the power from your facility is physically deliverable into the state of Ohio. The study may be conducted by someone other than the RTO provided that the RTO approves the study. This study must be appended to your application as an exhibit.

G. Certification Criteria 2: Qualified Resource or Technology

You should provide information for only one resource or technology on this application; please check and/or fill out only one of the sections below. If you are applying for more than one resource or technology, you will need to complete a separate application for each resource or technology.

G.1. For the resource or technology you identify in Sections G.4 – G.13 below, please provide a written description of the system.

Bridgewater Dairy employees milk approximately 3,500 cows twice daily and tend to about 4,500 acres of crop land. They have constructed an anaerobic digester system of waste treatment to address organic waste disposal problems. Methane gas, a byproduct of the digestion process, is utilized for the production of electricity. The generation facility is interconnected to a 12 kV distribution system owned by North Western Electric Cooperative, Inc., the local electric distribution company. Normally, all of the electricity produced by the facility is purchased by Buckeye Power, Inc., a generation and transmission organization owned by Ohio's rural electric cooperatives. However, equipment and procedures are in place to allow Bridgewater to self serve the farm operation in case of extended outages.

The generation facility consists of two Guascor combustion engines with Newage generators that can produce approximately 600 kW each (1,200 kW total). The 480 volt generation is stepped up through a 1,500 KVA transformer and is interconnected to North Western Electric Cooperative's 12,470 volt distribution system.


G.2. Please include a detailed description of how the output of the facility is going to be measured and verified, including the configuration of the meter(s) and the meter type(s).

The generation output is metered through a Landis + Gyr model AXS4-E, form 9S/8S type meter. The electronic meter is configurable and is equipped with 4 output relays. Power flow data is sent to Buckeye Power's facility in Columbus, Ohio, via satellite for monitoring and monthly statement preparation.

G.3. Please attach digital photographs that depict an accurate characterization of the renewable generating facility. Please indicate the date(s) the photographs were taken. For existing facilities, these photographs must be submitted for your application to be reviewed. For proposed facilities or those under construction, photographs will be required to be filed within 30 days of the on-line date of the facility.

Date photograph taken: March 9, 2010

INSERT PHOTOGRAPH(S)

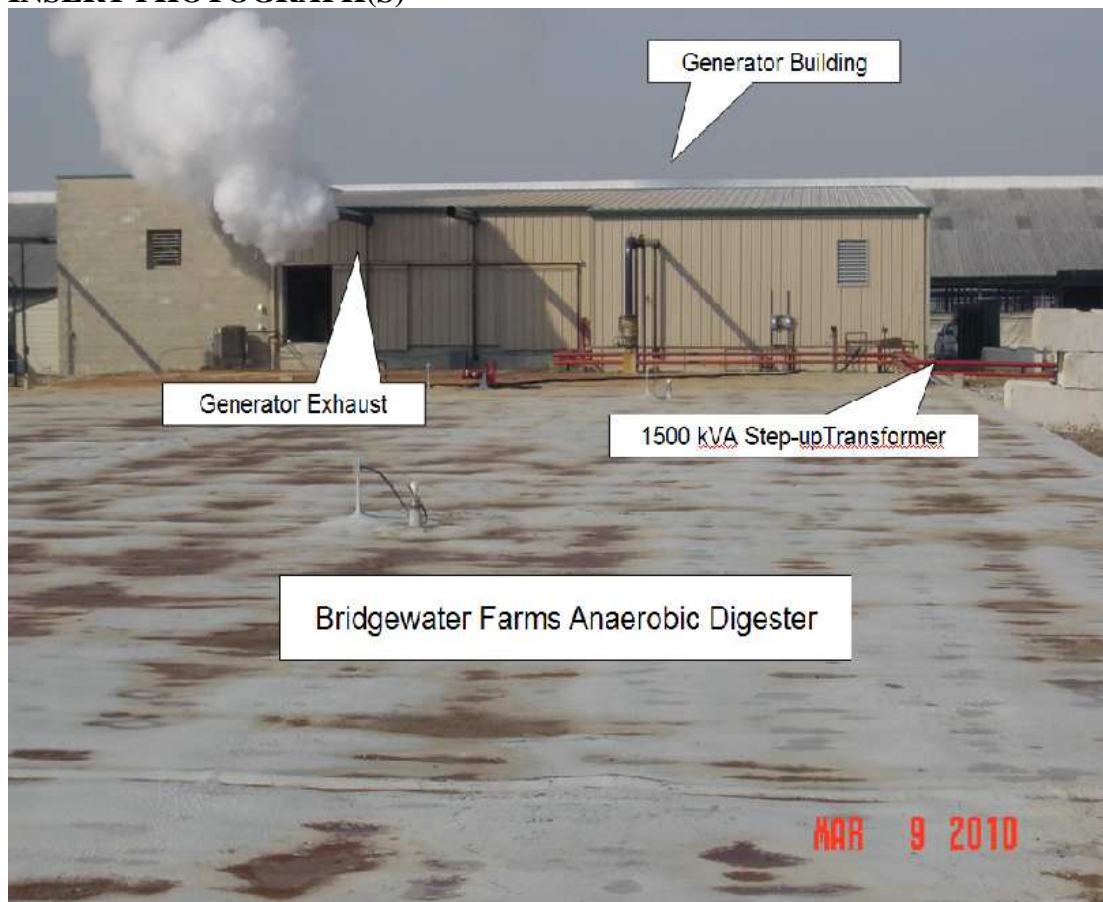



2 - 600 kW Guascor/Newage Gen-sets

MAR 9 2010

The Applicant is applying for certification in Ohio based on the following qualified resource or technology (Sec. 4928.01 O.R.C.):

G.4 __ SOLAR PHOTOVOLTAIC

Total PV Capacity (DC):

Total PV Capacity (AC):

Expected Capacity Factor:

Capacity factor is the ratio of the energy produced to the maximum possible at full power, over a given time period. Capacity factor may be calculated using this formula:

*Projected annual generation (kWh or MWh) **divided by** [the nameplate capacity (in kW or MW) **times** 8760]*

Anticipated Annual output in kWh/yr:

Location of the PV array: __ Roof __ Ground __ Other

of Modules and/or size of the array:

G.4a PV Modules

For each PV module, provide the following information:

Manufacturer:

Model and Rating:

G.5 __ SOLAR THERMAL (FOR ELECTRIC GENERATION)

G.6 __ WIND

Total Nameplate Capacity (kilowatts AC): _____ or kW DC:

Expected Capacity Factor:

Anticipated Annual Output in kWh/yr or MWh/yr:

of Generators:

G.6a Wind Generators

If your system includes multiple generators, please provide the following information for each unique generator you have in your system

Manufacturer:

Model Name and Number:

Generator Nameplate Capacity (kilowatts AC):

Wind Hub Height (ft):

Wind Rotor Diameter (ft):

G.7 __ HYDROELECTRIC ("hydroelectric facility" means a hydroelectric generating facility that is located at a dam on a river, or on any water discharged to a river, that is within or bordering this state or within or bordering an adjoining state (Sec. 4928.01(35) O.R.C.)

Check each of the following to verify that your facility meets each of the statutory standards (Sec. 4928.01(35) O.R.C.):

- __ (a) The facility provides for river flows that are not detrimental for fish, wildlife, and water quality, including seasonal flow fluctuations as defined by the applicable licensing agency for the facility.
- __ (b) The facility demonstrates that it complies with the water quality standards of this state, which compliance may consist of certification under Section 401 of the "Clean Water Act of 1977," 91 Stat. 1598, 1599, 33 U.S.C. 1341, and demonstrates that it has not contributed to a finding by this state that the river has impaired water quality under Section 303(d) of the "Clean Water Act of 1977," 114 Stat. 870, 33 U.S.C. 1313.
- __ (c) The facility complies with mandatory prescriptions regarding fish passage as required by the Federal Energy Regulatory Commission license issued for the project, regarding fish protection for riverine, anadromous, and catadromus fish.
- __ (d) The facility complies with the recommendations of the Ohio Environmental Protection Agency and with the terms of its Federal Energy Regulatory Commission license regarding watershed protection, mitigation, or enhancement, to the extent of each agency's respective jurisdiction over the facility.
- __ (e) The facility complies with provisions of the "Endangered Species Act of 1973," 87 Stat. 884, 16 U.S.C. 1531 to 1544, as amended.
- __ (f) The facility does not harm cultural resources of the area. This can be shown through compliance with the terms of its Federal Energy Regulatory Commission license or, if the facility is not regulated by that commission, through development of a plan approved by the Ohio Historic Preservation Office, to the extent it has jurisdiction over the facility.
- __ (g) The facility complies with the terms of its Federal Energy Regulatory Commission license or exemption that are related to recreational access, accommodation, and facilities or, if the facility is not regulated by that commission, the facility complies with similar requirements as are recommended by resource agencies, to the extent they have jurisdiction over the facility; and the facility provides access to water to the public without fee or charge.
- __ (h) The facility is not recommended for removal by any federal agency or agency of any state, to the extent the particular agency has jurisdiction over the facility.

G.7 .1 Is your facility currently certified by the Low-Impact Hydro Institute?

☐ Yes

☐ No

G.8 ☐ GEOTHERMAL

G.9 ☐ SOLID WASTE (as defined in ORC section 3734.01), electricity generation using fuel derived from solid wastes through fractionation, biological decomposition, or other process that does not principally involve combustion. (Sec. 4928.01(A)(35) O.R.C.)

Identify all fuel types used by the facility and respective proportions (show by the percent of heat input):

G.10 ☒ BIOMASS (includes biologically-derived methane gas, such as landfill gas)

Identify the fuel type used by the facility: Methane Gas

If co-firing an electric generating facility with a biomass energy resource, the proportion of fuel input attributable to the biomass energy resource shall dictate the proportion of electricity output from the facility that can be considered biomass energy.

G.10a List all fuel types used by the facility and respective proportions (show by the percent of heat input): Methane Gas

G.10b Please attach the formula for computing the proportions of output per fuel type by MWh or kWh generated.

G.11 ☐ FUEL CELL (any fuel cell used in the generation of electricity, including, but not limited to, a proton exchange membrane fuel cell, phosphoric acid fuel cell, molten carbonate fuel cell, or solid oxide fuel cell; Sec. 4928.01(35)(A) O.R.C.).

Identify all fuel types used by the facility and respective proportions:

G.12 ☐ STORAGE FACILITY

H. Certification Criteria 3: Placed in Service Date (Sec. 4928.64. (A)(1) O.R.C.)

The Renewable Energy Facility:

☐ has a placed-in-service date before January 1, 1998; (month/day/year):

☒ has a placed-in-service date on or after January 1, 1998; (month/day/year): 08/28/2008

☐ has been modified or retrofitted on or after January 1, 1998; (month/day/year):

Please provide a detailed description of the modifications or retrofits made to the facility that rendered it eligible for consideration as a qualified renewable energy resource. In your description, please include the date of initial operation and the date of modification or retrofit to use a qualified renewable resource. Please include this description as an exhibit attached to your application filing and identify the subject matter in the heading of the exhibit.

☐ Not yet online; projected in-service date (month/day/year):

H.1 Is the renewable energy facility owner a mercantile customer?

ORC Sec. 4928.01 (19) "Mercantile customer" means a commercial or industrial customer if the electricity consumed is for nonresidential use and the customer consumes more than seven hundred thousand kilowatt hours per year or is part of a national account involving multiple facilities in one or more states.

☐ No

☐ Yes

Has the mercantile customer facility owner committed to integrate the resource under the provisions of 4928.64(A)(1), O.R.C.?

☐ No

☐ Yes

If yes, please attach a copy of your approved application as an exhibit to this filing.

I. Facility Information

The nameplate capacity of the entire facility in megawatts (MW): 1.2

If applicable, what is the expected heat rate of resource used per kWh of net generation:

N/A

Number of Generating Units: 2

I.1 For each generating unit, provide the following information:

In-Service date of each unit	The nameplate capacity of each unit in megawatts (MW)	Projected Annual Generation	Expected Annual Capacity Factor %
8/28/2008	0.6	2,628	50
8/28/2008	0.6	2,628	50

(To expand the number of rows if more units need to be reported, place your cursor in the bottom right cell and hit tab).

J. Regional Transmission Organization Information

In which Regional Transmission Organization area is your facility located:

☒ Within Geographic Area of PJM Interconnection, L.L.C.

☐ Within Geographic Area of Midwest ISO

☐ Other (specify):

K. Attribute Tracking System Information

Are you currently registered with an attribute tracking system: ☐ Yes ☒ No

In which attribute tracking system are you currently registered or in which do you intend to register (*the tracking system you identify will be the system the PUCO contacts with your eligibility certification*):

☒ GATS (Generation Attribute Tracking System)

☐ M-RETS (Midwest Renewable Energy Tracking System)

☐ Other (specify):

K.1 Enter the generation ID number you have been assigned by the tracking system:

If the generation ID number has not yet been assigned, you will need to provide this number to the PUCO within 15 days of your facility receiving this number from the tracking system).

L. Other State Certification

Is the facility certified by another state as an eligible generating resource to meet the renewable portfolio standards of that state?

☐ Yes

☒ No

L.1 If yes, for each state, provide the following information:

Name of State	State Certification Agency	State Certification Number	Date Issued

(To expand the number of rows if more units need to be reported, place your cursor in the bottom right cell and hit tab).

M. Type of Generating Facility

Please check all of the following that apply to your facility:

- ☐ Utility Generating Facility:
 - ☐ Investor Owned Utility
 - ☐ Rural Electric Cooperative
 - ☐ Municipal System
- ☐ Electric Services Company (competitive retail electric service provider certified by the PUCO)
- ☐ Distributed Generation with a net metering and interconnection agreement with a utility.
Identify the utility:
- ☐ Distributed Generation with both on-site use and wholesale sales.
Identify the utility with which the facility is interconnected:
- ☒ Distributed Generation, interconnected without net metering.
Identify the utility with which the facility is interconnected: North Western Electric Cooperative, Inc.

Note: if the facility does not yet have an interconnection agreement with a utility or transmission system operator, please note here the status of the application for such an agreement:

N. Meter Specifications

Metering Requirements

If the renewable energy resource generating facility is 6 kW or below, the output may be measured with either an inverter meter or a utility grade meter.

All facilities that are larger than 6 kW must measure the output of the facility with a utility grade meter. Facilities that are larger than 6 kW and that are not measuring output with a utility grade meter will not be certified. OAC 4901:1-40-04 (D)(1)

Please only report on the meter or the meters used to measure the output from the facility which will be reported to the attribute tracking system.

The meter(s) that are measuring output from the facility are:

☐ Inverter Meter(s)

☒ Utility Grade Meter(s)

Please provide the following information for each meter used in your system.

Manufacturer: Landis + Gyr

Serial Number: 98 032 817

Type: AXS4e

Date of Last Certification: October 27, 2009

Attach a photograph of the meter(s) with date image taken. The meter reading(s) must be clearly visible in the photograph.

Report the total meter reading number at the time the photograph was taken and specify the appropriate unit of generation (e.g., kWh): 7026 kWh (600 multiplier)

Date photograph taken: March 9, 2010

INSERT PHOTOGRAPH(S)



Landis + Gyr Electric Meter

The Public Utilities Commission of Ohio reserves the right to verify the accuracy of the data reported to the tracking system and to the PUCO.

O. Start date for reporting generation data to an attribute tracking system

In the Commission's June 17, 2009 Entry on Rehearing in Case No. 08-888-EL-ORD, the Commission found it to be appropriate to recognize the creation of RECs back to July 31, 2008, when the Ohio alternative energy portfolio standard law became effective, provided that the facility was a participant in an existing attribute tracking system during that time, or had a meter in place which can accurately demonstrate generation levels from July 31, 2008, forward (page 34). If the facility is not registered with and reporting to an attribute tracking system please provide a methodology and documentation which will support the specific generation output that would be reported to the attribute tracking system for the period from the placed-in-service date of the facility to the date the facility is scheduled to be certified, which is usually 61 days from the filing date of the application. The documentation may include dated photographs of the inverter and utility grade meters, written documentation of meter and inverter readings and measures, and entries of meter readings in a spreadsheet.

INSERT PHOTOGRAPH(S) OR DOCUMENTATION**Historical Monthly Output**

Month	MWh
August-08	36.3
September-08	213.2
October-08	239.4
November-08	240.8
December-08	290.8
January-09	208.7
February-09	233.4
March-09	352.5
April-09	332.3
May-09	317.1
June-09	287.2
July-09	281.4
August-09	309.4
September-09	293.5
October-09	337.4
November-09	320.4
December-09	309.1
January-10	292.9
February-10	311.4
March-10	327.6

Please state the specific start date that will be used to report generation output to the attribute tracking system, either the placed-in-service date or other: 08/28/2008

In the Commission's Entry on Rehearing, the Commission explained that consistent with its policy on double counting, the Commission will not retroactively recognize any past RECs which have been sold or otherwise consumed (page 34).

Has any of the generation of the facility been tracked as RECS that have been sold or otherwise consumed? Yes No ☒

The Public Utilities Commission of Ohio reserves the right to verify the accuracy of the data reported to the tracking system and to the PUCO.

Version: April 6, 2010

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

4/26/2010 1:51:33 PM

in

Case No(s). 10-0370-EL-REN

Summary: Application Application for certification as an eligible Ohio renewable energy resource generating facility. electronically filed by Mr. Joe C Haugen on behalf of BUCKEYE POWER, INC.