

**Case No. 10- 1322-EL-REN**  
***Hunter Residential PV***  
**Staff Interrogatories – Initial Set - Response**

Question 1: In For Section M of the application, please identify the utility through which distributed generation will occur.

Answer 1: Allegheny Power

Question 2: In For Section N. of the application, please provide a clear photograph of the Sangamo meter identified within the application.

Answer 2:


Manufacturer: GE

Serial Number: 96 599 233

Type: 1-70-S

Date of Last Certification: 7/30/09

See attached.

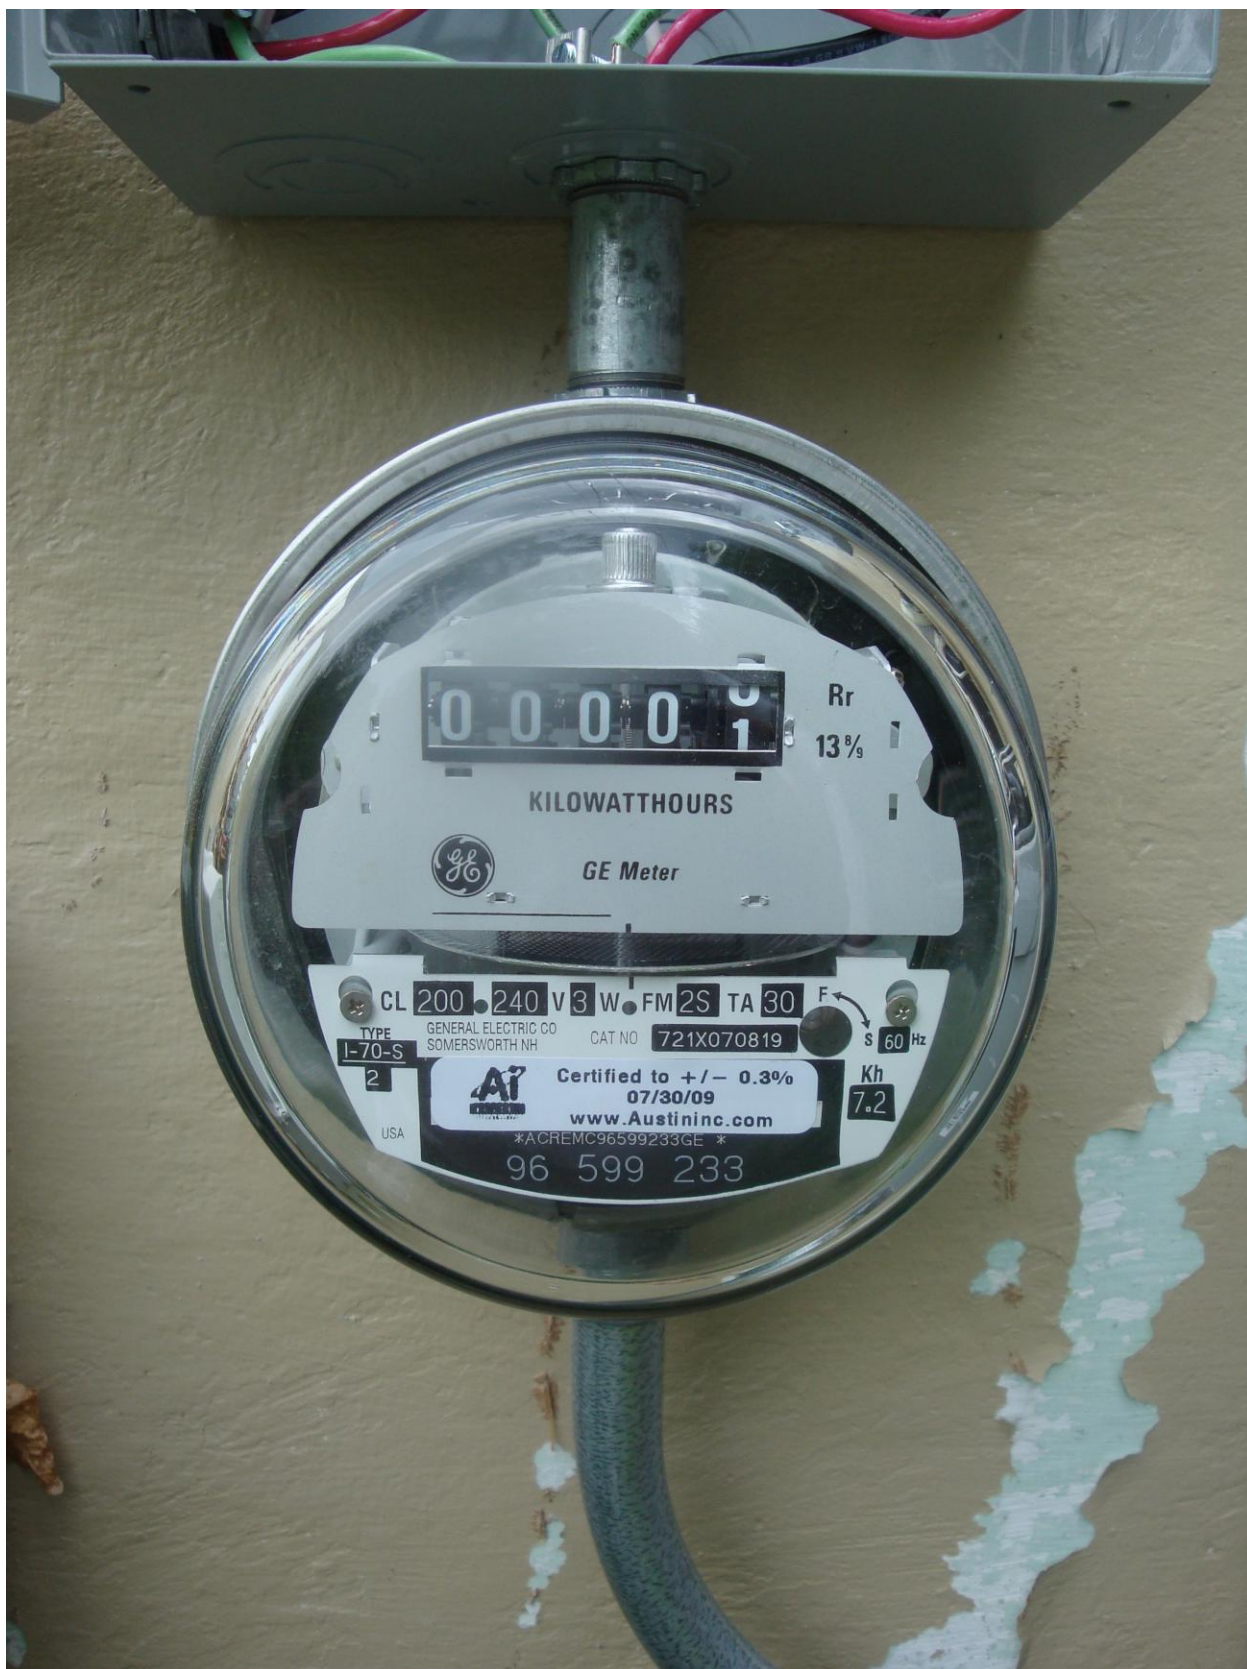

0 0 0 0 1

Rr  
13 <sup>8</sup>/<sub>9</sub>

KILOWATTHOURS



GE Meter

CL 200-240 V 3 W FM2S TA30 F 60 Hz  
TYPE I-70-S 2  
GENERAL ELECTRIC CO  
SOMERSWORTH NH  
CAT NO 721X070819  
Certified to +/- 0.3%  
07/30/09  
www.Austininc.com  
\*ACREMC96599233GE \*  
96 599 233  
USA  
Kh 7.2

**This foregoing document was electronically filed with the Public Utilities**

**Commission of Ohio Docketing Information System on**

**10/29/2010 2:24:23 PM**

**in**

**Case No(s). 10-1322-EL-REN**

Summary: Response Hunter Residential PV electronically filed by Mr. Brad Bowery on behalf of HUNTER RESIDENTIAL PV