

**BEFORE
THE PUBLIC UTILITIES COMMISSION OF OHIO**

**In the Matter of the Energy Efficiency and
Peak Demand Reduction Program Portfolio
of Ohio Edison Company, The Cleveland
Electric Illuminating Company, and The
Toledo Edison Company**

**Case No. 10-3023-EL-EEC
10-3024-EL-EEC
10-3025-EL-EEC**

APPLICATION

Pursuant to R.C. 4928.66(A)(2)(d) and Section E.6.a. of the Stipulation and Recommendation filed February 19, 2009 in Case No. 08-935-EL-SSO, Ohio Edison Company, The Cleveland Electric Illuminating Company ("CEI") and The Toledo Edison Company (collectively, "Companies") request approval of the transmission and distribution ("T&D") projects listed on attached Exhibits C and D, respectively, for inclusion as part of their compliance with the Companies' 2010 energy efficiency benchmarks.¹ In support of this Application, the Companies state:

I. BACKGROUND

1. Each of the Companies is an electric distribution utility ("EDU") as that term is defined in R.C. 4928.01(A)(6).
2. R.C. 4928.66(A)(1)(a) requires an EDU, starting in 2009, to "implement energy efficiency programs that achieve energy savings equivalent to at least three-tenths of one percent of the total annual average, and normalized kilowatt-hour sales of the

¹ This application is similar to that filed for the 2009 T&D projects in Case No. 09-951-EL-EEC -- a case in which Commission Staff concluded that the 2009 projects met "the requirements for integration in the Companies' energy efficiency compliance plans" and that "the energy savings claimed in the application and supplemental filing were appropriately determined." *In re Request by Ohio Edison Company, Cleveland Electric Illuminating Company, and The Toledo Edison Company For Approval to Include Transmission and Distribution Projects In Partial Compliance With Energy Efficiency Benchmark Requirements*, (Staff Review and Recommendation (Sept. 1, 2010.)

- [EDU] during the preceding three calendar years to customers in this state.”
3. The statutory benchmark for 2010 is five-tenths of one percent greater than that for 2009. R.C. 4928.66(A)(1)(a).²
 4. R.C. 4928.66(A)(2)(d) permits a utility to include, for purposes of compliance with the aforementioned statutorily mandated energy efficiency benchmark, “transmission and distribution infrastructure improvements that reduce line losses.”
 5. As part of their overall compliance strategy for 2009 and thereafter, the Companies intend to incorporate various T&D infrastructure improvement projects that they have completed. Projects completed during 2010 are included in this Application.
 6. These projects are only one aspect of the Companies’ compliance strategy, which also currently contemplates new and historic mercantile customer projects, existing residential and other energy efficiency projects, and new projects that have been reviewed by a collaborative of interested stakeholders and included in the Companies’ three year Energy Efficiency and Peak Demand Reduction Plan which was filed on December 15, 2009 in Case No. 09-1947-EL-POR et al.
 7. The use of the T&D projects is an important aspect of the Companies’ overall compliance plan. Not only do these projects provide very real energy efficiency results, but they have virtually no incremental compliance costs associated with them. The Companies are not seeking cost recovery for these projects in this filing.

II. NATURE OF THE PROJECTS

8. Inherent in the operation of a power system is the loss of a portion of the power being

² In its January 7, 2010 Finding and Order issued in Case No. 09-1004-EL-EEC , the Commission amended the Companies’ 2009 benchmarks, indicating that it would modify the Companies 2010 benchmarks to make up any differential created from 2009. To date the Commission has not indicated what the Companies’ 2010 benchmarks will be.

transmitted due to the electrical resistance of the various elements within the power system (e.g., conductors, transformers and regulators.) The transmission of power at various voltage levels throughout the power system has different levels of losses attributable to the delivery of the power. The farther through the system the power must travel, the greater the loss component associated with the transfer. There are various system improvements that, if made, can reduce the amount of line losses, including, as examples, the re-conductoring of lines, substation improvements, the addition of capacitor banks and the replacement of regulators.

9. A typical re-conductoring project involves the replacement of existing wires with larger wires between either the transmission towers or distribution poles. Re-conductoring projects reduce line losses by lowering the resistance of the system through which energy flows, such that the power consumed to transmit that energy – or line loss – is lowered. Re-conductoring projects are analogous to improving traffic flow on a highway by adding an extra traffic lane.
10. Substation projects typically include tying together previously unconnected transmission or distribution lines, and/or the addition or upgrade of transformers and circuits in new or existing locations. These projects generally improve efficiency, and thus reduce line losses, by providing an additional energy transformation point closer to the load center. As a result, a greater portion of the energy flows across high-voltage lines instead of lower-voltage lines. This is analogous to driving along a fast-moving interstate highway and being able to exit closer to your destination rather than driving on a slower, secondary road to reach the exit. The addition of new circuits on a distribution substation results in the transfer of load from one substation to another that is closer to the source, thus improving overall system operations. New

distribution circuits are analogous to providing a new exit ramp along the highway closer to your destination.

11. Typical transmission capacitor bank projects include the addition or expansion of large capacitor banks at a substation location. These projects involve reducing line losses by placing reactive sources at, or near, a load center. By doing so, a portion of the reactive load no longer travels across the entire transmission system, over which line losses occur. Typical distribution capacitor bank projects include the addition of capacitor banks, or a series of banks, in parallel at a substation location or on distribution poles along the circuit. These projects involve reducing line losses by placing reactive sources at or near a load center. The addition or upgrade of transmission and distribution capacitor banks can be compared to smoothing out the hills and valleys along a highway for more efficient travel.
12. A typical distribution voltage regulation project involves the replacement of existing equipment with larger and/or more efficient equipment. These projects improve the energy efficiency of the distribution system by reducing the losses and heating associated with smaller equipment. As a result of the upgrades, the distribution system transfers electricity more efficiently to the customer. This is similar to the re-conductoring projects discussed above and is also analogous to improving traffic flow on a highway by adding an extra lane.
13. The Companies have made some of the aforementioned types of improvements on their T&D systems during 2010. Transmission- and distribution-related projects are listed on attached Exhibits C and D, respectively. As indicated on attached Exhibit A, the completion of these projects results in a total annual contribution to energy efficiency savings in 2010 of 6,524 megawatt hours ("MWhs") for the Companies

generally, and more specifically, 3,004 MWhs for Ohio Edison Company; 885 MWhs for CEI; and 2,635 MWhs for The Toledo Edison Company. These annualized savings are based on models which are discussed in attached Exhibit B and which are consistent with those commonly used in the industry and/or by the North American Electric Reliability Council (NERC).

14. Attached in support of this Application are the following exhibits:

- | | |
|------------|--|
| Exhibit A: | A summary of Loss Reductions by Company, along with the allocation factors used to allocate transmission loss reductions among the Companies. ³ |
| Exhibit B: | A description of the methodology used to determine the Loss Factors for both transmission and distribution projects. |
| Exhibit C: | List of Transmission Projects included for consideration |
| Exhibit D: | List of Distribution Projects included for consideration (three pages) |


[The Remainder of this Page is Intentionally Blank]

³ Because losses occur at various points on the transmission system and the transmission system encompasses all three of the Companies' respective service territories, the loss reductions were allocated based on their individual line miles as a percent of the total FirstEnergy system line miles.

III. CONCLUSION

15. Based upon the foregoing, the Companies respectfully request that the Commission approve the energy savings set forth on attached Exhibit A for each of the Companies as part of their respective energy efficiency compliance with their 2010 energy efficiency benchmark requirements.

Respectfully submitted,

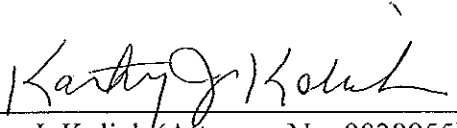

Kathy J. Kolich (Attorney No. 0038855)
- Counsel of Record
Carrie M. Dunn (Attorney No. 076952)

FIRSTENERGY SERVICE COMPANY
76 South Main Street
Akron, OH 44308
Telephone: (330) 384-4580
Facsimile: (330) 384-3875
kjkolich@firstenergycorp.com
cdunn@firstenergycorp.com

ATTORNEYS FOR APPLICANTS, OHIO
EDISON COMPANY, THE CLEVELAND
ELECTRIC ILLUMINATING COMPANY,
AND THE TOLEDO EDISON COMPANY

Summary of Energy Savings from Transmission and Distribution Projects

Exhibit A

Projects placed in service 2010 (a)

Case No. TBD

	(in MWhs)		
	OE	CEI	TE Total
Transmission System Annualized Energy Savings (b)	2,641	746	689 4,076
Distribution System Annualized Energy Savings	363	139	1,946 2,448
Total Energy Savings	3,004	885	2,635 6,524

(a) For Transmission project listing, see Exhibit C; for Distribution project listing, see Exhibit D

(b) Allocation of transmission energy savings is based on transmission line miles within each operating company compared to total FirstEnergy (Ohio) transmission line miles

	OE	CEI	TE
Loss Allocation %	64.80%	18.30%	16.90%

Exhibit B

Methodology for Determination of Energy Efficiency Savings on the Transmission and Distribution Systems

The calculation of energy efficiency savings associated with Transmission and Distribution infrastructure improvement projects is performed by modeling and documenting the pre-project and post-project electrical system parameters in a load flow analysis tool. The load flow analysis tool contains data base models that reflect the current and/or historic parameters of the electrical system. These tools are used to model the electrical grid at various system conditions and provide the electrical load flows resulting from those conditions. The measurement of the load flows throughout the electrical system, both before and after the improvements, allows for the calculation of the reduction in total losses in the system associated with the improvement projects.

DETERMINATION OF LINE LOSSES – GENERAL

For both the transmission and distribution systems, the loss factor is the ratio of the total system losses associated with supply to a specific voltage class, to the total system load connected to that voltage class. Ohio Edison Company, The Cleveland Electric Illuminating Company and The Toledo Edison Company (collectively, “Companies”) use various modeling and analytic software tools to determine, among other things, line losses on various parts of the transmission and distribution systems. Transmission losses were determined by using PSLF (Positive Sequence Load Flow) software, a General Electric software product. Information on this software package can be found at http://www.gepower.com/prod_serv/products/utility_software/en/ge_pslf/index.htm, which is incorporated herein by reference. Distribution losses were determined through the use of Milsoft – Windmill. Background information on this software tool can be found at <https://milsoft.com/smart-grid/windmill/analysis-functions>, which is also incorporated herein by reference. The Companies determined the reduction in line losses on both the transmission and distribution systems by modeling both before and after scenarios, with the former representing conditions on the system prior to the identified project being implemented, and the latter representing conditions on the system after the project was complete.

In order to model these various scenarios, three critical values had to be determined: (i) Peak-Load Coincident Factor; (ii) Load Factor; and (iii) Loss Factor. The Peak-Load Coincident Factor is defined as the portion of a demand that contributes to the peak load. The Load Factor is defined as the average demand for a time period divided by the maximum demand for the same time period. And the Loss Factor is defined as the average losses for a time period divided by the maximum losses for the same time period. System losses are comprised of two major components that can generally be characterized as (i) no-load losses; and (ii) load losses. The no-load losses never vary. Load losses, on the other hand, vary with the amount of current

being carried in the system. The more current that flows over a wire, the hotter the wire gets, expelling energy. This relationship of lost energy varies with the square of the current; so if the current is doubled, the losses increase by a factor of four. Similarly, if the current is reduced to half of its original value, the losses decrease by a factor of four. The method for determining these values for both the transmission and distribution systems is set forth below.

TRANSMISSION SYSTEM

When studying transmission system losses, it is necessary to determine the total energy consumed by losses over a given period of time, such as one year. It is not practical to perform an hour-by-hour evaluation of the losses. Therefore, the FE Companies, following an IEEE methodology, converted the losses evaluated at the peak hour into an average number that can be multiplied by the hours in a year to determine an annual loss factor. For a detailed discussion of the conversion methodology used, see *"The Equivalent Hours Loss Factor Revisited"*, Stone & Webster Management Consultants, (1988), which is incorporated herein by reference.

In order to determine the loss factor, the system load factor first needed to be calculated. Applying the IEEE methodology described above, the FE Companies obtained hourly load data through their energy management system. The system load factor is essentially the average load on the line over the period of time considered, which in this case was one year. It is determined by normalizing all the hourly load values so that the highest value (system peak hour) is 1.000, with all other hours being assigned values less than one. The normalized values were then summed and divided by the number of values used. This approach provides a way to convert the peak hour load for a year into a yearly total energy quantity.

The system loss factor calculation is then done by performing the same calculations as described above, except that the normalized values are squared before summing. This allows the user to evaluate the losses at the peak hour and still use the factor to obtain an energy value for the entire year.

DISTRIBUTION SYSTEM

The Peak-Load Coincident Factor was determined by first selecting a set of circuits to sample; and second, determining the top-five peak load periods for the overall distribution system. Using this information, the Companies determined the demand at each of the peak load periods as a percentage of the load's peak demand, taking the average of the results. For purposes of this calculation, the Companies studied a sample set of 98 Ohio distribution circuits, calculating the peak load coincidence factors at the operating company level based on the top-five peak load times.

The Load Factor was determined by using the same sample of 98 circuits and averaging the individual circuit load factors, using each circuit's average load as a weighting factor.

The Loss Factor was calculated by averaging the loss factor on each of the sample circuits, which was determined through the use of the following standard formula: $(0.15 * \text{Load Factor}) + (0.85 * (\text{Load Factor})^2)$ [David Farmer, *Distribution Planning*, Synergetic Design, Engineering Consultants, p. 26 (2008).]

Capacitor additions are calculated in two methods. For substation located (single location) capacitor banks, the same calculation applicable for distribution projects is applicable. For the distributed line capacitor additions, the line losses are determined through a different process. Distribution line capacitors reduce load losses by reducing the reactive portion of the current flow in the distribution lines and station power transformers. The Companies sampled 48 of their 161 existing capacitor banks and found that loss savings benefits ranged from a negligible change to as much as 8 kW/100 kVAR. Taking the average of all of the circuits studied, results in a 2.0 kW per 100 kVAR of capacitor additions at circuit peak load.

FE-Ohio Transmission Level Projects

Based on new transmission facilities placed in service 2010.
Case No. TBD

Exhibit C

A (column descriptions below)		B	C	D	E	F (D - E)	G
<u>Project Name</u>		Pri kV	Actual/Projected In Service Date	FE-Ohio Total Losses (Before)	FE-Ohio Total Losses (After)	2010 MW Loss Reduction	2010 Annualized MWH Loss Reduction
Lakeview 34.5 kV Cap Bank (18.9 MVAR)		34.5	1/4/2010	405	404.8	0.2	741
New 138 kV delivery point to Cleveland Public Power		138	7/12/2010	405.7	404.8	0.9	3,335
<u>Total</u>						<u>1.1</u>	<u>4,076</u>

Column Description

- A** Project description
- B** Primary voltage
- C** Date project was put into service
- D** FE-Total Losses Before - system modeled using PSLF software prior to project completion. For a description of the system, see http://www.gepower.com/prod_serv/products/utility_software/en/ge_pslfindex.htm
- E** FE-Total Losses After - system modeled using PSLF software after project completion
- F** MW Loss Reduction (column D - column E)
- G** Calculation of MWhs

Formula: MW Loss Reduction x Average Loss Factor x 8760

Ohio Edison Distribution Level Projects

Based on new distribution facilities placed in service 2010.

Case No. TBD

Exhibit D
(1 of 3)

Project Name	A (column descriptions below)	B	C	D
		Actual/Projected In Service Date	2010 Peak Loss Reduction MW	Annualized Loss Reduction MW/hrs
Reconductor line along North St.		7/12/2010	0.018	49
Jefferson Sub - R/P Transformer #2		10/26/2010	0.01	27
Capacitors - OE Distr. Additions - 2010		6/1/2010	0.11	287
Total 2010 Loss Reductions - Distribution Projects				363

Column Description

- A Project description
 - B Date project was put into service
 - C MW Loss Reduction - Losses Before minus Losses After modeled in Millsoft engineering software. For a description, see <https://millsoft.com/smart-grid/windmill/analysis-functions>
 - D Calculation of MWwhs
- Formula: MW Loss Reduction x Average Loss Factor x 8760
Loss Factor = 31.2%; derivation based on annual calculation of load factor and associated loss factor.

(a) As explained in the Application, loss reductions were based on a 2kW loss per 100 kVAR. The MWwh conversion is as described in (D) above.

Toledo Edison Distribution Level Projects

Based on new distribution facilities placed in service 2010.

Case No. TBD

Exhibit D
(2 of 3)

A <u>Project Name</u>	B <u>Actual/Projected In Service Date</u>	C <u>2010 Peak Loss Reduction MW</u>	D <u>2010 Annualized Loss Reduction MWhs</u>
Weston Sub - Replace #2 Transformer	5/26/2010	0.165	451
St. Charles Hospital - New Substation	9/29/2010	0.06	164
Replace Transformers Program 2010	12/31/2010	0.181	495
Capacitors - TE Distribution Additions - 2010	6/1/2010	0.31	836
Total 2010 Loss Reductions - Distribution Projects			1,946

Column Description

- A Project description
- B Date project was put into service
- C MW Loss Reduction - Losses Before minus Losses After modelled in Millsoft engineering software.
- D Calculation of MWhs
Formula: MW Loss Reduction x Average Loss Factor x 8760
Loss Factor = 31.2%; derivation based on annual calculation of load factor and associated loss factor.

(a) As explained in the Application, loss reductions were based on a 2kW loss per 100 kVAR. The MWh conversion is as described in (D) above.

CEI Distribution Level Projects

Based on new distribution facilities placed in service 2010.

Case No. TBD

Exhibit D
(3 of 3)

A <u>Project Name</u>	B <u>Actual/Projected In Service Date</u>	C <u>2010 Peak Loss Reduction MW</u>	D <u>2010 Annualized Loss Reduction MWhs</u>
Clifford Line Reconductor (Bagley Rd.)	7/20/2010	0.051	139
Total 2010 Loss Reductions - Distribution Projects		0.051	139

Column Description

- A Project description
- B Date project was put into service
- C MW Loss Reduction - Losses Before minus Losses After modelled in Millsoft engineering software.
- D Calculation of MWhs
Formula: MW Loss Reduction x Average Loss Factor x 8760
Loss Factor = 31.2%; derivation based on annual calculation of load factor and associated loss factor.
(a) Capacitor projects included in this exhibit are not the same as those included on page 1 and 2 of Exhibit E. Capacitor additions are calculated in two methods. For substation located (single location) capacitor banks, the same calculation applicable for distribution projects is applicable.

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

12/15/2010 3:56:00 PM

in

Case No(s). 10-3025-EL-EEC

Summary: Application For Approval of 2010 Transmission and Distribution Improvement Projects for Inclusion Towards the Company's Compliance With 2010 Energy Efficiency Benchmarks electronically filed by Ms. Kathy J Kolich on behalf of The Toledo Edison Company