

RECEIVED-DOCKETING DIV

2012 MAR -8 AM 9: 59

1-800-646-0400

PUCO

March 7, 2012

Ms. Betty McCauley
Director, Administration Department
Secretary to the Commission
Docketing Division
The Public Utilities Commission of Ohio
180 East Broad Street
Columbus, OH 43215-3793

Construction Notice

**Chrysler-Levis Park 138 kV Tap to Five Point Substation
Pole Relocation at State Route 25 and Five Point Road
Case No. 12-0880-EL-BNR**

Dear Ms. McCauley:

In accordance with Rule 4906-1-11 American Transmission Systems, Incorporated ("ATSI"), a subsidiary of FirstEnergy Corp., transmits one (1) original and eleven (11) copies of the enclosed Construction Notice. In this project, ATSI is proposing to relocate one pole, which is interfering with the installation of a new turn lane on Five Point Road, approximately 13 feet north from an existing pole. The new turn lane is a requirement from the Ohio Department of Transportation ("ODOT") as part of the construction and operation of the nearby St. Clare Commons Senior Assisted Living Complex. The Project is located in Perrysburg Township, Wood County, Ohio.

Please be advised of the following:

a) Name and address of the applicant:

American Transmission Systems, Incorporated
76 South Main Street
Akron, Ohio 44308

b) Name of proposed facilities:

Chrysler-Levis Park 138 kV Tap to Five Point Substation Pole Relocation at State
Route 25 and Five Point Road.

This is to certify that the images appearing are an
accurate and complete reproduction of a case file
document delivered in the regular course of business.
Technician Am Date Processed 3/8/12

c) Location of proposed facilities:

The Project is located near the intersection of State Route 25 and Five Point Road in Perrysburg Township, Wood County, Ohio.

d) Description of proposed facilities:

In this project, ATSI is proposing to relocate one pole approximately 13 feet north from an existing pole that is interfering with the installation of a new turn lane on Five Point Road. The new turn lane is a requirement from the Ohio Department of Transportation as part of the construction and operation of the nearby St. Clare Commons Senior Assisted Living Complex. As such, ODOT requires the relocation of this pole.


e) Applicant's representative:

John T. Toth
Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company
76 South Main Street
Akron, OH 44308-1890

After docketing this filing, please return one time-stamped copy of the Construction Notice for our records to us in the enclosed envelope. We have provided a copy of this Construction Notice by certified mail, with return receipt requested, to officials of the political subdivisions immediately affected by the proposed project as listed in the attached Exhibit 1. Copies of the transmittal letters addressed to the local government representatives of Perrysburg Township and Wood County are enclosed for your file.

Should the Ohio Power Siting Board desire further information or discussion of this submittal, please contact me at (330) 384-4564.

Sincerely,

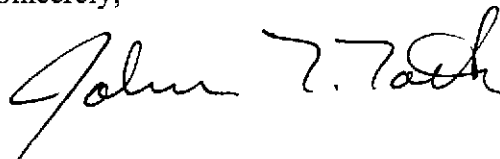

John T. Toth
Siting Supervisor
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

EXHIBIT 1
Officials Served Copy of Construction Notice
Chrysler-Levis Park 138 kV Tap to Five Point Substation
Pole Relocation at State Route 25 and Five Point Road Project
Case No. 12-089-EL-BNR

Wood County

The Honorable James F. Carter
Wood County Commissioner
One Courthouse Sq., Fl. 4
Bowling Green, OH 43402

Mr. Andrew Kalmar
County Administrator
One Courthouse Sq.
Bowling Green, OH 43402

The Honorable Tim W. Brown
Wood County Commissioner
One Courthouse Sq., Fl. 4
Bowling Green, OH 43402

Mr. David Steiner
Director, Planning Commission
One Courthouse Sq.
Bowling Green, OH 43402

The Honorable Joel Kuhlman
Wood County Commissioner
One Courthouse Sq., Fl. 4
Bowling Green, OH 43402

Mr. Raymond A. Huber, P.E.,
P.S.
Wood County Engineer
One Courthouse Sq.
Bowling Green, OH 43402

Ms. Kristy A. Muir
Clerk of Commissioners
One Courthouse Sq., Fl. 4
Bowling Green, OH 43402

Perrysburg Township

Gary R. Britten, Chairman
Perrysburg Township Trustee
10960 Roachton Rd.
Perrysburg OH 43551

Shirley A. Haar
Fiscal Officer, Perrysburg
Township
27696 Oregon Rd.
Perrysburg OH 43551

Robert P. Mack, Vice Chairman
Perrysburg Township Trustee
30195 Morningside Dr.
Perrysburg, OH 43551

John G. Hrosko
Perrysburg Township
Administrator
26609 Lime City Road
Perrysburg, OH 43551

Craig A. LaHote
Perrysburg Township Trustee
9742 Roachton Road
Perrysburg OH 43551

March 7, 2012

The Honorable James F. Carter
Wood County Commissioner
One Courthouse Sq., Fl. 4
Bowling Green, OH 43402

Construction Notice
Chrysler-Levis Park 138 kV Tap to Five Point Substation
Pole Relocation at State Route 25 and Five Point Road
Case No. 12-CRC-EL-BLN


Dear Commissioner Carter,

In the above captioned project, American Transmission Systems, Incorporated ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one pole, which is interfering with the installation of a new turn lane on Five Point Road, approximately 13 feet north from an existing pole. The Project is located at the northeast corner of the intersection of US-25 and Five Point Road in Perrysburg Township, Wood County Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John T. Toth
Supervisor, Siting
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachment

March 7, 2012

The Honorable Tim W. Brown
Wood County Commissioner
One Courthouse Sq., Fl. 4
Bowling Green, OH 43402

Construction Notice
Chrysler-Levis Park 138 kV Tap to Five Point Substation
Pole Relocation at State Route 25 and Five Point Road
Case No. 12-~~000~~-EL-BLN


Dear Commissioner Brown,

In the above captioned project, American Transmission Systems, Incorporated ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one pole, which is interfering with the installation of a new turn lane on Five Point Road, approximately 13 feet north from an existing pole. The Project is located at the northeast corner of the intersection of US-25 and Five Point Road in Perrysburg Township, Wood County Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John T. Toth
Supervisor, Siting
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachment

March 7, 2012

The Honorable Joel Kuhlman
Wood County Commissioner
One Courthouse Sq., Fl. 4
Bowling Green, OH 43402

Construction Notice
Chrysler-Levis Park 138 kV Tap to Five Point Substation
Pole Relocation at State Route 25 and Five Point Road
Case No. 12-0380-EL-BLN


Dear Commissioner Kuhlman,

In the above captioned project, American Transmission Systems, Incorporated ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one pole, which is interfering with the installation of a new turn lane on Five Point Road, approximately 13 feet north from an existing pole. The Project is located at the northeast corner of the intersection of US-25 and Five Point Road in Perrysburg Township, Wood County Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John T. Toth
Supervisor, Siting
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachment

March 7, 2012

Ms. Kristy A. Muir
Clerk of Commissioners
One Courthouse Sq., Fl. 4
Bowling Green, OH 43402

Construction Notice
Chrysler-Levis Park 138 kV Tap to Five Point Substation
Pole Relocation at State Route 25 and Five Point Road
Case No. 12-080-EL-BLN


Dear Ms. Long,

In the above captioned project, American Transmission Systems, Incorporated ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one pole, which is interfering with the installation of a new turn lane on Five Point Road, approximately 13 feet north from an existing pole. The Project is located at the northeast corner of the intersection of US-25 and Five Point Road in Perrysburg Township, Wood County Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John T. Toth
Supervisor, Siting
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachment

March 7, 2012

Mr. Andrew Kalmar
County Administrator
One Courthouse Sq.
Bowling Green, OH 43402

Construction Notice
Chrysler-Levis Park 138 kV Tap to Five Point Substation
Pole Relocation at State Route 25 and Five Point Road
Case No. 12-~~0890~~-EL-BLN


Dear Mr. Kalmar,

In the above captioned project, American Transmission Systems, Incorporated ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one pole, which is interfering with the installation of a new turn lane on Five Point Road, approximately 13 feet north from an existing pole. The Project is located at the northeast corner of the intersection of US-25 and Five Point Road in Perrysburg Township, Wood County Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John T. Toth
Supervisor, Siting
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachment

March 7, 2012

Mr. David Steiner
Director, Planning Commission
One Courthouse Sq.
Bowling Green, OH 43402

Construction Notice
Chrysler-Levis Park 138 kV Tap to Five Point Substation
Pole Relocation at State Route 25 and Five Point Road
Case No. 12-0880-EL-BLN


Dear Mr. Steiner,

In the above captioned project, American Transmission Systems, Incorporated ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one pole, which is interfering with the installation of a new turn lane on Five Point Road, approximately 13 feet north from an existing pole. The Project is located at the northeast corner of the intersection of US-25 and Five Point Road in Perrysburg Township, Wood County Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John T. Toth
Supervisor, Siting
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachment

March 7, 2012

Mr. Raymond A. Huber, P.E., P.S.
Wood County Engineer
One Courthouse Sq.
Bowling Green, OH 43402

Construction Notice
Chrysler-Levis Park 138 kV Tap to Five Point Substation
Pole Relocation at State Route 25 and Five Point Road
Case No. 12-0380-EL-BLN


Dear Mr. Huber,

In the above captioned project, American Transmission Systems, Incorporated ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one pole, which is interfering with the installation of a new turn lane on Five Point Road, approximately 13 feet north from an existing pole. The Project is located at the northeast corner of the intersection of US-25 and Five Point Road in Perrysburg Township, Wood County Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John T. Toth
Supervisor, Siting
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachment

March 7, 2012

Mr. Gary R. Britten, Chairman
Perrysburg Township Trustee
10960 Roachton Rd.
Perrysburg OH 43551

Construction Notice
Chrysler-Levis Park 138 kV Tap to Five Point Substation
Pole Relocation at State Route 25 and Five Point Road
Case No. 12-0880-EL-BLN


Dear Mr. Britten,

In the above captioned project, American Transmission Systems, Incorporated ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one pole, which is interfering with the installation of a new turn lane on Five Point Road, approximately 13 feet north from an existing pole. The Project is located at the northeast corner of the intersection of US-25 and Five Point Road in Perrysburg Township, Wood County Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John T. Toth
Supervisor, Siting
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachment

March 7, 2012

Mr. Robert P. Mack, Vice Chairman
Perrysburg Township Trustee
30195 Morningside Dr.
Perrysburg, OH 43551

Construction Notice
Chrysler-Levis Park 138 kV Tap to Five Point Substation
Pole Relocation at State Route 25 and Five Point Road
Case No. 12-0880-EL-BLN

Dear Mr. Mack,

In the above captioned project, American Transmission Systems, Incorporated ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one pole, which is interfering with the installation of a new turn lane on Five Point Road, approximately 13 feet north from an existing pole. The Project is located at the northeast corner of the intersection of US-25 and Five Point Road in Perrysburg Township, Wood County Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John T. Toth
Supervisor, Siting
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachment

March 7, 2012

Mr. Craig Al LaHote
Perrysburg Township Trustee
9742 Roachton Road
Perrysburg OH 43551

Construction Notice
Chrysler-Levis Park 138 kV Tap to Five Point Substation
Pole Relocation at State Route 25 and Five Point Road
Case No. 12-0880-EL-BLN


Dear Mr. LaHote,

In the above captioned project, American Transmission Systems, Incorporated ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one pole, which is interfering with the installation of a new turn lane on Five Point Road, approximately 13 feet north from an existing pole. The Project is located at the northeast corner of the intersection of US-25 and Five Point Road in Perrysburg Township, Wood County Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John T. Toth
Supervisor, Siting
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachment

March 7, 2012

Ms. Shirley A. Haar
Fiscal Officer, Perrysburg Township
27696 Oregon Rd.
Perrysburg OH 43551

Construction Notice
Chrysler-Levis Park 138 kV Tap to Five Point Substation
Pole Relocation at State Route 25 and Five Point Road
Case No. 12-0887-EL-BLN


Dear Ms. Haar,

In the above captioned project, American Transmission Systems, Incorporated ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one pole, which is interfering with the installation of a new turn lane on Five Point Road, approximately 13 feet north from an existing pole. The Project is located at the northeast corner of the intersection of US-25 and Five Point Road in Perrysburg Township, Wood County Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John T. Toth
Supervisor, Siting
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachment

March 7, 2012

John G. Hrosko
Township Administrator
26609 Lime City Road
Perrysburg, OH 43551

Construction Notice
Chrysler-Levis Park 138 kV Tap to Five Point Substation
Pole Relocation at State Route 25 and Five Point Road
Case No. 12-080-EL-BLN


Dear Mr. Hrosko,

In the above captioned project, American Transmission Systems, Incorporated ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one pole, which is interfering with the installation of a new turn lane on Five Point Road, approximately 13 feet north from an existing pole. The Project is located at the northeast corner of the intersection of US-25 and Five Point Road in Perrysburg Township, Wood County Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,

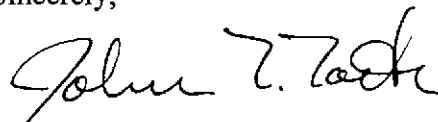

John T. Toth
Supervisor, Siting
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachment

RECEIVED-DOCKETING DIV

2012 MAR -8 AM 9:59

PUCO

AMERICAN TRANSMISSION SYSTEMS, INCORPORATED

**CONSTRUCTION NOTICE
CHRYSLER-LEVIS PARK 138 kV
TAP TO FIVE POINT SUBSTATION
POLE RELOCATION AT STATE ROUTE 25
AND FIVE POINT ROAD**

OPSB CASE NO. 12- 0880 -EL-BNR

March 7, 2012

**American Transmission Systems, Incorporated
76 South Main Street
Akron, Ohio 44308**

CONSTRUCTION NOTICE
CHRYSLER-LEVIS PARK 138 kV TAP TO FIVE POINT SUBSTATION
POLE RELOCATION AT STATE ROUTE 25 AND FIVE POINT ROAD

The following information is being provided in accordance with the procedures delineated in Ohio Administrative Code Section 4906-11-02: Construction Notice Requirements of the Rules and Regulations of the Ohio Power Siting Board.

4906-11-02 (A): Information Requirements

4906-11-02 (A) (1): Name of the Project

Name of Project: Chrysler-Levis Park 138 kV Tap to Five Point Substation
Pole Relocation at State Route 25 and Five Point Road

4906-11-02 (A) (2): Brief Description of Project

American Transmission Systems, Incorporated's ("ATSI"), a FirstEnergy Corp. subsidiary, Chrysler-Levis Park 138 kV Tap to Five Point Substation Pole Relocation at State Route 25 and Five Point Road Project ("Project") consists of relocating one existing pole of this transmission line. The general location of the Project is shown in Exhibit 1, which is a partial copy of United States Geologic Survey, Lucas and Wood Counties, Ohio Quad, Map ID 41083-E6. The Project is located in Perrysburg Township, Wood County, Ohio.

The existing Chrysler-Levis Park 138 kV Tap to Five Point Substation trends north-to-south along the east side of State Route 25 (also identified as Dixie Highway) and is supported on wood poles in the area of the Project. The first pole of the transmission line located approximately 15 feet north of Five Point Road interferes with the installation of a new turn lane on Five Point Road. The new turn lane is a requirement from the Ohio Department of Transportation (ODOT) as part of the construction and operation of the nearby St. Clare Commons Senior Assisted Living Complex. As such, ODOT is requiring the relocation of this pole. As shown in Exhibit 2, the general project layout, the existing 80 foot pole will be relocated by installing a new

80 foot pole, shown in Exhibit 3, approximately 13 feet to the north of the existing pole. The new pole will be located adjacent to the road right-of-way on the existing right-of-way of the transmission line.

The proposed Project meets the requirements for a Construction Notice because the project is within the types of project defined by Item (9) of the Application Requirement Matrix for Electric Power Transmission Lines in Appendix A of 4906-1-01 of the Ohio Administrative Code, which requires the filing of a Construction Notice. This item states:

- (9) Replacement or relocation of an electric power transmission line and associated facilities where the project is required by publicly funded entities and is located on or adjacent to right-of-way or land owned by the public entity requiring the project.*

The existing pole is located and the new pole will be located adjacent to the road right-of-way of State Route 25. The existing Chrysler-Levis Park 138 kV Tap to Five Point Substation and the relocated pole will be owned by ATSI.

4906-11-02 (A) (3): Construction Schedule

Construction on the proposed Project is proposed to begin on April 23, 2012, and is expected to be completed by May 2, 2012.

4906-11-02 (A) (4): Estimated Costs

The estimated capital costs for the Project is \$23,000.

4906-11-02 (A) (5): Operating Characteristics

The existing Chrysler-Levis Park 138 kV Tap to Five Point Substation operates at 138 kV. The proposed relocation of one pole will not change the operating characteristics of this transmission line. No new property rights are required for the proposed Project.

4906-11-02 (A) (6): Area Map

Exhibit No. 1 depicts the general location of the project site. This exhibit provides a partial copy of the United States Geologic Survey, Lucas and Wood Counties, Ohio Quad, Map ID 41083-E6. To locate and view the project site from Columbus, Ohio, travel north on Interstate 71 to exit 119, I-270/Dayton/Wheeling. Travel on I-270/US-23/Dayton to exit 23. Travel on US-23 north for approximately 66.4 miles where the name of the road changes to SR-15. Travel on SR-15 for approximately 14.4 miles where the road changes to US-68. Stay on US-68 for approximately 2.6 miles. Turn onto I-75 towards I-75/Oh-15/Toledo for approximately 30.4 miles, at exit 87 turn towards SR-582/Haskins/Luckey. Turn west onto SR-582 for approximately 1.6 miles. Turn north onto SR-25 for approximately 3.4 miles to project location. The Project is located on the northeast corner of the intersection of SR-25 and Five Point Road.

4906-11-02 (B): Documentation of Construction Notice Transmittal

This Construction Notice is being provided concurrently to the following officials of the Perrysburg Township and Wood County, Ohio. Copies of the transmittal letters to these officials have been included with the transmittal letter submitting this Construction Notice to the Ohio Power Siting Board.

Perrysburg Township

Mr. Gary R. Britten, Chairman
Perrysburg Township Trustee
10960 Roachton Rd.
Perrysburg OH 43551

Mr. Robert P. Mack, Vice
Chairman
Perrysburg Township Trustee
30195 Morningside Dr.
Perrysburg, OH 43551

Mr. Craig Al LaHote
Perrysburg Township Trustee
9742 Roachton Road
Perrysburg OH 43551

Ms. Shirley A. Haar
Fiscal Officer, Perrysburg
Township
27696 Oregon Rd.
Perrysburg OH 43551

Mr. John G. Hrosko
Township Administrator
26609 Lime City Road
Perrysburg, OH 43551

Wood County

The Honorable James F. Carter
Wood County Commissioner
One Courthouse Sq., Fl. 4
Bowling Green, OH 43402

The Honorable Tim W. Brown
Wood County Commissioner
One Courthouse Sq., Fl. 4
Bowling Green, OH 43402


The Honorable Joel Kuhlman
Wood County Commissioner
One Courthouse Sq., Fl. 4
Bowling Green, OH 43402

Ms. Kristy A. Muir
Clerk of Commissioners
One Courthouse Sq., Fl. 4
Bowling Green, OH 43402

Mr. Andrew Kalmar
County Administrator
One Courthouse Sq.
Bowling Green, OH 43402

Mr. David Steiner
Director, Planning Commission
One Courthouse Sq.
Bowling Green, OH 43402


Mr. Raymond A. Huber, P.E., P.S.
Wood County Engineer
One Courthouse Sq.
Bowling Green, OH 43402

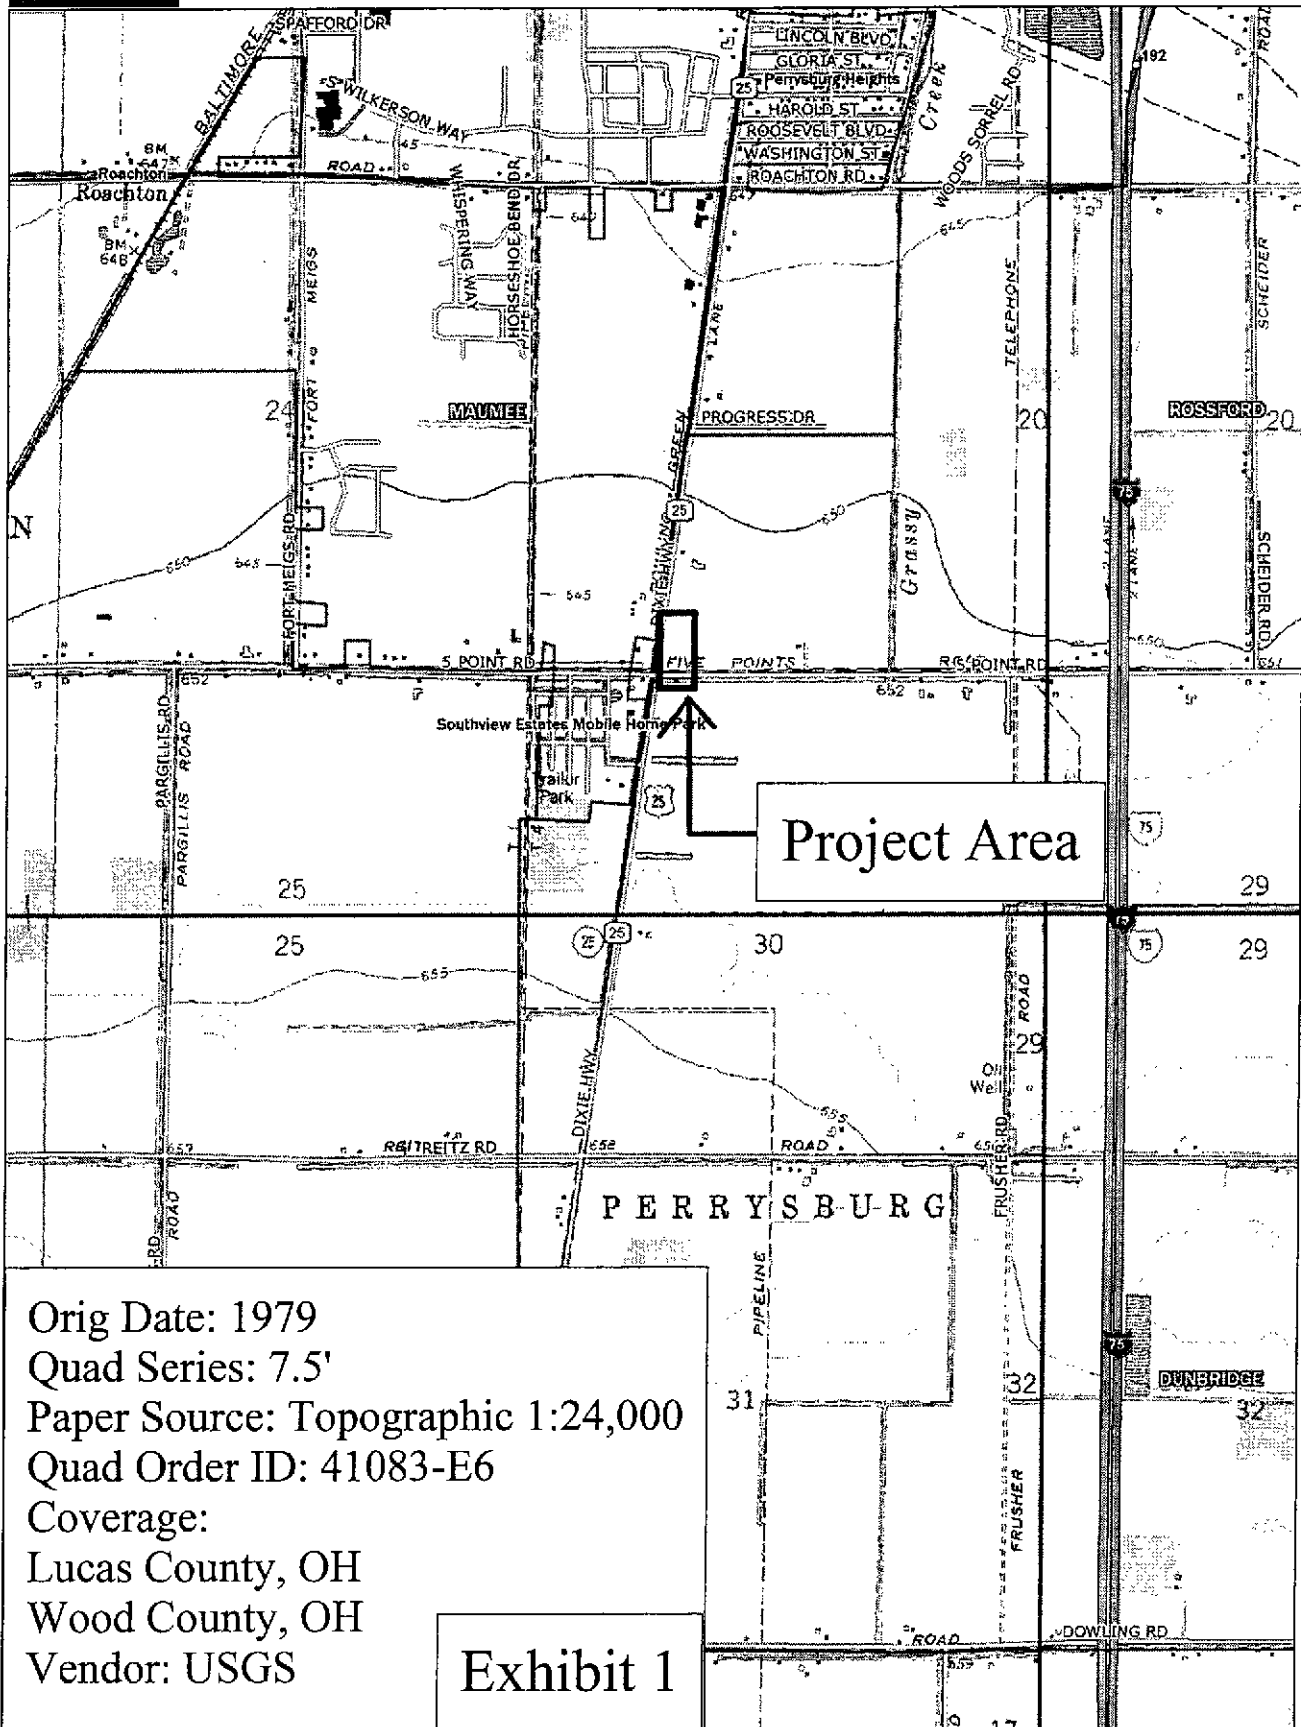

Data use subject to license.



© DeLorme, Topo USA® 8.

www.delorme.com





PERRYSBURG TWP.
WOOD COUNTY
STATE OF OHIO

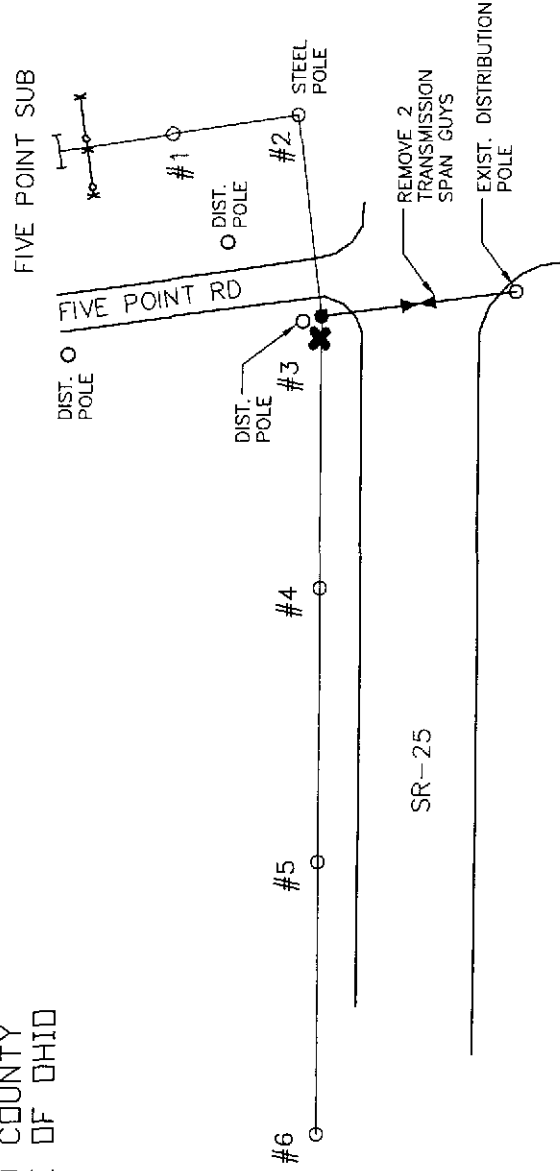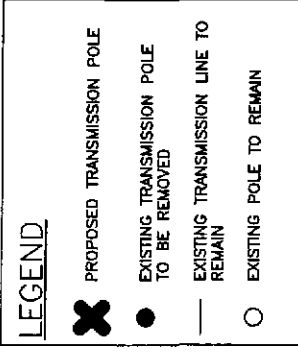


ATSI[®]

American Transmission Systems, Inc.
A MEMBER OF THE ATSI GROUP

Chrysler-Levis Park 138 kV
Tap to Five Point Substation
Pole Relocation at
State Route 25 & Five Point Road

GENERAL LAYOUT

EXHIBIT 2

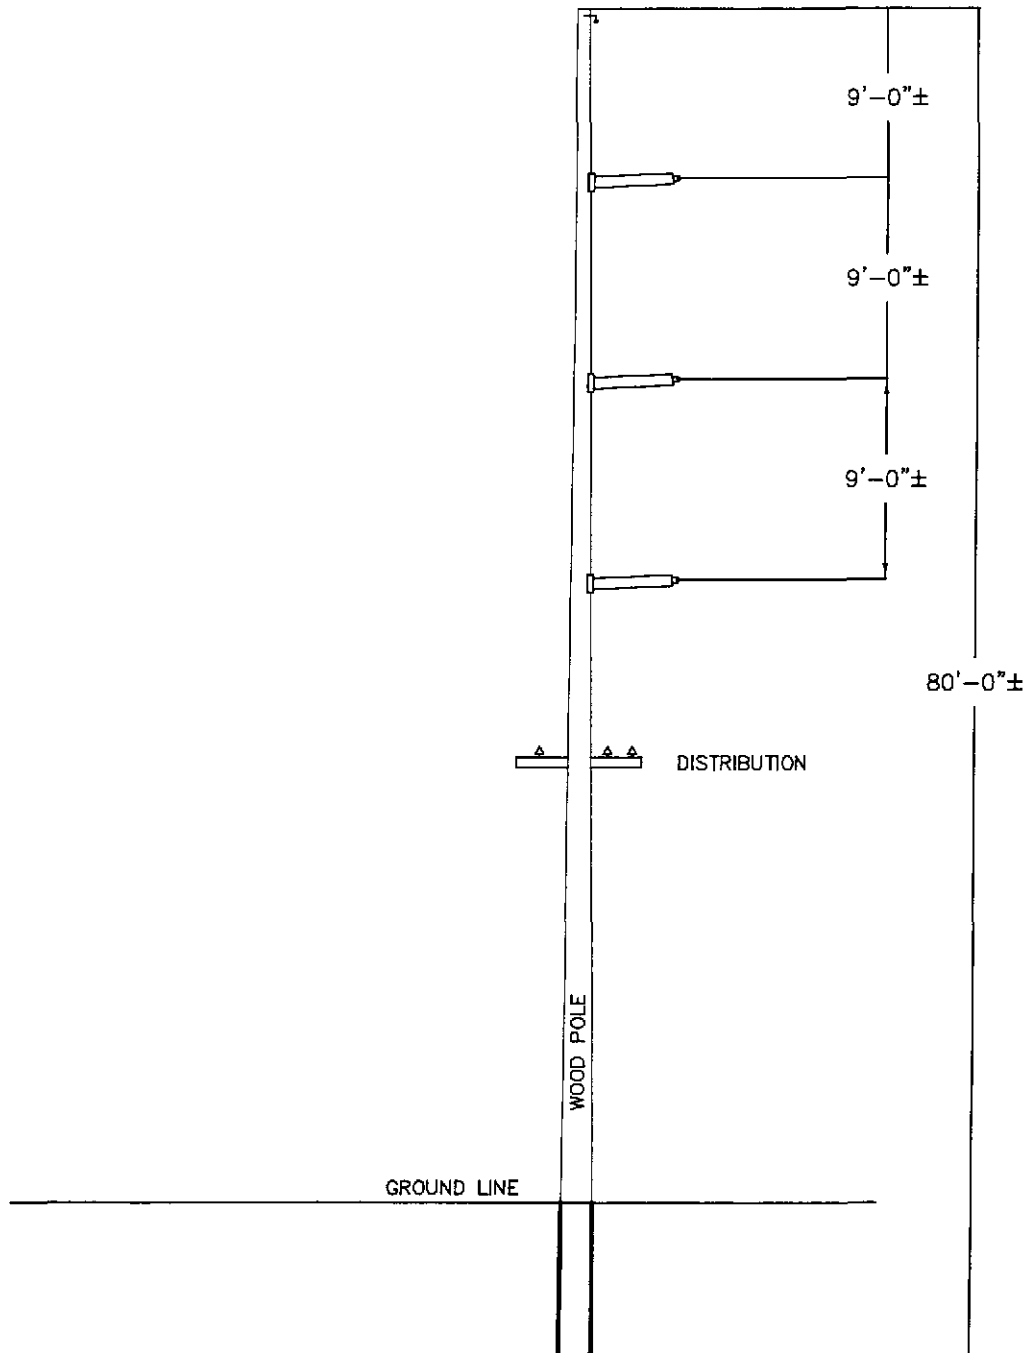

ATSI®

American Transmission Systems, Inc.
a subsidiary of FirstEnergy Corp.

Chrysler-Levis Park
Tap to Five Point Substation

Pole Relocation at
State Route 25 & Five Point Road

EXHIBIT 3