

Appendix

J:\Project\AAEP\14950749 Kirk-Jug LON Support Data-Tech\GIS\base.mxd



LEGEND:

— Proposed Jug Street-Kirk 138 kV Circuit



Overview Map

BASE MAP SOURCE:
ArcGIS Map Service, World_Street_Map
<http://services.arcgisonline.com/arcgis/services>





Jug Street-Kirk
138 kV Circuit

FIGURE 1
PROJECT OVERVIEW

JOB NO. 14950749



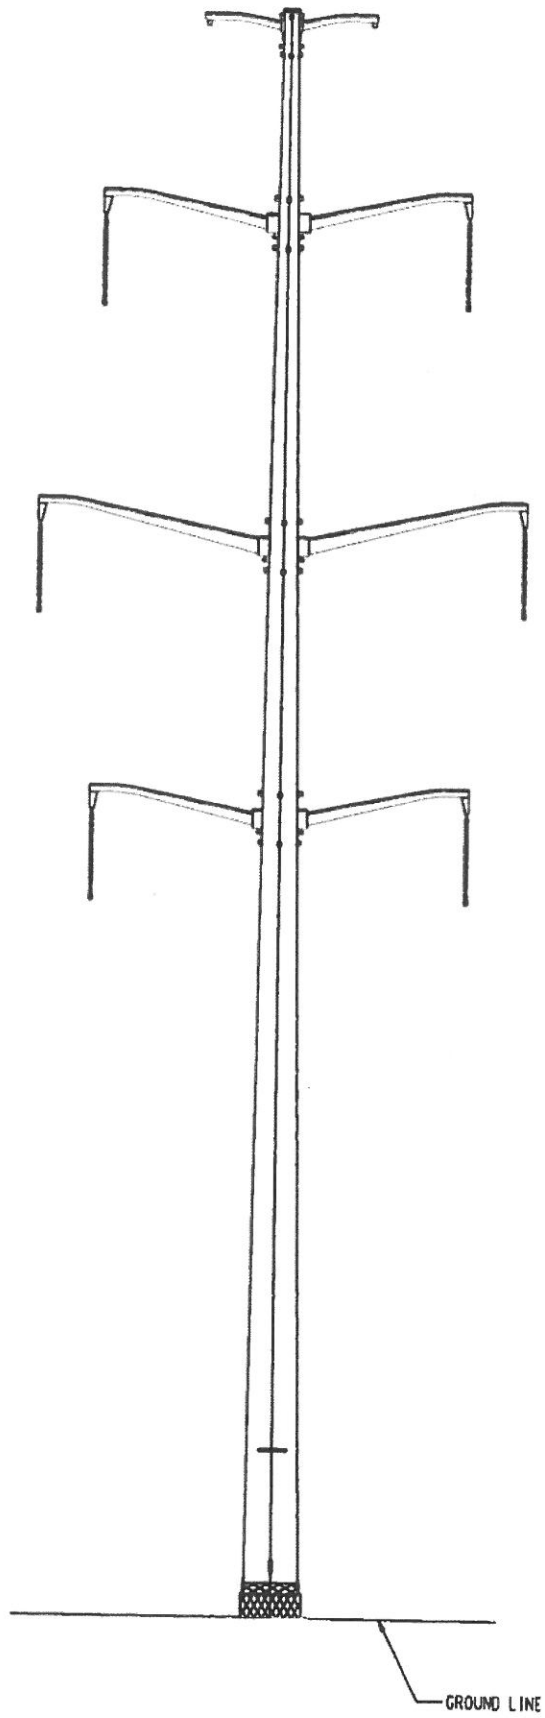

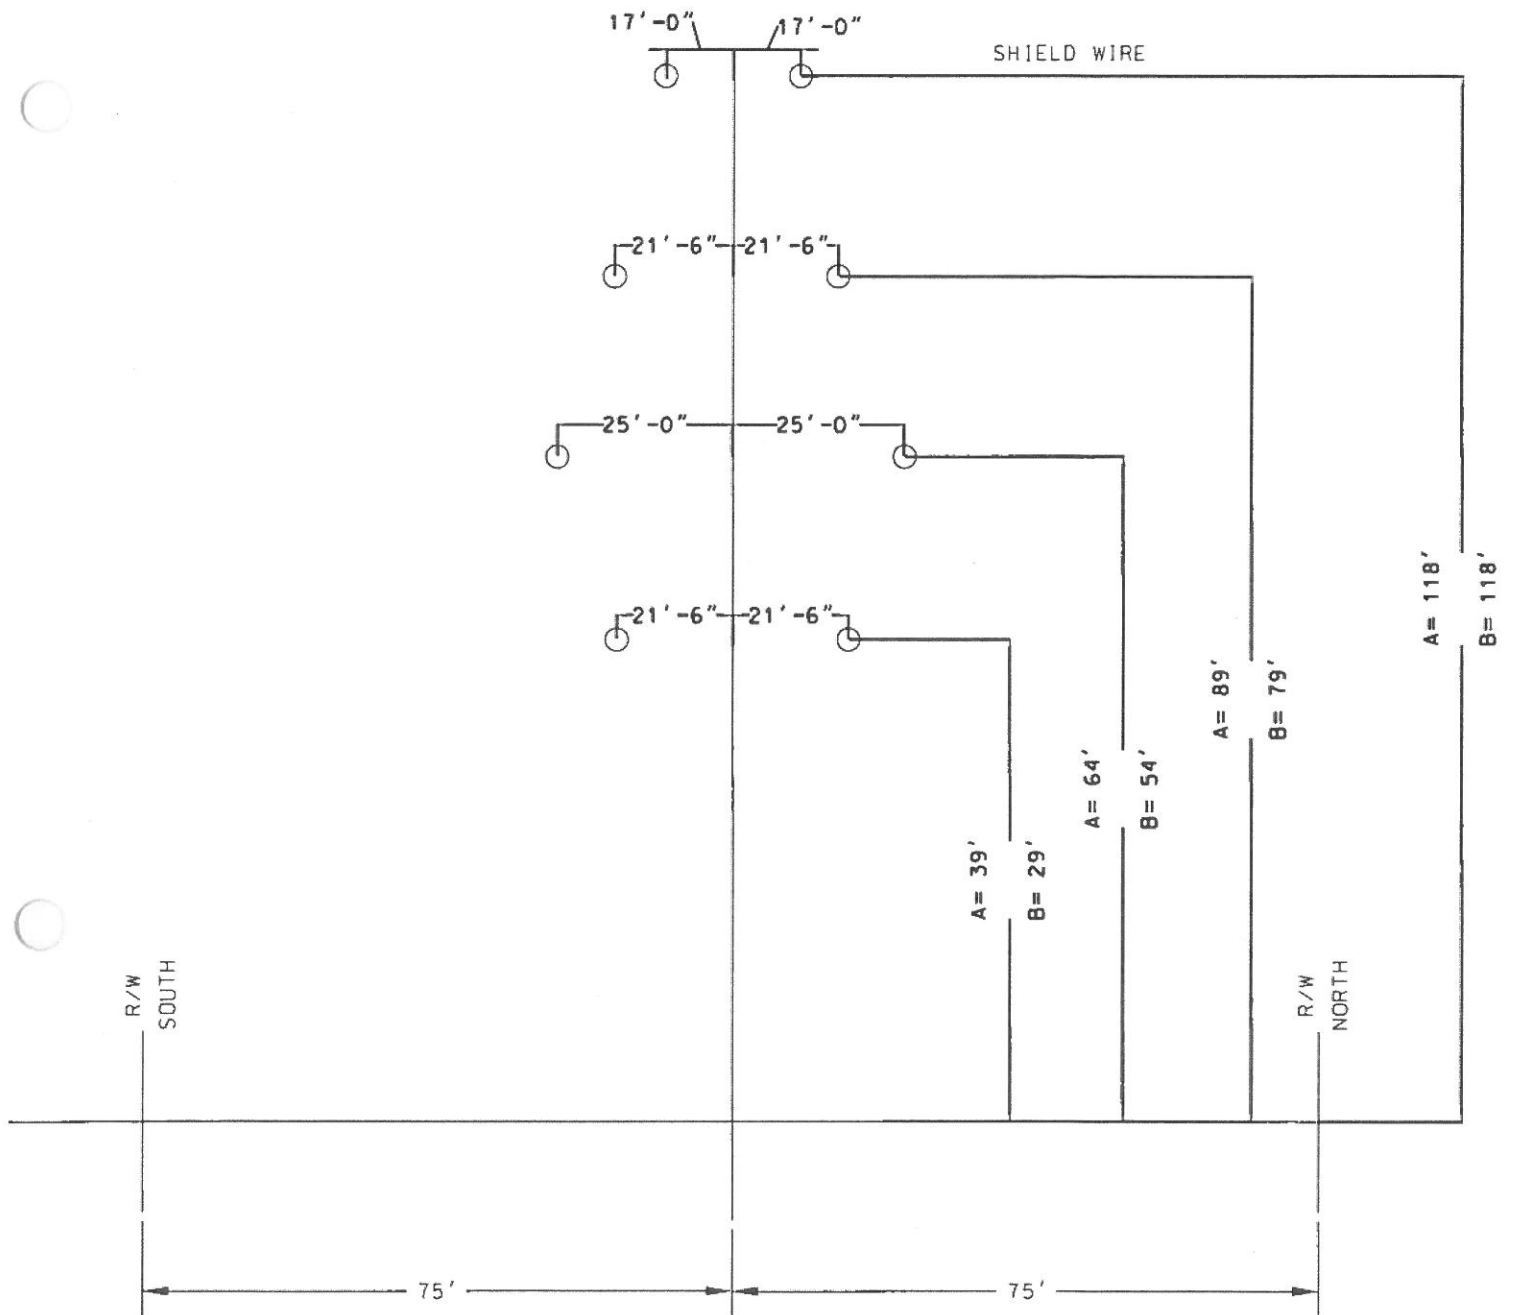

DIMENSION "A" - DOUBLE CIRCUIT - VERT. CONFIGURATION (STEEL POLE)
(UNDER EMERGENCY & NORMAL MAX. LINE LOADING)

DIMENSION "B" - DOUBLE CIRCUIT - VERT. CONFIGURATION (STEEL POLE)
(UNDER WINTER NORMAL CONDUCTOR RATING)

TYPICAL PHASE ARRANGMENT STEEL POLE	
NOT TO SCALE	FIGURE 06-3



American Electric Power
700 Morrison Road
Gahanna, OH 43230

September 10, 2012

Licking County Commissioners
Tim Bubb
Doug Smith
Brad Feightner
Donald D. Hill County Administration Building
20 South Second Street
Newark, Ohio 43055

**Letter of Notification
Jug Street – Kirk 138kV
Transmission Line Circuit Project**

Dear Trustees:

In accordance with Chapter 4906 of the Ohio Administrative Code, the AEP Ohio Transmission Company is required to submit a Letter of Notification to the State of Ohio Power Siting Board whenever a change is made to our transmission facilities.

American Electric Power is planning to replace 79 structures to accommodate a future second circuit in Harrison Township, Lima Township, Saint Albans Township, and Jersey Township, Licking County, Ohio.

In compliance with Rule 4906-11-02 of the OPSB Rules and Regulations, we have prepared and filed the attached Letter of Notification. This Notice contains details on the line location, project description and construction schedule, and is submitted for your information.

Cordially,

A handwritten signature in black ink, reading 'John R. Heppner', is positioned below the word 'Cordially,'.

John Heppner
Transmission Line Engineering



American Electric Power
700 Morrison Road
Gahanna, OH 43230

September 10, 2012

Saint Albans Township Trustees
19 North Liberty Street
Alexandria, Ohio 43001

**Letter of Notification
Jug Street – Kirk 138kV
Transmission Circuit Project**

Dear Trustees:

In accordance with Chapter 4906 of the Ohio Administrative Code, the AEP Ohio Transmission Company is required to submit a Letter of Notification to the State of Ohio Power Siting Board whenever a change is made to our transmission facilities.

American Electric Power is planning to replace 79 structures to accommodate a future second circuit in Harrison Township, Lima Township, Saint Albans Township, and Jersey Township, Licking County, Ohio.

In compliance with Rule 4906-11-02 of the OPSB Rules and Regulations, we have prepared and filed the attached Letter of Notification. This Notice contains details on the line location, project description and construction schedule, and is submitted for your information.

Cordially,

A handwritten signature in black ink, reading 'John R. Heppner', is positioned below the word 'Cordially,'.

John Heppner
Transmission Line Engineering



American Electric Power
700 Morrison Road
Gahanna, OH 43230

September 10, 2012

Lima Township Trustees
Box 116
Summit Station, Ohio 43073

**Letter of Notification
Jug Street – Kirk 138kV
Transmission Circuit Project**

Dear Trustees:

In accordance with Chapter 4906 of the Ohio Administrative Code, the AEP Ohio Transmission Company is required to submit a Letter of Notification to the State of Ohio Power Siting Board whenever a change is made to our transmission facilities.

American Electric Power is planning to replace 79 structures to accommodate a future second circuit in Harrison Township, Lima Township, Saint Albans Township, and Jersey Township, Licking County, Ohio.

In compliance with Rule 4906-11-02 of the OPSB Rules and Regulations, we have prepared and filed the attached Letter of Notification. This Notice contains details on the line location, project description and construction schedule, and is submitted for your information.

Cordially,

A handwritten signature in black ink, reading 'John R. Heppner', is positioned below the word 'Cordially,'.

John Heppner
Transmission Line Engineering



American Electric Power
700 Morrison Road
Gahanna, OH 43230

September 10, 2012

Jersey Township Trustees
Derek Meyers
Jim Endsley
Roy Bailey
4439 Mink Street
Johnstown, Ohio 43031

**Letter of Notification
Jug Street – Kirk 138kV
Transmission Circuit Project**

Dear Trustees:

In accordance with Chapter 4906 of the Ohio Administrative Code, the AEP Ohio Transmission Company is required to submit a Letter of Notification to the State of Ohio Power Siting Board whenever a change is made to our transmission facilities.

American Electric Power is planning to replace 79 structures to accommodate a future second circuit in Harrison Township, Lima Township, Saint Albans Township, and Jersey Township, Licking County, Ohio.

In compliance with Rule 4906-11-02 of the OPSB Rules and Regulations, we have prepared and filed the attached Letter of Notification. This Notice contains details on the line location, project description and construction schedule, and is submitted for your information.

Cordially,

A handwritten signature in black ink, which appears to read "John R. Heppner". The signature is written in a cursive, flowing style.

John Heppner
Transmission Line Engineering



American Electric Power
700 Morrison Road
Gahanna, OH 43230

September 10, 2012

Harrison Township Trustees
Ron Casey
Darrell Lairson
David Woods
5945 North Dixie Drive
Dayton, Ohio 45414

**Letter of Notification
Jug Street – Kirk 138kV
Transmission Circuit Project**

Dear Trustees:

In accordance with Chapter 4906 of the Ohio Administrative Code, the AEP Ohio Transmission Company is required to submit a Letter of Notification to the State of Ohio Power Siting Board whenever a change is made to our transmission facilities.

American Electric Power is planning to replace 79 structures to accommodate a future second circuit in Harrison Township, Lima Township, Saint Albans Township, and Jersey Township, Licking County, Ohio.

In compliance with Rule 4906-11-02 of the OPSB Rules and Regulations, we have prepared and filed the attached Letter of Notification. This Notice contains details on the line location, project description and construction schedule, and is submitted for your information.

Cordially,

A handwritten signature in black ink, reading 'John R. Heppner', is positioned below the word 'Cordially,'.

John Heppner
Transmission Line Engineering

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

9/14/2012 10:31:37 AM

in

Case No(s). 12-2519-EL-BLN

Summary: Letter of Notification and Attachments for Kirk-Jug 138 kV Circuit Project (Part 3 of 12) electronically filed by Erin C Miller on behalf of AEP Ohio Transmission Company, Inc.