

FILE



2
76 South Main Street
Akron, Ohio 44308

1-800-646-0400

January 15, 2013

Ms. Barcy F. McNeal
Secretary
Docketing Division
The Public Utilities Commission of Ohio
180 East Broad Street
Columbus, OH 43215-3793

**Letter of Notification
East Akron-Hanna 138 kV Transmission Line Tap
To Old Forge Substation
Case No. 13-0108-EL-BNR**

PUCO

2013 JAN 17 PM 1:16

RECEIVED-DOCKETING DIV

Dear Ms. McNeal:

Please be advised of supplemental engineering information that is being submitted to the above captioned Letter of Notification submitted on January 7, 2013. Enclosed are one (1) original and ten (10) copies of Exhibit 5A. Exhibit 5A replaces Exhibit 5 of the Letter of Notification.

The supplemental engineering information conveyed in Exhibit 5A indicates that the static wire structure will be 115 feet in height rather than 55 feet in height. The change is being made to accommodate communication equipment within the Old Forge Substation. The location of the pole has not changed. All other structures and features of the project remain the same.


Should the Ohio Power Siting Board desire further information or discussion of this submittal, please contact me at (330) 384-4564.

Sincerely,

John T. Toth
Siting Supervisor
Energy Delivery, Transmission and Substation
Design
First Energy Services Company

Attachment

This is to certify that the images appearing are an accurate and complete reproduction of a case file document delivered in the regular course of business
Technician Sam Date Processed JAN 17 2013

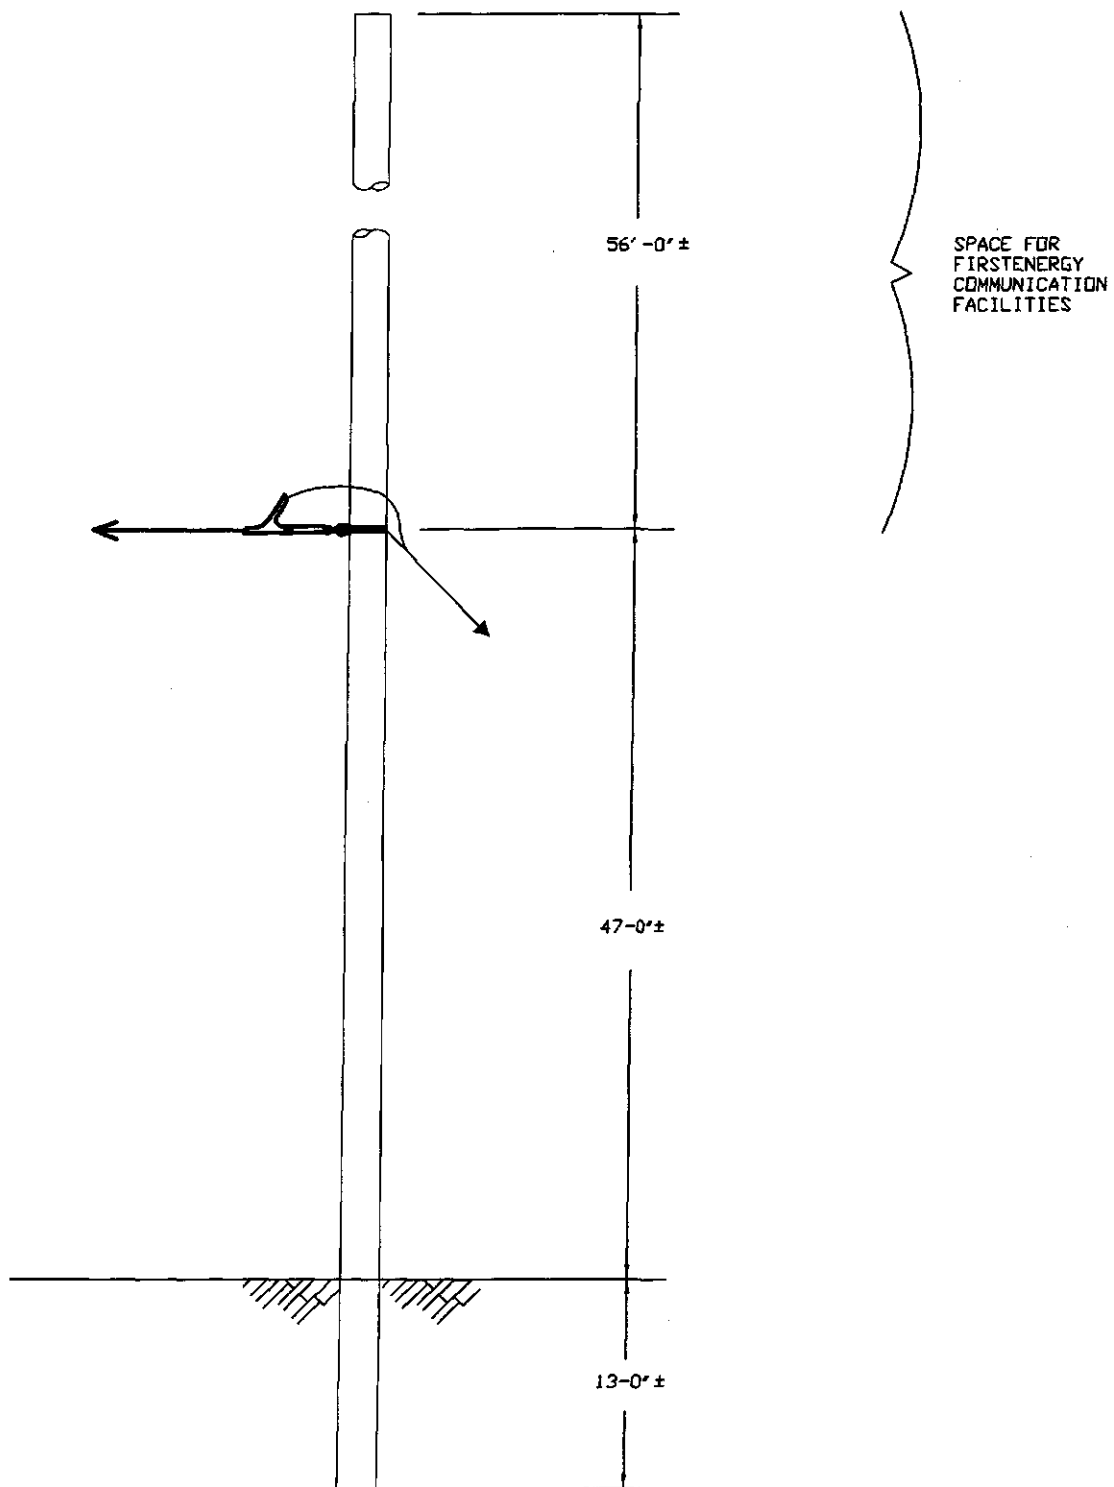

Ohio Edison®
A FirstEnergy Company

OLD FORGE
SUBSTATION

STATIC WIRE STRUCTURE

EXHIBIT 5A