



Legal Department

American Electric Power
1 Riverside Plaza
Columbus, OH 43215-2373
AEP.com

Chairman Thomas W. Johnson
The Public Utilities Commission of Ohio
Ohio Power Siting Board
180 East Broad Street
Columbus, Ohio 43215

September 11, 2014

**Re: Construction Notice for the Hazelton 138kv Transmission Line Tap Project
Case No. 14-1547-EL-BNR**

Yazen Alami, Esq.
Regulatory Services
(614) 716-2920 (P)
(614) 716-2950 (F)
yalami@aep.com

Dear Chairman Johnson:

In accordance with rules 4906-5-02(B) and 4906-11-02, Ohio Administrative Code ("OAC"), AEP Ohio Transmission Company ("AEP Ohio Transco") submits this Construction Notice. Construction of the project is scheduled to begin in November 2014 and is projected to be completed in December 2014.

As required by rule 4906-11-02(C), OAC, AEP Ohio Transco has submitted a copy of this Construction Notice to the chief executive officer of each municipal corporation and county and the head of each public agency charged with protecting the environment or of planning land use in the area in which the proposed project will be located. Attached to the Construction Notice is copies of cover letters that have been submitted.

Should you have any questions, please do not hesitate to contact me.

Respectfully submitted,

/s/ Yazen Alami
Yazen Alami

Attachements

CONSTRUCTION NOTICE

FOR THE

HAZELTON 138KV TRANSMISSION LINE TAP PROJECT

PUCO Case No. 14-1547-EL-BNR

Submitted pursuant to OAC 4906-5-02(B) and 4906-11-02

**AEP Ohio Transmission Company
(AEP Ohio Transco)**

September 2014

CONSTRUCTION NOTICE

Hazelton 138kV Transmission Line Tap Project

In accordance with Ohio Administrative Code Section 4906-11-02 Construction Notice Requirements, American Electric Power Ohio Transmission Company (AEP Ohio Transco) submits the following information:

4906-11-02(B)

(1) Name of the Project

The name of the project is Hazelton 138kV Transmission Line Tap Project.

(2) Description of this Project

The proposed project consists of constructing a 138kV tap line in and out off of the Kirk-Jug 345kV/138kV transmission line to service the proposed Hazelton distribution station operated by The Energy Cooperative (TEC) on the south side of Hollow Road in Pataskala, Licking County, Ohio. The project extends for approximately 800 feet.

(3) Need for this Project

The project is needed to service the proposed distribution substation and provide additional electrical capacity in the Pataskala and Licking County area.

(4) Construction Schedule

Construction is scheduled to begin early November 2014 with an estimated completion date of December 12, 2014.

(5) Estimated Cost

<u>FERC Accounts</u>	<u>Estimated Capital Costs</u>
355 Poles and Fixtures	\$282,800
356 Overhead Conductors and Devices	<u>\$84,400</u>
Total Cost	\$367,200

(6) Technical Features

The new conductor will be 2 bundle 954 ACSR (Rail) wire.

Maps

The line is located northeast of the City of Pataskala in Section 2 of Harrison Township, Licking County, Ohio. Please reference the attached map for project location and line route.

(7) Properties

The project is located entirely on existing AEP easements or on property belonging to The Energy Cooperative in fee.

4906-11-02(C) Notification

Copies of this Construction Notice have been sent to the Licking County Board of Commissioners as well as the Harrison Township Board of Trustees.



American Electric Power
700 Morrison Road
Gahanna, OH 43230

September 4, 2014

Harrison Township Board of Trustees
Mr. Eric R. Smith, Trustee
Mr. Mark A. Van Buren, Trustee
Mr. Raymond P. Foor, Trustee
Ms. Carolyn I. Elder, Fiscal Officer
6750 Outville Road
Pataskala, OH 43062

RE: Construction Notice
Hazelton 138-kV Transmission Line Tap Project
Case Number: 14-1547-EL-BNR

Dear Trustees:

In accordance with Rules 4906 of the Ohio Administrative Code (OAC), AEP Ohio Transmission Company (AEP Ohio Transco) is required to submit a Construction Notice to the State of Ohio Power Siting Board (OPSB) whenever certain changes are made to our transmission facilities.

The proposed Hazelton 138-kV Transmission Line Tap Project, Public Utilities Commission of Ohio (PUCO) Case Number 14-1547-EL-BNR, consists of constructing a 138-kilovolt (kV) tap off the Kirk-Jug 345-kV transmission line. The project extends for approximately 800 feet. The new line will provide additional electrical capacity in the Pataskala and Licking County area. The Hazelton 138-kV transmission line will be located on the south side of Hollow Road in Harrison Township, Licking County. Construction is anticipated to begin in early November 2014.

In compliance with Rule 4906-11-02 of the OPSB Rules and Regulations, we have prepared and filed the attached Construction Notice. This Notice contains details on the line location, project description and construction schedule, and is submitted for your information.

Please feel free to contact me at 614-552-1929 and I would be happy to answer any questions concerning this project.

Sincerely,

A handwritten signature in blue ink, appearing to read 'Brett E. Schmied', with a large, stylized circular flourish at the end.

Brett E. Schmied
Project Outreach Specialist
American Electric Power

cc: Denise Binford, Project Manager



American Electric Power
700 Morrison Road
Gahanna, OH 43230

September 4, 2014

Licking County Board of Commissioners
Mr. Tim E. Bubbs
Mr. Duane H. Flowers
Mr. Doug Smith
20 South Second Street
Newark, OH 43055

RE: Construction Notice
Hazelton 138-kV Transmission Line Tap Project
Case Number: 14-1547-EL-BNR

Dear Commissioners:

In accordance with Rules 4906 of the Ohio Administrative Code (OAC), AEP Ohio Transmission Company (AEP Ohio Transco) is required to submit a Construction Notice to the State of Ohio Power Siting Board (OPSB) whenever certain changes are made to our transmission facilities.

The proposed Hazelton 138-kV Transmission Line Tap Project, Public Utilities Commission of Ohio (PUCO) Case Number 14-1547-EL-BNR, consists of constructing a 138-kilovolt (kV) tap off the Kirk-Jug 345-kV transmission line. The project extends for approximately 800 feet. The new line will provide additional electrical capacity in the Pataskala and Licking County area. The Hazelton 138-kV transmission line will be located on the south side of Hollow Road in Harrison Township, Licking County. Construction is anticipated to begin in early November 2014.

In compliance with Rule 4906-11-02 of the OPSB Rules and Regulations, we have prepared and filed the attached Construction Notice. This Notice contains details on the line location, project description and construction schedule, and is submitted for your information.

Please feel free to contact me at 614-552-1929 and I would be happy to answer any questions concerning this project.

Sincerely,

A handwritten signature in blue ink, appearing to read 'Brett E. Schmied', is written over a light blue circular stamp.

Brett E. Schmied
Project Outreach Specialist
American Electric Power

cc: Denise Binford, Project Manager



American Electric Power
700 Morrison Road
Gahanna, OH 43230

September 4, 2014

Licking County Planning and Development
Mr. Brad Mercer, Manager
20 South Second Street
Newark, OH 43055

RE: Construction Notice
Hazelton 138-kV Transmission Line Tap Project
Case Number: 14-1547-EL-BNR

Dear Mr. Mercer:

In accordance with Rules 4906 of the Ohio Administrative Code (OAC), AEP Ohio Transmission Company (AEP Ohio Transco) is required to submit a Construction Notice to the State of Ohio Power Siting Board (OPSB) whenever certain changes are made to our transmission facilities.

The proposed Hazelton 138-kV Transmission Line Tap Project, Public Utilities Commission of Ohio (PUCO) Case Number 14-1547-EL-BNR, consists of constructing a 138-kilovolt (kV) tap off the Kirk-Jug 345-kV transmission line. The project extends for approximately 800 feet. The new line will provide additional electrical capacity in the Pataskala and Licking County area. The Hazelton 138-kV transmission line will be located on the south side of Hollow Road in Harrison Township, Licking County. Construction is anticipated to begin in early November 2014.

In compliance with Rule 4906-11-02 of the OPSB Rules and Regulations, we have prepared and filed the attached Construction Notice. This Notice contains details on the line location, project description and construction schedule, and is submitted for your information.

Please feel free to contact me at 614-552-1929 and I would be happy to answer any questions concerning this project.

Sincerely,

A handwritten signature in blue ink, appearing to read "Brett E. Schmied", is written over a light blue circular stamp.

Brett E. Schmied
Project Outreach Specialist
American Electric Power

cc: Denise Binford, Project Manager



American Electric Power
700 Morrison Road
Gahanna, OH 43230

September 4, 2014

Licking County Engineer
Mr. William C. Lozier
20 South Second Street
Newark, OH 43055

RE: Construction Notice
Hazelton 138-kV Transmission Line Tap Project
Case Number: 14-1547-EL-BNR

Dear Mr. Lozier:

In accordance with Rules 4906 of the Ohio Administrative Code (OAC), AEP Ohio Transmission Company (AEP Ohio Transco) is required to submit a Construction Notice to the State of Ohio Power Siting Board (OPSB) whenever certain changes are made to our transmission facilities.

The proposed Hazelton 138-kV Transmission Line Tap Project, Public Utilities Commission of Ohio (PUCO) Case Number 14-1547-EL-BNR, consists of constructing a 138-kilovolt (kV) tap off the Kirk-Jug 345-kV transmission line. The project extends for approximately 800 feet. The new line will provide additional electrical capacity in the Pataskala and Licking County area. The Hazelton 138-kV transmission line will be located on the south side of Hollow Road in Harrison Township, Licking County. Construction is anticipated to begin in early November 2014.

In compliance with Rule 4906-11-02 of the OPSB Rules and Regulations, we have prepared and filed the attached Construction Notice. This Notice contains details on the line location, project description and construction schedule, and is submitted for your information.

Please feel free to contact me at 614-552-1929 and I would be happy to answer any questions concerning this project.

Sincerely,

A handwritten signature in blue ink, appearing to read "Brett E. Schmied", is written over a light blue horizontal line.

Brett E. Schmied
Project Outreach Specialist
American Electric Power

cc: Denise Binford, Project Manager



American Electric Power
700 Morrison Road
Gahanna, OH 43230

September 4, 2014

Licking County Library
Ms. Babette Wofter, Director
101 West Main Street
Newark, OH 43055

RE: Construction Notice
Hazelton 138-kV Transmission Line Tap Project
Case Number: 14-1547-EL-BNR

Dear Ms. Wofter:

In accordance with Rules 4906 of the Ohio Administrative Code (OAC), AEP Ohio Transmission Company (AEP Ohio Transco) is required to submit a Construction Notice to the State of Ohio Power Siting Board (OPSB) whenever certain changes are made to our transmission facilities.

The proposed Hazelton 138-kV Transmission Line Tap Project, Public Utilities Commission of Ohio (PUCO) Case Number 14-1547-EL-BNR, consists of constructing a 138-kilovolt (kV) tap off the Kirk-Jug 345-kV transmission line. The project extends for approximately 800 feet. The new line will provide additional electrical capacity in the Pataskala and Licking County area. The Hazelton 138-kV transmission line will be located on the south side of Hollow Road in Harrison Township, Licking County. Construction is anticipated to begin in early November 2014.

In compliance with Rule 4906-11-02 of the OPSB Rules and Regulations, we have prepared and filed the attached Construction Notice. This Notice contains details on the line location, project description and construction schedule, and is submitted for your information.

We ask that you make this Construction Notice available to the general public.


Please feel free to contact me at 614-552-1929 and I would be happy to answer any questions concerning this project.

Sincerely,

A handwritten signature in blue ink, appearing to read "Brett E. Schmied", with a large, stylized loop at the end.

Brett E. Schmied
Project Outreach Specialist
American Electric Power

cc: Denise Binford, Project Manager

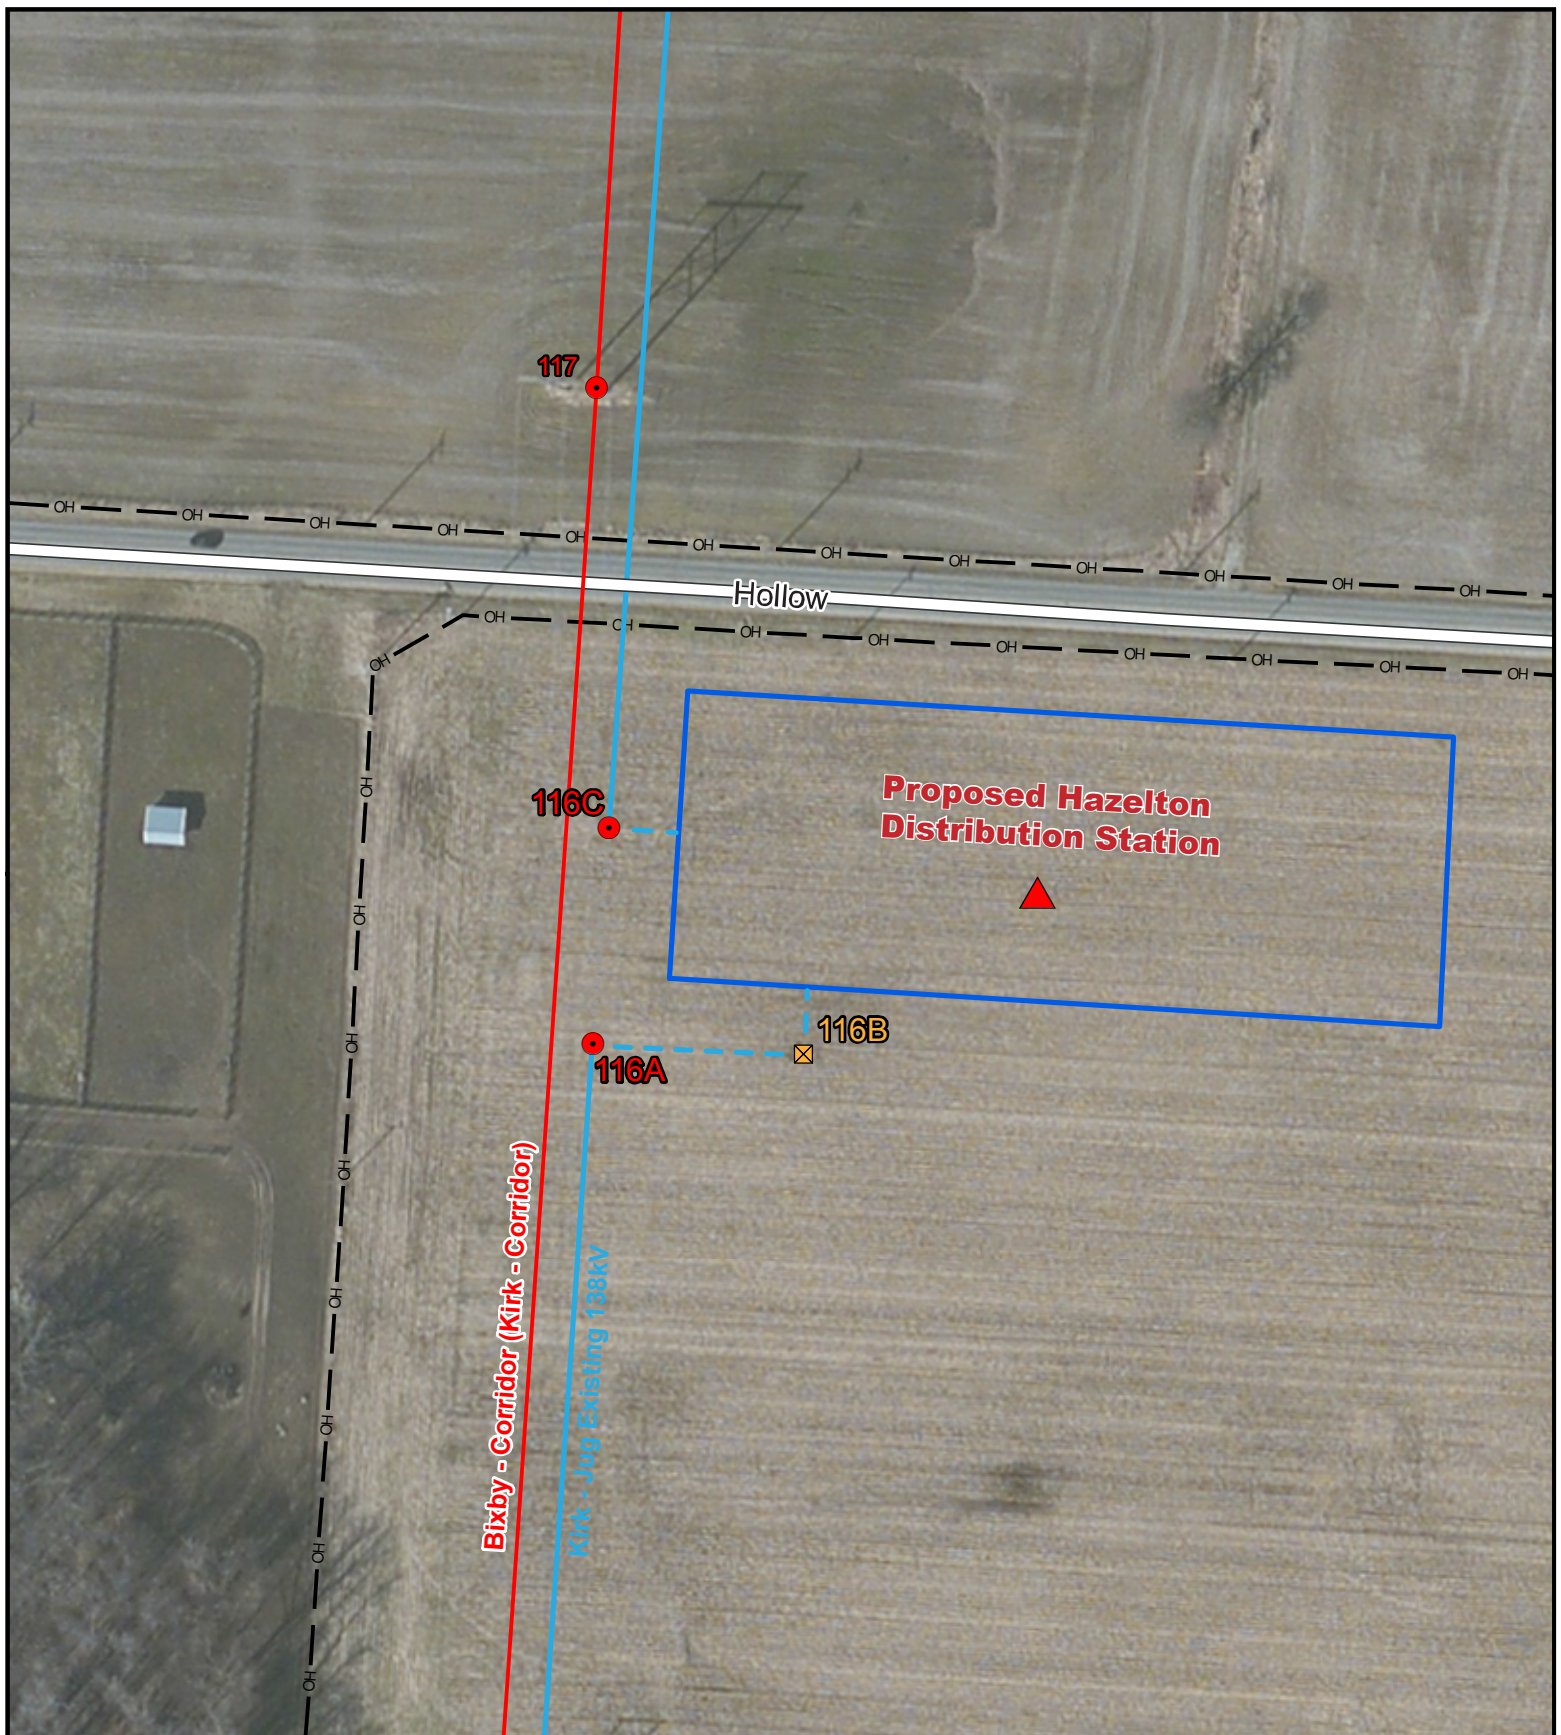

		<ul style="list-style-type: none">▲ Substation● Existing Structure■ Proposed Structure--- Proposed 138 kV--- Existing 138 kV To Be Removed--- Existing Distribution Line--- Existing 345 kV--- Existing 138 kV== Major/Local Road	<p>Scale: 1" = 100' (1,200) If printed at 8.5" x 11" (ANSI A) Portrait</p> <p>0 50 100 Feet</p> <p>Projected Coordinate System: Ohio State Plane Datum: North American Datum of 1983 Projection: Lambert Conformal Conic Zone: South Linear Unit: Feet</p>	Project Location & Route Map Hazelton 138 kV Tap	
<p>This drawing from Commonwealth Inc. is for the sole use of the intended recipient(s) and may contain confidential and privileged information. Any unauthorized review, use, disclosure or distribution is prohibited. If you are not the intended recipient, please contact the sender and destroy all copies of the original document.</p> <p>Source: Commonwealth Associates Inc., AEP, ESRI</p>				<p>Comments:</p>	<p>Drawn By: JEK Date: 9/10/2014</p>
				<p>700 Morrison Rd. Gahanna, OH 43230-6642 PH: (614) 716-1000 Fax: (614) 552-1818</p>	

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

9/11/2014 1:18:59 PM

in

Case No(s). 14-1547-EL-BNR

Summary: Application In the Matter of the Construction Notice for the Hazelton 138kv
Transmission Line Tap Project electronically filed by Mr. Yazen Alami on behalf of AEP Ohio
Transmission Company