

1-800-646-0400

June 19, 2015

Ms. Barcy F. McNeal Secretary Docketing Division The Public Utilities Commission of Ohio 180 East Broad Street Columbus, OH 43215-3793

Black River-Johnson No.1 and No.2 138 kV Transmission Line Extensions to Lake Avenue Substation Project Supplemental Information <u>Case No. 15-0289-EL-BLN</u>

Dear Ms. McNeal:

FirstEnerg

This letter provides supplemental information to the Board concerning the construction of the Black River-Johnson No.1 and No.2 138 kV Transmission Line Extensions to Lake Avenue Substation Project, Case No.15-0289-EL-BLN.

As part of the final engineering analysis for the Project, it was determined that a modification of the proposed design was needed to minimize impacts while meeting the overall Project need. The proposed design modification includes the removal of three (3) additional structures and the replacement of one (1) structure. The location of the structures to be removed and the location of the structure to be replaced is shown on the attached Exhibit 2A-1. A cross-sectional view of the proposed replacement H-Frame structure is shown in the attached Exhibit 8-A.

Should the Ohio Power Siting Board desire further information or discussion of this submittal, please contact me at (330) 761-4473.

Sincerely,


Natil.Br

Nataliya Bryksenkova Engineer, Transmission Siting Energy Delivery Transmission and Substation Design FirstEnergy Service Company

cc: J. O'Dell (OPSB)

.


· _ · _ _

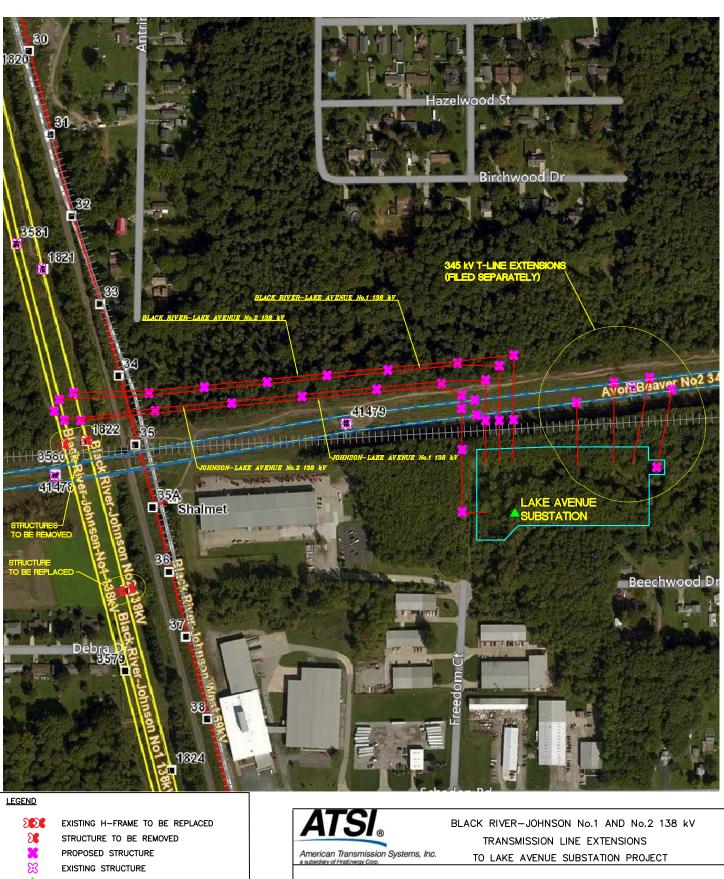

PROPOSED SUBSTATION
PROPOSED SUBSTATION FENCE LINE
EXISTING TRANSMISSION LINE
PROPOSED 138 kV TRANSMISSION LINE
HIHH RAILROAD

EXHIBIT 2A-1

GENERAL LAYOUT

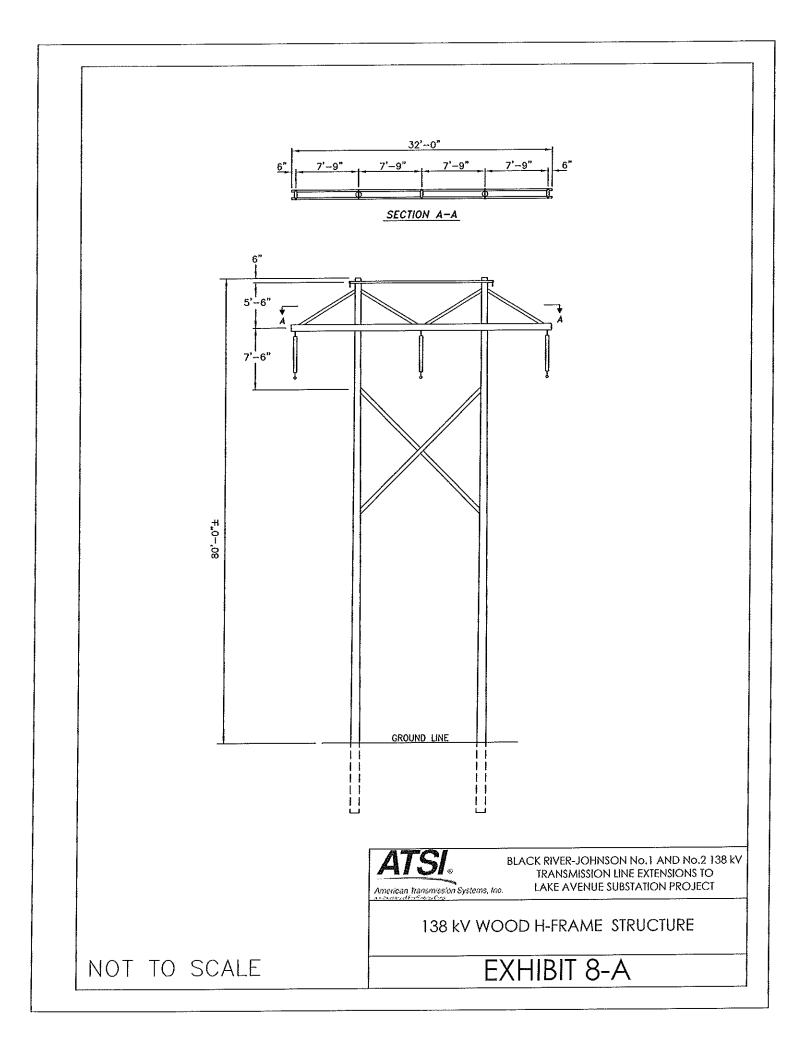

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

6/19/2015 1:25:52 PM

in

Case No(s). 15-0289-EL-BLN

Summary: Correspondence providing Supplemental Information on Project electronically filed by Mr. Robert J Schmidt on behalf of American Transmission Systems Inc.