

February 1, 2016

Ms. Barcy F. McNeal
Docketing Division
The Public Utilities Commission of Ohio
180 East Broad Street
Columbus, OH 43215-3793

**Supplemental Information Letter
Delta-Wauseon 138 kV Transmission Line
Tap to Nature Fresh Farms Project
Case No. 15-2081-EL-BLN**

Dear Ms. McNeal,

This letter provides supplemental information to the Board concerning the planned construction of the Delta Wauseon 138 kV Transmission Line Tap to Nature Fresh Farms Project ("Project"), Case No. 15-2081-EL-BLN. Since the filing of the application with the Board, final engineering analysis was completed on the switch structures which has resulted in minor modification of the location of the eastern switch structure. The eastern switch structure will now replace Structure 60 of the existing Delta-Wauseon 138 kV Transmission Line instead of Structure 61 as indicated in the Letter of Notification ("LON") (See Attachment 1). The engineering changes are as follows:

1. Structure 61 will still be replaced, as indicated in the LON, but it will be replaced with a 138 kV Wood Pole Structure, as depicted in Attachment 2, as opposed to the switch structure identified in the LON. Structure 61 will be installed approximately 20 feet to the southeast of the existing structure location, removes unnecessary line angles from the transmission line.


2. Structure 60 will be replaced with a 138 kV Wood Pole, Single Circuit, Switch Structure, as depicted in Attachment 3. The new Structure 60 will be located at approximately the same location as the existing structure.



No additional impacts are expected from this engineering change in the Project. Should the Ohio Power Siting Board desire further information or discussion of this submittal, please contact me at (330)-384-2740.

Sincerely,



William R. Beutler
Engineer II
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

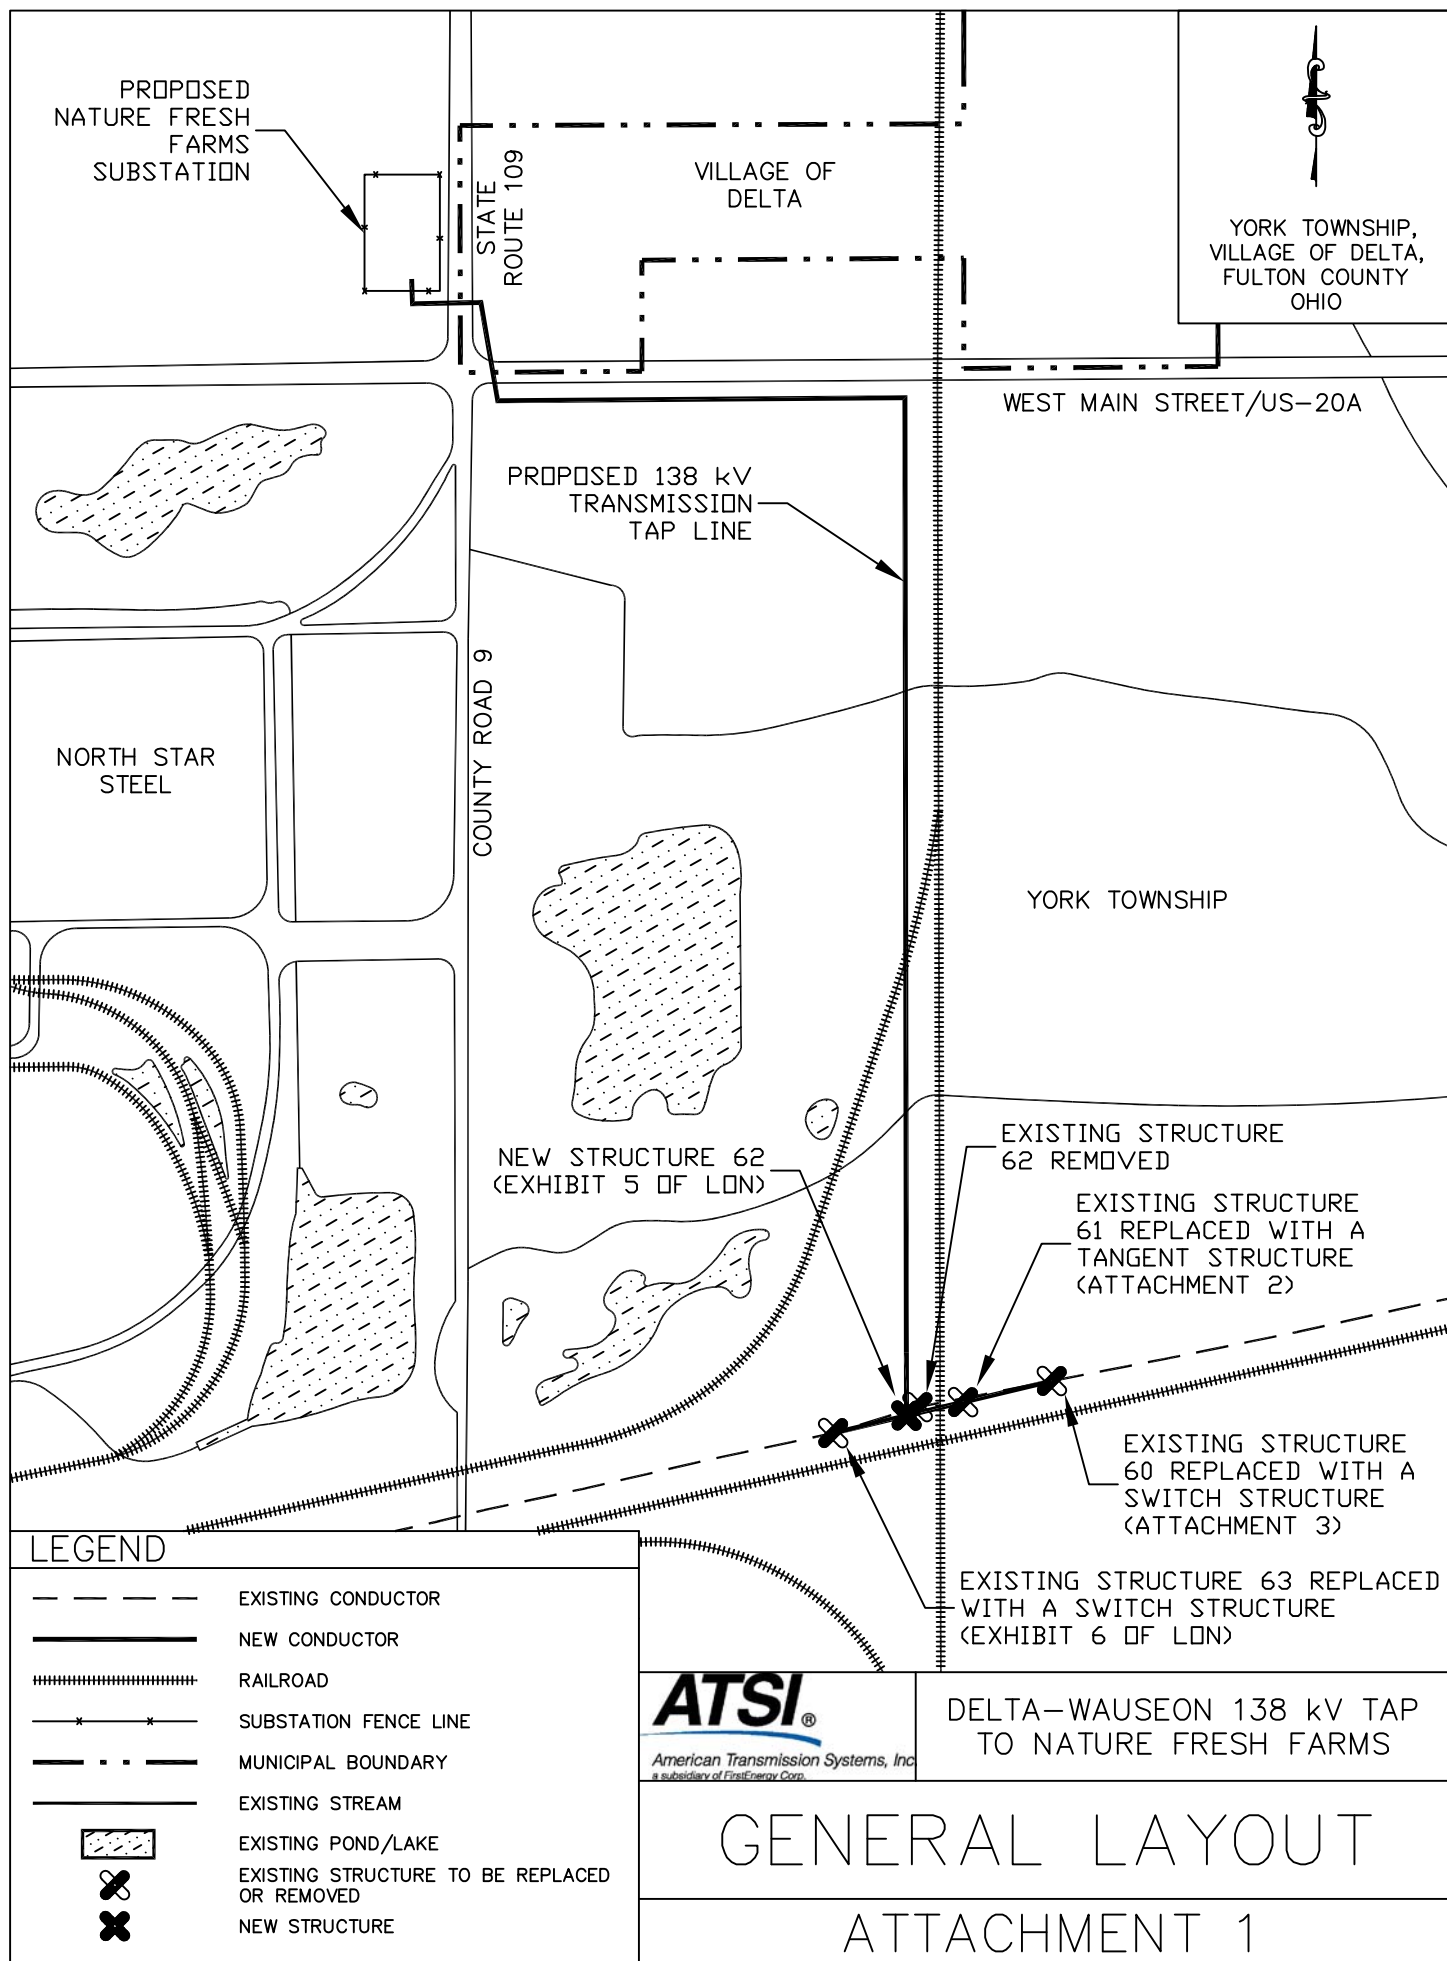

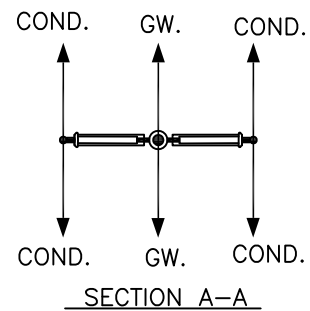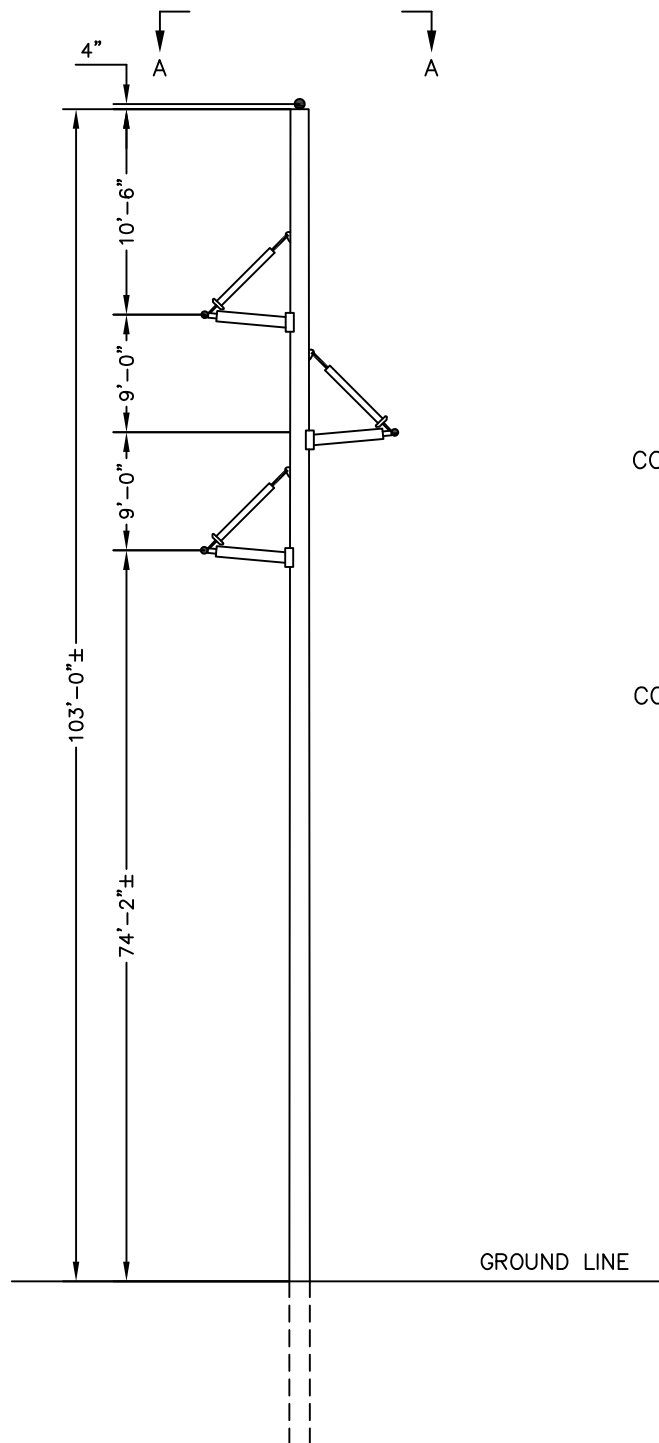


**NOT TO SCALE

ATSI
American Transmission Systems, Inc.
a subsidiary of FirstEnergy Corp.

DELTA-WAUSEON 138 kV
TRANSMISSION LINE TAP TO NATURE
FRESH FARMS

138 kV WOOD POLE, SINGLE CIRCUIT,
BRACE POST INSULATOR, DELTA TANGENT

ATTACHMENT 2

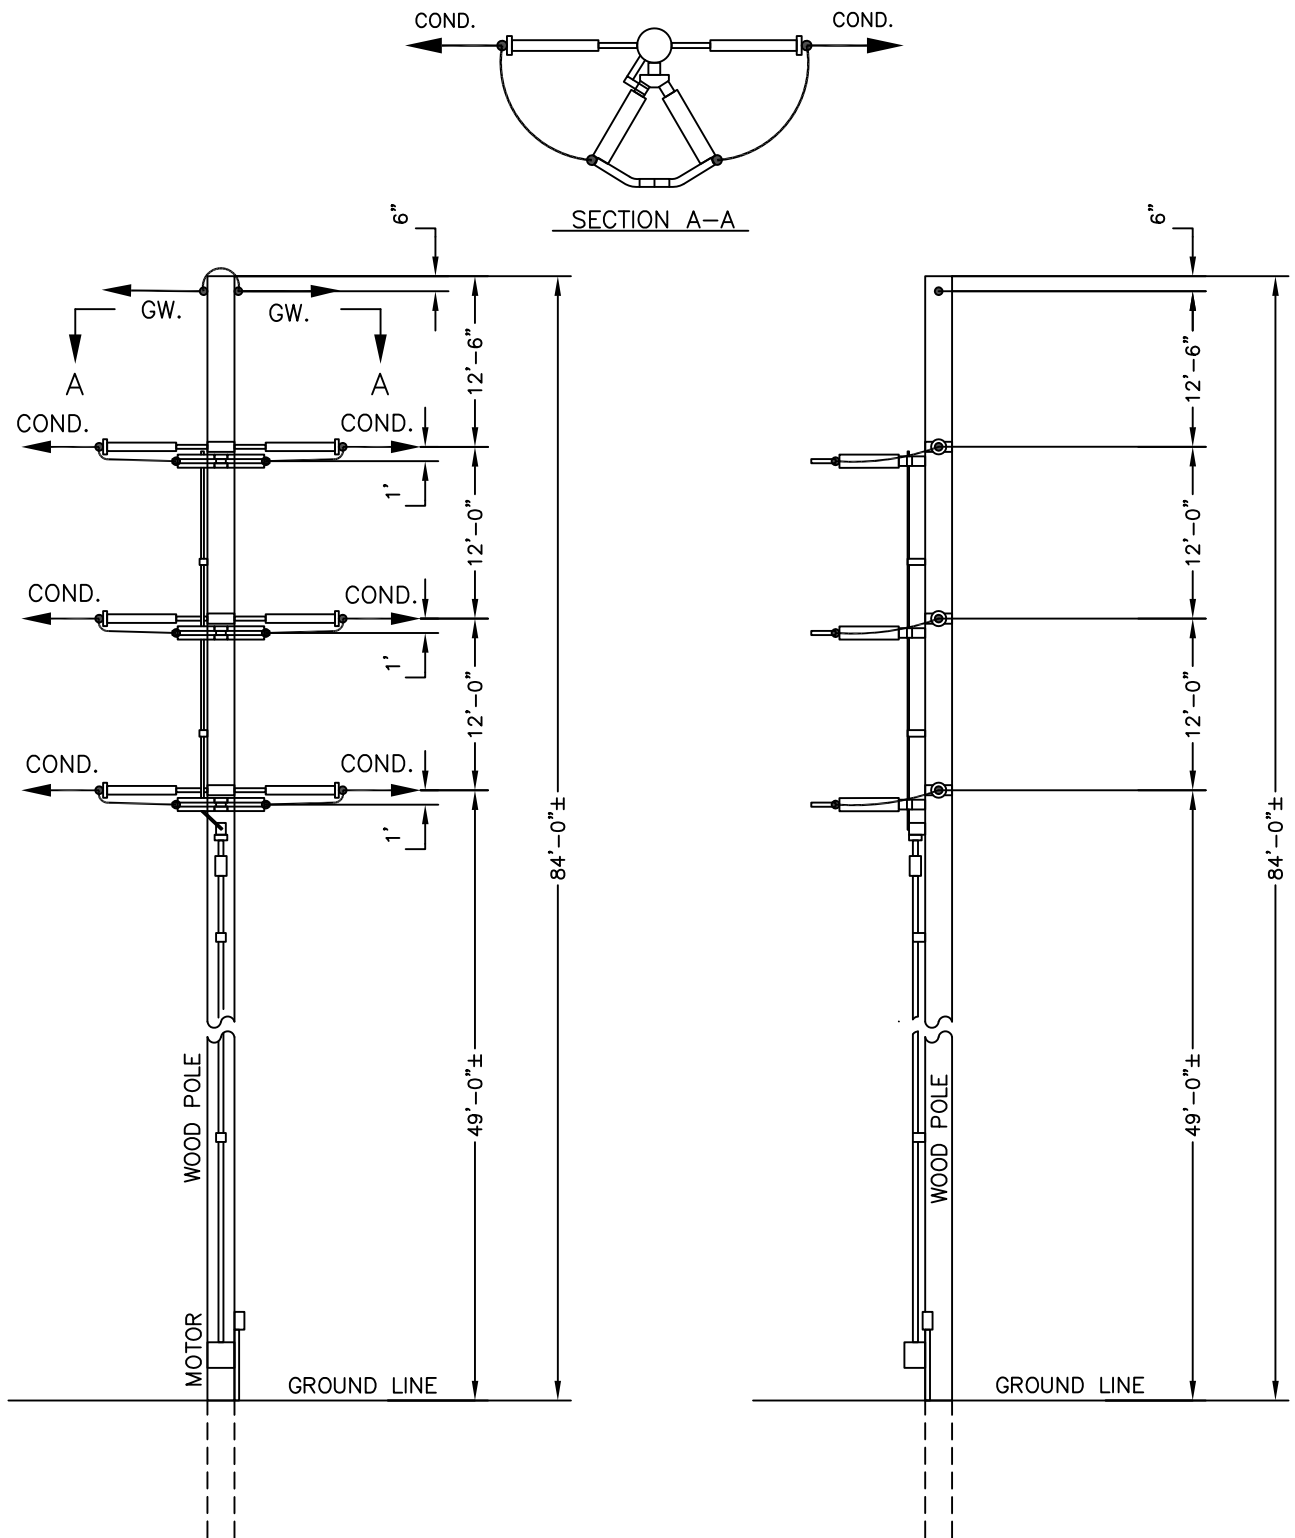

ATSI[®]
American Transmission Systems, Inc.
a subsidiary of FirstEnergy Corp.

DELTA-WAUSEON 138 kV
TRANSMISSION LINE TAP TO NATURE
FRESH FARMS

138 kV WOOD POLE, SINGLE CIRCUIT,
SWITCH

ATTACHMENT 3

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

2/1/2016 4:46:00 PM

in

Case No(s). 15-2081-EL-BLN

Summary: Notification of Supplemental Information Concerning Engineering Change to Project electronically filed by Mr. Robert J Schmidt on behalf of American Transmission Systems Inc. and The Toledo Edison Company