

Supplemental Appendix E

Wind Energy Turbine Manufacturer Information

CONTINUED

3 MW PLATFORM

Wind. It means the world to us.™

Are you looking for the maximum return on **your investment** in wind energy?

Wind energy means the world to us. And we want it to mean the world to our customers, too, by maximising your profits and strengthening the certainty of your investment in wind power.

That's why, together with our partners, we always strive to deliver cost-effective wind technologies, high quality products and first class services throughout the entire value chain. And it's why we put so much emphasis on the reliability, consistency and predictability of our technology.

We have more than 30 years' experience in wind energy. During that time, we've delivered more than 70 GW of installed capacity in 74 countries. That is more than 15 per cent of total wind turbine capacity installed globally – and over 15 GW more than our closest competitor. We currently monitor over 27,000 wind turbines across the globe. All tangible proof that Vestas is the right partner to help you realise the full potential of your wind site.

What is the 3 MW Platform today?

The 3 MW platform was introduced in 2010 with the launch of the V112-3.0 MW*. Over 7 GW of the 3 MW platform has been installed all over the world onshore and offshore making it the obvious choice for customers looking for highly flexible and trustworthy turbines.

Since then the 3 MW platform was upgraded and new variants were introduced utilising untapped potential of the platform. All variants carry the same nacelle design and the hub design has been re-used to the largest extent possible. In addition, our engineers have increased the nominal power across the entire platform improving your energy production significantly.

With this expansion, the 3 MW platform covers all IEC wind classes with a variety of rotor sizes and a higher rated output power of 3.45 MW.

You can choose from the following turbines on the 3 MW platform:

- V105-3.45 MW™ – IEC IA
- V112-3.45 MW™ – IEC IA
- V117-3.45 MW™ – IEC IB/IEC IIA
- V126-3.45 MW™ – IEC IIB
- V126-3.45 MW™ – IEC IIA
- V136-3.45 MW™ – IEC IIIA

All variants of the 3 MW platform are based on the proven technology of the V112-3.0 MW* with a full-scale converter, providing you with superior grid performance.

Our 3 MW platform is designed for a broad range of wind and site conditions, enabling you to mix turbines across your site or portfolio of sites, delivering industry-leading reliability, serviceability and exceptional energy capture optimising your business case.

All turbine variants are equipped with the same ergonomically designed and very spacious nacelle which makes it easier for maintenance crews to gain access, so they can reduce the time spent on service while maximizing the uptime without compromising safety. All turbines can be installed and maintained using standard installation and servicing tools and equipment further reducing the operation and maintenance costs by minimising your stock level of spare parts.

A photograph of two large, white, three-bladed wind turbines standing on a grassy hill. The sky is overcast with grey clouds, and the sun is visible as a bright patch behind the clouds. The foreground is filled with tall, dry grass.

+55,000

The V112-3.45 MW® and the other 3 MW variants advance the already proven technology powering over 55,000 installed Vestas turbines worldwide - more than any other supplier.

How does our technology generate **more energy?**

More power for every wind site

V112-3.45 MW™, V117-3.45 MW™, V126-3.45 MW™ and V136-3.45 MW™ are available with several noise modes to meet sound level restrictions with an optimised production. The power system enables superior grid support and it is capable of maintaining production across severe drops in grid voltage, while simultaneously minimising tower and foundation loads. It also allows rapid down-rating of production to 10 per cent nominal power.

Proven technologies - from the company that invented them

The 3 MW platform is a low-risk choice. It is based on the proven technologies that underpin more than 55,000 Vestas turbines installed around the world. Using the best features from across the range, as well as some of the industry's most stringently tested components and systems, the platform's reliable design minimises downtime – helping to give you the best possible return on your investment.

With an operating range that covers all wind classes, our 3 MW platform delivers unrivalled energy production. The proven blade technology from the V112-3.0 MW® is used on the V105-3.45 MW™, the V112-3.45 MW™ and on the V117-3.45 MW™. The industry known structural shell blades are used on the V126-3.45 MW™ and V136-3.45 MW™ - a technology which is also used on the 2 MW V110-2.0 MW™ variant.

Reliable and robust

The Vestas Test Centre is unrivalled in the wind industry. We test most nacelle components using Highly Accelerated Life Testing (HALT) to ensure reliability. For critical components, HALT identifies potential failure modes and mechanisms. Specialised test rigs ensure strength and robustness for the gearbox, generator, yaw and pitch system, lubrication system and accumulators. Our quality-control system ensures that each component is manufactured to design specifications and performs at site. We systematically monitor measurement trends that are critical to quality, locating defects before they occur.

The 3 MW platform covers all wind segments enabling you to find the best turbine for your specific site.

WINDCLASSES - IEC

TURBINE TYPE	IEC III (6.0 - 7.5 m/s)	IEC II (7.5 - 8.5 m/s)	IEC I (8.5 - 10.0 m/s)
3 MW TURBINES			
V105-3.45 MW™ IEC IA			
V112-3.45 MW™ IEC IA			
V117-3.45 MW™ IEC IB/IEC IIA			
V126-3.45 MW™ IEC IIA			
V126-3.45 MW™ IEC IIB			
V136-3.45 MW™ IEC IIIA			

Standard IEC conditions Site dependent

Options available for the 3 MW platform

An option is an extra feature that can be added to the turbine to suit a project’s specific needs. By adding options to the standard turbine, we can enhance the performance and adaptability of the wind power project and facilitate a shorter permitting cycle at restricted sites. The options can even be a decisive factor in realising your specific project, and the business case certainty of the investment.

Here is a list of the options available for the 3 MW platform:

- Power Mode (site specific)
- Condition Monitoring System
- Service Personnel Lift
- Vestas Ice Detection
- Vestas De-Icing
- Low Temperature Operation to - 30°C
- Fire Suppression
- Shadow detection
- Increased Cut-In
- Nacelle Hatch for Air Inlet
- Aviation Lights
- Aviation Markings on the Blades
- Obstacle Collision Avoidance System (OCAS™)

Life testing

The Vestas Test Centre has the unique ability to test complete nacelles using technologies like Highly Accelerated Life Testing (HALT). This rigorous testing of new components ensures the reliability of the 3 MW platform.



Is the 3 MW platform the optimal choice for your specific site?

One common nacelle – five different rotor sizes

The wind conditions on a wind project site are often not identical. The 3 MW platform features a range of turbines that cover all wind classes and combined across your site they can maximise the energy output of your wind power plant.

Tip-height restrictions and strict grid requirements

With a rotor size of 105 m, the V105-3.45 MW™ IEC IA is the turbine that fits the most severe wind conditions. It has an extremely robust design for tough site conditions and is especially suited for markets with tip-height restrictions and high grid requirements.

Like all the other 3 MW turbines, the V105-3.45 MW™ is equipped with a full-scale converter ensuring full compliance with the challenging grid codes in countries like the UK and Ireland.

Cold climates

The V112-3.45 MW™, V117-3.45 MW™, V126-3.45 MW™ and V136-3.45 MW™ can be combined with Vestas De-Icing and Vestas Ice Detection ensuring optimum production in cold climates.

The Vestas De-Icing System is fully SCADA integrated and can be triggered automatically or manually depending on your de-icing strategy. Automatic control protects your investment, optimising the trigger point so the turbine only stops to de-ice when there is an expected net power production gain.

High- and medium-wind sites

The V112-3.45 MW™ IEC IA is a high-wind turbine and has a very high capacity factor. Similar to the other 3 MW turbines, the V112-3.45 MW™ IEC IA turbine makes efficient use of its grid compatibility and is an optimal choice for sites with MW constraints.

On medium wind-sites the V117-3.45 MW™ IEC IB/IEC IIA, V126-3.45 MW™ IEC IIA and V126-3.45 MW™ IEC IIB are

excellent turbine choices. A combination of the variants can optimise your site layout and improve your production significantly on complex sites.

Low-wind sites

Built on the same proven technology as the V112-3.0 MW™, the V136-3.45 MW™ IEC IIIA is our best performer on low-wind sites. The larger rotor enable greater wind capture, which in turn produces more energy to reduce levelised cost of energy (LCOE). The result is exceptional profitability in areas with low wind, and new frontiers for wind energy investment.

Large Diameter Steel Towers (LDST) support the added rotor size and rating of Vestas turbines to increase Annual Energy Production on low-wind sites.

LDST is specially designed with a larger diameter in the bottom section that allows for optimal strength at high hub heights.

Maximising old permits

Although the V136-3.45 MW™ is one of the highest producing low wind turbine available, some old permits may simply be too tight to accept it. Although the V117-3.45 MW™ and V126-3.45 MW™ are medium-wind turbines, they still deliver an excellent business case on low-wind sites.

Due to the similar electrical properties and nacelle design, it is easy to mix and match the turbines from the 3 MW platform to maximise production on heavily constrained sites.



Would you **benefit** from uninterrupted control of wind energy production?

Knowledge about wind project planning is key

Getting your wind energy project up and operating as quickly as possible is fundamental to its long-term success. One of the first and most important steps is to identify the most suitable location for your wind power plant. Vestas' SiteHunt® is an advanced analytical tool that examines a broad spectrum of wind and weather data to evaluate potential sites and establish which of them can provide optimum conditions for your project.

In addition, SiteDesign® optimises the layout of your wind power plant. SiteDesign® runs Computational Fluid Dynamics (CFD) software on our powerful in-house supercomputer Firestorm to perform simulations of the conditions on site and analyse their effects over the whole operating life of the plant. Put simply, it finds the optimal balance between the estimated ratio of annual revenue to operating costs over the lifetime of your plant, to determine your project's true potential and provide a firm basis for your investment decision.

The complexity and specific requirements of grid connections vary considerably across the globe, making the optimal design of electrical components for your wind power plant essential. By identifying grid codes early in the project phase and simulating extreme operating conditions, Electrical PreDesign provides you with an ideal way to build a grid compliant, productive and highly profitable wind power plant. It allows customised collector network cabling, substation protection and reactive power compensation, which boost the cost efficiency of your business.

Advanced monitoring and real-time plant control

All our wind turbines can benefit from VestasOnline® Business, the latest Supervisory Control and Data Acquisition (SCADA) system for modern wind power plants.

This flexible system includes an extensive range of monitoring and management functions to control your wind power plant. VestasOnline® Business enables you to optimise production levels,



+27,000

The Vestas Performance and Diagnostics Centre monitors more than 27,000 turbines worldwide. We use this information to continually develop and improve our products and services.

monitor performance and produce detailed, tailored reports from anywhere in the world. The VestasOnline® Power Plant Controller offers scalability and fast, reliable real-time control and features customisable configuration, allowing you to implement any control concept needed to meet local grid requirements.

Surveillance, maintenance and service

Operating a large wind power plant calls for efficient management strategies to ensure uninterrupted power production and to control operational expenses. We offer 24/7 monitoring, performance reporting and predictive maintenance systems to improve turbine performance and availability. Predicting faults in advance is essential, helping to avoid costly emergency repairs and unscheduled interruptions to energy production.

Our Condition Monitoring System (CMS) assesses the status of the turbines by analysing vibration signals. For example, by measuring the vibration of the drive train, it can detect faults at

an early stage and monitor any damage. This information allows pre-emptive maintenance to be carried out before the component fails, reducing repair costs and production loss.

Additionally, our Active Output Management® (AOM) concept provides detailed plans and long term agreements for service and maintenance, online monitoring, optimisation and troubleshooting. It is possible to get a full scope contract, combining your turbines' state-of-the-art technology with guaranteed time or energy-based availability performance targets, thereby creating a solid base for your power plant investment. The Active Output Management® agreement provides you with long term and financial operational peace of mind for your business case.

V105-3.45 MW™

IEC IA

Facts & figures

POWER REGULATION

Pitch regulated with variable speed

OPERATING DATA

Rated power	3,450 kW
Cut-in wind speed	3 m/s
Cut-out wind speed	25 m/s
Re cut-in wind speed	23 m/s
Wind class	IEC IA
Standard operating temperature range from -20°C* to +45°C with de-rating above 30°C	

*subject to different temperature options

SOUND POWER

(Noise modes dependent on site and country)

ROTOR

Rotor diameter	105 m
Swept area	8,659 m²
Air brake	full blade feathering with 3 pitch cylinders

ELECTRICAL

Frequency	50/60 Hz
Converter	full scale

GEARBOX

Type	two planetary stages and one helical stage
------	--

TOWER

Hub height	72.5 m (IEC IA)
------------	-----------------

NACELLE DIMENSIONS

Height for transport	3.4 m
Height installed (incl. CoolerTop®)	6.9 m
Length	12.8 m
Width	4.2 m

HUB DIMENSIONS

Max. transport height	3.8 m
Max. transport width	3.8 m
Max. transport length	5.5 m

BLADE DIMENSIONS


Length	51.2 m
Max. chord	4 m

Max. weight per unit for transportation	70 metric tonnes
---	------------------

TURBINE OPTIONS

- Power Mode (site specific)
- Condition Monitoring System
- Service Personnel Lift
- Vestas Ice Detection
- Low Temperature Operation to -30°C
- Fire Suppression
- Shadow Detection
- Increased Cut-In
- Nacelle Hatch for Air Inlet
- Aviation Lights
- Aviation Markings on the Blades
- Obstacle Collision Avoidance System (OCAS™)

ANNUAL ENERGY PRODUCTION

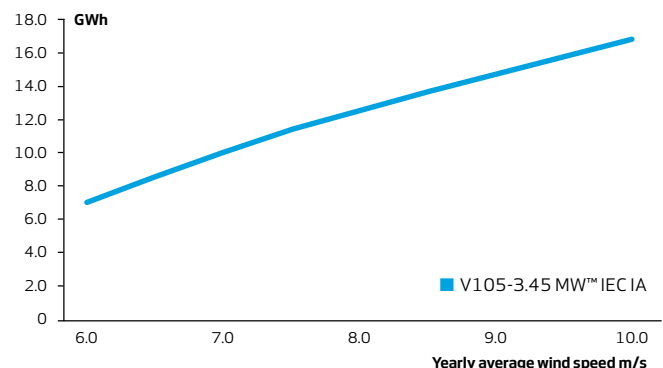

Assumptions

One wind turbine, 100% availability, 0% losses, k factor = 2, Standard air density = 1.225, wind speed at hub height

V112-3.45 MW™

IEC IA

Facts & figures

POWER REGULATION

Pitch regulated with variable speed

OPERATING DATA

Rated power	3,450 kW
Cut-in wind speed	3 m/s
Cut-out wind speed	25 m/s
Re cut-in wind speed	23 m/s
Wind class	IEC IA
Standard operating temperature range from -20°C to +45°C with de-rating above 30°C	

*subject to different temperature options

SOUND POWER

(Noise modes dependent on site and country)

ROTOR

Rotor diameter	112 m
Swept area	9,852 m²
Air brake	full blade feathering with 3 pitch cylinders

ELECTRICAL

Frequency	50/60 Hz
Converter	full scale

GEARBOX

Type	two planetary stages and one helical stage
------	--

TOWER

Hub height	69 m (IEC IA) and 94 m (IEC IA)
------------	---------------------------------

NACELLE DIMENSIONS

Height for transport	3.4 m
Height installed (incl. CoolerTop®)	6.9 m
Length	12.8 m
Width	4.2 m

HUB DIMENSIONS

Max. transport height	3.8 m
Max. transport width	3.8 m
Max. transport length	5.5 m

BLADE DIMENSIONS


Length	54.7 m
Max. chord	4 m

Max. weight per unit for transportation	70 metric tonnes
---	------------------

TURBINE OPTIONS

- Power Mode (site specific)
- Condition Monitoring System
- Service Personnel Lift
- Vestas Ice Detection
- Vestas De-Icing
- Low Temperature Operation to - 30°C
- Fire Suppression
- Shadow detection
- Increased Cut-In
- Nacelle Hatch for Air Inlet
- Aviation Lights
- Aviation Markings on the Blades
- Obstacle Collision Avoidance System (OCAS™)

ANNUAL ENERGY PRODUCTION

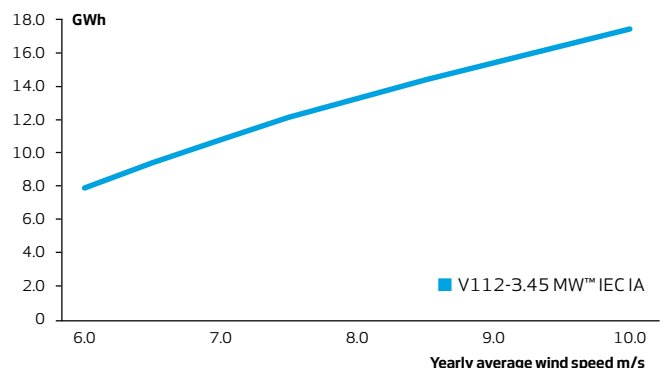

Assumptions

One wind turbine, 100% availability, 0% losses, k factor = 2, Standard air density = 1.225, wind speed at hub height

V117-3.45 MW™

IEC IB/IEC IIA

Facts & figures

POWER REGULATION

Pitch regulated with variable speed

OPERATING DATA

Rated power	3,450 kW
Cut-in wind speed	3 m/s
Cut-out wind speed	25 m/s
Re cut-in wind speed	23 m/s
Wind class	IEC IB/IEC IIA
Standard operating temperature range from -20°C* to +45°C with de-rating above 30°C	

*subject to different temperature options

SOUND POWER

(Noise modes dependent on site and country)

ROTOR

Rotor diameter	117 m
Swept area	10,751 m²
Air brake	full blade feathering with 3 pitch cylinders

ELECTRICAL

Frequency	50/60 Hz
Converter	full scale

GEARBOX

Type	two planetary stages and one helical stage
------	--

TOWER

Hub heights	80 m (IEC IB), 91.5 m (IEC IB) and 116.5 m (IEC IB/IEC IIA/DIBtS)
-------------	---

NACELLE DIMENSIONS

Height for transport	3.4 m
Height installed (incl. CoolerTop®)	6.9 m
Length	12.8 m
Width	4.2 m

HUB DIMENSIONS

Max. transport height	3.8 m
Max. transport width	3.8 m
Max. transport length	5.5 m

BLADE DIMENSIONS


Length	57.2 m
Max. chord	4 m

Max. weight per unit for transportation	70 metric tonnes
---	------------------

TURBINE OPTIONS

- Power Mode (site specific)
- Condition Monitoring System
- Service Personnel Lift
- Vestas Ice Detection
- Vestas De-Icing
- Low Temperature Operation to - 30°C
- Fire Suppression
- Shadow detection
- Increased Cut-In
- Nacelle Hatch for Air Inlet
- Aviation Lights
- Aviation Markings on the Blades
- Obstacle Collision Avoidance System (OCAS™)

ANNUAL ENERGY PRODUCTION

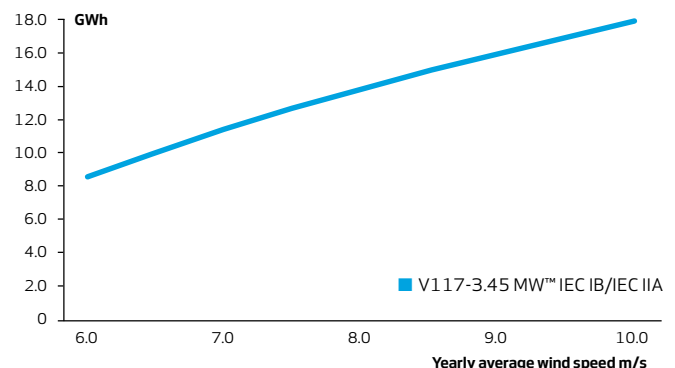

Assumptions

One wind turbine, 100% availability, 0% losses, k factor = 2, Standard air density = 1.225, wind speed at hub height

V126-3.45 MW™

IEC IIB

Facts & figures

POWER REGULATION

Pitch regulated with variable speed

OPERATING DATA

Rated power	3,450 kW
Cut-in wind speed	3 m/s
Cut-out wind speed	22.5 m/s
Re cut-in wind speed	20 m/s
Wind class	IEC IIB
Standard operating temperature range from -20°C* to +45°C with de-rating above 30°C	

*subject to different temperature options

SOUND POWER

(Noise modes dependent on site and country)

ROTOR

Rotor diameter	126 m
Swept area	12,469 m²
Air brake	full blade feathering with 3 pitch cylinders

ELECTRICAL

Frequency	50/60 Hz
Converter	full scale

GEARBOX

Type	two planetary stages and one helical stage
------	--

TOWER

Hub heights	87 m (IEC IIB), 117 m (IEC IIB), 137 m (IEC IIIA/DIBtS), 147 m (IEC IIIA), 149 m (DIBtS) and 166 m (DIBtS)
-------------	--

NACELLE DIMENSIONS

Height for transport	3.4 m
Height installed (incl. CoolerTop®)	6.9 m
Length	12.8 m
Width	4.2 m

HUB DIMENSIONS

Max. transport height	3.8 m
Max. transport width	3.8 m
Max. transport length	5.5 m

BLADE DIMENSIONS


Length	61.7 m
Max. chord	4 m

Max. weight per unit for transportation	70 metric tonnes
---	------------------

TURBINE OPTIONS

- Power Mode (site specific)
- Condition Monitoring System
- Service Personnel Lift
- Vestas Ice Detection
- Vestas De-Icing
- Low Temperature Operation to - 30°C
- Fire Suppression
- Shadow detection
- Increased Cut-In
- Nacelle Hatch for Air Inlet
- Aviation Lights
- Aviation Markings on the Blades
- Obstacle Collision Avoidance System (OCAS™)

ANNUAL ENERGY PRODUCTION

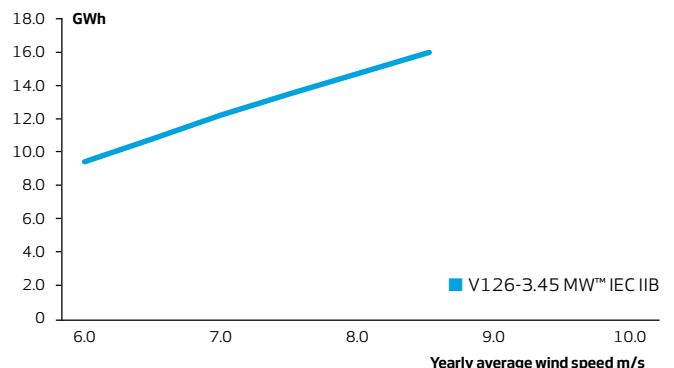

Assumptions

One wind turbine, 100% availability, 0% losses, k factor = 2.
Standard air density = 1.225, wind speed at hub height

V126-3.45 MW™

IEC IIA

Facts & figures

POWER REGULATION

Pitch regulated with variable speed

OPERATING DATA

Rated power	3,450 kW
Cut-in wind speed	3 m/s
Cut-out wind speed	22.5 m/s
Re cut-in wind speed	20 m/s
Wind class	IEC IIA
Standard operating temperature range from -20°C* to +45°C with de-rating above 30°C	

*subject to different temperature options

SOUND POWER

(Noise modes dependent on site and country)

ROTOR

Rotor diameter	126 m
Swept area	12,469 m²
Air brake	full blade feathering with 3 pitch cylinders

ELECTRICAL

Frequency	50/60 Hz
Converter	full scale

GEARBOX

Type	two planetary stages and one helical stage
------	--

TOWER

Hub heights	87 m (IEC IIA), 117 m (IEC IIA/DIBtS), 137 m (IEC IIIA/DIBtS), 147 m (IEC IIIA), 149 m (DIBtS) and 166 m (DIBtS)
-------------	--

NACELLE DIMENSIONS

Height for transport	3.4 m
Height installed (incl. CoolerTop®)	6.9 m
Length	12.8 m
Width	4.2 m

HUB DIMENSIONS

Max. transport height	3.8 m
Max. transport width	3.8 m
Max. transport length	5.5 m

BLADE DIMENSIONS


Length	61.7 m
Max. chord	4 m

Max. weight per unit for transportation	70 metric tonnes
---	------------------

TURBINE OPTIONS

- Power Mode (site specific)
- Condition Monitoring System
- Service Personnel Lift
- Vestas Ice Detection
- Vestas De-Icing
- Low Temperature Operation to -30°C
- Fire Suppression
- Shadow detection
- Increased Cut-In
- Nacelle Hatch for Air Inlet
- Aviation Lights
- Aviation Markings on the Blades
- Obstacle Collision Avoidance System (OCAS™)

ANNUAL ENERGY PRODUCTION

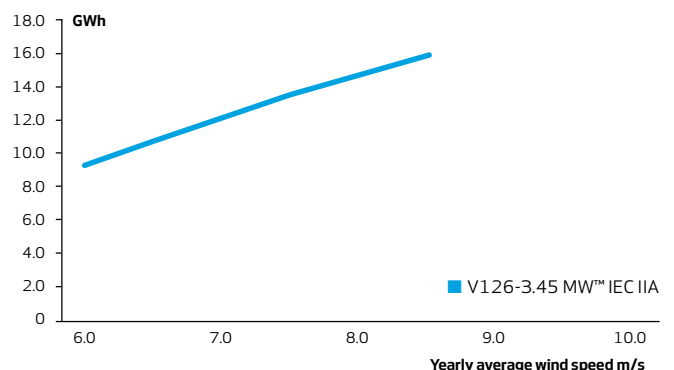

Assumptions

One wind turbine, 100% availability, 0% losses, k factor = 2,
Standard air density = 1.225, wind speed at hub height

V136-3.45 MW™

IEC IIIA

Facts & figures

POWER REGULATION

Pitch regulated with variable speed

OPERATING DATA

Rated power	3,450 kW
Cut-in wind speed	3 m/s
Cut-out wind speed	22.5 m/s
Re cut-in wind speed	20 m/s
Wind class	IEC IIIA
Standard operating temperature range from -20°C* to +45°C with de-rating above 30°C	

*subject to different temperature options

SOUND POWER

(Noise modes dependent on site and country)

ROTOR

Rotor diameter	136 m
Swept area	14,527 m²
Air brake	full blade feathering with 3 pitch cylinders

ELECTRICAL

Frequency	50/60 Hz
Converter	full scale

GEARBOX

Type	two planetary stages and one helical stage
------	--

TOWER

Hub heights	82 m (IEC IIIA), 112 m (IEC IIIA), 132 m (IEC IIIA/DIBt2) and 149 m (DIBtS)
-------------	---

NACELLE DIMENSIONS

Height for transport	3.4 m
Height installed (incl. CoolerTop®)	6.9 m
Length	12.8 m
Width	4.2 m

HUB DIMENSIONS

Max. transport height	3.8 m
Max. transport width	3.8 m
Max. transport length	5.5 m

BLADE DIMENSIONS


Length	66.7 m
Max. chord	4.1 m

Max. weight per unit for transportation	70 metric tonnes
---	------------------

TURBINE OPTIONS

- Power Mode (site specific)
- Condition Monitoring System
- Service Personnel Lift
- Vestas Ice Detection
- Vestas De-Icing
- Low Temperature Operation to -30°C
- Fire Suppression
- Shadow detection
- Increased Cut-In
- Nacelle Hatch for Air Inlet
- Aviation Lights
- Aviation Markings on the Blades
- Obstacle Collision Avoidance System (OCAS™)

ANNUAL ENERGY PRODUCTION

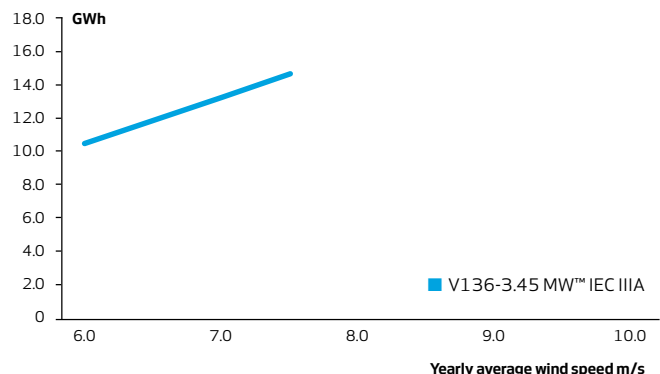

Assumptions

One wind turbine, 100% availability, 0% losses, k factor =2, Standard air density = 1.225, wind speed at hub height

Vestas Wind Systems A/S
Hedeager 42 . 8200 Aarhus N . Denmark
Tel: +45 9730 0000 . Fax: +45 9730 0001
vestas@vestas.com . vestas.com

© 2015 Vestas Wind Systems A/S. All rights reserved.

This document was created by Vestas Wind Systems A/S on behalf of the Vestas Group and contains copyrighted material, trademarks and other proprietary information. This document or parts thereof may not be reproduced, altered or copied in any form or by any means without the prior written permission of Vestas Wind Systems A/S. All specifications are for information only and are subject to change without notice. Vestas Wind Systems A/S does not make any representations or extend any warranties, expressed or implied, as to the adequacy or accuracy of this information. This document may exist in multiple language versions. In case of inconsistencies between language versions the English version shall prevail. Certain technical options, services and wind turbine models may not be available in all locations/countries.

Restricted
Document no.: 0053-3707 V01
2015-11-24

General Description

3MW Platform

Original Instruction: T05 0053-3707 VER 01



Table of contents

1	Introduction.....	5
2	General Description.....	5
3	Mechanical Design.....	6
3.1	Rotor.....	6
3.2	Blades.....	6
3.3	Blade Bearing	6
3.4	Pitch System.....	7
3.5	Hub.....	7
3.6	Main Shaft	7
3.7	Main Bearing Housing.....	8
3.8	Main Bearing.....	8
3.9	Gearbox.....	8
3.10	Generator Bearings.....	8
3.11	High-Speed Shaft Coupling.....	9
3.12	Yaw System.....	9
3.13	Crane.....	9
3.14	Towers.....	9
3.15	Nacelle Bedplate and Cover	10
3.16	Thermal Conditioning System	10
3.16.1	Generator and Converter Cooling	11
3.16.2	Gearbox and Hydraulic Cooling	11
3.16.3	Transformer Cooling	11
3.16.4	Nacelle Cooling.....	11
3.16.5	Optional Air Intake Hatches	11
4	Electrical Design.....	11
4.1	Generator	11
4.2	Converter.....	12
4.3	HV Transformer	12
4.3.1	IEC 50 Hz/60 Hz version.....	13
4.3.2	Ecodesign - IEC 50 Hz/60 Hz version	14
4.3.3	IEEE 60Hz version.....	16
4.4	HV Cables	17
4.5	HV Switchgear	18
4.5.1	IEC 50/60Hz version	20
4.5.2	IEEE 60Hz version.....	20
4.6	AUX System	21
4.7	Wind Sensors	21
4.8	Vestas Multi Processor (VMP) Controller	21
4.9	Uninterruptible Power Supply (UPS)	22
5	Turbine Protection Systems.....	23
5.1	Braking Concept	23
5.2	Short Circuit Protections	23
5.3	Overspeed Protection	23
5.4	Arc Detection	23
5.5	Smoke Detection	24
5.6	Lightning Protection of Blades, Nacelle, Hub and Tower.....	24
5.7	EMC System.....	24
5.8	Earthing	25
5.9	Corrosion Protection	25
6	Safety.....	25

6.1	Access	25
6.2	Escape.....	26
6.3	Rooms/Working Areas	26
6.4	Floors, Platforms, Standing, and Working Places	26
6.5	Service Lift.....	26
6.6	Climbing Facilities	26
6.7	Moving Parts, Guards, and Blocking Devices.....	26
6.8	Lights.....	27
6.9	Emergency Stop	27
6.10	Power Disconnection	27
6.11	Fire Protection/First Aid	27
6.12	Warning Signs	27
6.13	Manuals and Warnings	27
7	Environment.....	27
7.1	Chemicals	27
8	Design Codes.....	28
8.1	Design Codes – Structural Design	28
9	Colours	28
9.1	Nacelle Colour	28
9.2	Tower Colour	29
9.3	Blade Colour	29
10	Operational Envelope and Performance Guidelines	29
10.1	Climate and Site Conditions.....	29
10.2	Operational Envelope – Temperature	29
10.3	Operational Envelope – Grid Connection	31
10.4	Operational Envelope – Reactive Power Capability	31
10.5	Performance – Fault Ride Through.....	32
10.6	Performance – Reactive Current Contribution.....	33
10.6.1	Symmetrical Reactive Current Contribution.....	33
10.6.2	Asymmetrical Reactive Current Contribution.....	34
10.7	Performance – Multiple Voltage Dips	34
10.8	Performance – Active and Reactive Power Control.....	34
10.9	Performance – Voltage Control	35
10.10	Performance – Frequency Control	35
10.11	Main Contributors to Own Consumption.....	35
11	Drawings	36
11.1	Structural Design – Illustration of Outer Dimensions	36
11.2	Structural Design – Side View Drawing.....	36
12	General Reservations, Notes and Disclaimers	37

Recipient acknowledges that (i) this General Description is provided for recipient's information only, and, does not create or constitute a warranty, guarantee, promise, commitment, or other representation (Commitment) by Vestas Wind Systems or any of its affiliated or subsidiary companies (Vestas), all of which are disclaimed by Vestas and (ii) any and all Commitments by Vestas to recipient as to this general description (or any of the contents herein) are to be contained exclusively in signed written contracts between recipient and Vestas, and not within this document.

See general reservations, notes and disclaimers (including, section 12, p. 37) to this general description.

1 Introduction

The 3MW Platform wind turbine configurations covered by this General Description are listed below.

Turbine	Configuration
V105	V105-3.45 MW IEC IA 50/60 Hz
	V105-3.60 MW IEC IA 50/60 Hz Power Mode
V112	V112-3.45 MW IEC IA 50/60 Hz
	V112-3.60 MW IEC IA 50/60 Hz Power Mode
V117	V117-3.45 MW IEC IB 50/60 Hz
	V117-3.60 MW IEC S 50/60 Hz Power Mode
	V117-3.45 MW IEC IIA 50/60 Hz
	V117-3.60 MW IEC IIA 50/60 Hz Power Mode
V126	V126-3.45 MW IEC IIB 50/60 Hz – Low Torque
	V126-3.45 MW IEC IIIA 50/60 Hz – Low Torque
	V126-3.45 MW IEC IIA 50/60 Hz – High Torque
	V126-3.60 MW IEC IIA 50/60 Hz Power Mode – High Torque
	V126-3.45 MW IEC IIIA 50/60 Hz – High Torque
	V126-3.60 MW IEC IIIA 50/60 Hz Power Mode – High Torque
V136	V136-3.45 MW IEC IIIA 50/60 Hz

Table 1-1: 3MW Platform turbine configurations covered

2 General Description

Vestas 3MW Platform comprises a family of wind turbines sharing a common design basis. The 3MW Platform family of wind turbines includes V105-3.45 MW, V112-3.45 MW, V117-3.45 MW, V126-3.45 MW and V136-3.45 MW. These turbines are pitch regulated upwind turbines with active yaw and a three-blade rotor. The wind turbine family provides rotors with a diameter in the range 105 m to 136 m and a rated output power of 3.45 MW. A 3.6 MW Power Mode (PM) is available for all variants except V136-3.45 MW.

The wind turbine family utilises the OptiTip® concept and a power system based on an induction generator and full-scale converter. With these features, the wind turbine is able to operate the rotor at variable speed and thereby maintain the power output at or near rated power even in high wind speed. At low wind speed, the OptiTip® concept and the power system work together to maximise the power output by operating at the optimal rotor speed and pitch angle.

Operating the wind turbine with 3.6 MW Power Mode is achieved by extended derate strategy and reduced reactive power capability compared with 3.45 MW operation.

3 Mechanical Design

3.1 Rotor

The wind turbine is equipped with a rotor consisting of three blades and a hub. The blades are controlled by the microprocessor pitch control system OptiTip[®]. Based on the prevailing wind conditions, the blades are continuously positioned to optimise the pitch angle.

Rotor	V105	V112	V117	V126	V136
Diameter	105 m	112 m	117 m	126 m	136 m
Swept Area	8659 m ²	9852 m ²	10751 m ²	12469 m ²	14527 m ²
Speed, Dynamic Operation Range	8.3-17.6	8.1-17.6	6.7-17.6	5.6(7.0)-16.5	5.6-15.3
Rotational Direction	Clockwise (front view)				
Orientation	Upwind				
Tilt	6°				
Hub Coning	4°				
Number of Blades	3				
Aerodynamic Brakes	Full feathering				

Table 3-1: Rotor data

3.2 Blades

The blades are made of carbon and fibreglass and consist of two airfoil shells bonded to a supporting beam.

Blades	V105	V112	V117	V126	V136
Type Description	Airfoil shells bonded to supporting beam			Infused structural airfoil shell	
Blade Length	51.15 m	54.65 m	57.15 m	61.66 m	66.66 m
Material	Fibreglass reinforced epoxy, carbon fibres and Solid Metal Tip (SMT)				
Blade Connection	Steel roots inserted				
Airfoils	High-lift profile				
Maximum Chord	4.0 m				4.2 m

Table 3-2: Blades data

3.3 Blade Bearing

The blade bearings are double-row four-point contact ball bearings.

Blade Bearing	
Lubrication	Grease

Table 3-3: Blade bearing data

3.4 Pitch System

The turbine is equipped with a pitch system for each blade and a distributor block, all located in the hub. Each pitch system is connected to the distributor block with flexible hoses. The distributor block is connected to the pipes of the hydraulic rotating transfer unit in the hub by means of three hoses (pressure line, return line and drain line).

Each pitch system consists of a hydraulic cylinder mounted to the hub and a piston rod mounted to the blade bearing via a torque arm shaft. Valves facilitating operation of the pitch cylinder are installed on a pitch block bolted directly onto the cylinder.

Pitch System	
Type	Hydraulic
Number	1 per blade
Range	-10° to 90°

Table 3-4: Pitch system data

Hydraulic System	
Main Pump	Two redundant internal-gear oil pumps
Pressure	260 bar
Filtration	3 µm (absolute)

Table 3-5: Hydraulic system data.

3.5 Hub

The hub supports the three blades and transfers the reaction loads to the main bearing and the torque to the gearbox. The hub structure also supports blade bearings and pitch cylinders.

Hub	
Type	Cast ball shell hub
Material	Cast iron

Table 3-6: Hub data

3.6 Main Shaft

The main shaft transfers the reaction forces to the main bearing and the torque to the gearbox.

Main Shaft	
Type Description	Hollow shaft
Material	Cast iron

Table 3-7: Main shaft data

3.7 Main Bearing Housing

The main bearing housing covers the main bearing and is the first connection point for the drive train system to the bedplate.

Main Bearing Housing	
Material	Cast iron

Table 3-8: Main bearing housing data

3.8 Main Bearing

The main bearing carries all thrust loads.

Main Bearing	
Type	Double-row spherical roller bearing
Lubrication	Automatic grease lubrication

Table 3-9: Main bearing data

3.9 Gearbox

The main gear converts the low-speed rotation of the rotor to high-speed generator rotation.

The disc brake is mounted on the high-speed shaft. The gearbox lubrication system is a pressure-fed system.

Gearbox	
Type	Planetary stages + one helical stage
Gear House Material	Cast
Lubrication System	Pressure oil lubrication
Backup Lubrication System	Oil sump filled from external gravity tank
Total Gear Oil Volume	1000-1200
Oil Cleanliness Codes	ISO 4406-/15/12
Shaft Seals	Labyrinth

Table 3-10: Gearbox data

3.10 Generator Bearings

The bearings are grease lubricated and grease is supplied continuously from an automatic lubrication unit.

3.11 High-Speed Shaft Coupling

The coupling transmits the torque of the gearbox high-speed output shaft to the generator input shaft.

The coupling consists of two 4-link laminate packages and a fibreglass intermediate tube with two metal flanges. The coupling is fitted to two-armed hubs on the brake disc and the generator hub.

3.12 Yaw System

The yaw system is an active system based on a robust pre-tensioned plain yaw-bearing concept with PETP as friction material.

The yaw gears have a torque limiter.

Yaw System	
Type	Plain bearing system
Material	Forged yaw ring heat-treated. Plain bearings PETP
Yawing Speed (50 Hz)	0.45°/sec.
Yawing Speed (60 Hz)	0.55°/sec.

Table 3-11: Yaw system data

Yaw Gear	
Type	Multiple stages geared
Ratio Total	944:1
Rotational Speed at Full Load	1.4 rpm at output shaft

Table 3-12: Yaw gear data

3.13 Crane

The nacelle houses the internal safe working load (SWL) service crane. The crane is a single system hoist.

Crane	
Lifting Capacity	Maximum 800 kg

Table 3-13: Crane data

3.14 Towers

Tubular towers with flange connections, certified according to relevant type approvals, are available in different standard heights. The towers are designed with the majority of internal welded connections replaced by magnet supports to create a predominantly smooth-walled tower. Magnets provide load support in a horizontal direction and internals, such as platforms, ladders, and such like, are supported vertically (that is, in the gravitational direction) by a mechanical

connection. The smooth tower design reduces the required steel thickness, rendering the tower lighter compared to one with all internals welded to the tower shells.

Available hub heights are listed in the Performance Specification for each turbine variant. Designated hub heights include a distance from the foundation section to the ground level of approximately 0.2 m depending on the thickness of the bottom flange and a distance from tower top flange to centre of the hub of 2.2 m.

Towers	
Type	Cylindrical/conical tubular

Table 3-14: Tower structure data

3.15 Nacelle Bedplate and Cover

The nacelle cover is made of fibreglass. Hatches are positioned in the floor for lowering or hoisting equipment to the nacelle and evacuation of personnel. The roof section is equipped with wind sensors and skylights. The skylights can be opened from both inside the nacelle to access the roof and from outside to access the nacelle. Access from the tower to the nacelle is through the yaw system.

The nacelle bedplate is in two parts and consists of a cast iron front part and a girder structure rear part. The front of the nacelle bedplate is the foundation for the drive train and transmits forces from the rotor to the tower through the yaw system. The bottom surface is machined and connected to the yaw bearing and the yaw gears are bolted to the front nacelle bedplate.

The crane girders are attached to the top structure. The lower beams of the girder structure are connected at the rear end. The rear part of the bedplate serves as the foundation for controller panels, the cooling system and transformer. The nacelle cover is installed on the nacelle bedplate.

Type Description	Material
Nacelle Cover	GRP
Bedplate Front	Cast iron
Bedplate Rear	Girder structure

Table 3-15: Nacelle bedplate and cover data

3.16 Thermal Conditioning System

The thermal conditioning system consists of a few robust components:

- The Vestas CoolerTop[®] located on top of the rear end of the nacelle. The CoolerTop[®] is a free flow cooler, thus ensuring that there are no electrical components in the thermal conditioning system located outside the nacelle.
- The Liquid Cooling System, which serves the gearbox, hydraulic systems, generator and converter is driven by an electrical pumping system.
- The transformer forced air cooling comprised of an electrical fan.

3.16.1 Generator and Converter Cooling

The generator and converter cooling systems operate in parallel. A dynamic flow valve mounted in the generator cooling circuit divides the cooling liquid flow. The cooling liquid removes heat from the generator and converter unit using a free-air flow radiator placed on the top of the nacelle. In addition to the generator, converter unit and radiator, the circulation system includes an electrical pump and a three-way thermostatic valve.

3.16.2 Gearbox and Hydraulic Cooling

The gearbox and hydraulic cooling systems are coupled in parallel. A dynamic flow valve mounted in the gearbox cooling circuit divides the cooling flow. The cooling liquid removes heat from the gearbox and the hydraulic power unit through heat exchangers and a free-air flow radiator placed on the top of the nacelle. In addition to the heat exchangers and the radiator, the circulation system includes an electrical pump and a three-way thermostatic valve.

3.16.3 Transformer Cooling

The transformer is equipped with forced-air cooling. The ventilator system consists of a central fan, located below the converter and an air duct leading the air to locations beneath and between the high voltage and low voltage windings of the transformer.

3.16.4 Nacelle Cooling

Hot air generated by mechanical and electrical equipment is removed from the nacelle by a fan system located in the nacelle.

3.16.5 Optional Air Intake Hatches

Primary air intakes in the nacelle can optional be fitted with hatches which can be operated as a part of the thermal control strategy. In case of lost grid to the turbine, the hatches will automatically be closed.

4 Electrical Design

4.1 Generator

The generator is a three-phase asynchronous induction generator with cage rotor that is connected to the grid through a full-scale converter.

The generator housing allows the circulation of cooling air within the stator and rotor. The air-to-water heat exchange occurs in an external heat exchanger

Generator	
Type	Asynchronous with cage rotor
Rated Power [P_N]	3650 kW / 3800 kW
Frequency [f_N]	0-100 Hz
Voltage, Stator [U_{NS}]	3 x 750 V (at rated speed)
Number of Poles	4/6

Winding Type	Form with VPI (Vacuum Pressurized Impregnation)
Winding Connection	Star or Delta
Rated rpm	1450-1550 rpm
Overspeed Limit Acc. to IEC (2 minutes)	2400 rpm
Generator Bearing	Hybrid/ceramic
Temperature Sensors, Stator	3 PT100 sensors placed at hot spots and 3 as back-up
Temperature Sensors, Bearings	1 per bearing
Insulation Class	F or H
Enclosure	IP54

Table 4-1: Generator data

4.2 Converter

The converter is a full-scale converter system controlling both the generator and the power quality delivered to the grid.

The converter consists of 3 machine-side converter units and 3 line-side converter units operating in parallel with a common controller.

The converter controls conversion of variable frequency power from the generator into fixed frequency AC power with desired active and reactive power levels (and other grid connection parameters) suitable for the grid. The converter is located in the nacelle and has a grid side voltage rating of 650 V. The generator side voltage rating is up to 750 V dependent on generator speed.

Converter	
Rated Apparent Power [S_N]	4000 kVA
Rated Grid Voltage	650 V
Rated Generator Voltage	750 V
Rated generator Current	3550 A
Enclosure	IP54

Table 4-2: Converter data

4.3 HV Transformer

The step-up HV transformer is located in a separate locked room in the back of the nacelle.

The transformer is a three-phase, two-winding, dry-type transformer that is self-extinguishing. The windings are delta-connected on the high-voltage side unless otherwise specified.

The transformer comes in different versions depending on the market where it is intended to be installed.

- For 50 Hz regions the transformer is as default designed according to IEC standards. However on special request, a 60 Hz transformer based on IEC standards could also be delivered. Refer to Table 3-3.
- For turbines installed in Member States of the European Union, it is required to fulfil the Ecodesign regulation No 548/2014 set by the European Commission. Refer to Table 3-4.
- For 60 Hz regions the transformer is as default designed mainly according to IEEE standards but on areas not covered by IEEE standards, the design is also based on parts of the IEC standards. Refer to Table 3-5.

4.3.1 IEC 50 Hz/60 Hz version

Transformer	
Type description	Dry-type cast resin transformer.
Basic layout	3 phase, 2 winding transformer.
Applied standards	IEC 60076-11, IEC 60076-16, IEC 61936-1.
Cooling method	AF
Rated power	4000 kVA
Rated voltage, turbine side	
U _m 1.1kV	0.650 kV
Rated voltage, grid side	
U _m 12.0kV	10.0-11.0 kV
U _m 24.0kV	11.1-22.0 kV
U _m 36.0kV	22.1-33.0 kV
U _m 41.5kV	33.1-36.0 kV
Insulation level AC / LI / LIC	
U _m 1.1kV	3 ¹ / - / - kV
U _m 12.0kV	28 ¹ / 75 / 75 kV
U _m 24.0kV	50 ¹ / 125 / 125 kV
U _m 36.0kV	70 ¹ / 170 / 170 kV
U _m 41.5kV	80 ¹ / 170 / 170 kV
Off-circuit tap changer	±2 x 2.5 %
Frequency	50 Hz / 60Hz
Vector group	Dyn5 / YNyn0
No-load loss ²	>5.8 kW
Load loss @ rated power HV, 120°C ²	>30.5 kW
No-load reactive power ²	>16 kVAr
Full load reactive power ²	>345 kVAr
No-load current ²	0.5 %
Positive sequence short-circuit impedance @ rated power, 120°C ³	9.0 %
Positive sequence short-circuit resistance@ rated power, 120°C ²	0.8 %
Zero sequence short-circuit impedance@ rated power, 120°C ²	8.2 %
Zero sequence short-circuit resistance@ rated power, 120°C ²	0.7 %
Inrush peak current ²	
Dyn5	6-9 x \hat{I}_n
YNyn0	8-12 x \hat{I}_n

Transformer	
Half crest time ²	~0.7 s
Sound power level	≤ 80 dB(A)
Average temperature rise at max altitude	≤90 K
Max altitude ⁴	2000 m
Insulation class	155 (F)
Environmental class	E2
Climatic class	C2
Fire behaviour class	F1
Corrosion class	C4
Weight	≤9500 kg
Temperature monitoring	PT100 sensors in LV windings and core
Overvoltage protection	Surge arresters on HV terminals
Temporary earthing	3 x Ø20 mm earthing ball points

Table 4-3: Transformer data for IEC 50 Hz/60 Hz version

- NOTE**
- ¹ @1000m. According to IEC 60076-11, AC test voltage is altitude dependent. All values are preliminary.
- ² Based on an average of calculated values across voltages and manufacturers. All values are preliminary.
- ³ Subjected to standard IEC tolerances. All values are preliminary.
- ⁴ Transformer max altitude may be adjusted to match turbine location.

4.3.2 Ecodesign - IEC 50 Hz/60 Hz version

Transformer	
Type description	Ecodesign dry-type cast resin transformer.
Basic layout	3 phase, 2 winding transformer.
Applied standards	IEC 60076-11, IEC 60076-16, IEC 61936-1, Commission Regulation No 548/2014.
Cooling method	AF
Rated power	4000 kVA
Rated voltage, turbine side	
U _m 1.1kV	0.650 kV
Rated voltage, grid side	
U _m 12.0kV	10.0-11.0 kV
U _m 24.0kV	11.1-22.0 kV
U _m 36.0kV	22.1-33.0 kV
U _m 40.5kV	33.1-36.0 kV
Insulation level AC / LI / LIC	
U _m 1.1kV	3 ¹ / - / - kV
U _m 12.0kV	28 ¹ / 75 / 75 kV
U _m 24.0kV	50 ¹ / 125 / 125 kV
U _m 36.0kV	70 ¹ / 170 / 170 kV
U _m 40.5kV	80 ¹ / 170 / 170 kV
Off-circuit tap changer	±2 x 2.5 %

Transformer	
Frequency	50 Hz / 60 Hz
Vector group	Dyn5 / YNyn0
Peak Efficiency Index (PEI) ²	Ecodesign requirement
U _m 12.0kV	Pending
U _m 24.0kV	Pending
U _m 36.0kV	Pending
U _m 40.5kV	Pending
No-load loss ²	
U _m 12.0kV	Pending
U _m 24.0kV	Pending
U _m 36.0kV	Pending
U _m 40.5kV	Pending
Load loss @ rated power HV, 120°C ²	
U _m 12.0kV	Pending
U _m 24.0kV	Pending
U _m 36.0kV	Pending
U _m 40.5kV	Pending
No-load reactive power ³	>25 kVAr
Full load reactive power ³	>370 kVAr
No-load current ³	0.5 %
Positive sequence short-circuit impedance @ rated power, 120°C ⁴	9.0 %
Positive sequence short-circuit resistance @ rated power, 120°C ³	0.8 %
Zero sequence short-circuit impedance @ rated power, 120°C ³	8.2 %
Zero sequence short-circuit resistance @ rated power, 120°C ³	0.7 %
Inrush peak current ³	
Dyn5	6-9 x \hat{I}_n
YNyn0	8-12 x \hat{I}_n
Half crest time ³	~ 0.7 s
Sound power level	≤ 80 dB(A)
Average temperature rise at max altitude	≤90 K
Max altitude ⁵	2000 m
Insulation class	155 (F)
Environmental class	E2
Climatic class	C2
Fire behaviour class	F1
Corrosion class	C4
Weight	≤10000 kg
Temperature monitoring	PT100 sensors in LV windings and core
Overvoltage protection	Surge arresters on HV terminals
Temporary earthing	3 x Ø20 mm earthing ball points

Table 4-4: Transformer data for Ecodesign IEC 50 Hz/60 Hz version.

- NOTE** ¹ @1000m. According to IEC 60076-11, AC test voltage is altitude dependent. All values are preliminary.
- ² For Ecodesign transformers, PEI is the legal requirement and is calculated according to the Commission Regulation based on rated power, no-load and load losses. Losses are maximum values and will not simultaneously occur in a specific design as this will be incompliant with the PEI requirement. All values are preliminary.
- ³ Based on an average of calculated values across voltages and manufacturers. All values are preliminary.
- ⁴ Subjected to standard IEC tolerances. All values are preliminary.
- ⁵ Transformer max altitude may be adjusted to match turbine location.

4.3.3 IEEE 60Hz version

Transformer	
Type description	Dry-type cast resin transformer.
Basic layout	3 phase, 2 winding transformer.
Applied standards	UL 1562, CSA C22.2 No. 47, IEEE C57.12, IEC 60076-11, IEC 60076-16, IEC 61936-1.
Cooling method	AFA
Rated power	3750 kVA
Rated voltage, turbine side	
N _{LL} 1.2 kV	0.650 kV
Rated voltage, grid side	
N _{LL} 15.0 kV	10.0-15.0 kV
N _{LL} 25.0 kV	15.1-25.0 kV
N _{LL} 34.5 kV	25.1-34.5 kV
Insulation level AC / LI & LIC	
N _{LL} 1.2 kV	4 ¹ / +10 kV
N _{LL} 15.0 kV	34 ¹ / +95 kV
N _{LL} 25.0 kV	50 ¹ / +125 kV
N _{LL} 34.5 kV	70 ¹ / (+150 & -170) or +170 kV
Off-circuit tap changer	±2 x 2.5 %
Frequency	60 Hz
Vector group	Dyn5 / YNyn0
No-load loss ²	>5.8 kW
Load loss @ rated power HV, 120°C ²	>30.5 kW
No-load reactive power ²	>16 kVAr
Full load reactive power ²	>345 kVAr
No-load current ²	0.5 %
Positive sequence short-circuit impedance @ rated power, 120°C ³	9.0 %
Positive sequence short-circuit resistance @ rated power, 120°C ²	0.7 %
Zero sequence short-circuit impedance @ rated power, 120°C ²	8.3 %
Zero sequence short-circuit resistance @ rated power, 120°C ²	0.7 %
Inrush peak current ²	

Transformer	
	Dyn5
	YNyn0
	6-9 x \hat{I}_n
	8-12 x \hat{I}_n
Half crest time ²	~ 0.7 s
Sound power level	≤ 80 dB(A)
Average temperature rise at max altitude	≤ 90 K
Max altitude ⁴	2000 m
Insulation class	150°C
Environmental class	E2
Climatic class	C2
Fire behaviour class	F1
Corrosion class	C4
Weight	≤ 9500 kg
Temperature monitoring	PT100 sensors in LV windings and core
Overvoltage protection	Surge arresters on HV terminals
Temporary earthing	3 x Ø20 mm earthing ball points

Table 4-5: Transformer data for IEEE 60 Hz version

NOTE

¹ @1000m. According to IEEE C57.12, AC test voltage is altitude dependent. All values are preliminary.

² Based on an average of calculated values across voltages and manufacturers. All values are preliminary.

³ Subjected to standard IEEE C57.12 tolerances. All values are preliminary.

⁴ Transformer max altitude may be adjusted to match turbine location.

4.4 HV Cables

The high-voltage cable runs from the transformer in the nacelle down the tower to the HV switchgear located at the bottom of the tower. The high-voltage cable is a four-core, rubber-insulated, halogen-free, high-voltage cable.

HV Cables	
High-Voltage Cable Insulation Compound	Improved ethylene-propylene (EP) based material-EPR or high modulus or hard grade ethylene-propylene rubber-HEPR
Conductor Cross Section	3 x 70 / 70 mm ²
Maximum Voltage	24 kV for 10.0-22.0 kV rated voltage 42 kV for 22.1-36.0 kV rated voltage

Table 4-6: HV cables data

4.5 HV Switchgear

A gas insulated switchgear is installed in the bottom of the tower as an integrated part of the turbine. Its controls are integrated with the turbine safety system which monitors the condition of the switchgear and high voltage safety related devices in the turbine. This ensures all protection devices are fully operational whenever high voltage components in the turbine are energised. The earthing switch of the circuit breaker contains a trapped-key interlock system with its counterpart installed on the access door to the transformer room in order to avoid unauthorized access to the transformer room during live condition.

The switchgear is available in three variants with increasing features, see Table 4-7. Beside the increase in features, the switchgear can be configured depending on the number of grid cables planned to enter the individual turbine. The design of the switchgear solution is optimized such grid cables can be connected to the switchgear even before the tower is installed and still maintain its protection toward weather conditions and internal condensation due to a gas tight packing.

The switchgear is available in an IEC version and in an IEEE version. The IEEE version is however only available in the highest voltage class. The electrical parameters of the switchgear are seen in Table 4-8 for the IEC version and in Table 4-9 for the IEEE version.

HV Switchgear			
Variant	Basic	Streamline	Standard
IEC standards	○	⊙	⊙
IEEE standards	⊙	○	⊙
Vacuum circuit breaker panel	⊙	⊙	⊙
Overcurrent, short-circuit and earth fault protection	⊙	⊙	⊙
Disconnecter / earthing switch in circuit breaker panel	⊙	⊙	⊙
Voltage Presence Indicator System for circuit breaker	⊙	⊙	⊙
Voltage Presence Indicator System for grid cables	⊙	⊙	⊙
Double grid cable connection	⊙	⊙	⊙
Triple grid cable connection	⊙	○	○
Preconfigured relay settings	⊙	⊙	⊙
Turbine safety system integration	⊙	⊙	⊙
Redundant trip coil circuits	⊙	⊙	⊙
Trip coil supervision	⊙	⊙	⊙
Pendant remote control from outside of tower	⊙	⊙	⊙
Sequential energisation	⊙	⊙	⊙
Reclose blocking function	⊙	⊙	⊙
Heating elements	⊙	⊙	⊙
Trapped-key interlock system for circuit breaker panel	⊙	⊙	⊙
UPS power back-up for protection circuits	⊙	⊙	⊙
Motor operation of circuit breaker	⊙	⊙	⊙
Cable panel for grid cables (configurable)	○	⊙	⊙
Switch disconnector panels for grid cables – max three panels (configurable)	○	⊙	⊙
Earthing switch for grid cables	○	⊙	⊙
Internal arc classification	○	⊙	⊙
Supervision on MCB's	○	⊙	⊙
Motor operation of switch disconnector	○	○	⊙
SCADA ready	○	○	⊙
SCADA operation of circuit breaker	○	○	⊙
SCADA operation of switch disconnector	○	○	⊙

Table 4-7: HV switchgear variants and features.

4.5.1 IEC 50/60Hz version

HV Switchgear	
Type description	Gas Insulated Switchgear
Applied standards	IEC 62271-103 IEC 62271-1, 62271-100, 62271-102, 62271-200, IEC 60694
Insulation medium	SF ₆
Rated voltage	
U _r 24.0kV	10.0-22.0 kV
U _r 36.0kV	22.1-33.0 kV
U _r 40.5kV	33.1-36.0 kV
Rated insulation level AC // LI Common value / across isolation distance	
U _r 24.0kV	50 / 60 // 125 / 145 kV
U _r 36.0kV	70 / 80 // 170 / 195 kV
U _r 40.5kV	85 / 90 // 185 / 215 kV
Rated frequency	50 Hz / 60 Hz
Rated normal current	630 A
Rated Short-time withstand current	
U _r 24.0kV	20 kA
U _r 36.0kV	25 kA
U _r 40.5kV	25 kA
Rated peak withstand current 50 / 60 Hz	
U _r 24.0kV	50 / 52 kA
U _r 36.0kV	62.5 / 65 kA
U _r 40.5kV	62.5 / 65 kA
Rated duration of short-circuit	1 s
Internal arc classification (option)	
U _r 24.0kV	IAC A FLR 20 kA, 1 s
U _r 36.0kV	IAC A FLR 25 kA, 1 s
U _r 40.5kV	IAC A FLR 25 kA, 1 s
Connection interface	Outside cone plug-in bushings, IEC interface C1.
Loss of service continuity category	LSC2
Ingress protection	
Gas tank	IP 65
Enclosure	IP 2X
LV cabinet	IP 3X
Corrosion class	C3

Table 4-8: HV switchgear data for IEC version.

4.5.2 IEEE 60Hz version

HV Switchgear	
Type description	Gas Insulated Switchgear
Applied standards	IEEE 37.20.3, IEEE C37.20.4, IEC 62271-200, ISO 12944.
Insulation medium	SF ₆
Rated voltage	
U _r 38.0kV	22.1-36.0 kV

HV Switchgear	
Rated insulation level AC / LI	70 / 150 kV
Rated frequency	60 Hz
Rated normal current	600 A
Rated Short-time withstand current	25 kA
Rated peak withstand current	65 kA
Rated duration of short-circuit	1 s
Internal arc classification (option)	IAC A FLR 25 kA, 1 s
Connection interface grid cables	Outside cone plug-in bushings, IEEE 386 interface type deadbreak, 600A.
Ingress protection	
Gas tank	NEMA 4X / IP 65
Enclosure	NEMA 2 / IP 2X
LV cabinet	NEMA 2 / IP 3X
Corrosion class	C3

Table 4-9: HV switchgear data for IEEE version.

4.6 AUX System

The AUX system is supplied from a separate 650/400 V transformer located in the nacelle. All motors, pumps, fans and heaters are supplied from this system.

All 230 V consumers are supplied from a 400/230 V transformer located in the tower base.

Power Sockets	
Single Phase (Nacelle and Tower Platforms)	230 V (16 A)/110 V (16 A)/ 2 x 55 V (16 A)
Three Phase (Nacelle and Tower Base)	3 x 400 V (16 A)

Table 4-10: AUX system data

4.7 Wind Sensors

The turbine is either equipped with two ultrasonic wind sensors or optional one ultrasonic wind sensor and one mechanical wind vane and anemometer. The sensors have built-in heaters to minimise interference from ice and snow. The wind sensors are redundant, and the turbine is able to operate with one sensor only.

4.8 Vestas Multi Processor (VMP) Controller

The turbine is controlled and monitored by the System 8000 control system.

System 8000 is a multiprocessor control system comprised of main controller, distributed control nodes, distributed IO nodes and ethernet switches and other network equipment. The main controller is placed in the tower bottom of the turbine. It runs the control algorithms of the turbine, as well as all IO communication.

The communications network is a time triggered Ethernet network (TTEthernet).

The System 8000 control system serves the following main functions:

- Monitoring and supervision of overall operation.
- Synchronizing of the generator to the grid during connection sequence.
- Operating the wind turbine during various fault situations.
- Automatic yawing of the nacelle.
- OptiTip® - blade pitch control.
- Reactive power control and variable speed operation.
- Noise emission control.
- Monitoring of ambient conditions.
- Monitoring of the grid.
- Monitoring of the smoke detection system.

4.9 Uninterruptible Power Supply (UPS)

During grid outage, an UPS system will ensure power supply for specific components.

The UPS system is built by 3 subsystems:

1. 230V AC UPS for all power backup to nacelle and hub control systems
2. 24V DC UPS for power backup to tower base control systems and optional SCADA Power Plant Controller.
3. 230V AC UPS for power backup to internal lights in tower and nacelle.
Internal light in the hub is fed from built-in batteries in the light armature.

UPS		
Backup Time	Standard	Optional
Control System* (230V AC and 24V DC UPS)	15 min	Up to 400 min**
Internal Lights (230V AC UPS)	30 min	60 min***
Optional SCADA Power Plant Controller (24V DC UPS)	N/A	48 hours****

Table 4-11: UPS data

*The control system includes: the turbine controller (VMP6000), HV switchgear functions, and remote control system.

**Requires upgrade of the 230V UPS for control system with extra batteries.

***Requires upgrade of the 230V UPS for internal light with extra batteries.

****Requires upgrade of the 24V DC UPS with extra batteries.

NOTE For alternative backup times, consult Vestas.

5 Turbine Protection Systems

5.1 Braking Concept

The main brake on the turbine is aerodynamic. Stopping the turbine is done by full feathering the three blades (individually turning each blade). Each blade has a hydraulic accumulator to supply power for turning the blade.

In addition, there is a mechanical disc brake on the high-speed shaft of the gearbox with a dedicated hydraulic system. The mechanical brake is only used as a parking brake and when activating the emergency stop buttons.

5.2 Short Circuit Protections

Breakers	Breaker for Aux. Power. (not settled)	Breaker for Converter Modules (not settled)
Breaking Capacity, Icu, Ics	TBD	TBD
Making Capacity, Icm	TBD	TBD

Table 5-1: Short circuit protection data

5.3 Overspeed Protection

The generator rpm and the main shaft rpm are registered by inductive sensors and calculated by the wind turbine controller to protect against overspeed and rotating errors.

In addition, the turbine is equipped with a safety PLC, an independent computer module that measures the rotor rpm. In case of an overspeed situation, the safety PLC activates the emergency feathered position (full feathering) of the three blades independently of the turbine controller.

Overspeed Protection	
Sensors Type	Inductive
Trip Level (variant dependent)	15.3-17.6 rpm / 2000 (generator rpm)

Table 5-3: Overspeed protection data

5.4 Arc Detection

The turbine is equipped with an Arc Detection system including multiple optical arc detection sensors placed in the HV transformer compartment and the grid

interface cabinet. The Arc Detection system is connected to the turbine safety system ensuring immediate opening of the HV switchgear if an arc is detected.

5.5 Smoke Detection

The turbine is equipped with a Smoke Detection system including multiple smoke detection sensors placed in the nacelle (above the disc brake), in the transformer compartment, in main electrical cabinets in the nacelle and above the HV switchgear in the tower base. The Smoke Detection system is connected to the turbine safety system ensuring immediate opening of the HV switchgear if smoke is detected.

5.6 Lightning Protection of Blades, Nacelle, Hub and Tower

The Lightning Protection System (LPS) helps protect the wind turbine against the physical damage caused by lightning strikes. The LPS consists of five main parts:

- Lightning receptors.
- Down conducting system (a system to conduct the lightning current down through the wind turbine to help avoid or minimise damage to the LPS itself or other parts of the wind turbine).
- Protection against overvoltage and overcurrent.
- Shielding against magnetic and electrical fields.
- Earthing system.

Lightning Protection Design Parameters			Protection Level I
Current Peak Value	i_{\max}	[kA]	200
Impulse Charge	Q_{impulse}	[C]	100
Long Duration Charge	Q_{long}	[C]	200
Total Charge	Q_{total}	[C]	300
Specific Energy	W/R	[MJ/Ω]	10
Average Steepness	di/dt	[kA/μs]	200

Table 5-4: Lightning protection design parameters

NOTE The Lightning Protection System is designed according to IEC standards (see section 8 Design Codes, p. 28).

5.7 EMC System

The turbine and related equipment fulfils the EU Electromagnetic Compatibility (EMC) legislation:

- DIRECTIVE 2004/108/EC OF THE EUROPEAN PARLIAMENT AND OF THE COUNCIL of 15 December 2004 on the approximation of the laws of the Member States relating to electromagnetic compatibility and repealing Directive 89/336/EEC.

5.8 Earthing

The Vestas Earthing System consists of a number of individual earthing electrodes interconnected as one joint earthing system.

The Vestas Earthing System includes the TN-system and the Lightning Protection System for each wind turbine. It works as an earthing system for the medium voltage distribution system within the wind farm.

The Vestas Earthing System is adapted for the different types of turbine foundations. A separate set of documents describe the earthing system in detail, depending on the type of foundation.

In terms of lightning protection of the wind turbine, Vestas has no separate requirements for a certain minimum resistance to remote earth (measured in ohms) for this system. The earthing for the lightning protection system is based on the design and construction of the Vestas Earthing System.

A primary part of the Vestas Earthing System is the main earth bonding bar placed where all cables enter the wind turbine. All earthing electrodes are connected to this main earth bonding bar. Additionally, equipotential connections are made to all cables entering or leaving the wind turbine.

Requirements in the Vestas Earthing System specifications and work descriptions are minimum requirements from Vestas and IEC. Local and national requirements, as well as project requirements, may require additional measures.

5.9 Corrosion Protection

Classification of corrosion protection is according to ISO 12944-2.

Corrosion Protection	External Areas	Internal Areas
Nacelle	C5-M	C3
Hub	C5-M	C3
Tower	C5-I	C3

Table 5-5: Corrosion protection data for nacelle, hub, and tower

6 Safety

The safety specifications in this section provide limited general information about the safety features of the turbine and are not a substitute for Buyer and its agents taking all appropriate safety precautions, including but not limited to (a) complying with all applicable safety, operation, maintenance, and service agreements, instructions, and requirements, (b) complying with all safety-related laws, regulations, and ordinances, and (c) conducting all appropriate safety training and education.

6.1 Access

Access to the turbine from the outside is through a door located at the entrance platform approximately 3 meter above ground level. The door is equipped with a lock. Access to the top platform in the tower is by a ladder or service lift. Access to the nacelle from the top platform is by ladder. Access to the transformer room

in the nacelle is controlled with a lock. Unauthorised access to electrical switchboards and power panels in the turbine is prohibited according to IEC 60204-1 2006.

6.2 Escape

In addition to the normal access routes, alternative escape routes from the nacelle are through the crane hatch, from the spinner by opening the nose cone, or from the roof of the nacelle. Rescue equipment is placed in the nacelle.

The hatch in the roof can be opened from both the inside and outside.

Escape from the service lift is by ladder.

An emergency response plan, placed in the turbine, describes evacuation and escape routes.

6.3 Rooms/Working Areas

The tower and nacelle are equipped with power sockets for electrical tools for service and maintenance of the turbine.

6.4 Floors, Platforms, Standing, and Working Places

All floors have anti-slip surfaces.

There is one floor per tower section.

Rest platforms are provided at intervals of 9 metres along the tower ladder between platforms.

Foot supports are placed in the turbine for maintenance and service purposes.

6.5 Service Lift

The turbine is delivered with a service lift installed as an option.

6.6 Climbing Facilities

A ladder with a fall arrest system (rigid rail) is installed through the tower.

There are anchor points in the tower, nacelle and hub, and on the roof for attaching fall arrest equipment (full-body harness).

Over the crane hatch there is an anchor point for the emergency descent equipment.

Anchor points are coloured yellow and are calculated and tested to 22.2 kN.

6.7 Moving Parts, Guards, and Blocking Devices

All moving parts in the nacelle are shielded.

The turbine is equipped with a rotor lock to block the rotor and drive train.

Blocking the pitch of the cylinder can be done with mechanical tools in the hub.

6.8 Lights

The turbine is equipped with lights in the tower, nacelle, transformer room, and hub.

There is emergency light in case of the loss of electrical power.

6.9 Emergency Stop

There are emergency stop buttons in the nacelle, hub and bottom of the tower.

6.10 Power Disconnection

The turbine is equipped with breakers to allow for disconnection from all power sources during inspection or maintenance. The switches are marked with signs and are located in the nacelle and bottom of the tower.

6.11 Fire Protection/First Aid

A handheld 5-6 kg CO₂ fire extinguisher, first aid kit and fire blanket are required to be located in the nacelle during service and maintenance.

- A handheld 5-6 kg CO₂ fire extinguisher is required only during service and maintenance activities, unless a permanently mounted fire extinguisher located in the nacelle is mandatorily required by authorities.
- First aid kits are required only during service and maintenance activities.
- Fire blankets are required only during non-electrical hot work activities.

6.12 Warning Signs

Warning signs placed inside or on the turbine must be reviewed before operating or servicing the turbine.

6.13 Manuals and Warnings

The Vestas Corporate OH&S Manual and manuals for operation, maintenance and service of the turbine provide additional safety rules and information for operating, servicing or maintaining the turbine.

7 Environment

7.1 Chemicals

Chemicals used in the turbine are evaluated according to the Vestas Wind Systems A/S Environmental System certified according to ISO 14001:2004. The following chemicals are used in the turbine:

- Anti-freeze to help prevent the cooling system from freezing.
- Gear oil for lubricating the gearbox.
- Hydraulic oil to pitch the blades and operate the brake.
- Grease to lubricate bearings.
- Various cleaning agents and chemicals for maintenance of the turbine.

8 Design Codes

8.1 Design Codes – Structural Design

The turbine design has been developed and tested with regard to, but not limited to, the following main standards:

Design Codes	
Nacelle and Hub	IEC 61400-1 Edition 3 EN 50308
Tower	IEC 61400-1 Edition 3 Eurocode 3
Blades	DNV-OS-J102 IEC 1024-1 IEC 60721-2-4 IEC 61400 (Part 1, 12 and 23) IEC WT 01 IEC DEFU R25 ISO 2813 DS/EN ISO 12944-2
Gearbox	ISO 81400-4
Generator	IEC 60034
Transformer	IEC 60076-11, IEC 60076-16, CENELEC HD637 S1
Lightning Protection	IEC 62305-1: 2006 IEC 62305-3: 2006 IEC 62305-4: 2006 IEC 61400-24:2010
Rotating Electrical Machines	IEC 34
Safety of Machinery, Safety-related Parts of Control Systems	IEC 13849-1
Safety of Machinery – Electrical Equipment of Machines	IEC 60204-1

Table 8-1: Design codes

9 Colours

9.1 Nacelle Colour

Colour of Vestas Nacelles	
Standard Nacelle Colour	RAL 7035 (light grey)

Colour of Vestas Nacelles	
Standard Logo	Vestas

Table 9-1: Colour, nacelle

9.2 Tower Colour

Colour of Vestas Tower Section		
	External:	Internal:
Standard Tower Colour	RAL 7035 (light grey)	RAL 9001 (cream white)

Table 9-2: Colour, tower

9.3 Blade Colour

Blade Colour	
Standard Blade Colour	RAL 7035 (light grey)
Tip-End Colour Variants	RAL 2009 (traffic orange), RAL 3020 (traffic red)
Gloss	< 30% DS/EN ISO 2813

Table 9-3: Colour, blades

10 Operational Envelope and Performance Guidelines

Actual climate and site conditions have many variables and should be considered in evaluating actual turbine performance. The design and operating parameters set forth in this section do not constitute warranties, guarantees, or representations as to turbine performance at actual sites.

10.1 Climate and Site Conditions

Values refer to hub height:

Extreme Design Parameters	
Wind Climate	All
Ambient Temperature Interval (Standard Temperature Turbine)	-40° to +50°C

Table 10-1: Extreme design parameters

10.2 Operational Envelope – Temperature

Values refer to hub height and are determined by the sensors and control system of the turbine.

Operational Envelope – Temperature	
Ambient Temperature Interval (Standard Turbine)	-20° to +45°C
Ambient Temperature Interval (Low Temperature Turbine)	-30° to +45°C

Table 10-2: Operational envelope - temperature

NOTE At ambient temperatures above +30°C, the turbine will maintain derated production, within the component capacity as seen in figure 9-1. For 3.6 MW Power Mode, derated production will start from +20°C.

The wind turbine will stop producing power at ambient temperatures above 45°C.

For the low temperature options of the wind turbine, consult Vestas.

Power derating as a function of ambient temperature (0-1000 m.a.s.l.)

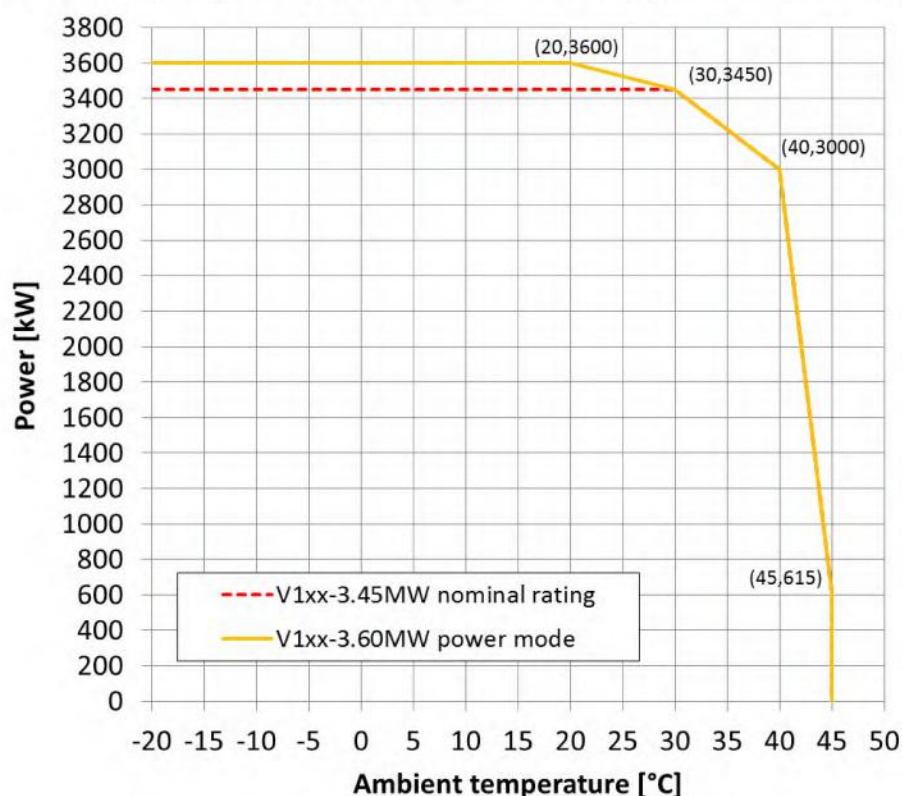


Figure 9-1: Derated operation for 3.45 MW rating and 3.6 MW Power Mode

10.3 Operational Envelope – Grid Connection

Operational Envelope – Grid Connection		
Nominal Phase Voltage	[U _{NP}]	650 V
Nominal Frequency	[f _N]	50/60 Hz
Maximum Frequency Gradient	±4 Hz/sec.	
Maximum Negative Sequence Voltage	3% (connection) 2% (operation)	
Minimum Required Short Circuit Ratio at Turbine HV Connection	5.0	
Maximum Short Circuit Current Contribution	1.05 p.u. (continuous) 1.45 p.u. (peak)	

Table 10-3: Operational envelope – grid connection

The generator and the converter will be disconnected if*:

Protection Settings	
Voltage Above 110% ^{**} of Nominal for 3600 Seconds	715 V
Voltage Above 121% of Nominal for 2 Seconds	787 V
Voltage Above 136% of Nominal for 0.150 Seconds	884 V
Voltage Below 90% ^{**} of Nominal for 60 Seconds	585 V
Voltage Below 80% of Nominal for 10 Seconds	520 V
Frequency is Above 106% of Nominal for 0.2 Seconds	53/63.6 Hz
Frequency is Below 94% of Nominal for 0.2 Seconds	47/56.4 Hz

Table 10-4: Generator and converter disconnecting values

NOTE

* Over the turbine lifetime, grid drop-outs are to occur at an average of no more than 50 times a year.

** The turbine may be configured for continuous operation @ +/- 13 % voltage. Reactive power capability is limited for these widened settings (See section 9.4).

10.4 Operational Envelope – Reactive Power Capability

The 3.45 MW turbine has a reactive power capability on the low voltage side of the HV transformer as illustrated in Figure 9-4.:

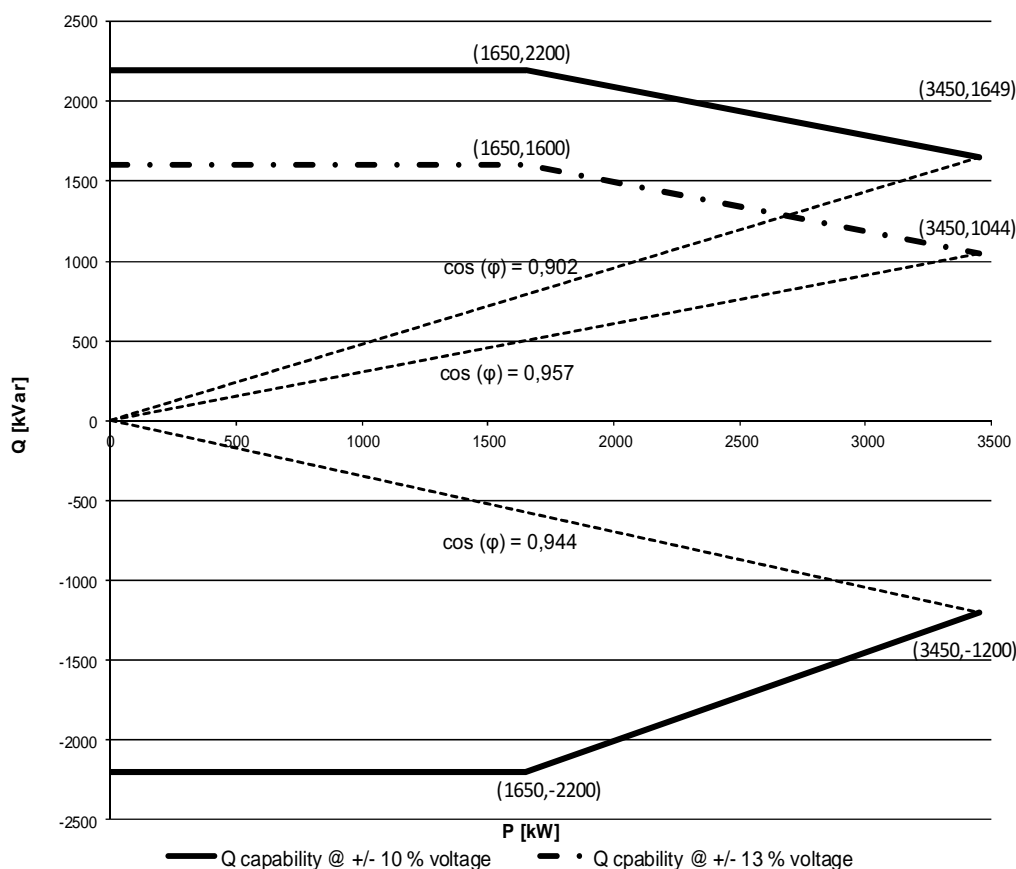


Figure 10-4: Reactive power capability for 3.45 MW rating

Reactive power capability at full load on high voltage side of the HV transformer is approximately: $\cos\phi = 0.93/0.92$ capacitive/inductive @ +/- 10 % voltage and 0.98/0.92 capacitive/inductive @ +/- 13 % voltage.

Reactive power is produced by the full-scale converter. Traditional capacitors are, therefore, not used in the turbine.

The turbine is able to maintain the reactive power capability at low wind with no active power production.

The reactive power capability for 3.6 MW Power Mode is pending finalization.

10.5 Performance – Fault Ride Through

The turbine is equipped with a full-scale converter to gain better control of the wind turbine during grid faults. The turbine control system continues to run during grid faults.

The turbine is designed to stay connected during grid disturbances within the voltage tolerance curve as illustrated:

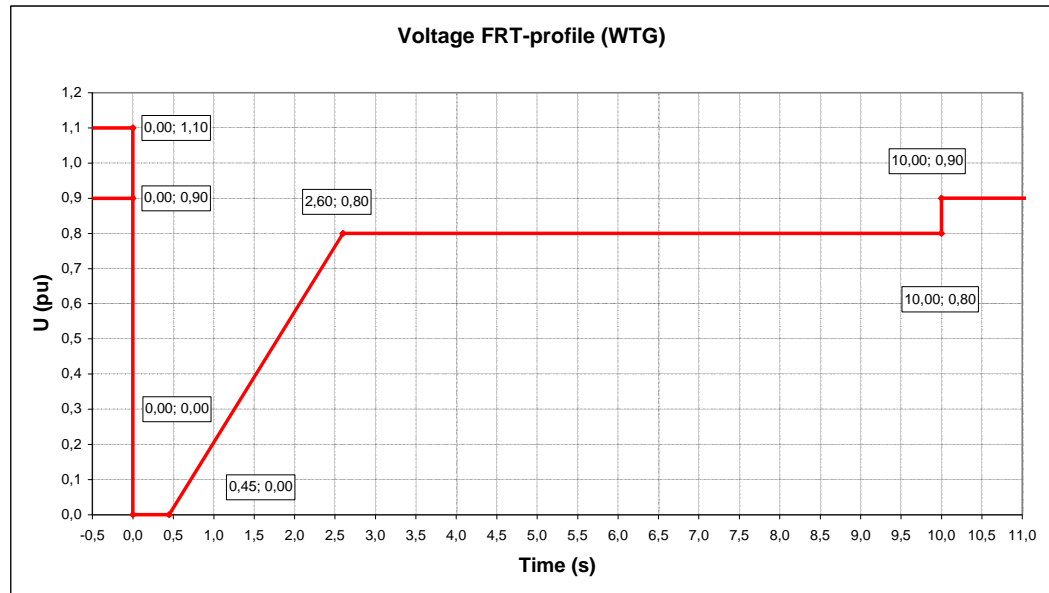


Figure 10-5: Low voltage tolerance curve for symmetrical and asymmetrical faults, where U represents voltage as measured on the grid

For grid disturbances outside the tolerance curve in Figure 10-5, the turbine will be disconnected from the grid.

Power Recovery Time	
Power Recovery to 90% of Pre-Fault Level	Maximum 0.1 seconds

Table 10-5: Power recovery time

10.6 Performance – Reactive Current Contribution

The reactive current contribution depends on whether the fault applied to the turbine is symmetrical or asymmetrical.

10.6.1 Symmetrical Reactive Current Contribution

During symmetrical voltage dips, the wind farm will inject reactive current to support the grid voltage. The reactive current injected is a function of the measured grid voltage.

The default value gives a reactive current part of 1 pu of the rated active current at the high voltage side of the HV transformer. Figure 10-6, indicates the reactive current contribution as a function of the voltage. The reactive current contribution is independent from the actual wind conditions and pre-fault power level.

As seen in Figure 10-5, the default current injection slope is 2% reactive current increase per 1% voltage decrease. The slope can be parameterized between 0 and 10 to adapt to site specific requirements.

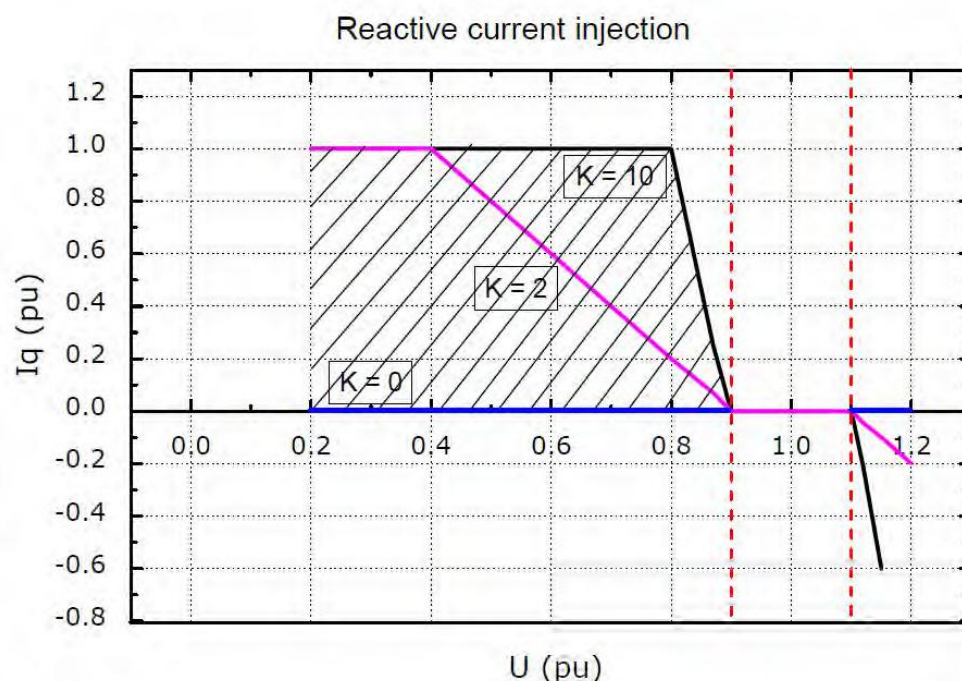


Figure 10-6: Reactive current injection

10.6.2 Asymmetrical Reactive Current Contribution

The injected current is based on the measured positive sequence voltage and the used K-factor. During asymmetrical voltage dips, the reactive current injection is limited to approximate 0.4 pu to limit the potential voltage increase on the healthy phases.

10.7 Performance – Multiple Voltage Dips

The turbine is designed to handle re-closure events and multiple voltage dips within a short period of time due to the fact that voltage dips are not evenly distributed during the year. For example, the turbine is designed to handle 10 voltage dips of duration of 200 ms, down to 20% voltage, within 30 minutes.

10.8 Performance – Active and Reactive Power Control

The turbine is designed for control of active and reactive power via the VestasOnline® SCADA system.

Maximum Ramp Rates for External Control	
Active Power	0.1 pu/sec (345 kW/s) for max. power level change of 0.3 pu (1035 kW)
	0.3 pu/sec (1035 kW/s) for max. power level change of 0.1 pu (345 kW)
Reactive Power	20 pu/sec

Table 10-6: Active/reactive power ramp rates (values are preliminary)

To support grid stability the turbine is capable to stay connected to the grid at active power references down to 10 % of nominal power for the turbine. For active power references below 10 % the turbine may disconnect from the grid.

10.9 Performance – Voltage Control

The turbine is designed for integration with VestasOnline® voltage control by utilising the turbine reactive power capability.

10.10 Performance – Frequency Control

The turbine can be configured to perform frequency control by decreasing the output power as a linear function of the grid frequency (over frequency).

Dead band and slope for the frequency control function are configurable.

10.11 Main Contributors to Own Consumption

The consumption of electrical power by the wind turbine is defined as the power used by the wind turbine when it is not providing energy to the grid. This is defined in the control system as Production Generator 0 (zero). The following components have the largest influence on the own consumption of the wind turbine (the average own consumption depends on the actual conditions, the climate, the wind turbine output, the cut-off hours, etc.):

Main contributors to Own Consumption	
Hydraulic Motor	2 x 15 kW (master/slave)
Yaw Motors	Maximum 18 kW in total
Water Heating	10 kW
Water Pumps	2.2 + 5.5 kW
Oil Heating	7.9 kW
Oil Pump for Gearbox Lubrication	10 kW
Controller Including Heating Elements for the Hydraulics and all Controllers	Approximately 3 kW
HV Transformer No-load Loss	See section 4.3 HV Transformer, p. 13

Table 10-7: Main contributors to own consumption data (values are preliminary)

11 Drawings

11.1 Structural Design – Illustration of Outer Dimensions

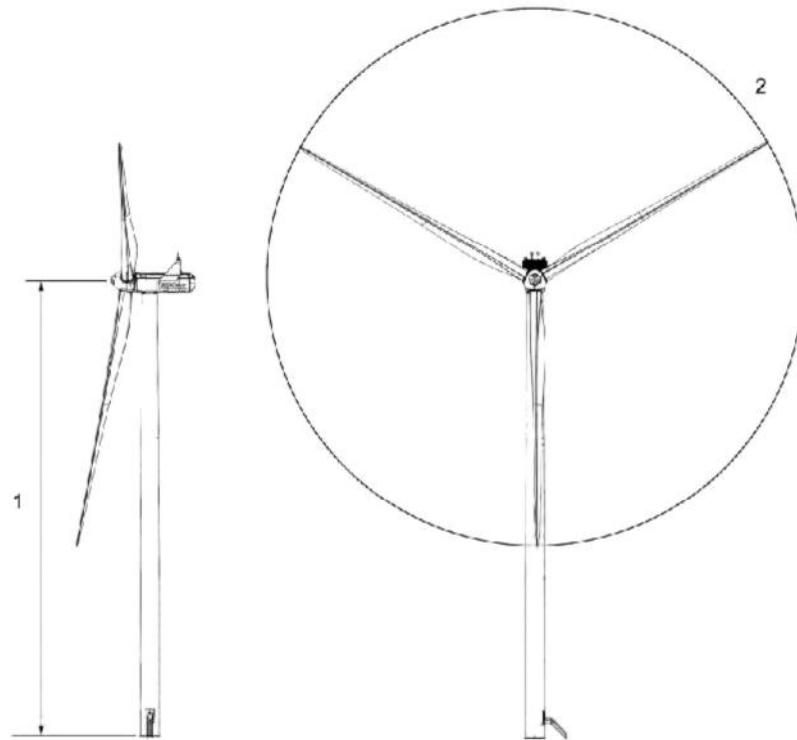


Figure 11-1: Illustration of outer dimensions – structure

- | | |
|--|---|
| <p>1 Hub heights: See Performance Specification</p> | <p>2 Rotor diameter: 105-136 m</p> |
|--|---|

11.2 Structural Design – Side View Drawing

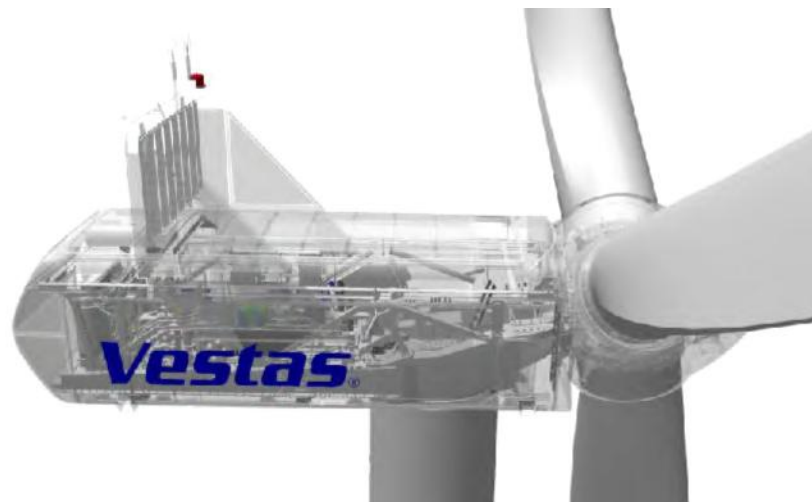


Figure 11-2: Side-view drawing

12 General Reservations, Notes and Disclaimers

- © 2015 Vestas Wind Systems A/S. This document is created by Vestas Wind Systems A/S and/or its affiliates and contains copyrighted material, trademarks, and other proprietary information. All rights reserved. No part of the document may be reproduced or copied in any form or by any means – such as graphic, electronic, or mechanical, including photocopying, taping, or information storage and retrieval systems – without the prior written permission of Vestas Wind Systems A/S. The use of this document is prohibited unless specifically permitted by Vestas Wind Systems A/S. Trademarks, copyright or other notices may not be altered or removed from the document.
- The general descriptions in this document apply to the current version of the 3MW Platform wind turbines. Updated versions of the 3MW Platform wind turbines, which may be manufactured in the future, may differ from this general description. In the event that Vestas supplies an updated version of a specific 3MW Platform wind turbine, Vestas will provide an updated general description applicable to the updated version.
- Vestas recommends that the grid be as close to nominal as possible with limited variation in frequency and voltage.
- A certain time allowance for turbine warm-up must be expected following grid dropout and/or periods of very low ambient temperature.
- All listed start/stop parameters (e. g. wind speeds and temperatures) are equipped with hysteresis control. This can, in certain borderline situations, result in turbine stops even though the ambient conditions are within the listed operation parameters.
- The earthing system must comply with the minimum requirements from Vestas, and be in accordance with local and national requirements and codes of standards.
- This document, General Description, is not an offer for sale, and does not contain any guarantee, warranty and/or verification of the power curve and noise (including, without limitation, the power curve and noise verification method). Any guarantee, warranty and/or verification of the power curve and noise (including, without limitation, the power curve and noise verification method) must be agreed to separately in writing.

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

2/18/2016 1:19:21 PM

in

Case No(s). 16-0343-EL-BGA

Summary: Application of Trishe Wind Ohio, LLC for an Amendment to its Certificate of Environmental Compatibility and Public Need - Part 3 - Supplemental Appendix E Continued electronically filed by Teresa Orahod on behalf of Sally Bloomfield