



Z:\W-1896 Amlin-Cole 138kV\GIS\mxd\1896 Amlin_Cole_FW.mxd LS (4/7/2016 - office) - LP-4/4/2016 1:12:12 PM - LExported-4/7/2016 11:38:28 AM

Sheet#1

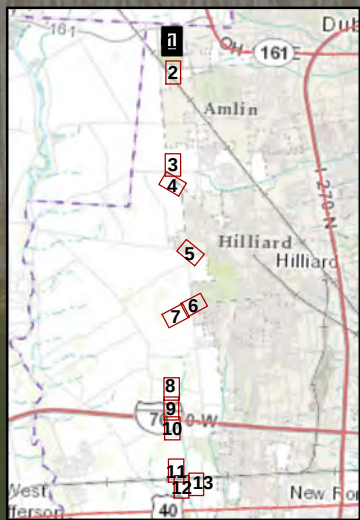

- Legend**
- Work Areas
 - Disturbed
 - Sheet Matchline
 - Existing Structure
 - Photo Location

Newly Constructed
Amlin
Substation

14-1

20

Fishel Dr

Fishel Dr S

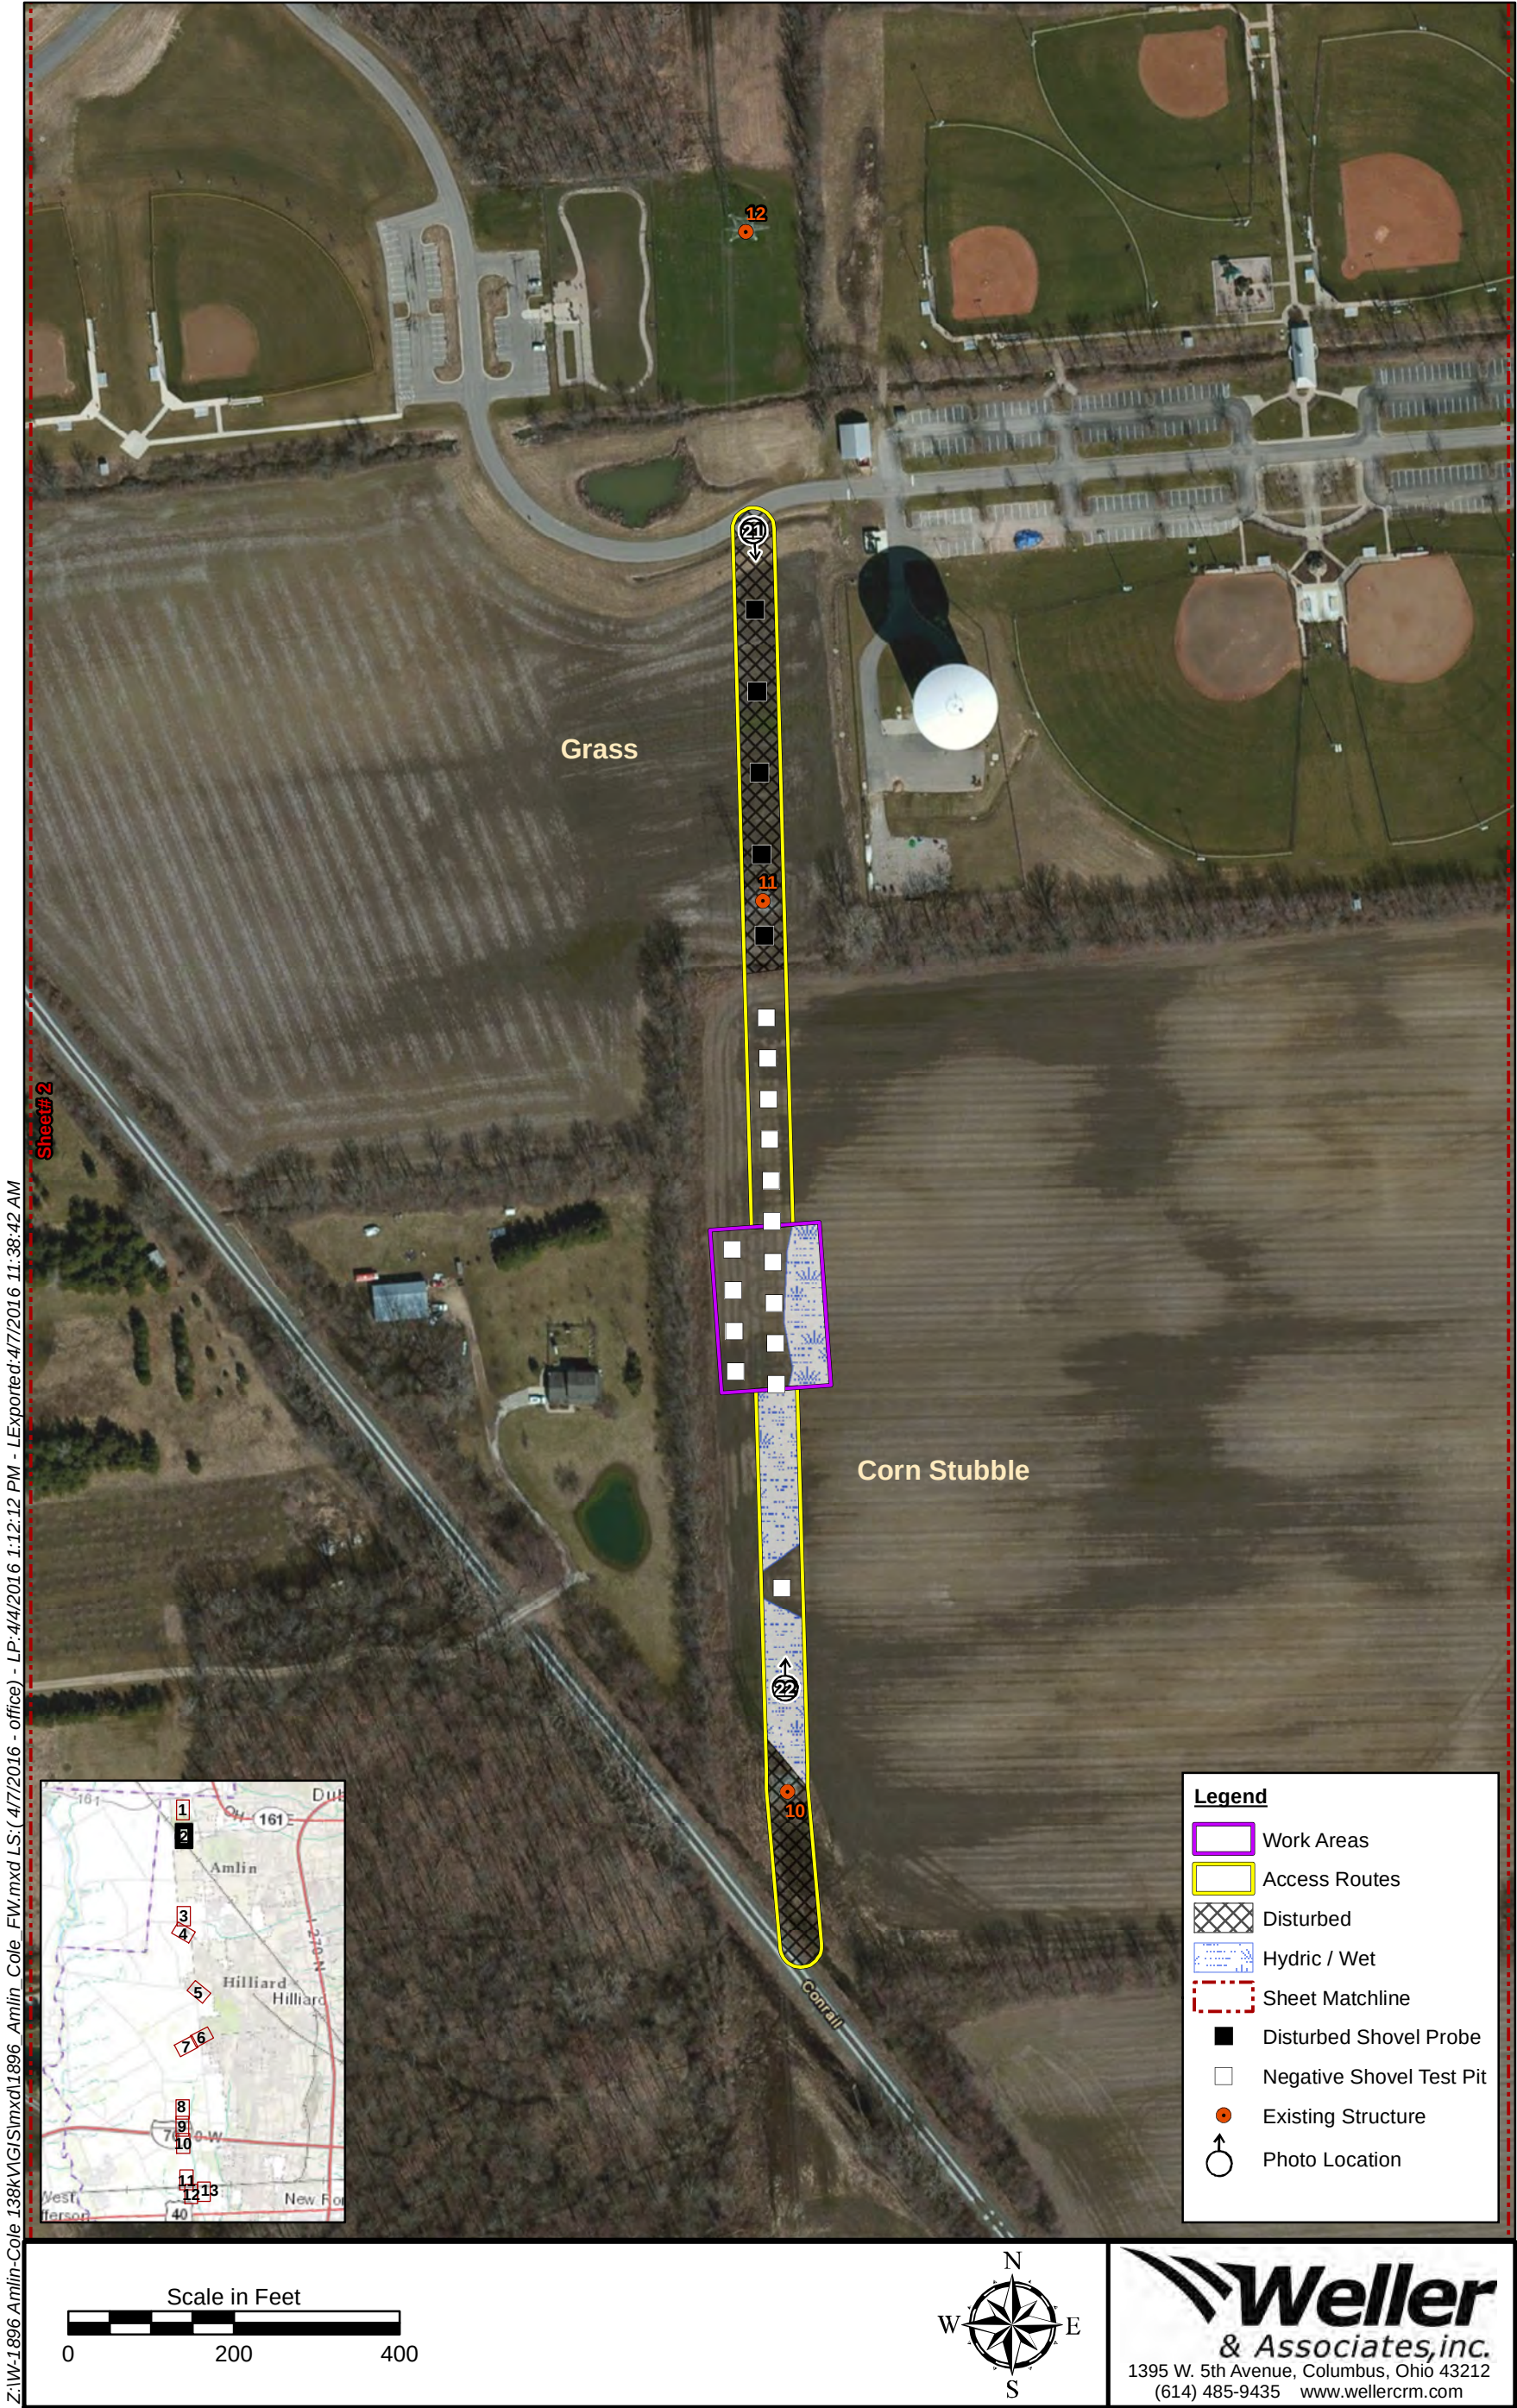


Figure 8. Fieldwork results & photo orientation for Sheet 2.

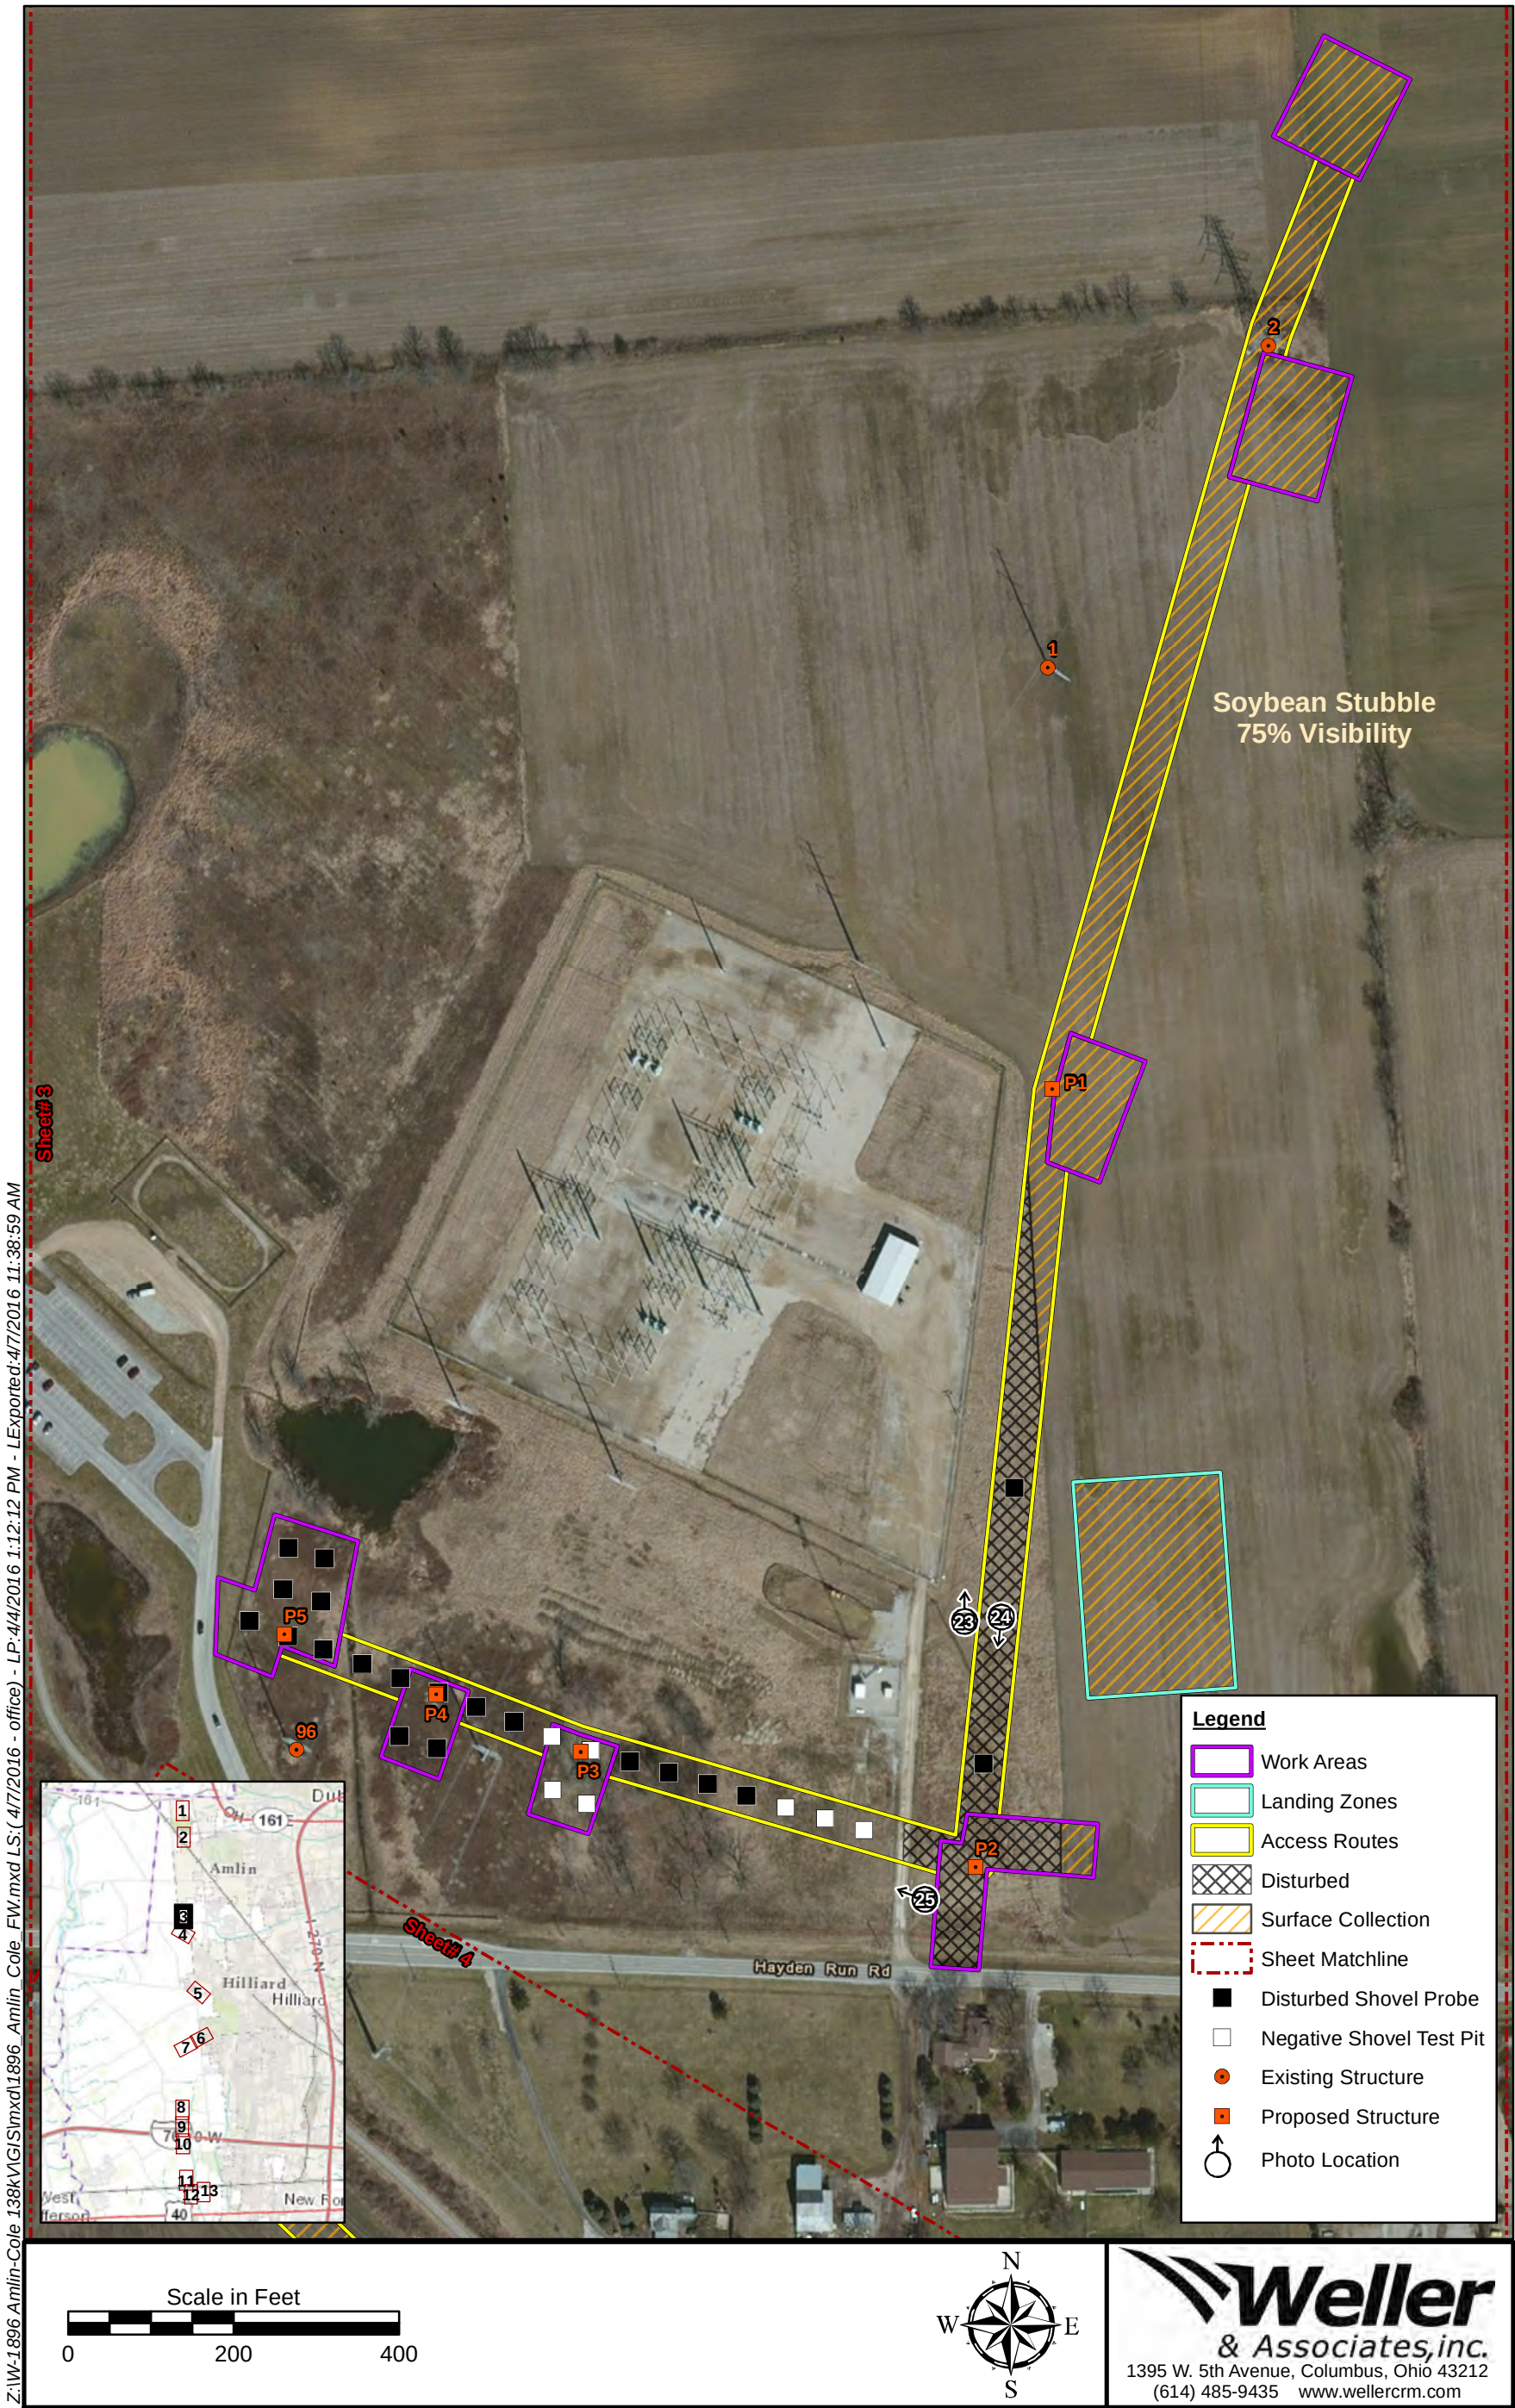


Figure 9. Fieldwork results & photo orientation for Sheet 3.

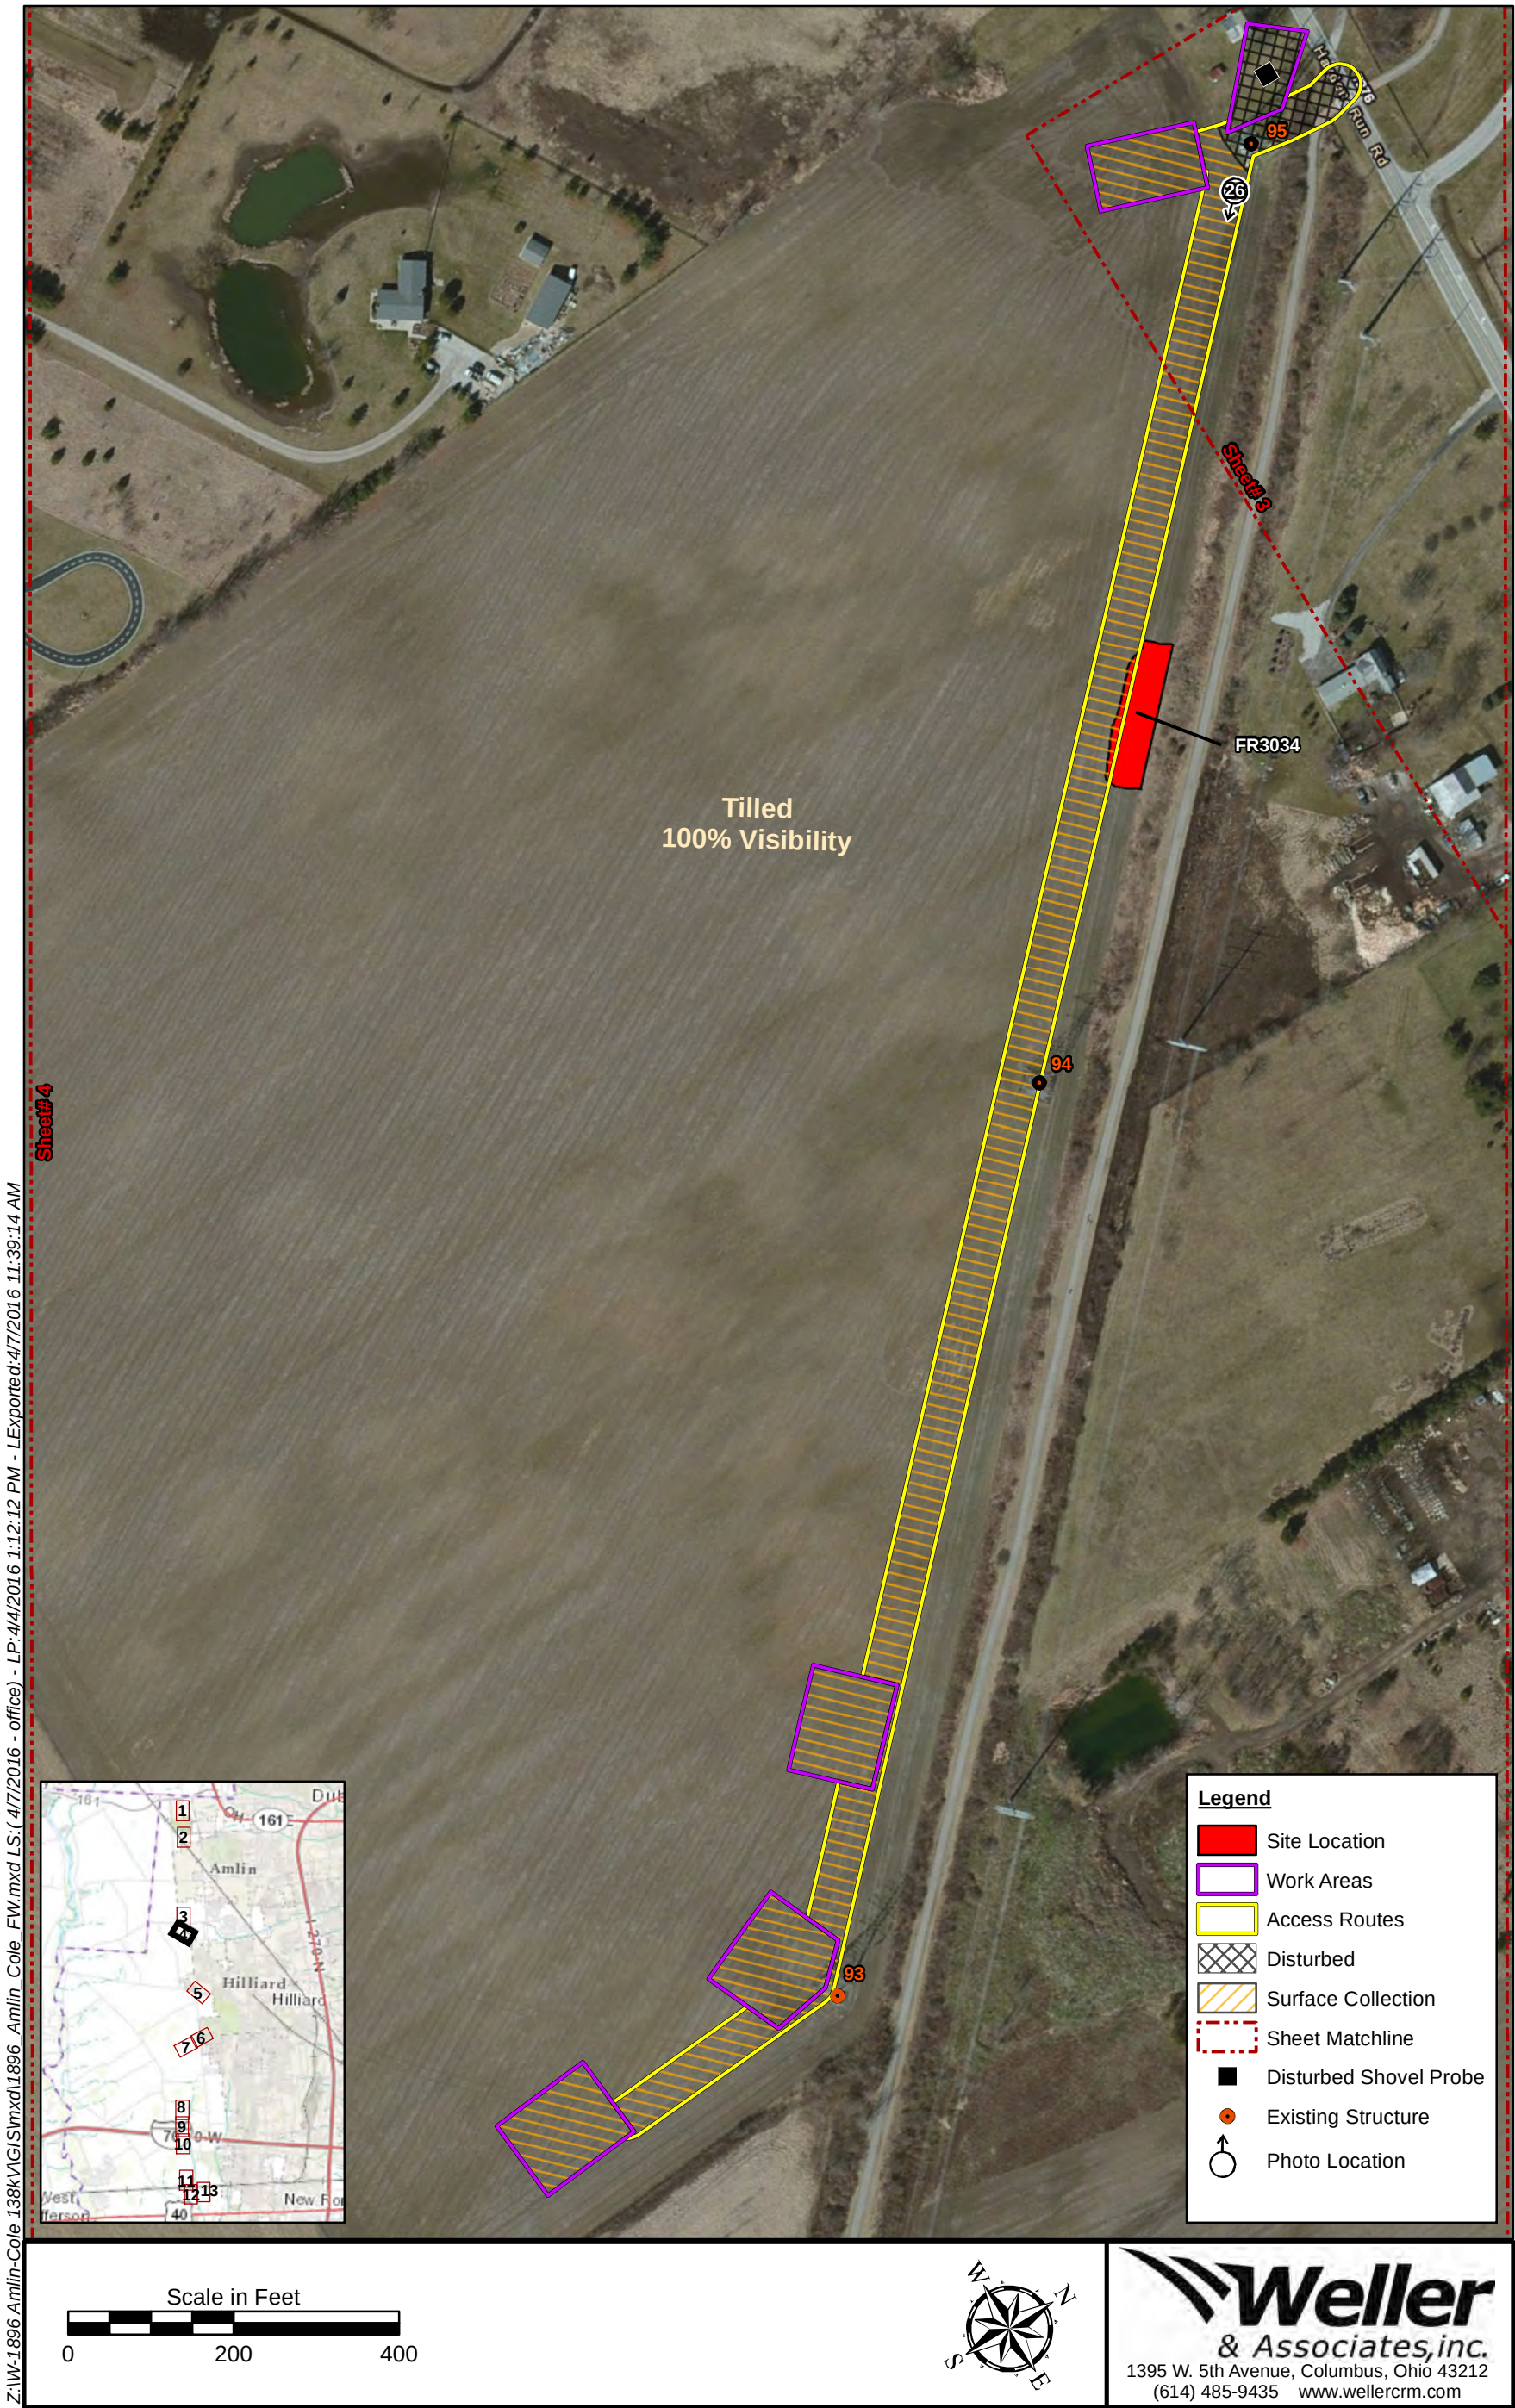


Figure 10. Fieldwork results & photo orientation for Sheet 4.



Figure 11. Fieldwork results & photo orientation for Sheet 5.



Figure 12. Fieldwork results & photo orientation for Sheet 6.

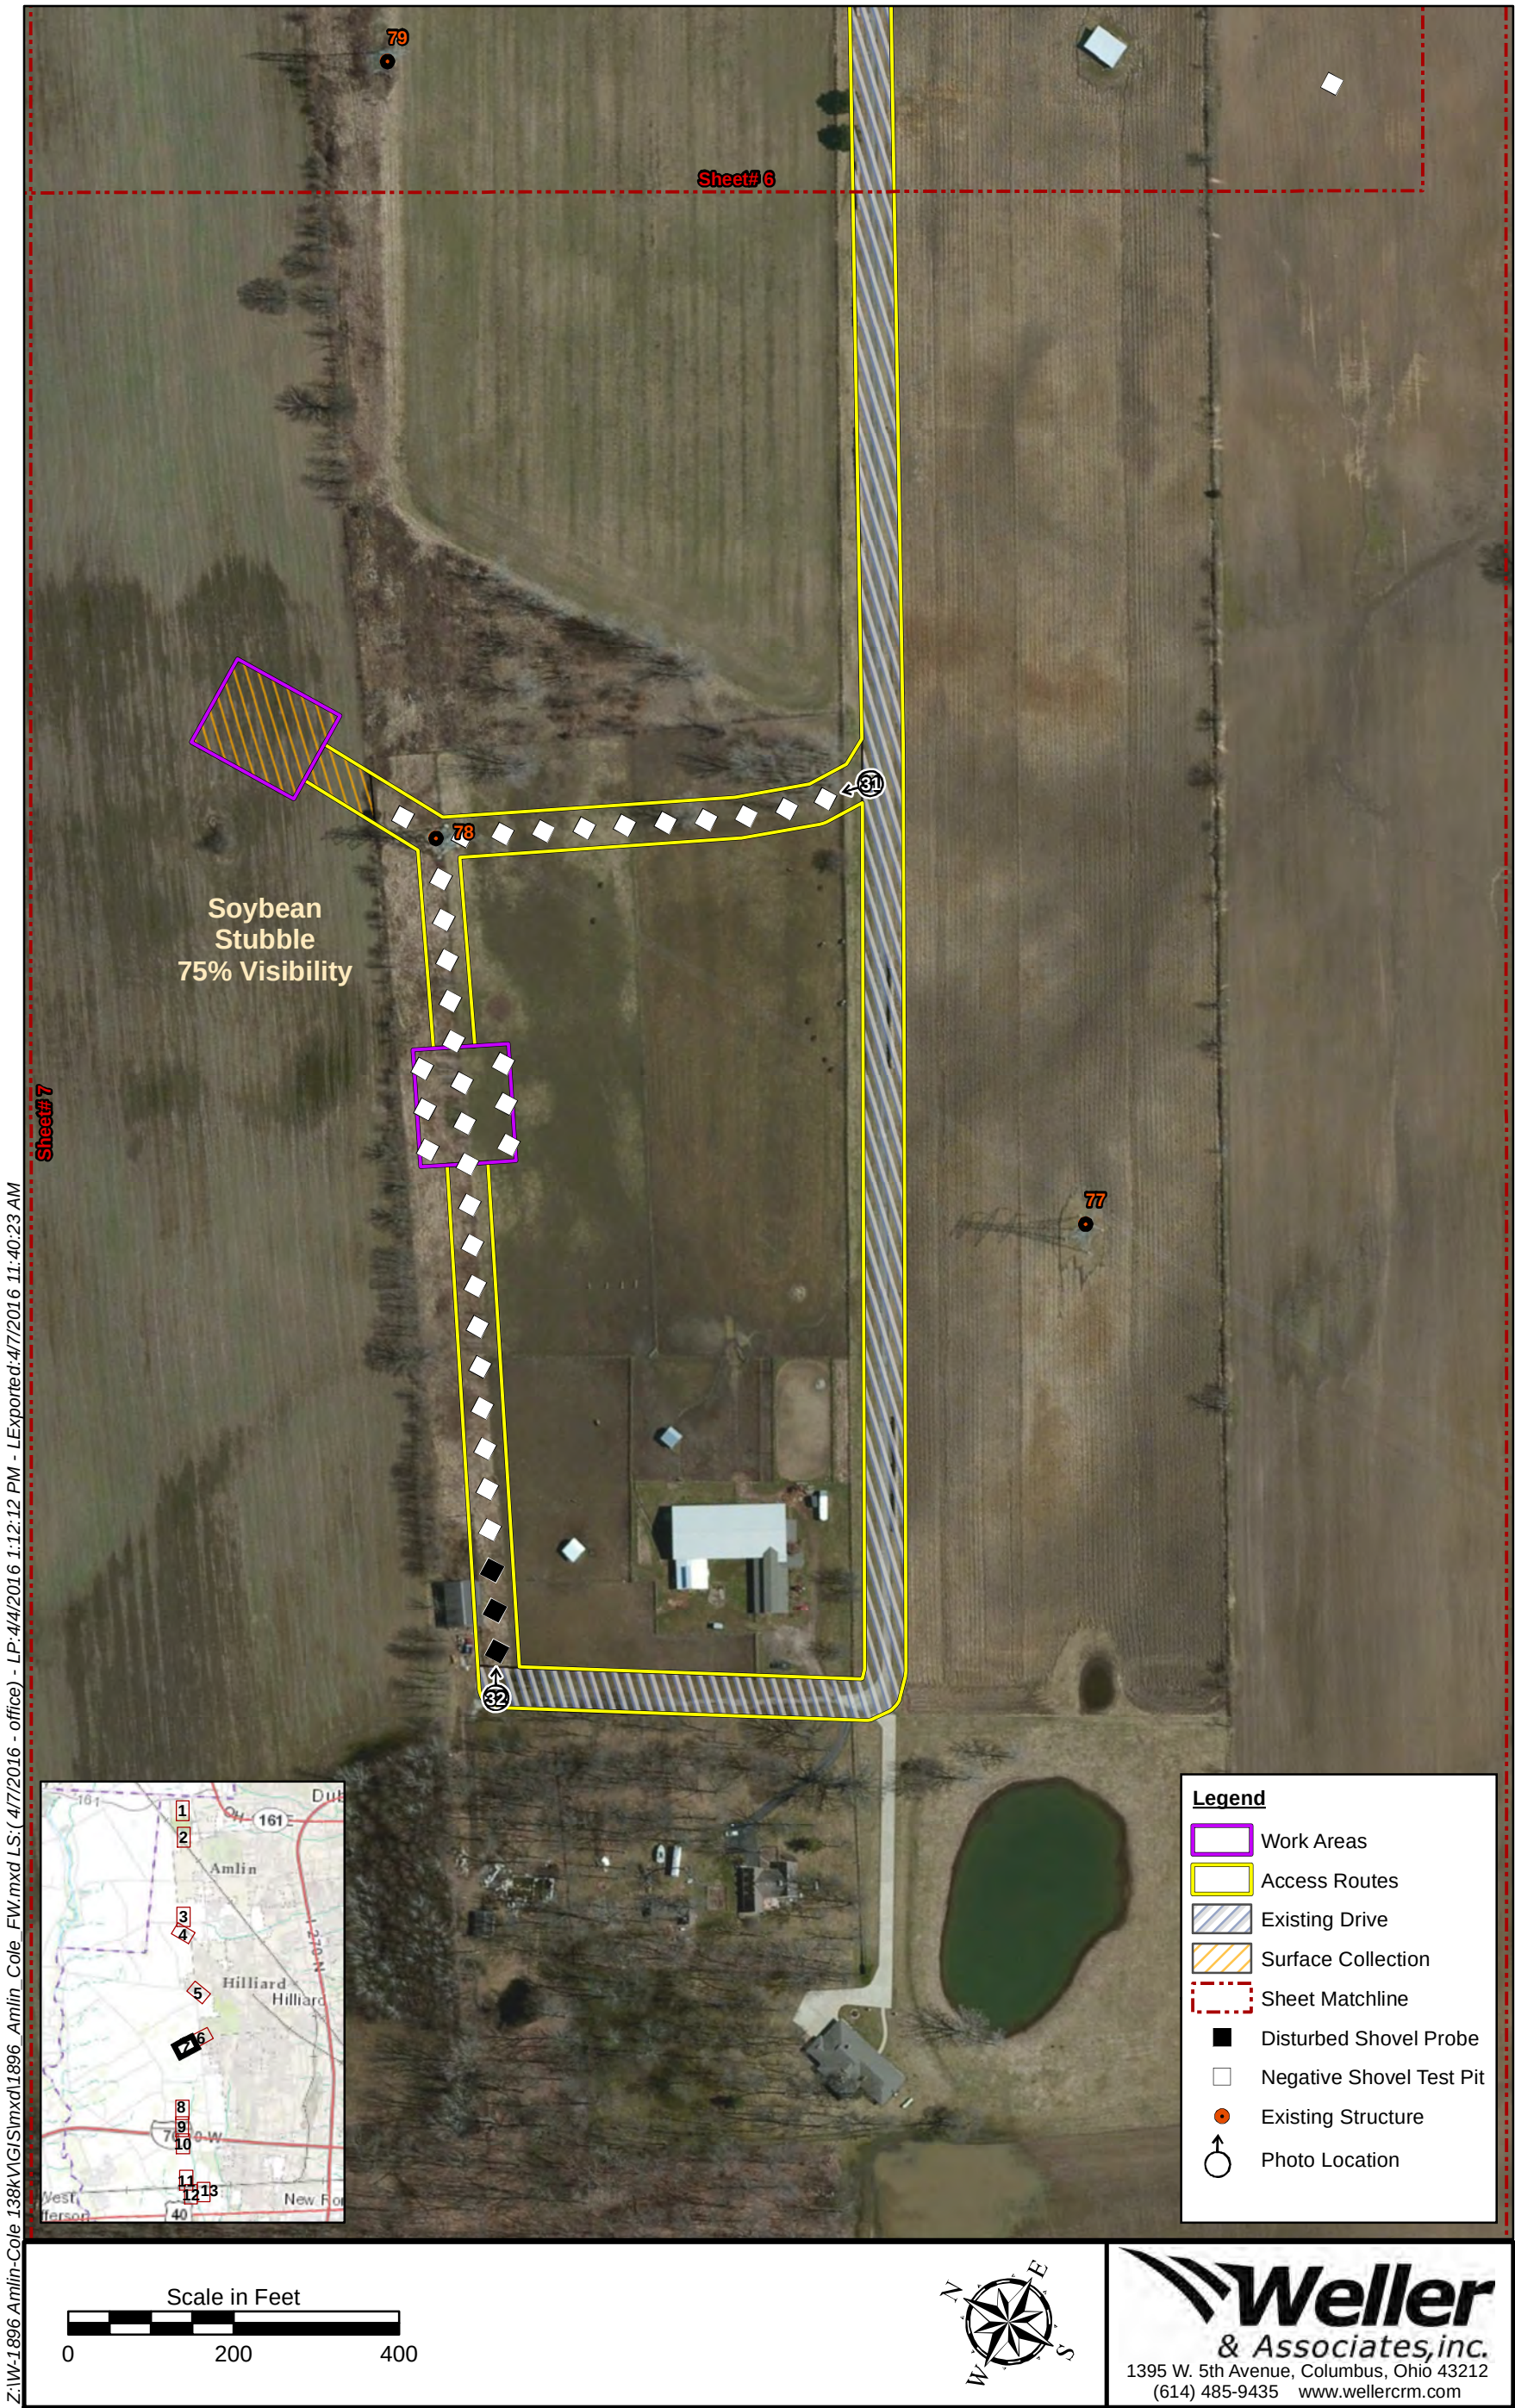


Figure 13. Fieldwork results & photo orientation for Sheet 7.



Figure 14. Fieldwork results & photo orientation for Sheet 8.



Figure 15. Fieldwork results & photo orientation for Sheet 9.




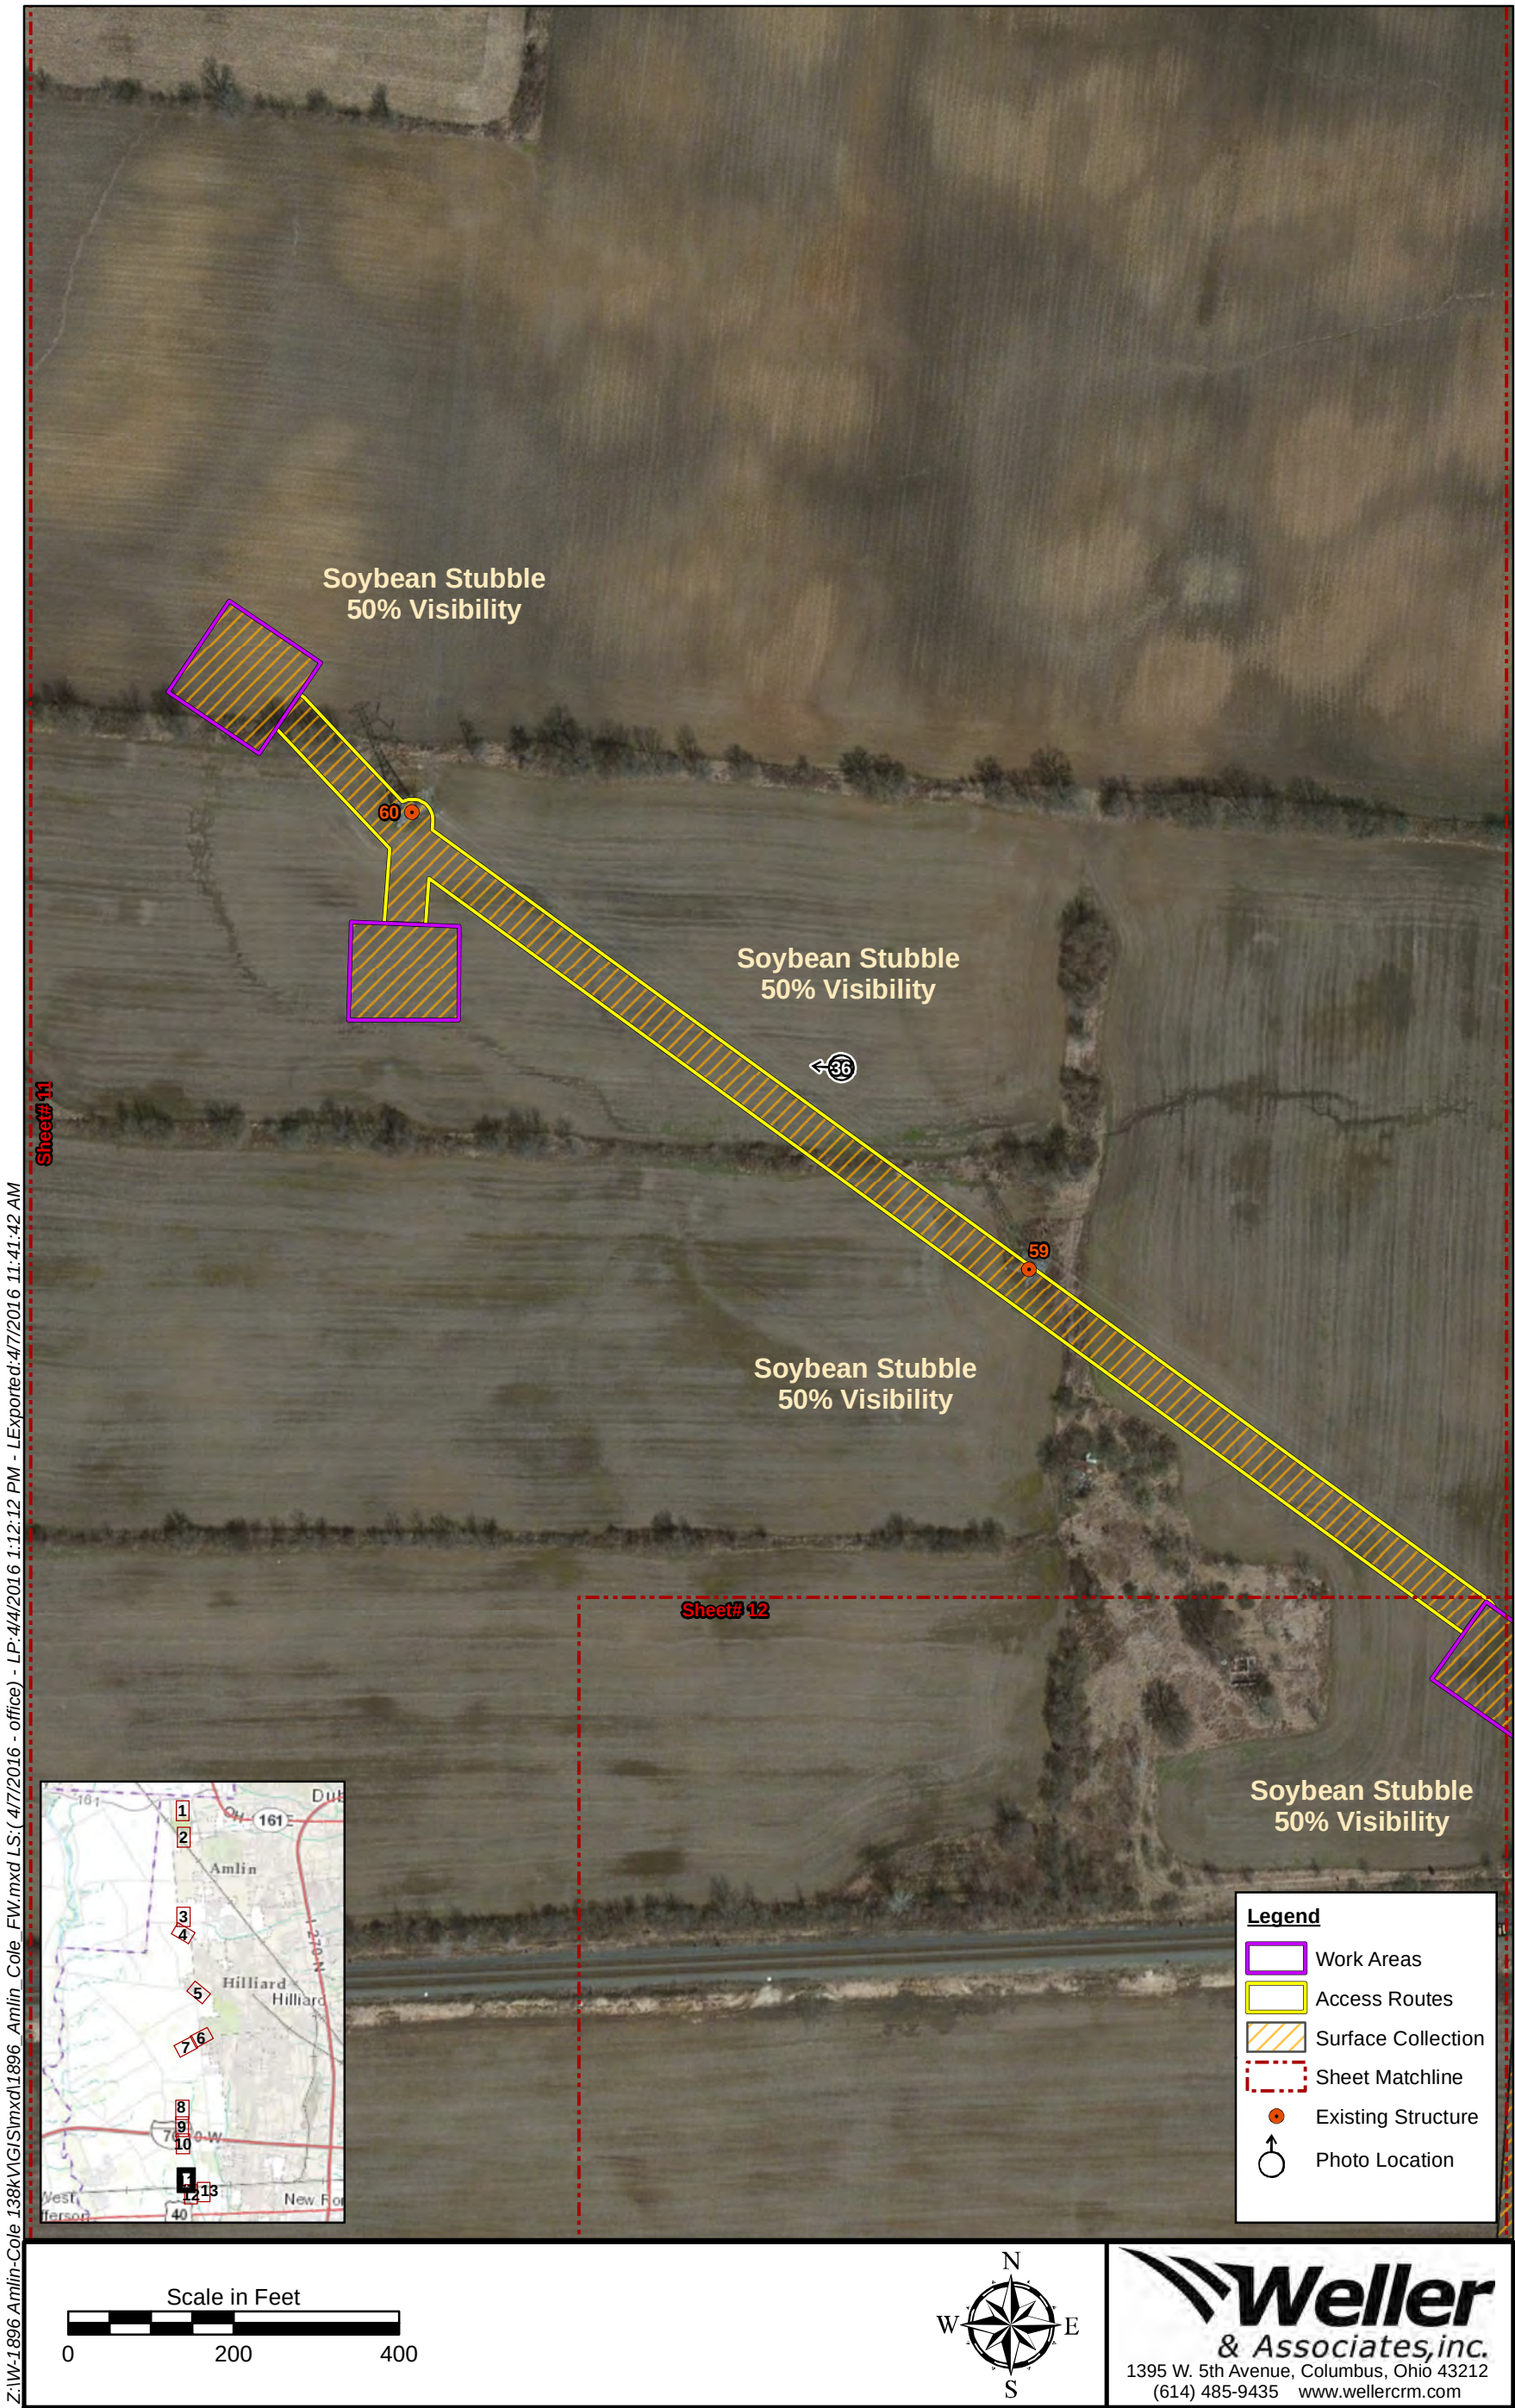


Figure 17. Fieldwork results & photo orientation for Sheet 11.



Figure 18. Fieldwork results & photo orientation for Sheet 12.

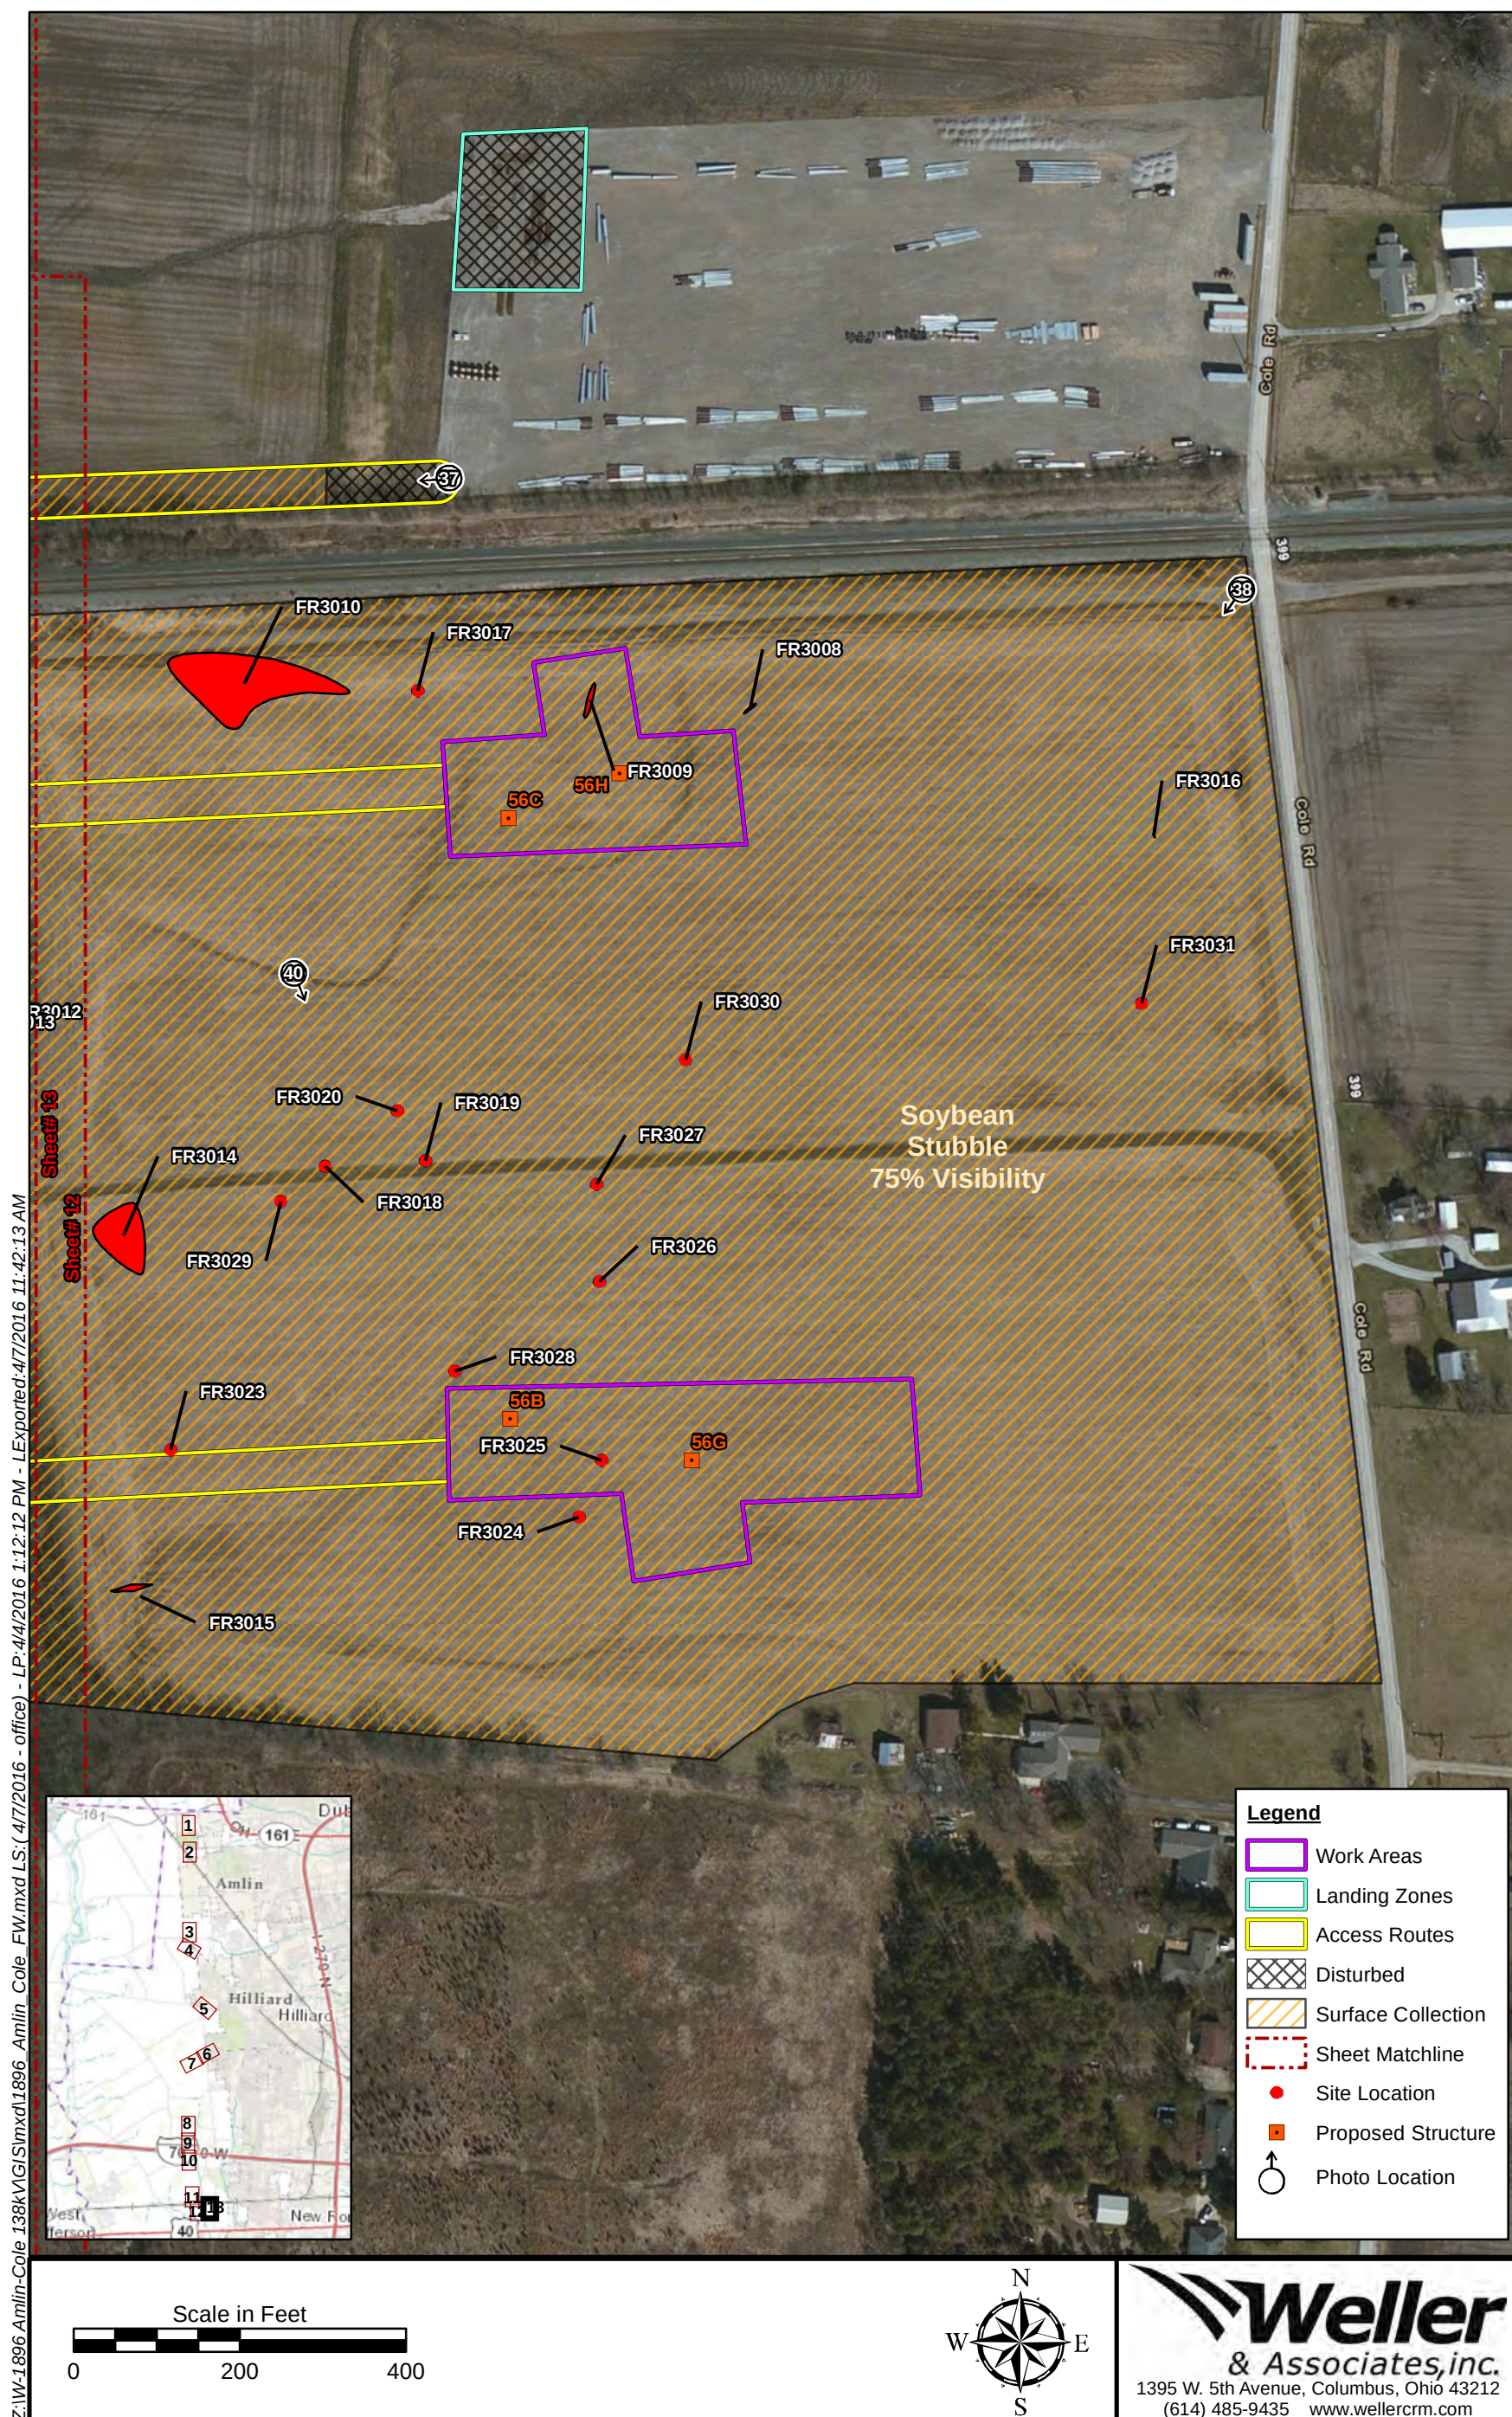

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

8/10/2016 4:19:48 PM

in

Case No(s). 16-1558-EL-BLN

Summary: Letter of Notification - Part 5 of 7 electronically filed by Mrs. Erin C Miller on behalf of AEP Ohio Transmission Company