

X:\W-1915 Hedding Road Switch-Fulton Station (Section 2)\GIS\mxd\1915_FW4.mxd LS: (6/6/2016 - office) - LP:3/1/2016 2:34:08 PM - LExported:6/6/2016 4:03:17 PM



Figure 14. Fieldwork results and photo orientations for Sheet 6.

X:\W-1915 Hadding Road Switch-Fulton Station (Section 2)\GIS\mxd\1915_FW4.mxd LS: (6/6/2016 2:34:08 PM - LExported:6/6/2016 4:03:32 PM



Figure 15. Fieldwork results and photo orientations for Sheet 7.

X:\W-1915 Hedding Road Switch-Fulton Station (Section 2)\GIS\mxd\1915_FW4.mxd LS: (6/6/2016 2:34:08 PM - LExported:6/6/2016 4:03:47 PM

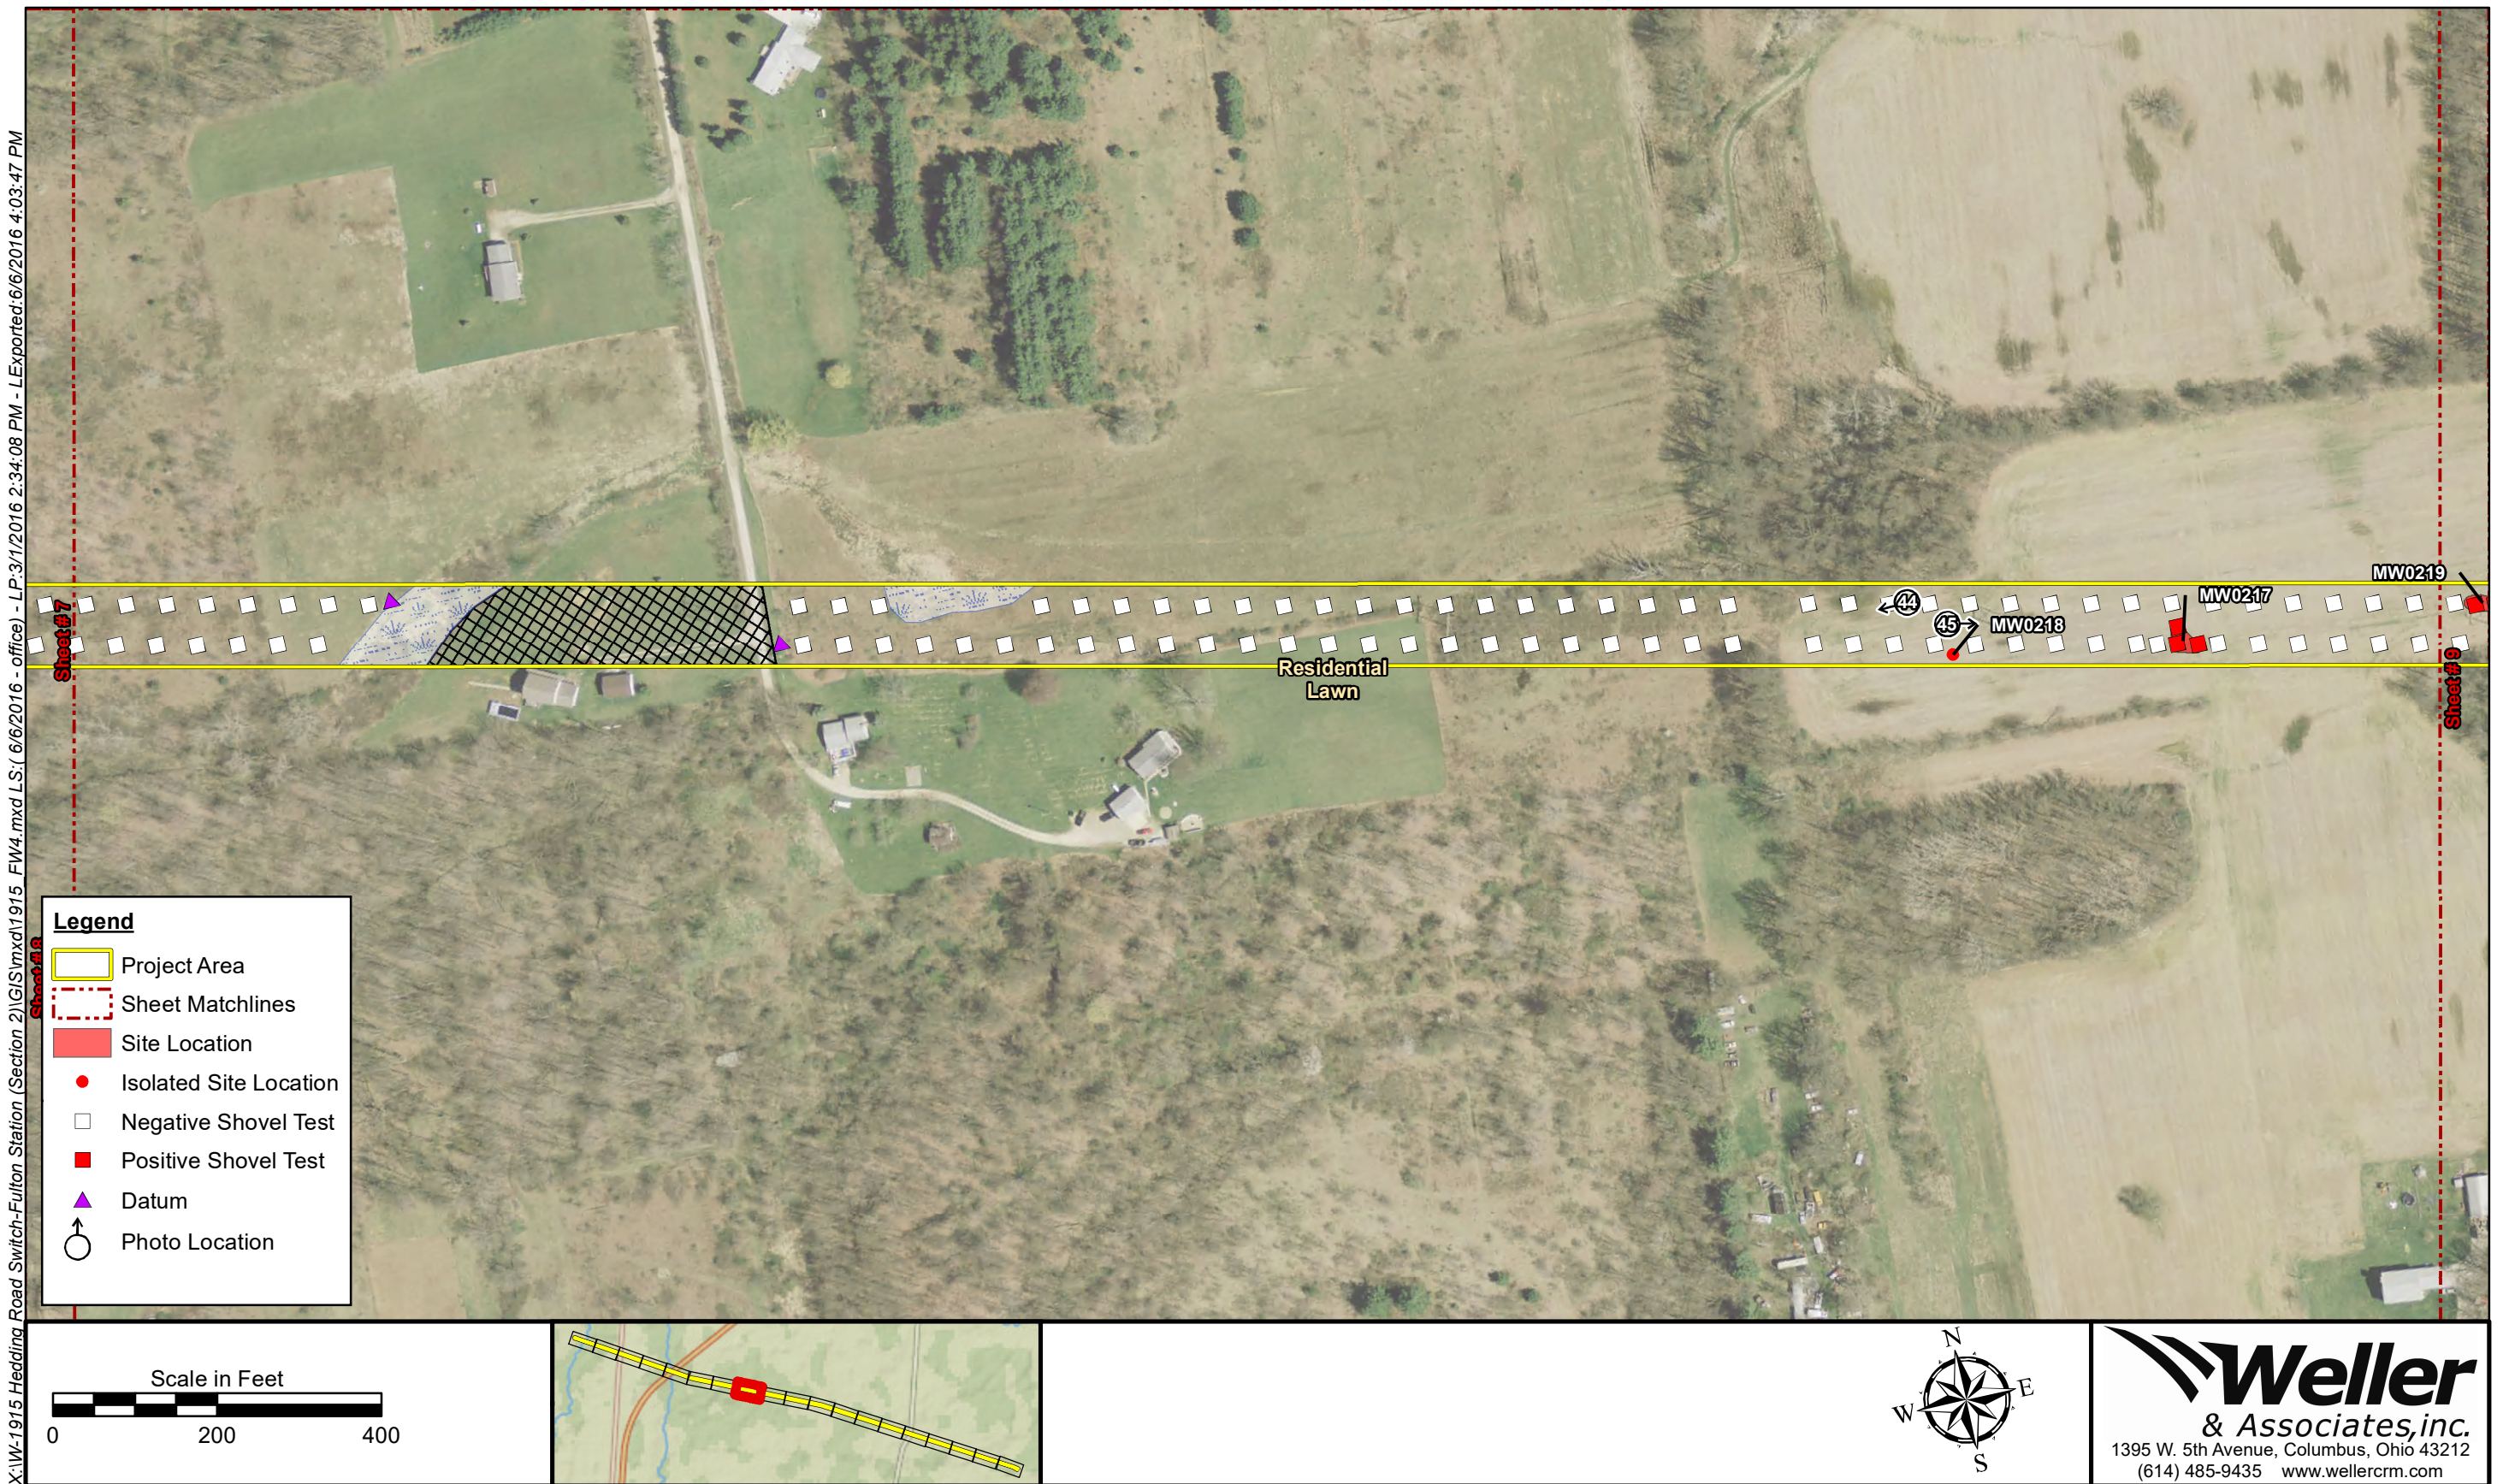


Figure 16. Fieldwork results and photo orientations for Sheet 8.



This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

9/26/2016 1:52:51 PM

in

Case No(s). 16-1531-EL-BLN

Summary: Letter of Notification Part 6 electronically filed by Mr. Hector Garcia on behalf of AEP Ohio Transmission Company