



Legal Department

American Electric Power  
1 Riverside Plaza  
Columbus, OH 43215-2373  
AEP.com

September 28, 2016

Chairman Asim Z. Haque  
Ohio Power Siting Board  
180 East Broad Street  
Columbus, Ohio 43215

**Hector Garcia**  
Senior Counsel –  
Regulatory Services  
(614) 716-3410 (P)  
(614) 716-2014 (F)  
hgarcia1@aep.com

**Re: PUCO Case No. 16-1530-EL-BLN Request for Expedited Treatment  
In the Matter of the Letter of Notification for the  
West Mount Vernon-Hedding 138kV Transmission Line Rebuild Project**

Dear Chairman Haque,

As indicated in the West Mount Vernon-Hedding 138kV Transmission Line Rebuild Project Letter of Notification ("LON") submitted by AEP Ohio Transmission Company, Inc. ("AEP Ohio Transco") on September 26, 2016, AEP Ohio Transco submits a drawing of the proposed structure type (Appendix B), to supplement its previous LON filing.

If you have any questions, please do not hesitate to contact me.

Respectfully submitted,

/s/ Hector Garcia

Hector Garcia  
Counsel for AEP Ohio Transmission Company, Inc.

cc: Jon Pawley

# REF. DRAWINGS

| ITEM | QTY. | ASSEMBLY  | DESCRIPTION  |  |
|------|------|-----------|--|--|
| 1    | 1    | 74D0-1268 | 138KV LIGHT SUSPENSION CROSSARM 32 FT - CONCRETE OR STEEL H-FRAME - GALVANIZED |  |
| 2    | 3    | 11B6-2722 | 138KV SUSPENSION INSULATOR, POLYMER, 25K, W/CORONA RING                        |  |
| 3    | 2    | 30T0-1102 | OHGW, SUSPENSION, CONCRETE, STEEL OR WOOD POLE                                 |  |
| 4    | 2    | 21SE-1456 | GROUND ROD FOR DIRECT EMBEDDED STEEL POLE                                      |  |
| 5    | 2    | 71A0-1971 | A449 1IN - HIGH STRENGTH DOUBLE ARMING BOLT, CONCRETE OR STEEL                 |  |


Appendix B – Structural Drawing

AEP Ohio Transmission Company, Inc.

16-1530-EL-BLN

West Mount Vernon-Hedding 138kV Line

September 28, 2016

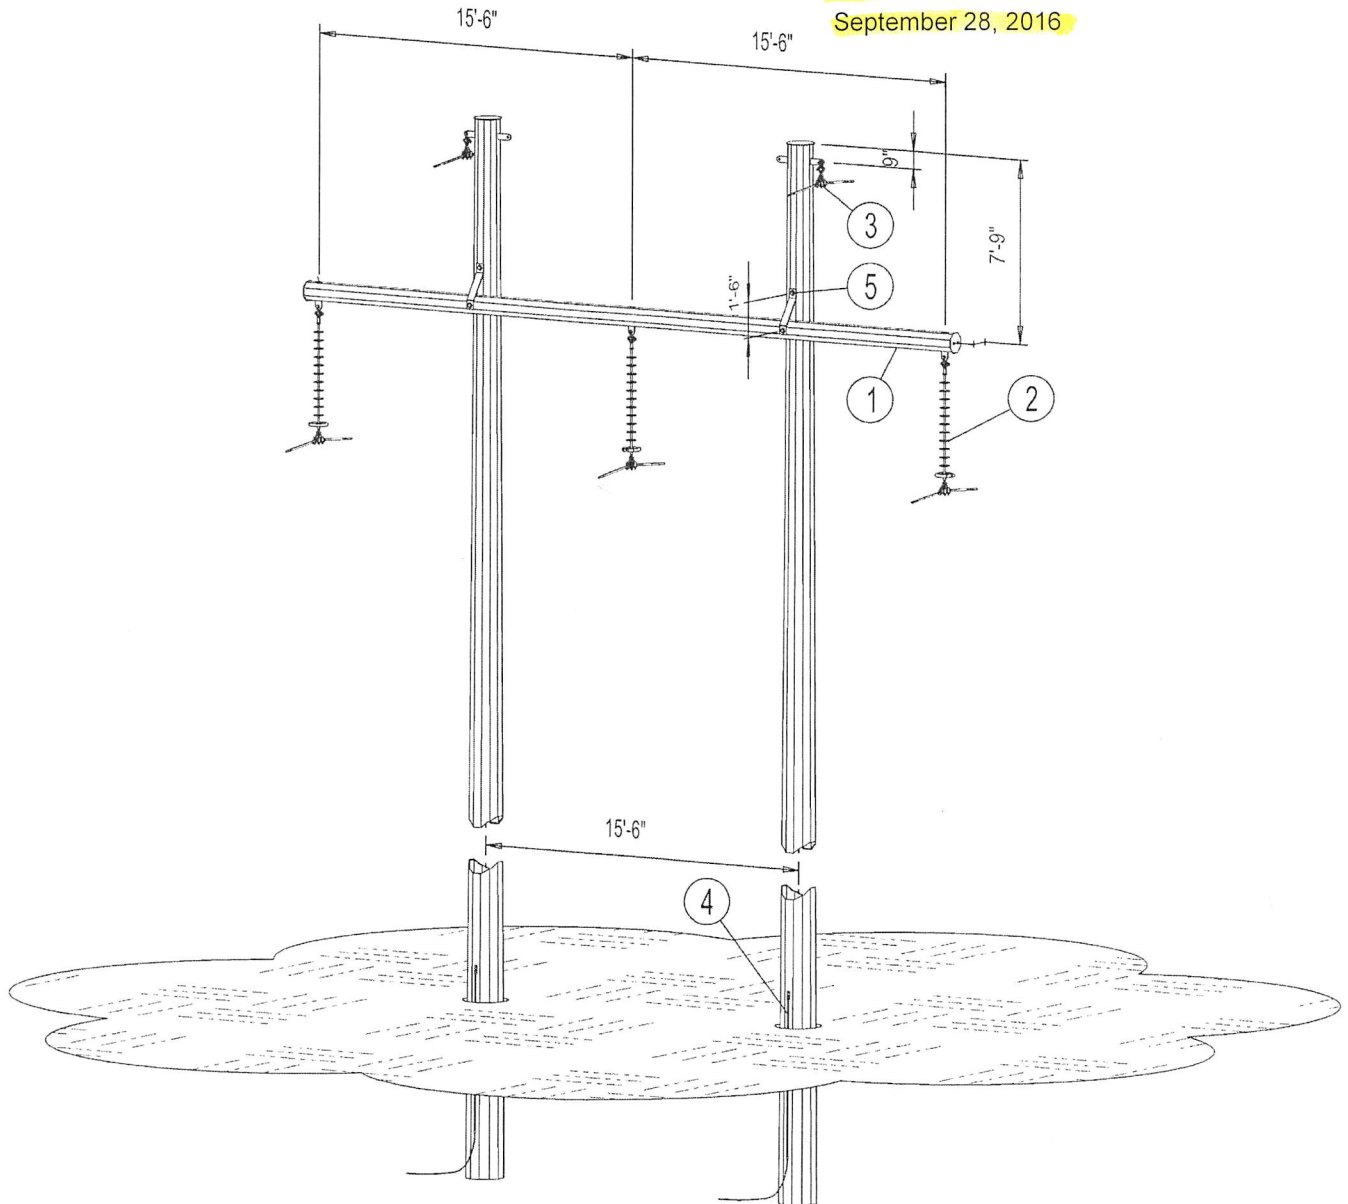

AMERICAN ELECTRIC POWER COMPANY, INC. DISCLAIMS ANY AND ALL WARRANTIES WITH RESPECT TO THE ACCURACY OR USE OF THIS DRAWING WHETHER EXPRESSED OR IMPLIED, INCLUDING SPECIFICALLY THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE. THIS DRAWING IS PROVIDED "AS IS" AND THE USER AGREES THAT IT ASSUMES ALL RISKS OF ITS USE, QUALITY, AND PERFORMANCE.

| REV  | DESCRIPTION              | BY  | DATE     | <div>TRANSMISSION LINE STANDARDS</div> <div>POLYMER - 138KV LIGHT SUSPENSION</div> <div>W/CORONA RING,</div> <div>H-FRAME, GALVANIZED STEEL</div> |                                   |                                  |
|--|--------------------------|-----|----------|---|-----------------------------------|----------------------------------|
| 1  | REVISED BILL OF MATERIAL | McP | 04/30/15 |   |                                   |                                  |
| <div>ENGR:</div> <div>DRAWN: SAS</div> <div>CHECKED: MCP</div> |                          |     |          | <div>DRAWING No.</div> <div>CS45-2468</div>   | <div>SHEET No.</div> <div>1</div> | <div>REV. No.</div> <div>1</div> |

Archive ID: 905-530



**This foregoing document was electronically filed with the Public Utilities**

**Commission of Ohio Docketing Information System on**

**9/28/2016 2:25:39 PM**

**in**

**Case No(s). 16-1530-EL-BLN**

Summary: Correspondence - Supplemental Filing (W Mt. Vernon-Hedding) electronically filed by Mr. Hector Garcia on behalf of AEP Ohio Transmission Company