



Legal Department

American Electric Power
1 Riverside Plaza
Columbus, OH 43215-2373
AEP.com

September 28, 2016

Chairman Asim Z. Haque
Ohio Power Siting Board
180 East Broad Street
Columbus, Ohio 43215

Hector Garcia
Senior Counsel –
Regulatory Services
(614) 716-3410 (P)
(614) 716-2014 (F)
hgarcia1@aep.com

**Re: PUCO Case No. 16-1531-EL-BLN Request for Expedited Treatment
In the Matter of the Letter of Notification for the
Hedding-Fulton 138kV Transmission Line Rebuild Project**

Dear Chairman Haque,

As indicated in the Hedding-Fulton 138kV Transmission Line Rebuild Project Letter of Notification ("LON") submitted by AEP Ohio Transmission Company, Inc. ("AEP Ohio Transco") on September 26, 2016, AEP Ohio Transco submits a drawing of the proposed structure type (Appendix B), to supplement its previous LON filing.

If you have any questions, please do not hesitate to contact me.

Respectfully submitted,

/s/ Hector Garcia


Hector Garcia
Counsel for AEP Ohio Transmission Company, Inc.

cc: Jon Pawley


REF. DRAWINGS

ITEM	QTY.	ASSEMBLY	DESCRIPTION	
1	1	74D0-1268	138KV LIGHT SUSPENSION CROSSARM 32 FT - CONCRETE OR STEEL H-FRAME - GALVANIZED	
2	3	11B6-2722	138KV SUSPENSION INSULATOR, POLYMER, 25K, W/CORONA RING	
3	2	30T0-1102	OHGW, SUSPENSION, CONCRETE, STEEL OR WOOD POLE	
4	2	21SE-1456	GROUND ROD FOR DIRECT EMBEDDED STEEL POLE	
5	2	71A0-1971	A449 1IN - HIGH STRENGTH DOUBLE ARMING BOLT, CONCRETE OR STEEL	

Appendix B – Structural Drawing
AEP Ohio Transmission Company, Inc.
16-1531-EL-BLN
Hedding-Fulton 138kV Line
September 28, 2016

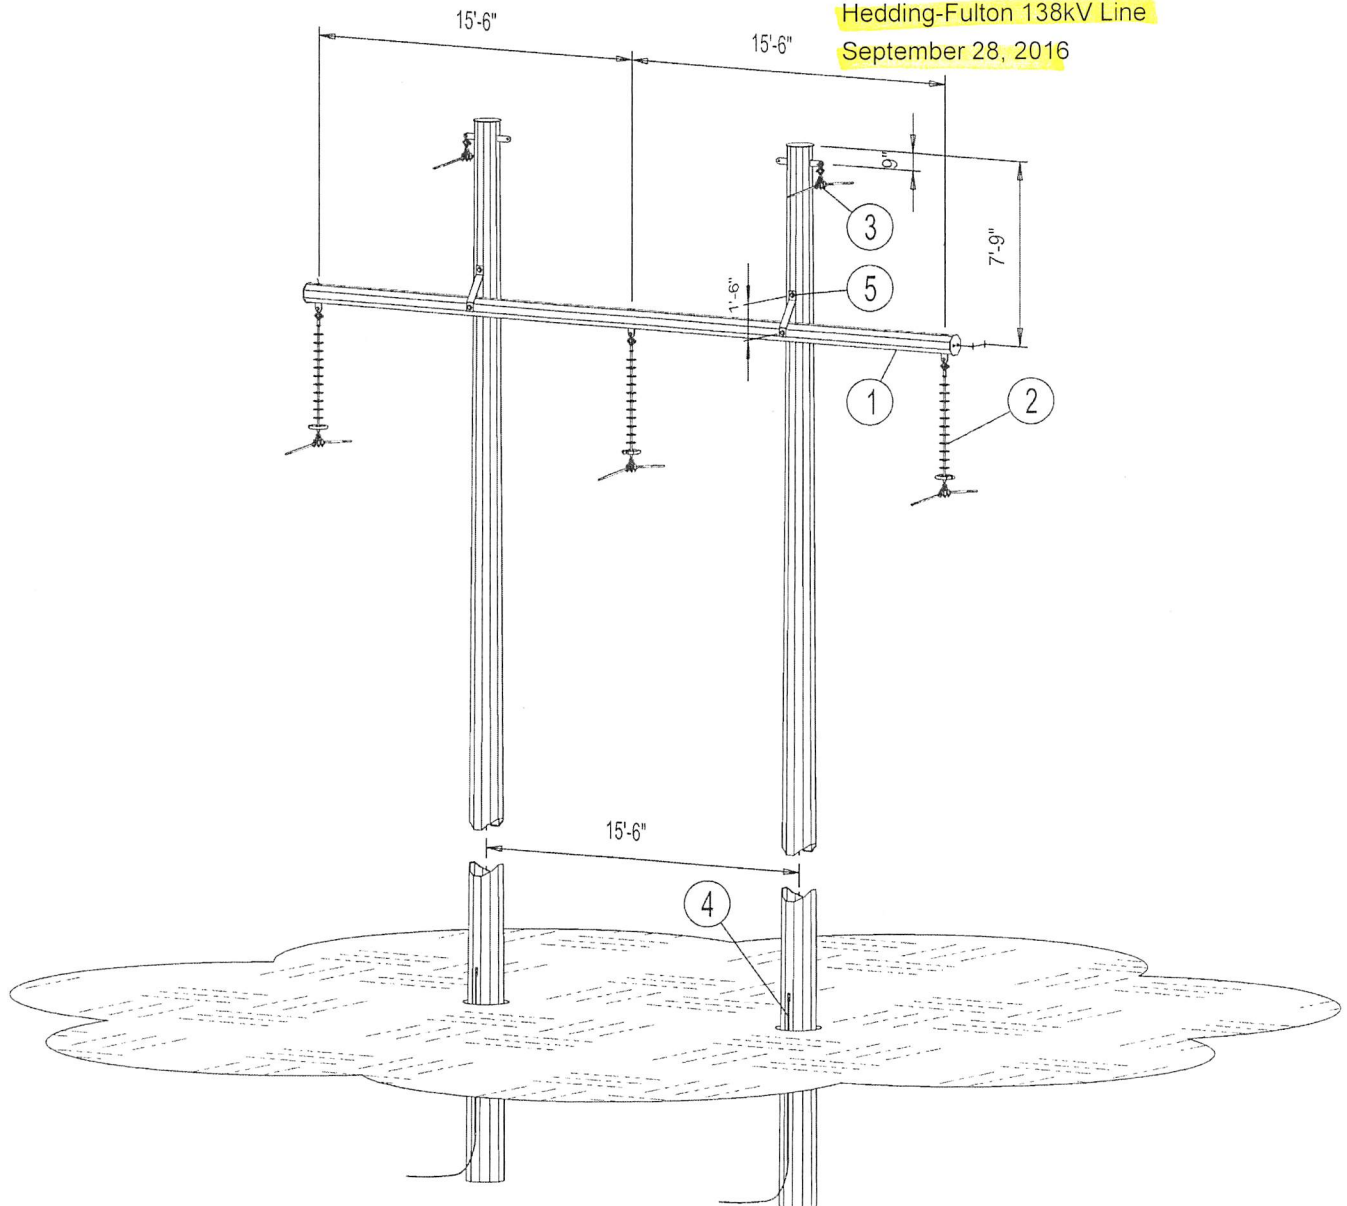

AMERICAN ELECTRIC POWER COMPANY, INC. DISCLAIMS ANY AND ALL WARRANTIES WITH RESPECT TO THE ACCURACY OR USE OF THIS DRAWING WHETHER EXPRESSED OR IMPLIED, INCLUDING SPECIFICALLY THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE. THIS DRAWING IS PROVIDED "AS IS" AND THE USER AGREES THAT IT ASSUMES ALL RISKS OF ITS USE, QUALITY, AND PERFORMANCE."

REV	DESCRIPTION		BY	DATE		TRANSMISSION LINE STANDARDS				
1	REVISED BILL OF MATERIAL		McP	04/30/15		POLYMER - 138KV LIGHT SUSPENSION W/CORONA RING, H-FRAME, GALVANIZED STEEL				
ENGR:		DRAWN: SAS	CHECKED: MCP	APPROVED: JCN		DATE: 10/23/12	DRAWING No. CS45-2468		SHEET No. 1	REV. No. 1

Archive ID: 905-530

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

9/28/2016 2:27:05 PM

in

Case No(s). 16-1531-EL-BLN

Summary: Correspondence - Supplemental Filing (Hedding-Fulton) electronically filed by Mr. Hector Garcia on behalf of AEP Ohio Transmission Company