

Case No. 16-0592-EL-REN Branstrator Farm LLC Solar Staff Interrogatories – Initial Set

Question 1: In section H of the application you state that the facility is not yet online and the projected in-service date as 9/15/16. Is the facility online now? If so, what is the in-service date? If not, what is the new projected in-service date?

Answer 1: **Online as of 10/10/16.**

Question 2: In section I.1 the nameplate capacity is listed as 7.5 kW. But in section G.1 you state the facility has 30 275W panels. Since $30 \times 275W = 8,250W$ or 8.25 kW. Is the nameplate capacity 8.25 kW?

Answer 2: **Yes. 8.25kW**

Question 3: If the facility is now online, please fill out the following section for the utility grade meter:

N.1 Please provide the following information for each meter used in your system.

N.1.a Manufacturer: GE

N.1.b Serial Number: 68 255 743

N.1.c Type: N2 bidirectional

N.1.d Date of Last Certification: 10/10/16

Attach a photograph of the meter(s) with date image taken. The meter reading(s) must be clearly visible in the photograph.


N.1.e Report the total meter reading number at the time the photograph was taken and specify the appropriate unit of generation (e.g., kWh): 293 kWh

Date photograph taken: 10/24/16

INSERT PHOTOGRAPH(S)

NEVER OPEN OR REMOVE THE
COVER OF THIS METER WHEN
IT IS ENERGIZED.

⚠ WARNING DUAL POWER SOURCE
SECOND SOURCE IS PHOTOVOLTAIC SYSTEM

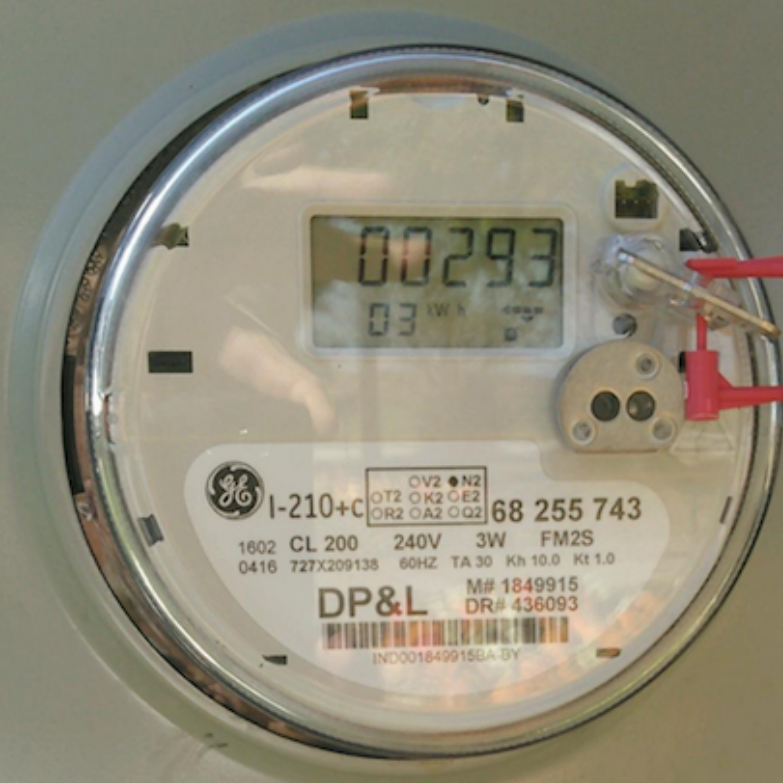

GE I-210+C
OV2 N2
OT2 OK2 OE2
OR2 OA2 OQ2
1602 CL 200 240V 3W FM2S
0416 727X209138 60HZ TA 30 Kh 10.0 Kt 1.0
68 255 743
DP&L M# 1849915
DR# 436093
IND001849915BA-BY



**WARNING: PHOTOVOLTAIC
POWER SOURCE**

PANEL A

⚠ WARNING
TURN OFF PHOTOVOLTAIC
CONNECT PRIOR TO

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

10/25/2016 10:14:01 PM

in

Case No(s). 16-0592-EL-REN

Summary: Reply Reply to Staff Inquiry
electronically filed by Mr. Jon V Branstrator on behalf of Branstrator Properties LLC and
Branstrator, Jon V Mr.