



# Herlan Switching Substation Layout

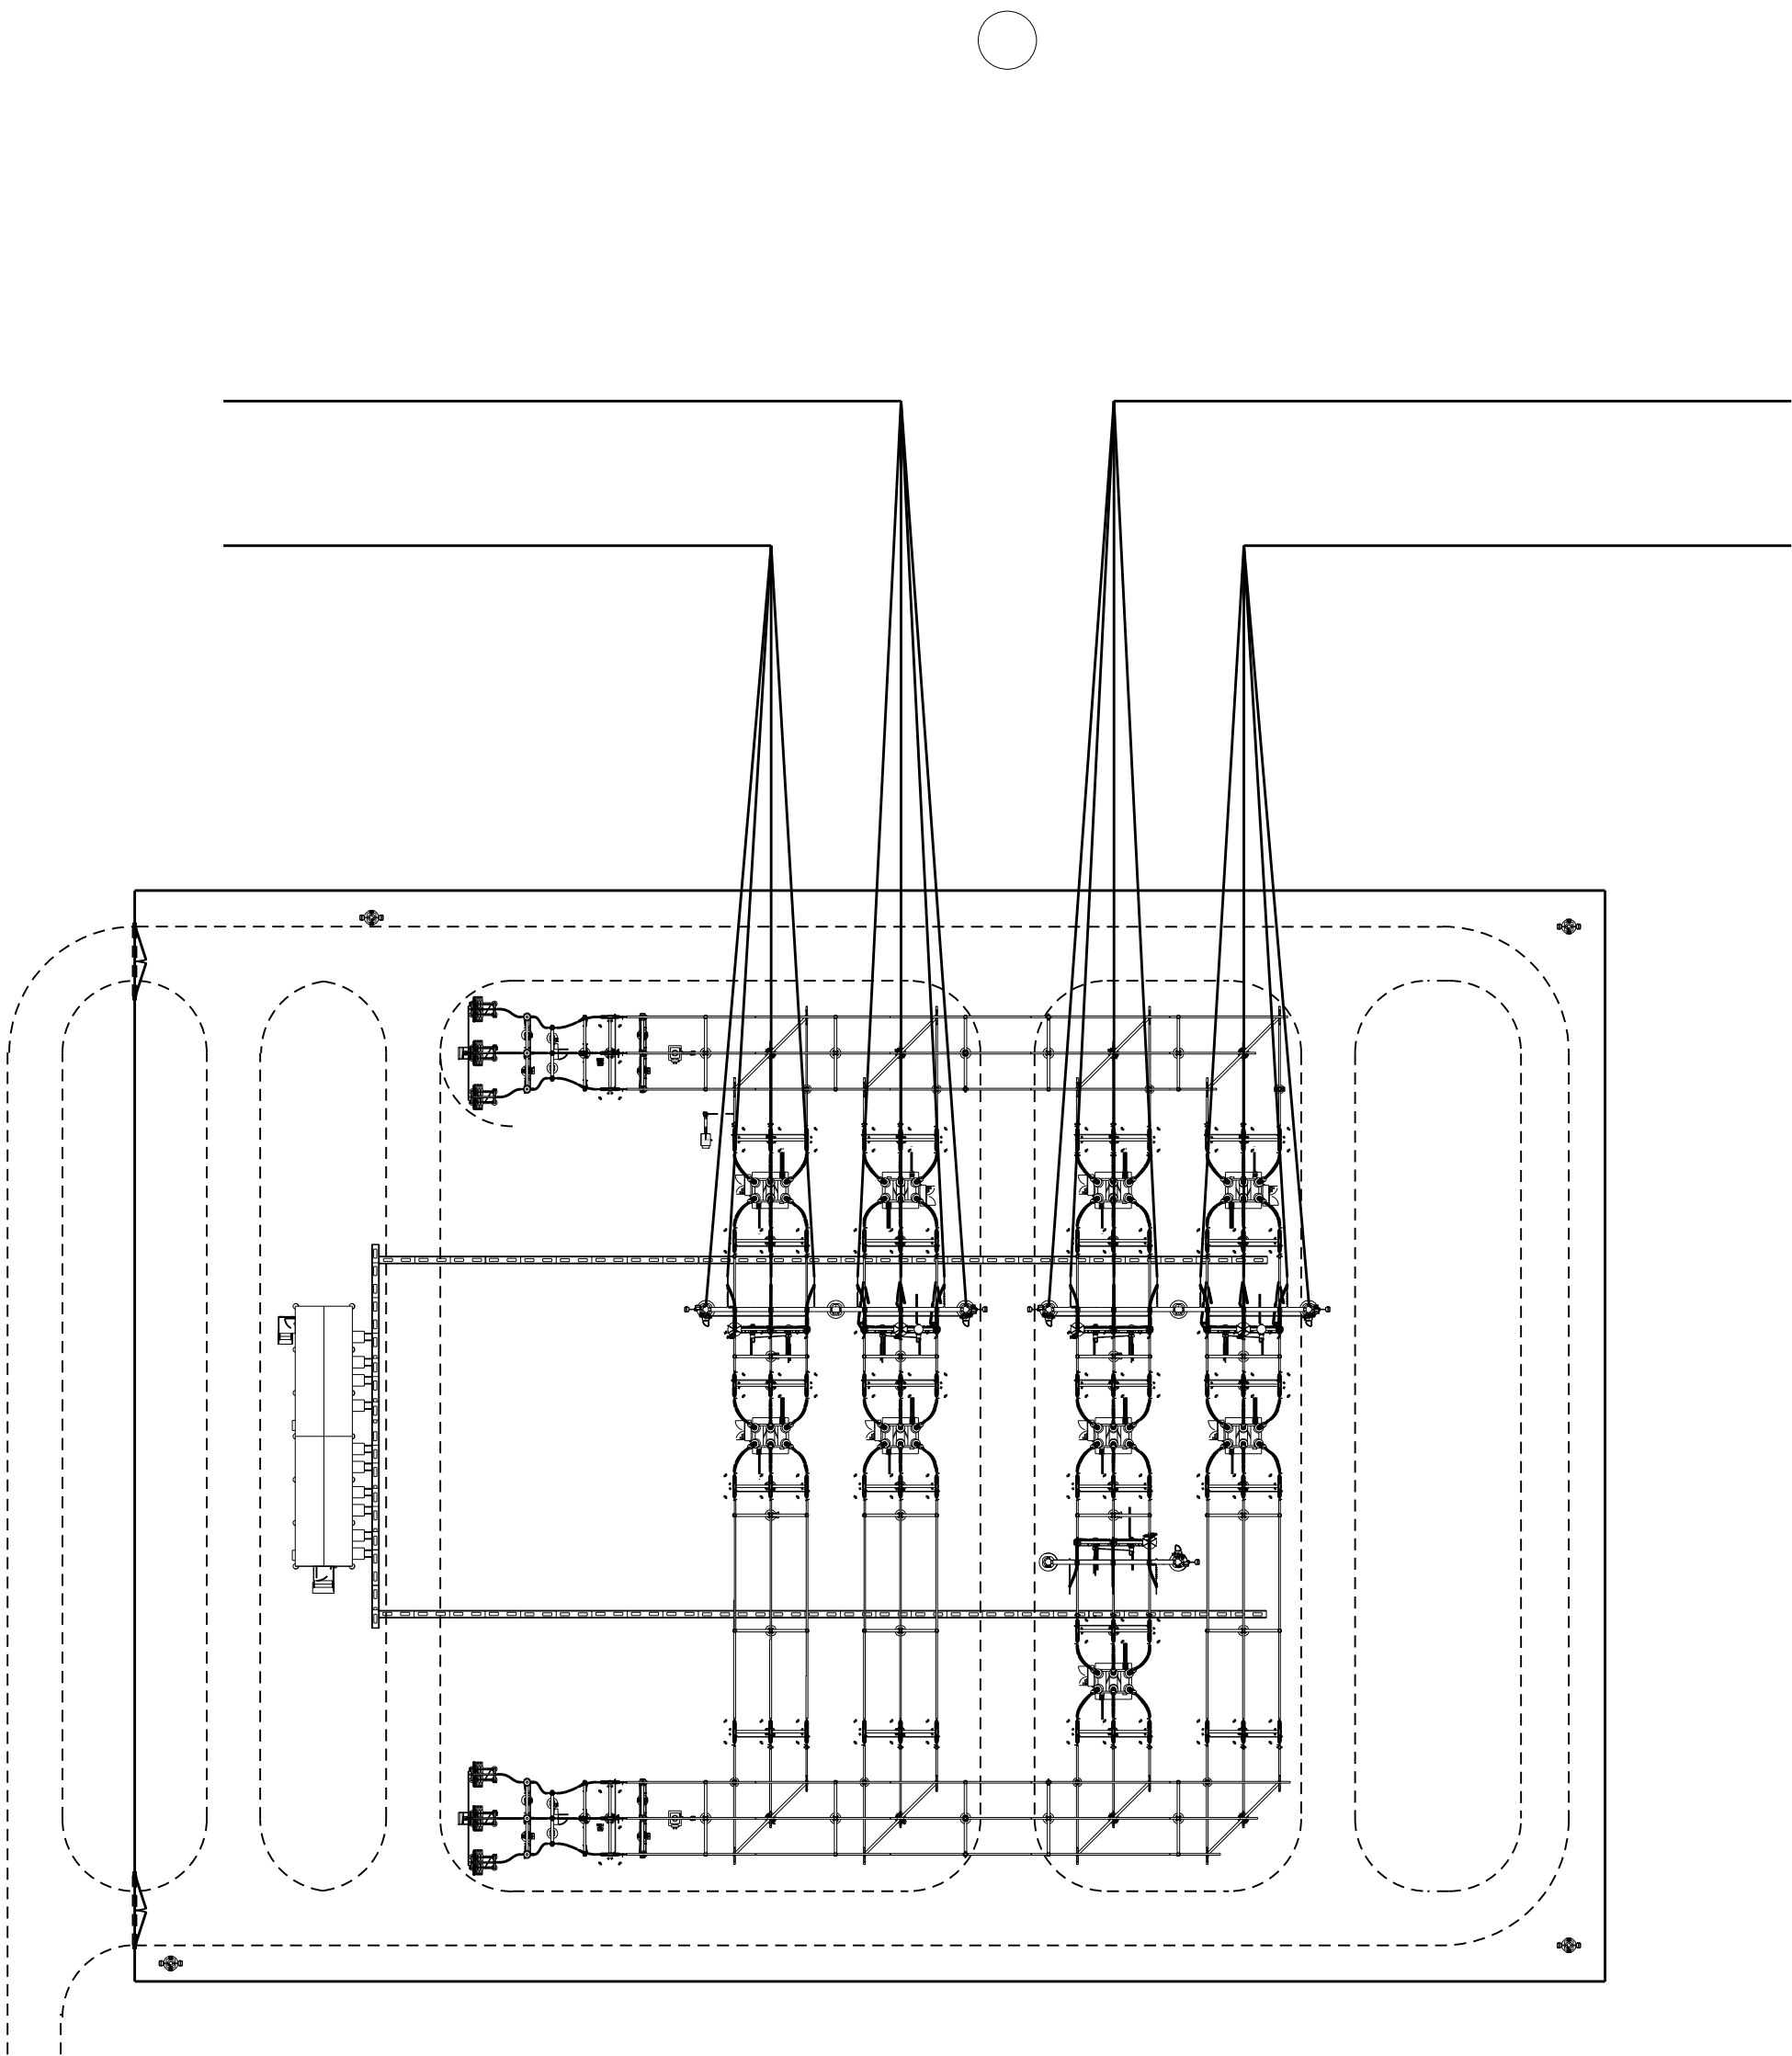

S.W. (1) 159,000 CM ACSR (12/7) (GUINEA)  
COND. (6) 556,500 CM ACSR (26/7) (DOVE)

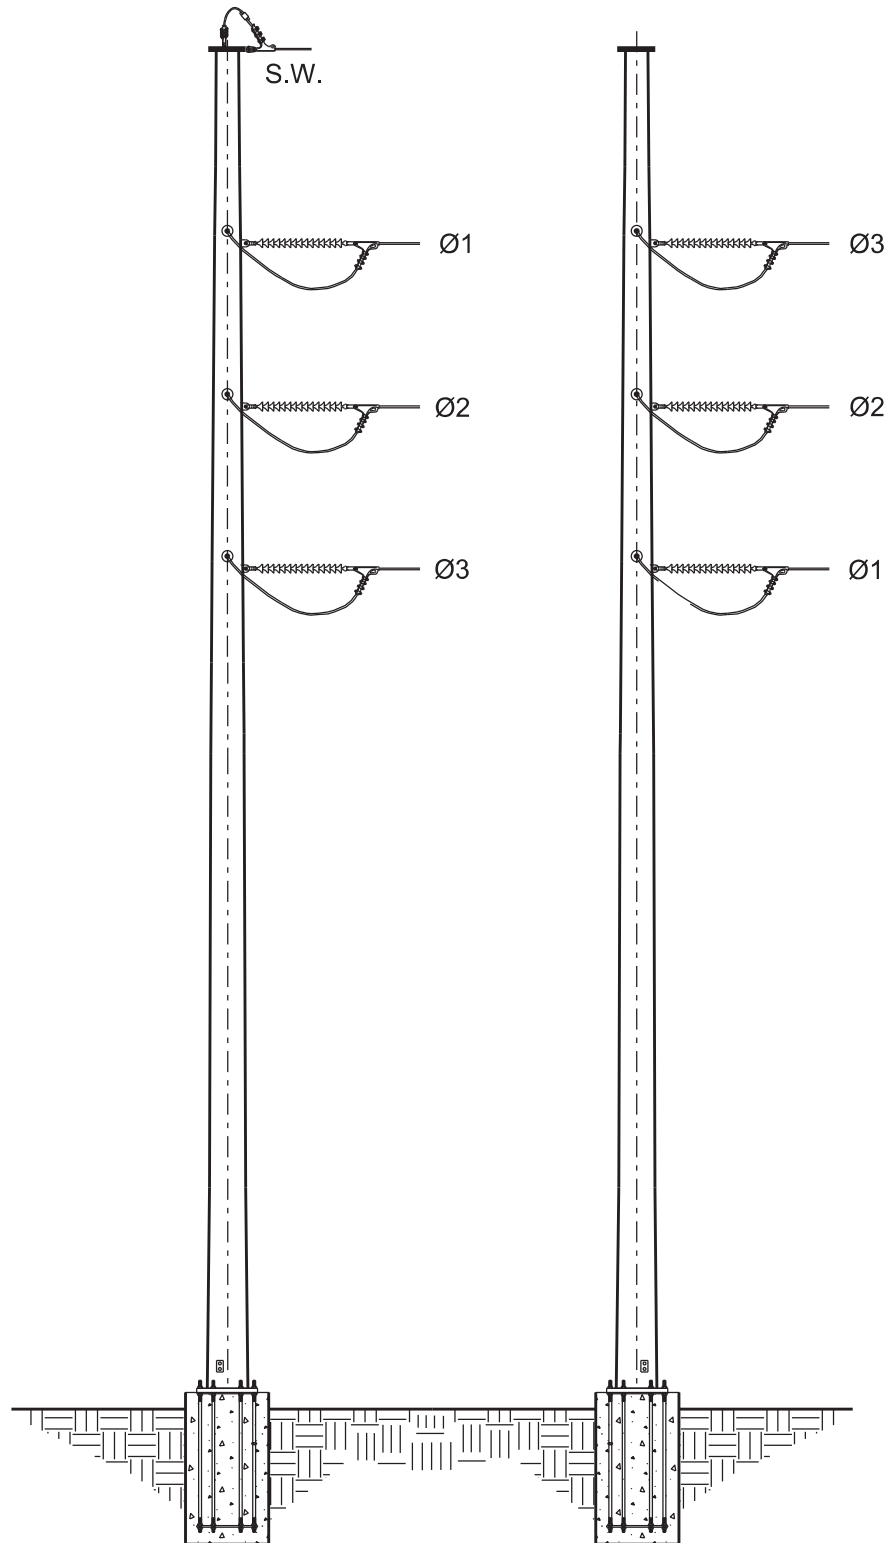

SUMMERFIELD - NATRIUM 138kV LINE



PROPOSED DOUBLE CIRCUIT  
138kV DEADEND  
STEEL POLE STRUCTURE

NOT TO SCALE

FIGURE

**This foregoing document was electronically filed with the Public Utilities**

**Commission of Ohio Docketing Information System on**

**11/22/2016 5:04:46 PM**

**in**

**Case No(s). 16-1856-EL-BLN**

Summary: Letter of Notification -Herlan 138kV Switching Substation Project Part 3 of 5  
electronically filed by Mrs. Erin C Miller on behalf of AEP Ohio Transmission Company