

Differences between a Smart Meter and a Regular Meter

AMI Smart Meter - NMD06
Blue Label



Regular Meter - NP008
White Label




Communications Card




No Communications Card



Communications Card

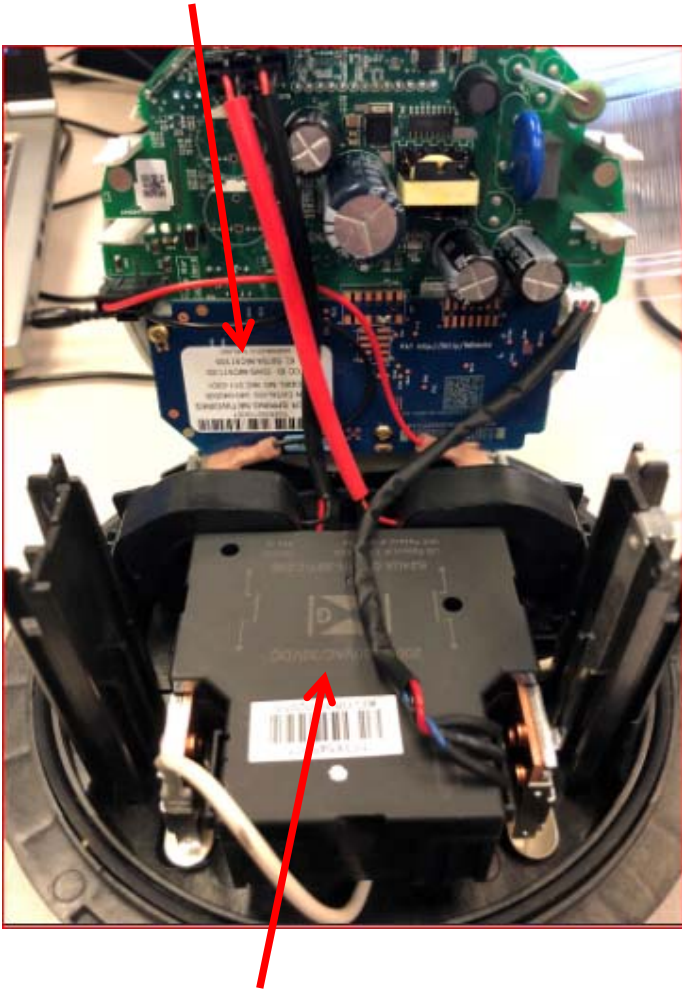


No Communications Card

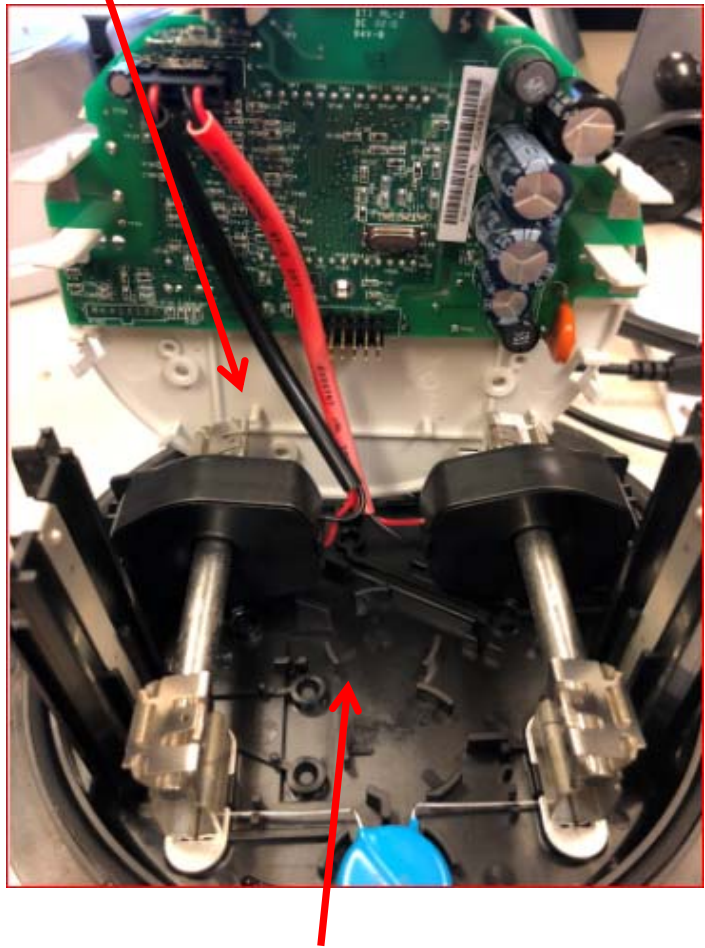

Disconnect Switch



No Disconnect Switch

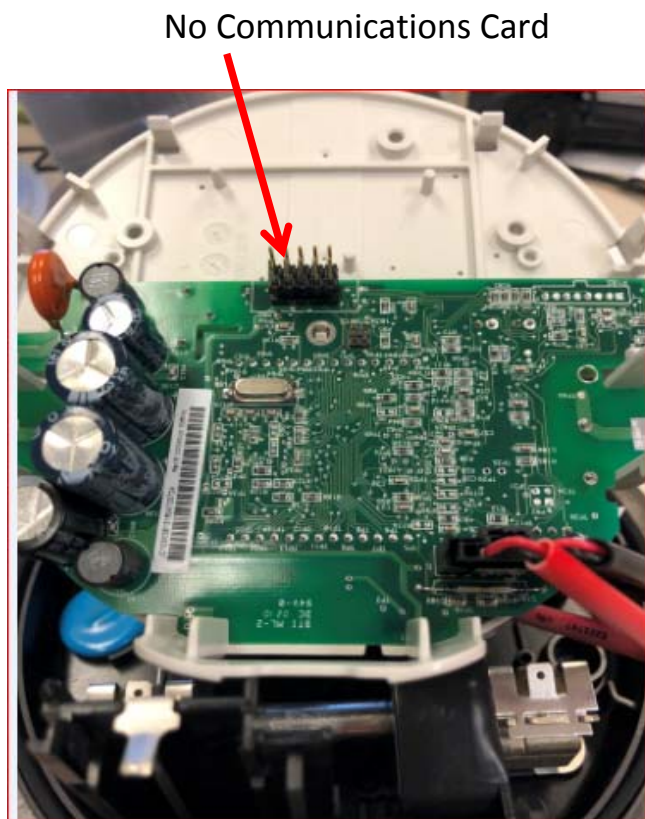

Communications Card

No Communications Card

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

9/10/2019 8:35:24 PM

in

Case No(s). 18-1832-EL-CSS

Summary: Exhibit Opt-Out Meter I-210+C with A2 Soft Switch Enabled electronically filed by Mr. Aaron Young on behalf of YOUNG, THAAH AND AARON