

October 23, 2019

Ms. Tanowa Troupe
Docketing Division
The Public Utilities Commission of Ohio
180 East Broad Street
Columbus, OH 43215-3793

**Letter of Notification for
Lemoyne-Woodville-Fostoria 138 kV Transmission Line and Substation Upgrade Project
Case No. 19-1337-EL-BLN**

Dear Ms. Troupe:

Attached please find copies of the notice letters to public officials and libraries and each owner of a property crossed and/or adjacent to the preferred and alternative routes. These letters are being docketed in accordance with OAC Rule 4906-3-10(B) as proof of publication of the second public notice required by OAC Rule 4906-3-9(A)(2).

The letters were mailed via US Postal Service First Class Mail on September 16, 2109 to each of the addressees listed in the attached Exhibit 1 and Exhibit 2.

In addition, the proof of publication on September 12, 2019, in Bowling Green Sentinel newspaper and the proof of publication on September 13, 2019, in the Fremont News Messenger is enclosed.

Should the Ohio Power Siting Board desire further information or discussion of this submittal, please contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore, Transmission Specialist II
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

cc: J. O'Dell

Certificate of Publication

Robin R. Crusa Spoores, an advertising representative of the Sentinel-Tribune, a newspaper published and of general circulation in the City of Bowling Green and in the county of Wood, State of Ohio, being duly sworn according to law, says that a notice a true copy of which is hereto attached, was published in said paper on

Thursday, September 12, 2019

Sworn to and subscribed before me this 12 day of September, 2019.

Lucinda S. Bennett
Notary Public, Wood County, Ohio

Total \$ 1060.00
Ad # 70147402



Lucinda S. Bennett
Notary Public, State of Ohio
My Commission Expires
February 8, 2024

Rogers

From page 1

and messy issues," Rogers said.

"We know that significant learning occurs when students work through complex and messy questions." Following his speech, Rogers commented

on the growth in enrollment, despite associated demographic concerns. He said he sees three factors driving it.

"One, we have a variety of new academic programs that we've launched over the last few years that are in very high demand, whether it be aviation, forensic science,

software engineering or inclusive early childhood. Nursing saw a huge increase this year as well," Rogers said. "I think, number two, and I keep hearing this from students who made the decision to attend Bowling Green, they are struck by the community we have here. It's a supportive community. One in which they

believe they can thrive." Rogers stressed the economics of a modern university education.

"Third, we tried to be much more intentional in how we build scholarship programs. I think about the Thompson scholarship program as one example, where we are meeting the need for a lot of students that may be coming from lower income families," Rogers said.

In his speech, Rogers said that Ellen Bowen and Bob Thompson made a financial commitment to "support students from working families with lower income who may not be able to afford higher education." As a result, almost 500 students will be receiving scholarships.

The state has also increased financial support from last year, by 2%.

A Task Force on Diversity and Inclusion has been formed.

"What if we truly enhance our culture to support diversity, so not all, but each student, faculty and staff member felt like they belonged here?" Rogers asked.

He also addressed the Gish Film Theater controversy and the task force that studied the related issues and recommended removal of the Gish name.

"They studied the issue. They engaged in a structured process and a thoughtful dialogue, often looking externally to inform their recommendations. We learned from each other. We listened. We embraced and didn't shy away," Rogers said.

"And if we cannot do that here, at a public university, a place of learning to pursue knowledge, then where can this space live?"

Jennifer McCary was asked to serve in a new cabinet level role as chief diversity and belonging officer. She has been tasked with the creation of a strategic diversity plan.

"What if?" was part of Rogers' address to an audience of university faculty, staff and students that filled the Lenhart Grand Ballroom of the Bowen-Thompson Student Union.

"Now, we are in this moment in time. It's the most transformative period in higher education, including when the Morrill Act funded land-grants or when the GI Bill sparked a major influx in veterans after World War II. The difference is that during those times came large financial support and resources," Rogers said. "Today, we must rely on our creativity and have courage in our convictions. And so I ask, what if? What if we rise to the occasion, like we have done so many times in our past?"

Rogers also announced the receipt of several grants and donations illustrating the direction of the university's commitment to maintaining financial value.

A National Science Foundation grant of \$1.9 million has been awarded to Jonathan Bostic, Ph.D., School of Teaching and Learning, for exploration of testing standards and assessment.

Tim Davis, Ph.D., biological sciences, has led research into water quality in the Sandusky Bay and algal blooms. The National Oceanic and Atmospheric Administration awarded the university an \$875,000 grant. In addition, because of a donation from the Ryan family, a research vessel has been purchased, which will be called the R.Y. Ziggy.

Calling ALL ALUMNI!

Penta Career Center is seeking nominations for its Annual Outstanding Alumni Awards.

Nominations must have been completed by High School or Adult Education programs by Penta prior to 2018.

Applications are available by calling 419-661-0251 or via www.pentacareercenter.org


Completed Applications Due: September 16, 2019

PENTA CAREER CENTER

NOTICE OF PROPOSED MAJOR UTILITY FACILITY

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has proposed in a Letter of Notification Application submitted to the Ohio Power Siting Board ("Board") for a Certificate of Environmental Compatibility and Public Need to expand the existing Woodville No. 2 substation and convert approximately 3.1 miles of existing 138kV transmission line to double circuit as part of the Fostoria West End (AEF)-Lemoyne-West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project, ("Project").

The Project is located Woodville Township, Sandusky County and Troy Township, Wood County Ohio. The substation is located at the southwest corner of the intersection of Pemberville Road and OH-582 in Woodville Township, Sandusky County, the substation expansion will be located entirely within existing Toledo Edison owned property. ATSI is proposing the Project to improve the efficiency, reliability, and operational flexibility of the electric transmission system.

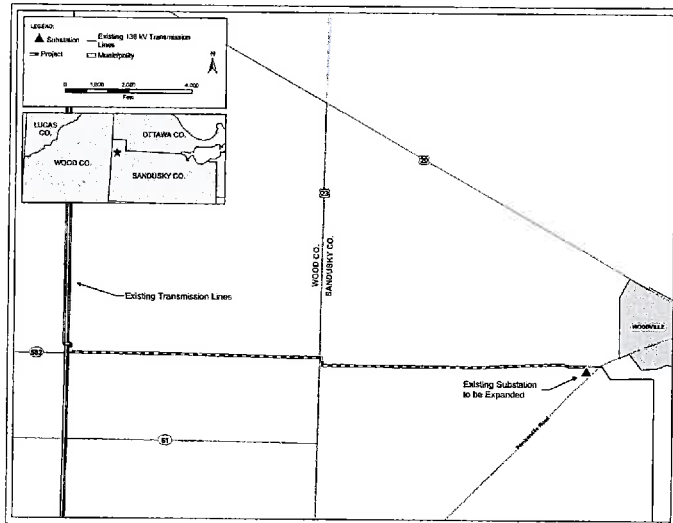

The following public officials and agencies have been served with copies of the Application as required by the Ohio Power Siting Board regulations:

Ms. Kay Reiter, Sandusky County Board of Commissioners
 Mr. Scott Miller, Sandusky County Board of Commissioners
 Mr. Russ Zimmerman, Sandusky County Board of Commissioners
 Mr. Carlos Baz, Sandusky County Engineer's Office
 Ms. Jill Simpson, President of Sandusky County Regional Planning Commission
 Ms. Sandy Yoho, Office Manager of Sandusky County Soil & Water District
 Mr. Ken Green, Woodville Township Trustee
 Mr. Bill Hammer, Woodville Township Trustee
 Mr. Paul Runion, Woodville Township Trustee
 Ms. Lori Kepus, Fiscal Officer of Woodville Township
 Dr. Theodore Bowls, Wood County Board of Commissioners
 Ms. Doris Herringshaw, Wood County Board of Commissioners
 Mr. Craig LaForte, Wood County Board of Commissioners
 Mr. John Musteric, Wood County Engineer's Office
 Mr. Dave Steiner, Director of Wood County Planning Commission
 Mr. Jim Carter, District Administrator of Wood County Soil & Water District
 Mr. Matthew Brinker, Troy Township Trustee
 Mr. Skip Recker, Troy Township Trustee
 Mr. Richard Grewlich Jr., Troy Township Trustee
 Ms. Linda Brinker, Fiscal Officer of Troy Township

A copy of the application is available for public inspection at the offices of the Ohio Power Siting Board, c/o Public Utilities Commission of Ohio, Utilities Department, 12th Floor, Borden Building, 180 East Broad Street, Columbus, Ohio 43215-3793, www.opsb.ohio.gov. A copy of the application has also been sent to the following libraries:

Woodville Public Library, 101 East Main Street, Woodville, Ohio 43468
 Luckey Branch Library, 228 Main Street, Luckey, Ohio 43443

A copy of the application and information on how to request a hard copy of the application can also be found on FirstEnergy's website for transmission projects, www.firstenergycorp.com/about/transmission_project/ohio.html.

A Letter of Notification Application for a certificate to construct, operate, and maintain the above-named electric substation and transmission line facility is now pending before the Board. The Project application has been assigned Docket No. 19-1337-EL-BLN, and this docket number should be referenced in all communications about this proceeding.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-6-08(A)(6), please be advised that interested persons may file motions to intervene and/or file comments with the Board within ten days of the date of publication of this notice, in accordance with OAC Rule 4906-2-12, or later if good cause is shown. Petitions to intervene and comments should be addressed to the Ohio Power Siting Board, 180 East Broad Street, Columbus, Ohio 43215-3793 and cite the above-listed case number 19-1337-EL-BLN.

Honored

From page 1

Reiter served on the Owens Board of Trustees from 1976-1985, which included time serving as chairman of the board from 1979-1981.

He is a founding member of the Owens Community College Foundation, serving from 2002-04, then becoming an emeritus director.

Reiter said he helped change the foundation position from part time to full time.

"It's an important part of my life," he said about Owens. "Every time I could help them, I really tried to do that."

He and his wife Linda, who also was at the meeting, established the Edward and Linda Reiter Endowed Scholarship Fund in 1984, which has been awarded to more than 50 Owens students.

Reiter is retired CEO of the former Bowling Green-based Mid Ann Bank and is a former vice president of the Bowling Green State University alumni board. He also was a member of BGSU's first Distinguished Graduate class and has served on the board at Lourdes University in Sylvania.

"I tried to serve in local education circles that benefited this area," he said.

"My whole life has been helping others," he said.

"The most important thing I think you can do in your life is help others."

The News - Messenger

A GANNETT COMPANY

Media

Advertiser:

FIRST ENERGY-LEGALS
100 S 3RD ST
COLUMBUS, OH 43215

AFFIDAVIT OF PUBLICATION

Newspaper: MCO-Fre-Fremont News Messenger

LEGAL NOTICE
ATTACHED

STATE OF WISCONSIN

RE: Order #: 0001244452

Account#: MCO-0000002368

Total Amount of Claim: \$297.62

I, Forrest Allen, Sales Assistant for the above-mentioned newspaper, hereby
certify that the attached advertisement appeared in said newspaper on the following dates:

09/13/2019


Last Run Date: 09/13/2019

Subscribed and sworn to me this 9 day of September, 2019

Vicky Felty
Notary Public

9-19-21

Notary Expires



Scientists try gene-editing tool to fight HIV

Marilynn Marchione
ASSOCIATED PRESS

Scientists are reporting the first use of the gene-editing tool CRISPR to try to cure a patient's HIV infection by providing blood cells that were altered to resist the AIDS virus.

The gene-editing tool has long been used in research labs, and a Chinese scientist was scolded last year when he revealed he used it on embryos that led to

the birth of twin girls. Editing embryos is considered too risky, partly because the DNA changes can pass to future generations.

Wednesday's report in the New England Journal of Medicine, by different Chinese researchers, is the first published account of using CRISPR to treat a disease in an adult, where the DNA changes are confined to that person.

The attempt was successful in some ways but fell short of being an HIV cure.

Still, it shows that gene editing holds promise and seems precise and safe in this patient so far, said Dr. Carl June, a University of Pennsylvania genetics expert who wrote a commentary in the journal.

"That's really good for the field," June said.

Chinese government grants paid for the research, which was done openly with advance notice on a scientific registry and standard informed consent

procedures. Some of those steps were missing or questioned in last year's embryo work.

"There are no ethical concerns on this one," June said.

Gene editing permanently alters DNA, the code of life. CRISPR is a relatively new tool scientists can use to cut DNA at a specific spot.

Roundup

Continued from Page 3A

behave, and the experiences we create for others. It is the foundation of which our school district is built," stated Patrick Adkins, Superintendent of Schools.

As a result of this first week of school, the culture of the school district is changing and the school district wants to carry this message to parents and the

community.

Adkins added, "Over two years ago, with the backing of our athletic boosters, our schools entered into a partnership with an organization called Focus 3.

Film on Johnson to be shown at festival

FREMONT – A film about a sex scandal that rocked President Lyndon Johnson's re-election bid in 1964 will be

shown this fall at the American Presidents Film & Literary Festival.

"The Original October Surprise," directed by Scott Calosino, is a one of the short films that will be featured at the festival Oct. 4 to Oct. 6, at various locations in Fremont.

A schedule of show times and tickets will be available at americanpresidentsfilmfestival.org.

"The Original October Surprise" examines the first "October Surprise," a sex scandal involving Johnson's closest

aide and how it affected Johnson's re-election campaign.

An October Surprise is a scandal that, whether by design or chance, threatens to destroy a presidential candidate with just weeks to go until Election Day.

This film will be shown during the short film block throughout the weekend at The Strand Concert Theater in downtown Fremont. The block will include five other short films with run times ranging from 7 and a half minutes to 28 minutes.



Is your business keeping up with digital? We'll help you get a clearer picture.

No one knows Central Ohio and reaches your customers in more places and more ways - including search, email, print, mobile, and social media. Media Network of Central Ohio has the right angles to make your business know its best.

Visit OhioMediaSolutions.com



OUR SOLUTION ISN'T JUST ON THE INTERNET. IT IS THE INTERNET.

the job network

Media
network of central ohio


USA TODAY NETWORK

888.592.5510
OhioJobs360.com

NOTICE OF PROPOSED MAJOR UTILITY FACILITY

American Transmission Systems, Incorporated ("ATS"), a FirstEnergy company, has proposed in a Letter of Notification Application submitted to the Ohio Power Siting Board ("Board") for a Certificate of Environmental Compatibility and Public Need to expand the existing Woodville No. 2 substation and convert approximately 3.1 miles of existing 138kV transmission line to double circuit as part of the Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project, ("Project").

The Project is located Woodville Township, Sandusky County and Troy Township, Wood County Ohio. The substation is located at the southwest corner of the intersection of Pemberville Road and OH-582 in Woodville Township, Sandusky County, the substation expansion will be located entirely within existing Toledo Edison owned property. ATS is proposing the Project to improve the efficiency, reliability, and operational flexibility of the electric transmission system.

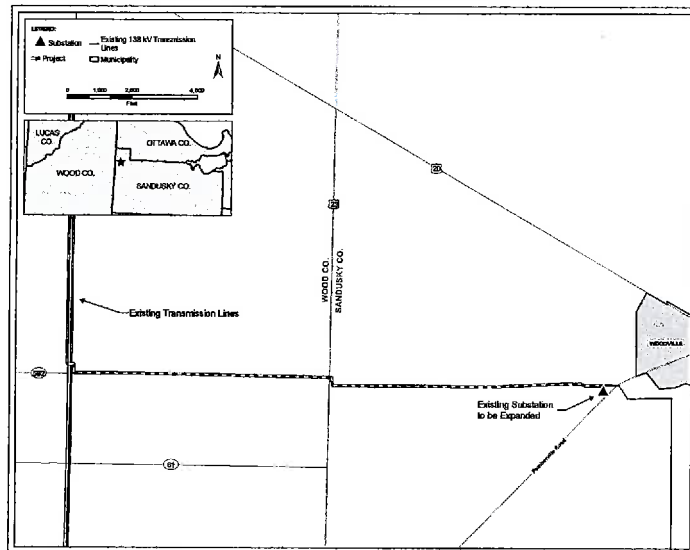

The following public officials and agencies have been served with copies of the Application as required by the Ohio Power Siting Board regulations:

Ms. Kay Reiter, Sandusky County Board of Commissioners
Mr. Scott Miller, Sandusky County Board of Commissioners
Mr. Russ Zimmerman, Sandusky County Board of Commissioners
Mr. Carlos Buz, Sandusky County Engineer's Office
Ms. Jill Simpson, President of Sandusky County Regional Planning Commission
Ms. Sandy Yohe, Office Manager of Sandusky County Soil & Water District
Mr. Ken Green, Woodville Township Trustee
Mr. Bill Hammer, Woodville Township Trustee
Mr. Paul Runion, Woodville Township Trustee
Ms. Lori Kepus, Fiscal Officer of Woodville Township
Dr. Theodore Bowlus, Wood County Board of Commissioners
Ms. Coris Herringshaw, Wood County Board of Commissioners
Mr. Craig LaHole, Wood County Board of Commissioners
Mr. John Musteric, Wood County Engineer's Office
Mr. Dave Steiner, Director of Wood County Planning Commission
Mr. Jim Carter, District Administrator of Wood County Soil & Water District
Mr. Matthew Brinker, Troy Township Trustee
Mr. Skip Recker, Troy Township Trustee
Mr. Richard Greulich Jr., Troy Township Trustee
Ms. Linda Binkler, Fiscal Officer of Troy Township

A copy of the application is available for public inspection at the offices of the Ohio Power Siting Board, c/o Public Utilities Commission of Ohio, Utilities Department, 12th Floor, Borden Building, 180 East Broad Street, Columbus, Ohio 43215-3793, www.opsb.ohio.gov. A copy of the application has also been sent to the following libraries:

Woodville Public Library, 101 East Main Street, Woodville, Ohio 43469
Lucky Branch Library, 228 Main Street, Luckey, Ohio 43443

A copy of the application and information on how to request a hard copy of the application can also be found on FirstEnergy's website for transmission projects, www.firstenergycorp.com/about/transmission_project/ohio.html.

A Letter of Notification Application for a certificate to construct, operate, and maintain the above-named electric substation and transmission line facility is now pending before the Board. The Project application has been assigned Docket No. 19-1337-EL-BLN, and this docket number should be referenced in all communications about this proceeding.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-6-08(A)(6), please be advised that interested persons may file motions to intervene and/or file comments with the Board within ten days of the date of publication of this notice. In accordance with OAC Rule 4906-2-12, or later if good cause is shown. Petitions to intervene and comments should be addressed to the Ohio Power Siting Board, 180 East Broad Street, Columbus, Ohio 43215-3793 and cite the above-listed case number 19-1337-EL-BLN.

EXHIBIT 1
Officials Served Copy of Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Sandusky County

Ms. Kay Reiter
Sandusky County Commissioner
622 Croghan Street
Fremont, OH 43420

Mr. Carlos Baez, P.E., P.S.
Sandusky County Engineer
2500 West State Street
Fremont, OH 43420

Mr. Scott Miller
Sandusky County Commissioner
622 Croghan Street
Fremont, OH 43420

Ms. Jill Simpson, President
Sandusky County Regional
Planning Committee
108 South Park Avenue
Fremont OH, 43420

Mr. Russ Zimmerman
Sandusky County Commissioner
622 Croghan Street
Fremont, OH 43420

Ms. Sandy Yohe, Office Manager
Sandusky County Soil & Water
District
2000 Countryside Drive, Suite A
Fremont, OH 43420

Woodville Township

Mr. Ken Green, Trustee
Woodville Township
321 East Main Street
P.O. Box 121
Woodville, OH 43469

Mr. Paul Runion, Trustee
Woodville Township
321 East Main Street
P.O. Box 121
Woodville, OH 43469

Mr. Bill Hammer, Trustee
Woodville Township
321 East Main Street
P.O. Box 121
Woodville, OH 43469

Ms. Lori Kepus, Fiscal Officer
Woodville Township
321 East Main Street
P.O. Box 121
Woodville, OH 43469

Wood County

Dr. Theodore Bowlus
Board of County Commissioners
One Courthouse Square, 5th Floor
Bowling Green, OH 43402

Ms. Doris Herringshaw
Board of County Commissioners
One Courthouse Square, 5th Floor
Bowling Green, OH 43402

Mr. Craig LaHote
Board of County Commissioners
One Courthouse Square, 5th Floor
Bowling Green, OH 43402

Mr. John Musteric
Wood County Engineer's Office
One Courthouse Square, 5th Floor
Bowling Green, OH 43402

Troy Township

Mr. Matthew Brinker, Trustee
Troy Township
4707 Dowling Road
Perrysburg, OH 43551

Mr. Skip Recker, Chairman
Troy Township
1651 Ottawa Road
Genoa, OH 43430

Libraries

Luckey Branch Library
Ms. Susan Titkemeier, Director
228 Main Street
Luckey, OH 43443

Mr. Dave Steiner, Director
Wood County Planning Commission
One Courthouse Square, 5th Floor
Bowling Green, OH 43402

Mr. Jim Carter, District Admin.
Wood County Soil & Water District
1616 E. Wooster Street, Suite 32
Bowling Green, OH 43402

Mr. Richard Greulich Jr., Trustee
Troy Township
23445 Stony Ridge Road
Perrysburg, OH 43551

Ms. Linda Biniker, Fiscal Officer
Troy Township
5929 Fremont Pike
P.O. Box 205
Stony Ridge, OH 43463

Woodville Public Library
Ms. Pam Hoesman, Director
101 East Main Street
Woodville, OH 43469

September 9, 2019

Ms. Kay Reiter
Sandusky County Commissioner
622 Croghan Street
Fremont, OH 43420

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Ms. Reiter,

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Mr. Scott Miller
Sandusky County Commissioner
622 Croghan Street
Fremont, OH 43420

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Mr. Miller,

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Mr. Russ Zimmerman
Sandusky County Commissioner
622 Croghan Street
Fremont, OH 43420

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Mr. Zimmerman,

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Mr. Carlos Baez, P.E., P.S.
Sandusky County Engineer
2500 West State Street
Fremont, OH 43420

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Mr. Baez,


American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Ms. Jill Simpson, President
Sandusky County Regional Planning Committee
108 South Park Avenue
Freemont OH, 43420

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Ms. Simpson,

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Ms. Sandy Yohe, Office Manager
Sandusky County Soil & Water District
2000 Countryside Drive, Suite A
Fremont, OH 43420

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Ms. Yohe,


American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,

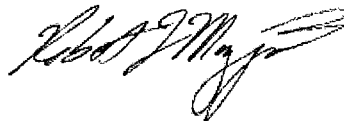

Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Mr. Ken Green, Trustee, Woodville Township
321 East Main Street
P.O. Box 121
Woodville, OH 43469

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Mr. Green,

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Mr. Bill Hammer, Trustee, Woodville Township
321 East Main Street
P.O. Box 121
Woodville, OH 43469

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Mr. Hammer,

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Mr. Paul Runion, Trustee, Woodville Township
321 East Main Street
P.O. Box 121
Woodville, OH 43469

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Mr. Runion,

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Ms. Lori Kepus, Fiscal Officer, Woodville Township
321 East Main Street
P.O. Box 121
Woodville, OH 43469

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Ms. Kepus,

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Dr. Theodore Bowlus
Board of County Commissioners
One Courthouse Square, 5th Floor
Bowling Green, OH 43402

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Dr. Bowlus,

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Mr. Craig LaHote
Board of County Commissioners
One Courthouse Square, 5th Floor
Bowling Green, OH 43402

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Mr. LaHote,

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Mr. John Musteric
Wood County Engineer's Office
One Courthouse Square, 5th Floor
Bowling Green, OH 43402

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Mr. Musteric,

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Ms. Doris Herringshaw
Board of County Commissioners
One Courthouse Square, 5th Floor
Bowling Green, OH 43402

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Ms. Herringshaw,

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Mr. Dave Steiner, Director
Wood County Planning Commission
One Courthouse Square, 5th Floor
Bowling Green, OH 43402

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Mr. Steiner,

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Mr. Jim Carter, District Admin.
Wood County Soil & Water District
1616 E. Wooster Street, Suite 32
Bowling Green, OH 43402

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Mr. Carter,

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Mr. Matthew Brinker, Trustee
Troy Township
4707 Dowling Road
Perrysburg, OH 43551

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Mr. Brinker,

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Mr. Skip Recker, Chairman
Troy Township
1651 Ottawa Road
Genoa, OH 43430

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Mr. Recker,

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Mr. Richard Greulich Jr., Trustee
Troy Township
23445 Stony Ridge Road
Perrysburg, OH 43551

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Mr. Greulich,

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Ms. Linda Biniker, Fiscal Officer, Troy Township
5929 Fremont Pike
P.O. Box 205
Stony Ridge, OH 43463

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Ms. Biniker,

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, has filed with the Public Utilities Commission of Ohio, Docketing Division, a Letter of Notification application for a Certificate of Environmental Compatibility and Public Need to construct the Fostoria West End (AEP) – Lemoyne – West Fremont 138kV Transmission Line and Woodville No. 2 Substation Upgrade Project. This Project will improve the transmission system in the Project area as described in more detail in the application.

In the Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to facilitate the installation of new equipment and eliminating a four-terminal transmission line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of the existing 138kV transmission line from single circuit to double circuit from AEP West End Transmission Line to the Woodville No. 2 Substation. The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification application. Therefore, in compliance with OAC 4906-6, we have prepared and filed the attached Letter of Notification application with the OPSB for their review and approval. The Letter of Notification application contains a description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

September 9, 2019

Luckey Branch Library
Ms. Susan Titkemeier, Director
228 Main Street
Luckey, OH 43443

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Dear Ms. Titkemeier,

Enclosed please find one copy of the Letter of Notification application of American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, for the Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission Line and Woodville No.2 Substation Upgrade Project ("Project") that has been filed with the Ohio Power Siting Board ("OPSB"). Please make the Letter of Notification application available for public reference in the Woodville Public Library.

We are providing a copy of the Letter of Notification application for placement in your library in response to the requirements of the Ohio Administrative Code ("OAC") Section 4906-6-07(A)(2), which requires us to place a copy of the Letter of Notification application in the main public libraries of the political subdivisions in which any portion of the Project is to be located.

In this Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to convert the substation to a five (5) breaker ring bus and to eliminate the existing Fostoria West End (AEP)-Lemoyne-West Fremont four-terminal line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of Fostoria West End (AEP)-Lemoyne-West Fremont 138 kV line from single circuit to double circuit. The Project will improve the transmission system in the Project area.

The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

Please feel free to call me with any question you have on making the Letter of Notification application available to your patrons. My phone number is (330) 384-2743.

Sincerely,



Robert Maggiore
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

Enclosure

September 9, 2019

Woodville Public Library
Ms. Pam Hoesman, Director
101 East Main Street
Woodville, OH 43469

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission
Line and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

Dear Ms. Hoesman,

Enclosed please find one copy of the Letter of Notification application of American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, for the Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission Line and Woodville No.2 Substation Upgrade Project ("Project") that has been filed with the Ohio Power Siting Board ("OPSB"). Please make the Letter of Notification application available for public reference in the Woodville Public Library.

We are providing a copy of the Letter of Notification application for placement in your library in response to the requirements of the Ohio Administrative Code ("OAC") Section 4906-6-07(A)(2), which requires us to place a copy of the Letter of Notification application in the main public libraries of the political subdivisions in which any portion of the Project is to be located.

In this Project, ATSI proposes the expansion of the existing Woodville No. 2 138kV Substation to convert the substation to a five (5) breaker ring bus and to eliminate the existing Fostoria West End (AEP)-Lemoyne-West Fremont four-terminal line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of Fostoria West End (AEP)-Lemoyne-West Fremont 138 kV line from single circuit to double circuit. The Project will improve the transmission system in the Project area.

The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

Please feel free to call me with any question you have on making the Letter of Notification application available to your patrons. My phone number is (330) 384-2743.

Sincerely,



Robert Maggioro
Transmission Specialist II
Energy Delivery
Transmission and Substation Design
FirstEnergy Service Company

Enclosure

283000000404	AHRENS, SHERRI L	7163 SR 582	WOODVILLE	OH	43469
283000001500, 283000000100	AMERICAN TITLE AGENCY INC	19410 DUNBRIDGE RD	BOWLING GREEN	OH	43402
U69-612-260000003000	AVERS DALE J TRUSTEE	2873 MIDDLETON PK	LUCKEY	OH	43443
U69-612-250000020000	BALLARD THOMAS A	1791 MIDDLETON PIKE	LUCKEY	OH	43443
283000000403	BANKEY, TROY W & JENNIFER L	3868 CR 16	WOODVILLE	OH	43469
283000000409	BAUMGARTNER STEVEN A & KIMBERLY A	7214 SR 582	WOODVILLE	OH	43469
U69-612-250000016000	BELLA JOHN H & JOYCE A	3902 PLUMEY RD	NORTHWOOD	OH	43619
283000001006	BORCHERDING, JAMES L & MONA M	7479 SR 582	WOODVILLE	OH	43469
283000000900, 282900001800	BOWEN, DONALD L & BONNIE J	669 PEMBERVILLE RD	WOODVILLE	OH	43469
283000001004	BRASSARD, SANDRA & SCHULTE, TODD	7441 SR 582	WOODVILLE	OH	43469
U69-612-230000044000, U69-612-250000000000	BROWN DALE R & DIANE M	17441 CARTER RD	BOWLING GREEN	OH	43402
U69-612-260000022000	BRUNNET CLAYTON G	2071 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-260000015000, U69-612-260000000000	BURKE TODD J & BURKE SARAH A	2262 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-260000010000	CARTER RICHARD A & SANDRA R	2450 MIDDLETON PIKE	LUCKEY	OH	43443
283000000410	CHAGNON, JAMES A & MARGARET BAKER	7192 SR 582	WOODVILLE	OH	43469
283000001007	CHESNUTTE, RODNEY S & SCHULTZ, DEBORAH S	7501 SR 582	WOODVILLE	OH	43469
283000000902	CLARK, GERALD E & KARCHER-CLARK, MICHELE R	7385 ST RT 582	WOODVILLE	OH	43469
U69-612-250000001005	CLEVELAND KELLY	1110 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-250000032005	CONRAD SCOTT & NAGY KRISTINA	1197 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-250000010503	COUCH JAMES H JR & SHARON K	1776 MIDDLETON PIKE	LUCKEY	OH	43443
283000001501	CROUSE, PAUL W & ROGER P	2922 BAYS RD	RISINGSUN	OH	43457
306000002900	DAVIES, R NIGEL & TRUDY E	PO BOX 596	PEMBERVILLE	OH	43450
283000000301, 283000000407, 283000000000	DEITEMEYER TINA M	3990 CR 16	WOODVILLE	OH	43469
U69-612-250000007000, U69-612-250000000000	EDDINGTON MARK & EDDINGTON EMILY	20612 BRADNER RD	LUCKEY	OH	43443
281900000400	EF DISTRIBUTION 2 LLC & EF DISTRIBUTION 3 LLC	23842 CR 2	WOODVILLE	OH	43469
U69-612-250000019002	FROELICH RAYMOND J	1831 MIDDLETON PIKE	LUCKEY	OH	43443
283000000406	GENTRY, BRIAN S & TRACI A	3900 CR 16	WOODVILLE	OH	43469
U69-612-250000018000	GILSON ERIC R & ALISHA M	1551 MIDDLETON PIKE	LUCKEY	OH	43443
282900001300	GREEN, STEVEN E & DREA H L	1367 W MAIN ST	WOODVILLE	OH	43469
U69-612-250000019003	GREULICH KENNETH E & SUSAN J	1745 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-230000026000	GRIFFITH JAY E & JENNIFER L	21221 BRADNER RD	LUCKEY	OH	43443
283000001011	GRIMM RICHARD D & SHOEMAKER,	27696 OREGON LOT 22	PERRYSBURG	OH	43551
U69-612-250000001001	HAAR RICHARD A & DEBRAH	1226 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-260000026000	HARDY DONALD G & SUZANNE E	2355 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-260000017000, U69-612-260000000000	HARPEL LUCAS M & ASHLEY M	2240 MIDDLETON PIKE	LUCKEY	OH	43443
283000000405	HARRINGTON TIMOTHY D & MICHELE ANN	7180 SR 582	WOODVILLE	OH	43469
U69-612-250000032000	HARTLEY PAMELA L & BRANDEL THERESA A	PO BOX 293	MOUNTAIN VIEW	MO	65548
U69-612-250000032004	HARTLEY PAMELA L & BRANDEL THERESA A	1037 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-260000029002, U69-612-260000000000	HEISE CLAIR H	2455 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-250000006000	HIRZEL LIZABETH JO TRUSTEE	20658 BRADNER RD	LUCKEY	OH	43443
U69-612-250000012000, U69-612-250000000000	HOLLIDAY EDGAR & JUDITH	430 W SMITH ST	GIBSONBURG	OH	43431
U69-612-260000021000, U69-612-260000000000	HOWARD M BELINDA	2055 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-250000019001	HUSS ALLAN P & GACKSTETTER ASHLEY M	1396 W MAIN ST	WOODVILLE	OH	43469
282900000902	HUSS DAIRY LLC	1220 PEMBERVILLE RD	WOODVILLE	OH	43469
U69-612-250000014000, U69-612-250000000000	HUSS SUSAN KAY	1442 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-260000029510	JACKSON KEITH A & PATRICIA A	2443 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-260000050000, U69-612-260000000000	JACOBS JEFF	9440 SEAMAN RD	CURTICE	OH	43412
282900000504	KELLEY, KRISTA L	6821 SR 582	WOODVILLE	OH	43469
282900000502	KELLEY, ROBERT E & LINDA M	6833 SR 582	WOODVILLE	OH	43469
282900000500, 282900000800	KONESKY, VERA J	842 PEMBERVILLE RD	WOODVILLE	OH	43469
U69-612-260000001500, U69-612-260000000000	KRISTON ANDREW & GAYLE	20565 BRADNER RD	LUCKEY	OH	43443
U69-612-250000009000, U69-612-250000000000	KROTZER RICHARD E	1980 MIDDLETON PIKE	LUCKEY	OH	43443
283000001005	KRUSE, KEITH E & AMY J	PO BOX 96	WOODVILLE	OH	43469
U69-612-250000033000	LAWNICZAK JOSEPH & PATRICIA A	20673 FOSTORIA RD	LUCKEY	OH	43443
U69-612-260000004501	LEJEUNE DAVID A	20990 PEMBERVILLE RD	LUCKEY	OH	43443
283000000200	LEKING, CHRISTOPHER G	1113 GIBSONBURG RD	BRADNER	OH	43406
U69-612-260000004500	LINKEY MARILYN J & KENNETH E JR TRUSTEES	19381 BRADNER RD	PEMBERVILLE	OH	43450
U69-612-260000025000	LOWE RAYMOND M & SUSAN R	2195 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-250000032003	MASON ERIC D & ROXANNE N	1217 MIDDLETON PIKE	LUCKEY	OH	43443
283000000101	MASON, GAROLD D & LINDA ANN	20770 FOSTORIA RD	LUCKEY	OH	43443
U69-612-260000009500	MCBRIDE ETHAN	2728 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-260000048000, U69-612-260000000000	MESSER KAREN M	20545 BRADNER RD	LUCKEY	OH	43443
283000000400	MICHAELIS, STEVEN R & LUANNE M	3926 CR 16	WOODVILLE	OH	43469
283000000700, 283000000500, 283000000000	MICKEY, ANN; DEJANOVICH, JUDY & SHEFFER, SUSAN	7081 SR 582	WOODVILLE	OH	43469
U69-612-250000032001	MIESLE KRISTY L	20381 FOSTORIA RD	WOODVILLE	OH	43469
U69-612-260000031000	MILLER GARWIN B	2597 MIDDLETON PK	LUCKEY	OH	43443
283000001010	MILLERSCHONE, KENNETH C & JENNIFER L	1095 BENT CREEK DR	ST. JOHNS	FL	32259
U69-612-260000002001	MONHOLLEN DUSTIN & NICOLE	20909 BRADNER RD	LUCKEY	OH	43443
282900000200	MORAN, PETER L	4912 SKELLY RD	TOLEDO	OH	43623
U69-612-250000030000	MORITZ BETTY L	13 DRBA WAY	NEW CASTLE	DE	19720
U69-612-250000002000	MORITZ BETTY L / MORITZ JOHN A	13 DRBA WAY	NEW CASTLE	DE	19720
U69-612-260000027000	MORRIS THOMAS E	2403 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-250000013000	MUNDRICK DANIEL J & ASHLEY N	1458 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-250000001008	MYERS LOREN D	1050 MIDDLETON PIKE	LUCKEY	OH	43443
282900000600	NEDELCO, JEFF & MIGLIORI, DONNA	6845 W SR 582	WOODVILLE	OH	43469
U69-612-250000003000	NORTHWOOD REALTY	427 W DUSSELL DR SUTE 337	MAUMEE	OH	43537
U69-612-260000011000, U69-612-260000000000	OBERHOUSE STEVEN R & DEBORAH L	2354 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-250000002000	OGDEN AVE PROPERTIES LLC	29407 BELMONT LAKE RD	PERRYSBURG	OH	43551
283000001008	OSBORNE, DAVID J II & DANIELLE L	7515 SR 582	WOODVILLE	OH	43469
283000001009	OVERLY, TIMOTHY & MICHELLE	7555 SR 582	WOODVILLE	OH	43469
U69-612-260000009000, U69-612-260000000000	PERRY THOMAS E & COLLEEN E	2606 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-250000010501	POIRY LAWRENCE & CHRISTIE	326 HARDING AVE	NORTHWOOD	OH	43619
U69-612-250000001006	PREY DONALD G & PATRICIA A	1166 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-260000051000	PROCHASKA ANTHONY F	20735 BRADNER RD	LUCKEY	OH	43443
U69-612-260000009002	RADABAUGH MARK R & PAULA S	2670 MIDDLETON PIKE	LUCKEY	OH	43443

U69-612-24000006000	RADELOFF ROGER L & RENALD F	820 BARKER RD	FREMONT	OH	43420
281900000600	RELE FARMS LLC	23842 CR 2	WOODVILLE	OH	43469
U69-612-260000046000	RENTZ WILLIAM O & SUSAN L	20533 BRADNER RD	LUCKEY	OH	43443
U69-612-260000019000	RICHARDSON JAMES J & ANNETTE L	2196 MIDDLETON PIKE	LUCKEY	OH	43443
283000000903	RICHIE, WILLIAM G SR & KATHY A	7407 SR 582	WOODVILLE	OH	43469
283000000401	ROOD, JEFFERY P & KAREN	7150 SR 582	WOODVILLE	OH	43469
U69-612-260000031001, U69-612-2600000	ROSS MARK R & MARCIA L	2545 MIDDLETON PIKE	LUCKEY	OH	43443
283000000901	SCHEANWALD, MARTIN J & LISA D	7433 SR 582	WOODVILLE	OH	43469
282900001002	SHEFFER, CAROL; DEJANOVICH, JUDITH; MICKEY, A	7081 SR 582	WOODVILLE	OH	43469
U69-612-250000010502	SHELDRIK ALEXIS L & JACOB M	1832 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-250000001004	STEWART KEITH & SUMMER	20679 FOSTORIA RD	LUCKEY	OH	43443
U69-612-250000021000	STOLL MICHAEL WILLIAM	20360 BRADNER RD	PEMBERVILLE	OH	43450
282000000600, 282000000700	STOLLER, TODD A & PAMELA S	4824 ROAD 71	PAYNE	OH	45880
283000000402	TIPTON, SUSAN J	7138 SR 582	WOODVILLE	OH	43469
U69-612-250000010504	TRESSEL TIMOTHY J & SUSAN M	1738 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-250000017000	VAN DENK ERIC& REBECCA S	1525 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-260000024000, U69-612-2600000	VESTAL DOUGLAS ROBERT	2109 MIDDLETON PIKE	LUCKEY	OH	43443
283000000300	VIMAR LLC	7310 W CAMPER RD	WOODVILLE	OH	43469
281900000300	WASSERMAN, THEODORE L & JANICE M	21440 FOSTORIA RD	LUCKEY	OH	43443
U69-612-260000002000, U69-612-2600000	WEAVER BRENT A	20767 BRADNER RD	LUCKEY	OH	43443
U69-612-260000025511	YORK KENNETH F & KANDACE G	2273 MIDDLETON PIKE	LUCKEY	OH	43443
U69-612-230000028000, U69-612-2300000	YOUNG DONALD W & YOUNG MARCIA L	2330 JOSEPH RD	LUCKEY	OH	43443

[Date]

<Property Owner Name>

<Address>

<City>, <State> <Zip>

Re: Parcels: <Parcel Number(s)>

Letter of Notification
Fostoria West End (AEP)-Lemoyne-West Fremont 138kV Transmission Line
and Woodville No. 2 Substation Upgrade Project
Case No. 19-1337-EL-BLN

To <Property Owner Name>,

American Transmission Systems, Incorporated (“ATSI”), a FirstEnergy company, has recently filed a Letter of Notification application with the Ohio Power Siting Board (“Board”) for approval to expand the existing Woodville No. 2 138kV Substation to convert the substation to a five (5) breaker ring bus and to eliminate the existing Fostoria West End (AEP)-Lemoyne-West Fremont four-terminal line configuration. The existing Woodville No. 2 138kV Substation is proposed to expand by 223% to facilitate the installation of new equipment. This Project will also involve replacing structures and rebuilding a 3.1-mile section of Fostoria West End (AEP)-Lemoyne-West Fremont 138kV line from single circuit to double circuit. The Project is needed to improve the operation of the electric transmission system in your area.

The Project will be located in Woodville Township, Sandusky County, Ohio and Troy Township, Wood County, Ohio.

In accordance with Ohio Administrative Code (“OAC”) Rule 4906-1-01, this Project falls within the Board’s requirements for a Letter of Notification application. This letter is being sent to you in compliance with OAC Rule 4906-6-08(A) to inform you that we have prepared and filed a Letter of Notification application to construct, operate, and maintain the Project and that application is now pending before the Board.

The application contains a description of the Project, and can be view at the following public locations:

Woodville Public Library, 101 East Main Street, Woodville, OH 43469
Luckey Branch Library, 228 Main Street, Luckey, OH 43443

A copy of the application is also available for public inspection at the offices of the Ohio Power Siting Board, c/o Public Utilities Commission of Ohio, Utilities Department, 12th Floor, Borden Building, 180 East Broad Street, Columbus, Ohio 43215-3793, or on the website of the Board: www.opsb.ohio.gov.

The Board can also be reached via email at: contactOPSB@puc.state.oh.us.

Finally, a copy of the Letter of Notification application will be posted on FirstEnergy's website at www.firstenergycorp.com/about/transmission_project/ohio.html along with information on how to request a hard copy of the application, if you wish to order one.

In accordance with OAC Rule 4906-6-08(A)(6), please be advised that interested persons may file motions to intervene and/or comments with the Board within ten days of the date of the publication of the public notice of the filing of this Project with the Board, in accordance with OAC Rule 4906-2-12, or later if good cause is shown. Petitions to intervene and comments should be addressed to the Ohio Power Siting Board, 180 East Broad Street, Columbus, Ohio 43215-3793 and reference Case No. 19-1337-EL-BLN.

Please note that the Project has been assigned Case No. 19-1337-EL-BLN by the Board, and this case number should be referenced in all communications regarding this Project.

If you have any questions concerning the Project, I will be happy to answer them. You can contact me at the transmission projects hotline number 1-800-589-2837 or by email at transmissionprojects@firstenergycorp.com. The Project name and Case Number (19-1337-EL-BLN) should be referenced in all communications.

Sincerely,

A handwritten signature in black ink, appearing to read "Robt J Maggiore". The signature is fluid and cursive, with a large, stylized "M" at the end.

Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

10/23/2019 3:51:21 PM

in

Case No(s). 19-1337-EL-BLN

Summary: Proof of Pub of Newspaper Notices and Public Notice Letters for Project
electronically filed by Mr. Robert J Schmidt on behalf of American Transmission Systems Inc.