

October 23, 2019

Ms. Tanowa Troupe
Secretary
Docketing Division
The Public Utilities Commission of Ohio
180 East Broad Street
Columbus, OH 43215-3793

**Letter of Notification for the
Napoleon-Richland-Stryker 138 kV Transmission Line
Open Arm Project
Case No. 19-1765-EL-BLN**

Dear Ms. Troupe:

Attached please find copies of the notice letters to public officials and libraries and each owner of a property crossed and/or adjacent to the preferred and alternative routes. These letters are being docketed in accordance with OAC Rule 4906-6-08(A) as proof of publication.

The letters were mailed via US Postal Service First Class Mail on October 9, 2019 to each of the addressees listed in the attached Exhibit 1 and Exhibit 2.

In addition, the proof of publications on October 8, 2019, in the Bryan Times and the Northwest Signal newspapers are enclosed.

Should the Ohio Power Siting Board desire further information or discussion of this submittal, please contact me at 330-384-2526.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

cc: J. O'Dell



STATE OF OHIO
COUNTY OF WILLIAMS

Christopher Cullis, being first duly sworn, says that he is the Publisher of The Bryan Times, a daily newspaper, published and of general circulation in the county of Williams aforesaid, and that the annexed notice was published in one issue in said paper, publishing on the 8th day of October, 2019



Christopher Cullis

Subscribed and sworn to before me this 8th day of October 2019.



Notary Public

Ramona L. Engelberth

RAMONA L. ENGELBERTH
NOTARY PUBLIC, STATE OF OHIO
DEFIANCE COUNTY
My Commission Expires 7/11/2022

PRINTER'S FEE \$733.60

Judge says New York prosecutors can see Trump’s tax returns

By LARRY NEUMEISTER
Associated Press

NEW YORK — With President Donald Trump under siege on Capitol Hill, a federal judge dealt him a setback on another front Monday and ruled that New York City prosecutors can see his tax returns for an investigation into matters including the payment of hush money to porn star Stormy Daniels and a Playboy centerfold.

U.S. District Judge Victor Marrero emphatically rejected Trump’s attempt to keep his financial records under wraps, calling the president’s broad claim of immunity from all criminal proceedings “extraordinary” and “an overreach of executive power” at odds with the Constitution.

For now, at least, the tax returns remain beyond the reach of prosecutors. The president’s lawyers appealed the judge’s ruling to the 2nd U.S. Circuit Court of Appeals, which put the matter on hold while it considers the case on an expedited basis.

At issue is a request from Manhattan District Attorney Cyrus R. Vance Jr. that Trump’s accounting firm

turn over eight years’ worth of his business and personal tax returns dating back to 2011.

Vance, a Democrat, is investigating payments made to buy the silence of Daniels and model Karen McDougal, both of whom claimed to have had affairs with the president.

“The Radical Left Democrats have failed on all fronts,” Trump fumed on Twitter after the judge’s ruling, “so now they are pushing local New York City and State Democrat prosecutors to go get President Trump. A thing like this has never happened to any President before. Not even close!”

The district attorney’s office declined to comment.

The investigation is unfolding with Trump already facing a fast-moving impeachment drive by House Democrats that was set off by his attempts to get Ukraine’s leader to investigate his political rival Joe Biden.

Trump’s lawyers have said that Vance’s investigation is politically motivated and that the request for tax records should be stopped because Trump is immune from any criminal probe as

long as he is president.

The judge swept that claim aside as overly broad.

“As the court reads it, presidential immunity would stretch to cover every phase of criminal proceedings, including investigations, grand jury proceedings and subpoenas, indictment, prosecution, arrest, trial, conviction, and incarceration,” Marrero wrote. “That constitutional protection presumably would encompass any conduct, at any time, in any forum, whether federal or state, and whether the President acted alone or in concert with other individuals.”

The judge said he couldn’t accept that legal view, “especially in the light of the fundamental concerns over excessive arrogation of power” that led the founding fathers to create a balance of power among the three branches of government.

Trump has steadfastly refused to make his tax returns public, breaking a tradition set by presidents and White House candidates decades ago. He has also gone to court to fight congressional subpoenas issued to his bank for various personal financial records, including his tax returns. That dispute is also before the federal appeals court.

In yet another effort to pry loose Trump’s tax records, California recently passed a law requiring candidates for president or governor to turn over five years’ worth of returns, or else they cannot appear on the state’s primary ballot. A federal judge blocked the law this month, saying it is probably unconstitutional.

Vance began his probe after federal prosecutors in New York completed their investigation into payments that Trump’s former personal lawyer, Michael Cohen, arranged to be made to the two women to keep them silent during the presidential race.

Cohen is serving a three-year prison sentence for crimes that included campaign finance violations in connection with the hush money.

Trump was never charged, though prosecutors said publicly that he was aware of and directed the illegal payments. Justice Department policy has long been that sitting presidents cannot be charged criminally.

Grand jury proceedings and records in New York are secret. If Vance gains access to Trump’s returns through a grand jury investigation, that doesn’t necessarily mean their contents will be disclosed publicly.

It is unclear what Trump’s returns might have to do with the criminal investigation or why prosecutors are reaching back as far as 2011.

But the long reach of the subpoena might stem in part from testimony Cohen gave to Congress early this year when he asserted that Trump overstated his wealth to financial institutions before he became president.

Cohen turned over copies of financial statements he said the president provided to Deutsche Bank during a 2014 effort to buy the Buffalo Bills. The statements showed Trump’s net worth soaring from \$4.55 billion in 2012 to \$8.66 billion in 2013.

Despite fall, former President Carter helps build home

By TRAVIS LOLLER

NASHVILLE, Tenn. (AP) — With a bandage above his left eye and a large, red welt below it, former President Jimmy Carter was greeted by a cheering crowd Monday morning as he prepared to help build a home with Habitat for Humanity in Nashville.

Carter fell at home on Sunday, requiring 14 stitches, but he did not let his injuries keep him from participating in his 36th building project with the nonprofit Christian housing organization. He turned 95 last Tuesday, becoming the first U.S. president to reach that milestone.

Before construction began, Carter led a morning devotion for a group of several hundred volunteers.

He walked slowly across the uneven, muddy ground to the stage helped by a cane and several people who were nearby to steady him. Once seated, Carter, who still teaches Sunday school twice a month at Maranatha Baptist Church in Plains, Georgia, spoke in a clear voice, peppering his inspirational message with jokes.

He spoke about Jesus’ brother James who taught that “if your life is not filled with peace, joy and thanksgiving, it’s your fault.”

Carter said God gives us life and freedom. “With our freedom, every one of us can make a basic decision. ... ‘What kind of person do I,



Former President Jimmy Carter. AP Photo/Mark Humphrey

myself, choose to be?’”

Carter said every person “can be a complete success in the eyes of God.”

Speaking about what makes a successful life, Carter reminded the crowd that Jesus was poor, and died young, abandoned by his closest friends.

“But Jesus lived a perfect life because he followed the will of God,” Carter said.

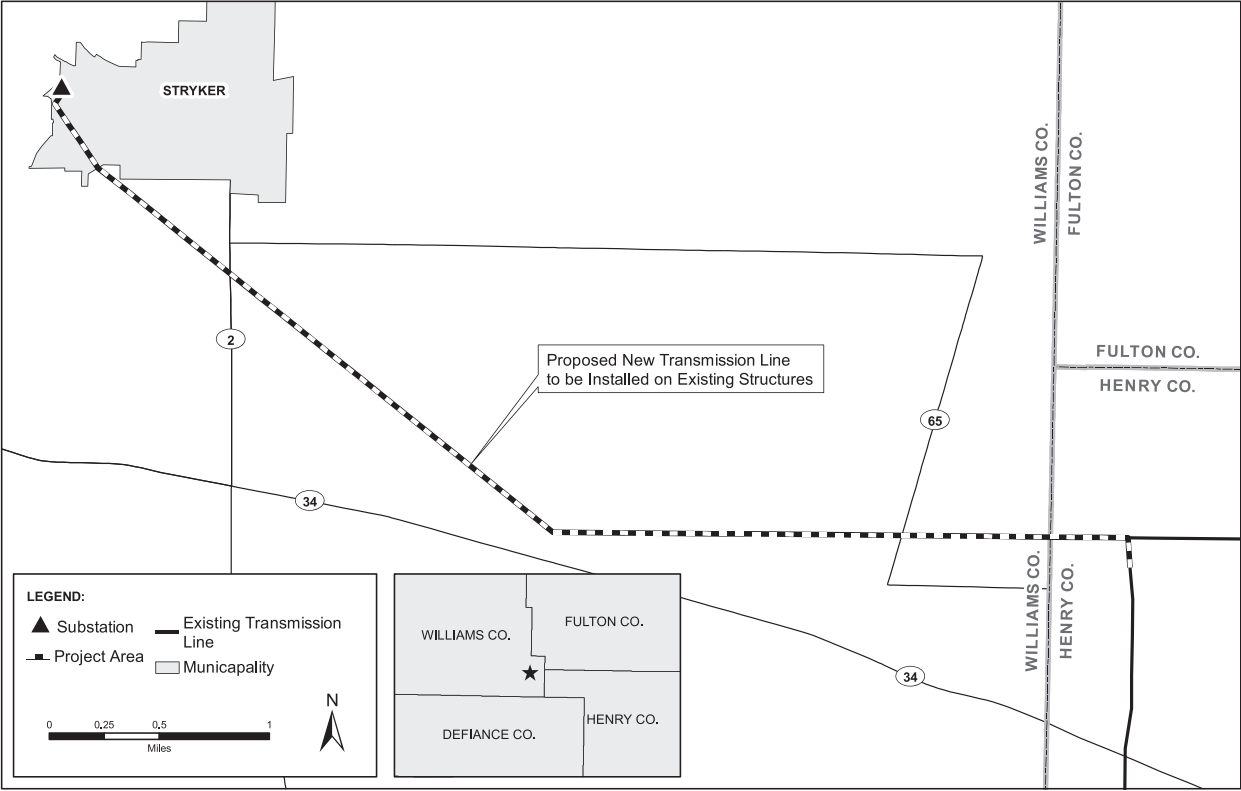
Joining Carter at the building site on Monday were former First Lady Rosalynn Carter; husband and wife country music stars Garth Brooks and Trisha Yearwood; and Tennessee Gov. Bill Lee and First Lady Maria Lee.

The Carters worked on building corbels, a type of support bracket, for one of 21 homes that will be constructed in Nashville this week during the Jimmy and Rosalynn Carter Work Project.

NOTICE OF PROPOSED MAJOR UTILITY FACILITY

American Transmission Systems, Incorporated (“ATSI”), a FirstEnergy company, proposes to construct Napoleon-Richland-Stryker 138 kV Transmission Line Open Arm Project (“Project”), in a Letter of Notification Application submitted to the Ohio Power Siting Board (“Board”) for a Certificate of Environmental Compatibility and Public Need.

In this Project, ATSI is proposing to construct an approximately 5.7-mile transmission line utilizing the open tower arms on the existing Napoleon-Richland-Stryker 138 kV Transmission Line to create a loop to Stryker Substation and eliminate the current three-line terminal configuration. The new lines will be the Richland-Stryker 138 kV Transmission Line and the Napoleon-Stryker 138 kV Transmission Line. This Project also proposes to add a new shield wire, add equipment to Stryker Substation for the new line exit, and install one new structure in existing Toledo Edison right-of-way to accommodate the new line arrangement. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.



The following public officials and agencies have been served with copies of the Application as required by the Ohio Power Siting Board regulations:

Mr. Terry Rummel, Williams County Board of Commissioners
Mr. Lewis Hilkert, Williams County Board of Commissioners
Mr. Brian Davis, Williams County Board of Commissioners
Mr. Todd Roth, P.E., P.S., Williams County Engineer’s Office
Mr. Dennis Miller, Williams County Regional Planning Commission
Mr. Chris Dancer, District Administrator, Williams County Soil & Water District
Mr. Ed Ruffer, Trustee, Springfield Township Trustee
Mr. Rusty Goebel, Springfield Township Trustee
Mr. Steve Planson, Springfield Township Trustee
Ms. Patti Rosebrock, Springfield Township Fiscal Officer
Mr. Joe Beck, Mayor, Village of Stryker
Mr. Alan Riegsecker, Village of Stryker Administrator
Ms. Beth Rediger, Village of Stryker Fiscal Officer
Mr. Wesley White, Village of Stryker Public Works
Mr. Tom VonDeylen, Henry County Board of Commissioners
Mr. Glenn Miller, Henry County Board of Commissioners
Mr. Robert Hastedt, Henry County Board of Commissioners
Mr. Tim Schumm P.E., P.S., Henry County Engineer’s Office
Mr. Nicholas Rettig, Henry County Regional Planning Commission Director
Mr. Bob George, Henry County Soil & Water District Administrator
Mr. Carlos Grieser, Trustee, Ridgeville Township Officials
Ms. Peggy Yoder, Ridgeville Township Trustee
Mr. Charles Haines, Ridgeville Township Trustee
Ms. Cheryl Bostelman, Ridgeville Township Fiscal Officer

A copy of the application is available for public inspection at the offices of the Ohio Power Siting Board, c/o Public Utilities Commission of Ohio, Utilities Department, 12th Floor, Borden Building, 180 East Broad Street, Columbus, Ohio 43215-3793, www.opsb.ohio.gov. A copy of the application has also been sent to the following libraries:

Napoleon Public Library, 310 West Clinton Street, Napoleon, OH 43545
Stryker Public Library, 304 South Defiance Street, Stryker, OH 43557

A copy of the application and information on how to request a hard copy of the application can also be found on FirstEnergy’s website for transmission projects, www.firstenergycorp.com/about/transmission_project/ohio.html.

A Letter of Notification Application for a certificate to construct operate, and maintain the above named electric transmission line facility is now pending before the Board. The Project application has been assigned Docket No. 19-1765-EL-BLN, and this docket number should be referenced in all communications about this proceeding.

In accordance with Ohio Administrative Code (“OAC”) Rule 4906-6-08(A)(6), please be advised that interested persons may file motions to intervene and/or file comments with the Board within ten days of the date of publication of this notice, in accordance with OAC Rule 4906-2-12, or later if good cause is shown. Petitions to intervene and comments should be addressed to the Ohio Power Siting Board, 180 East Broad Street, Columbus, Ohio 43215-3793 and cite case number 19-1765-EL-BLN.

WARNING
KEEP YOUR PETS AWAY FROM
POISONOUS MUSHROOMS

Fall and spring are mushroom seasons. While 99% of mushrooms have little or no toxicity, 1% are highly toxic and can cause life-threatening problems in pets. Keep pets away from areas where any mushrooms are growing. If you suspect your pet has eaten a toxic mushroom, immediately contact your veterinarian or the ASPCA Animal Poison Control Center at 888-426-4435.

FOUNTAIN CITY VETERINARY HOSPITAL

1202 S. Main St.
Bryan, OH 43506
419-636-5081

STATE OF OHIO
COUNTY OF HENRY

Sally Heaston, being first duly sworn, states that she is the General Manager of The Bryan Publishing Company, owner of The Northwest Signal, a daily newspaper, published and of general circulation in the county of Henry aforesaid, and that the annexed notice was published in one issue in said paper, on the 8th day of October, 2019.

Sally Heaston

Sally Heaston

Subscribed and sworn to before me this
8th day of October, 2019

Beverly Griteman

Beverly Griteman
Notary Public,
State of Ohio
My Commission Expires
February 13, 2021

Printer's Fee: \$683.20



BEVERLY GRITEMAN
Notary Public, State of Ohio
My Commission Expires
February 13, 2021



Exhibit 1
Officials Served Copy of Letter of the Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Williams County

Board of Commissioners
Mr. Terry Rummel
One Courthouse Square
4th floor
Bryan, OH 43506

Board of Commissioners
Mr. Lewis Hilker
One Courthouse Square
4th floor
Bryan, OH 43506

Board of Commissioners
Mr. Brian Davis
One Courthouse Square
4th floor
Bryan, OH 43506

Williams County Engineer's Office
Mr. Todd Roth P.E., P.S.
12953 County Road G
Bryan, OH 43506

Williams County Regional Planning
Commission
Mr. Dennis Miller
12953 County Road G
Bryan, OH 43506

Williams County Soil & Water District
Mr. Chris Dancer, District Admin.
1120 West High Street
Bryan, OH 43506

Springfield Township

Springfield Township Trustee
Mr. Ed Ruffer, Trustee
03075 County Road 23.50
Stryker, OH 43557

Springfield Township Trustee
Mr. Rusty Goebel, Trustee
05870 County Road 23.50
Stryker, OH 43557

Springfield Township Trustee
Mr. Steve Planson, Trustee
22199 County Road F
Stryker, OH 43557

Springfield Township Fiscal Officer
Ms. Patti Rosebrock,
304 East Curtis Street
Stryker, OH 43557

Village of Stryker

Village of Stryker Mayors Office
Mayor Joe Beck
200 North Defiance Street
P.O. Box 404
Stryker, OH 43557

Village of Stryker Administrator
Mr. Alan Riegsecker
200 North Defiance Street
P.O. Box 404
Stryker, OH 43557

Village of Stryker Fiscal Officer
Ms. Beth Rediger
200 North Defiance Street
P.O. Box 404
Stryker, OH 43557

Village of Stryker Public Works
Mr. Wesley White
200 North Defiance Street
P.O. Box 404
Stryker, OH 43557

Henry County

Board of Commissioners
Mr. Tom VonDeylen
1853 Oakwood Avenue
Napoleon, OH 43545

Henry County Engineer's Office
Mr. Tim Schumm P.E., P.S
660 North Perry Street
Napoleon, OH 43545

Board of Commissioners
Mr. Glenn Miller
1853 Oakwood Avenue
Napoleon, OH 43545

Henry County Regional Planning
Commission
Mr. Nicholas Rettig, Director
1853 Oakwood Avenue
Napoleon, OH 43545

Board of Commissioners
Mr. Robert Hastedt
1853 Oakwood Avenue
Napoleon, OH 43545

Henry County Soil & Water District
Mr. Bob George, District Admin.
2260 North Scott Street
Napoleon, OH 43545

Ridgeville Township

Ridgeville Township Officials
Mr. Carlos Grieser, Trustee
191 County Road 22
Archbold, OH 43502

Ridgeville Township Trustee
Mr. Charles Haines
20692 County Road X
Napoleon, OH 43545

Ridgeville Township Trustee
Ms. Peggy Yoder
778 County Road 20B
Archbold, OH 43502

Ridgeville Township Fiscal Officer
Ms. Cheryl Bostelman
20348 County Road X
P.O. Box 65
Napoleon, OH 43545

Libraries

Napoleon Public Library
Ms. Betsy Eggers, Director
310 West Clinton Street
Napoleon, OH 43545

Stryker Public Library
Ms. Connie Aeschilman, Director
304 South Defiance Street
Stryker, OH 43557

October 2, 2019

Mr. Carlos Grieser, Trustee
Ridgeville Township Officials
191 County Road 22
Archbold, OH 43502

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Mr. Grieser,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kemil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mr. Bob George, District Admin.
Henry County Soil & Water District
2260 North Scott Street
Napoleon, OH 43545

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Mr. George,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mr. Terry Rummel
Williams County Board of Commissioners
One Courthouse Square, 4th Floor
Bryan, OH 43506

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Mr. Rummel,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mr. Lewis Hilkert
Williams County Board of Commissioners
One Courthouse Square, 4th Floor
Bryan, OH 43506

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Mr. Hilkert,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kemil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mr. Brian Davis
Williams County Board of Commissioners
One Courthouse Square, 4th Floor
Bryan, OH 43506

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Mr. Davis,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mr. Todd Roth P.E., P.S.
Williams County Engineer's Office
12953 County Road G
Bryan, OH 43506

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Mr. Roth,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mr. Dennis Miller
Williams County Regional Planning Commission
12953 County Road G
Bryan, OH 43506

**Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN**

Dear Mr. Miller,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is in this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mr. Chris Dancer, District Admin.
Williams County Soil & Water District
1120 West High Street
Bryan, OH 43506

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Mr. Dancer,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kemil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mr. Ed Ruffer, Trustee
Springfield Township Trustee
03075 County Road 23.50
Stryker, OH 43557

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Mr. Ruffer,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mr. Rusty Goebel, Trustee
Springfield Township Trustee
05870 County Road 23.50
Stryker, OH 43557

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Mr. Goebel,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mr. Steve Planson, Trustee
Springfield Township Trustee
22199 County Road F
Stryker, OH 43557

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Mr. Planson,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Ms. Patti Rosebrock,
Springfield Township Fiscal Officer
304 East Curtis Street
Stryker, OH 43557

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Ms. Rosebrock,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kemil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mayor Joe Beck
Village of Stryker Mayors Office
200 North Defiance Street, P.O. Box 404
Stryker, OH 43557

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Mayor Beck,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mr. Alan Riegsecker
Village of Stryker Administrator
200 North Defiance Street, P.O. Box 404
Stryker, OH 43557

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Mr. Riegsecker,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

October 2, 2019

Ms. Beth Rediger
Village of Stryker Fiscal Officer
200 North Defiance Street, P.O. Box 404
Stryker, OH 43557

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Ms. Rediger,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mr. Wesley White
Village of Stryker Public Works
200 North Defiance Street, P.O. Box 404
Stryker, OH 43557

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Mr. White,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mr. Tom VonDeylen
Board of Commissioners
1853 Oakwood Avenue
Napoleon, OH 43545

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Mr. VonDeylen,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kemil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mr. Glenn Miller
Board of Commissioners
1853 Oakwood Avenue
Napoleon, OH 43545

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Mr. Miller,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mr. Robert Hastedt
Board of Commissioners
1853 Oakwood Avenue
Napoleon, OH 43545

**Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN**

Dear Mr. Hastedt,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is in this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mr. Tim Schumm P.E., P.S.
Henry County Engineer's Office
660 North Perry Street
Napoleon, OH 43545

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Mr. Schumm,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mr. Nicholas Rettig, Director
Henry County Regional Planning Commission
1853 Oakwood Avenue
Napoleon, OH 43545

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Mr. Rettig,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Ms. Peggy Yoder
Ridgeville Township Trustee
778 County Road 20B
Archbold, OH 43502

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Ms. Yoder,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is in this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Mr. Charles Haines
Ridgeville Township Trustee
20692 County Road X
Napoleon, OH 43545

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Mr. Haines,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Ms. Cheryl Bostelman
Ridgeville Township Fiscal Officer
20348 County Road X, P.O. Box 65
Napoleon, OH 43545

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Ms. Bostelman,

American Transmission Systems, Incorporated, ("ATSI"), a FirstEnergy company, is In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

In accordance with Ohio Administrative Code ("OAC") Rule 4906-1-01, this Project falls within the Ohio Power Siting Board's requirements for a Letter of Notification ("LON") application. Therefore, in compliance with OAC Chapter 4906-6, we have prepared and filed the attached application with the Board for their review and approval. The application contains a more detailed description of the Project and is provided for your information.

I will be happy to answer your questions concerning this matter. You can contact me at 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

Attachment

October 2, 2019

Napoleon Public Library
Ms. Betsy Eggers, Director
310 West Clinton Street
Napoleon, OH 43545

Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear Ms. Eggers,

Enclosed please find one copy of the Letter of Notification Application of American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, for the Napoleon-Richland-Stryker 138 kV Open Arm Project ("Project") that has been filed with the Ohio Power Siting Board ("OPSB"). Please make the Letter of Notification application available for public reference in the Napoleon Public Library. We are providing a copy of the Letter of Notification Application for placement in your library in response to the requirements of the Ohio Administrative Code ("OAC") Rule 4906-6-07(A)(2), which requires us to place a copy of the Letter of Notification Application in the main public libraries of the political subdivisions in which any portion of the Project is to be located.

As described in the Letter of Notification Application, in this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line towers extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

Please feel free to call me with any question you may have concerning this application or making it available to your patrons. My phone number is 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission and Substation
Design
FirstEnergy Service Company

Enclosure

October 2, 2019

Stryker Public Library
Ms. Connie Aeschilman, Director
304 South Defiance Street
Stryker, OH 43557

**Letter of Notification
Napoleon-Richland-Stryker 138 kV
Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN**

Dear Ms. Aeschilman,

Enclosed please find one copy of the Letter of Notification Application of American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, for the Napoleon-Richland-Stryker 138 kV Open Arm Project ("Project") that has been filed with the Ohio Power Siting Board ("OPSB"). Please make the Letter of Notification application available for public reference in the Napoleon Public Library. We are providing a copy of the Letter of Notification Application for placement in your library in response to the requirements of the Ohio Administrative Code ("OAC") Rule 4906-6-07(A)(2), which requires us to place a copy of the Letter of Notification Application in the main public libraries of the political subdivisions in which any portion of the Project is to be located.

As described in the Letter of Notification Application, in this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kcmil 36/7 ACSR transmission line and 7#8 Alumoweld shield wire utilizing the open arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line towers extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

Please feel free to call me with any question you may have concerning this application or making it available to your patrons. My phone number is 330-384-2743.

Sincerely,



Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission and Substation
Design
FirstEnergy Service Company

Enclosure

ID County PID	Owner	Address 1	City	State	ZIP Code
064-050-04-007.000	A SCHULMAN INC	3637 RIDGEWOOD RD	FAIRLAWN	OH	44333
064-080-04-011.000	AMES ALVA	109 CHASE ST	STRYKER	OH	43557
064-080-04-012.000	AMES ALVA R AND CAROL A	109 CHASE ST	STRYKER	OH	43557
064-130-00-012.000	BACKHAUS GERALD H AND NANCY S	01408 DOMERSVILLE RT 2	DEFIANCE	OH	43512
064-090-09-002.000	BARNUM MARY L (LE) ETAL	21542 COUNTY ROAD E50	STRYKER	OH	43557
064-130-00-013.000	BAUS CHAD D AND BETH A	24657 COUNTY ROAD D	ARCHBOLD	OH	43502
064-130-00-017.001	BREIER JOHN L	4187 COUNTY ROAD 25	ARCHBOLD	OH	43502
064-130-00-017.000	BREIER JOHN L AND BRENDA L	4187 COUNTY ROAD 25	ARCHBOLD	OH	43502
064-150-00-012.000	BURGGRABE RUBY L	503 ST FRANCIS RD	EUFULA	AL	36027
064-080-04-013.000	CHRISMER ROBERT C AND JUDITH A	111 CHASE RD PO BOX 3600	STRYKER	OH	43557
064-080-04-023.000	DERRINGER KAREN L	603 W CURTIS ST	STRYKER	OH	43557
064-080-01-020.000,	ENGLER LONNIE L TRUSTEE	PO BOX 261	BRYAN	OH	43506
011800160000	GERICKE, MARILYN J.	3524 WESTWOOD DR	ARCHBOLD	OH	43502
064-140-00-006.000	GOEBEL DARRELL J ETAL	4769 COUNTY ROAD 2350	STRYKER	OH	43557
064-080-05-006.000	GREATHOUSE IRMA	803 SHAWNEE ST	STRYKER	OH	43557
064-080-06-002.000,	HARRINGTON MARK A & VERA	PO BOX 251	RIDGEVILLE CORNERS	OH	43555
064-090-08-026.000	HARVEST REST FARMS LLC	19751 COUNTY ROAD D	ARCHBOLD	OH	43502
064-080-05-019.000	HUBER JUDY J	205 CHASE ST	STRYKER	OH	43557
064-050-08-002.000	HURD RONALD L	908 W CURTIS ST	STRYKER	OH	43557
064-080-04-016.000	LEININGER MICHAEL L AND UNDERWOOD KAREN M	802 SHAWNEE ST	STRYKER	OH	43557
064-080-04-017.000	LEUPP CARMEN	800 SHAWNEE ST	STRYKER	OH	43557
011800120000	LOHSE, ELDOR W	V-410 COUNTY ROAD 25	ARCHBOLD	OH	43502
064-090-08-027.000	LUTY CAROLYN W TRUSTEE AND CLINE KAREN TRUSTEE	1523 S LYNN ST	BRYAN	OH	43506
064-130-00-010.000	MILLER JOYCE TRUSTEE ETAL	4434 COUNTY ROAD 24D	STRYKER	OH	43557
064-080-05-005.000	MILLER JUSTIN B AND CHASTITY D	703 SHAWNEE ST	STRYKER	OH	43557
064-080-05-017.000	NEWCOMER DAVID C TRUSTEE(ENGLER)	117 W MAPLE ST	BRYAN	OH	43506
064-080-06-017.000	OAKWOOD CEMTERY	P O BOX 404	STRYKER	OH	43557
064-090-09-004.000,	PLANSON FAMILY PARTNERS	22199 COUNTY ROAD F	STRYKER	OH	43557
064-090-08-026.001	PLANSON STEVEN J AND CONNIE R	22199 COUNTY ROAD F	STRYKER	OH	43557
064-090-09-003.000	PLANSON TERRY A TRUSTEE	4949 COUNTY ROAD 22	STRYKER	OH	43557
064-080-06-004.000	RACHEL TAZE D	905 W CURTIS ST PO BOX 708	STRYKER	OH	43557
064-130-00-007.000	RIDGEFIELD FARMS LLC	24405 COUNTY ROAD W	ARCHBOLD	OH	43502
064-080-06-019.000,	ROGGEMAN ALBERT L	100 CHASE ST	STRYKER	OH	43557
064-150-00-016.000,	RUFFER ED J AND JULIE	3075 COUNTY ROAD 2350	STRYKER	OH	43557
064-150-00-013.000,	RUFFER JAMES E TRUSTEE	23046 STATE ROUTE 34	STRYKER	OH	43557
064-080-04-007.000	SHINDLEDECKER SHARON K	803 W CURTIS ST	STRYKER	OH	43557
064-130-00-008.000	SHORT KERRI J	4115 COUNTY ROAD 24D	STRYKER	OH	43557
064-130-00-011.000	SHORT NED L TRUSTEE	24345 COUNTY ROAD F50	STRYKER	OH	43557
064-140-00-011.000	SKYLINE 250 LLC	6388 MUIRFIELD DR	TEMPERANCE	MI	48182
064-150-00-017.000	SPROW ANNA MARIE	4033 COUNTY ROAD 2275	STRYKER	OH	43557
064-140-00-010.000	STRAWN JAMES C AND KRISTY M	22881 MONROE ST	ARCHBOLD	OH	43502
064-140-00-007.000,	STUCKEY LARRY D (LE) ETAL	1806 S DEFIANCE ST	ARCHBOLD	OH	43502
064-050-08-004.000,	TODD REPLOGLE PROPERTIES	PO BOX 69	STRYKER	OH	43557

October 9, 2019

[Property Owner]

[Address]

[City, State Zip]

Re: Parcel(s): [Parcel Number]

Letter of Notification
Napoleon-Richland-Stryker 138 kV Transmission Line Open Arm Project
Case No. 19-1765-EL-BLN

Dear [Property Owner],

American Transmission Systems, Incorporated (“ATSI”), a FirstEnergy company, is proposing in an application recently filed with the Ohio Power Siting Board (“OPSB”) to upgrade the transmission line that crosses your property. The proposed Project does not require ATSI to acquire any new property rights or expand the existing transmission right-of-way. Rather, over the entire length of this Project, ATSI is proposing to add an additional conductor to the existing transmission line structures. Details regarding the changes to the transmission line on your property can be found in the application itself and a map of the proposed Project is included with this letter.

In accordance with Ohio Administrative Code (“OAC”) Rule 4906-1-01, this Project falls within the Ohio Power Siting Board’s (“OPSB”) requirements for a Letter of Notification application. You are receiving this letter as we are required to notify affected property owners in accordance with OAC Rule 4906-6-08(A) that we have prepared and filed a Letter of Notification application to construct, operate, and maintain the Project and that such an application is that is now pending before the OPSB.

In this Project, ATSI is proposing to construct approximately 5.7-miles of new 336 kmil 36/7 ACSR transmission line and OPGW shield wire utilizing the open tower arm position located on the northern side of the existing Napoleon-Richland-Stryker 138 kV Transmission Line extending from Stryker Substation to structure #265 to eliminate the three-terminal line configuration. The Project will be located in the Village of Stryker, Springfield Township in Williams County, and Ridgeville Township in Henry County, Ohio.

The LON application contains a description of the Project, and can be viewed at the following public locations:

Napoleon Public Library, 310 West Clinton Street, Napoleon, OH 43545
Stryker Public Library, 304 South Defiance Street, Stryker, OH 43557

A copy of the Letter of Notification application is also available for public inspection at the offices of the Ohio Power Siting Board, c/o Public Utilities Commission of Ohio, Utilities Department, 12th Floor, Borden Building, 180 East Broad Street, Columbus, Ohio 43215-3793, or on the website of the Board: www.opsb.ohio.gov. The Board can also be reached via email at: contactOPSB@puc.state.oh.us.

Finally, a copy of the Letter of Notification application will also be posted on FirstEnergy's website at www.firstenergycorp.com/about/transmission_project/ohio.html along with information on how to request a hard copy of the application, if you wish to order one.

In accordance with OAC Rule 4906-6-08(A)(6), please be advised that interested persons may file motions to intervene and/or file comments with the Board within ten days of the date of the publication of the public notice of the filing of this Project with the Board, in accordance with OAC Rule 4906-2-12, or later if good cause is shown. Petitions to intervene and comments should be addressed to the Ohio Power Siting Board, 180 East Broad Street, Columbus, Ohio 43215-3793 and reference Case No. 19-1765-EL-BLN.

Please note that the Project has been assigned Case No. 19-1765-EL-BLN by the OPSB, and this case number should be referenced in all communications regarding this Project.

If you have any questions concerning the Project, I will be happy to answer them. You can contact me at the transmission projects hotline number 1-800-589-2837 or by email at transmissionprojects@firstenergycorp.com. The Project name and Case Number (19-1765-EL-BLN) should be referenced in all communications.

Sincerely,

A handwritten signature in black ink, appearing to read "Robert J. Maggiore".

Robert J. Maggiore
Transmission Specialist II
Energy Delivery Transmission & Substation Design
FirstEnergy Service Company

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

10/23/2019 3:54:11 PM

in

Case No(s). 19-1765-EL-BLN

Summary: Proof of Pub of Newspaper Notices and Public Notice Letters for Project
electronically filed by Mr. Robert J Schmidt on behalf of American Transmission Systems Inc.