

Figure No.


2

Erosion and Sediment Control Plan

Client/Project  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project  
Project Location  
Adams County, Ohio  
Prepared By: J.H. on 2020-10-01  
Reviewed By: J.H. on 2020-10-01  
Revised By: J.H. on 2020-12-09



- Legend**
- Temporary Construction Entrance
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - Proposed Structure
  - Existing 138 kV Transmission Line to be Replaced
  - Proposed 138 kV Transmission Line
  - Existing and Proposed 100' ROW
  - Proposed 50' ROW
  - Gravel Crane Pad (100'x100')
  - Timber Mat Crane Pad (100'x100')
  - Existing Access Road
  - Modified Access Road
  - New Access Road (AR)
  - Timber Mat Access Road (AR)
  - Township Boundary
  - Municipal Boundary
  - \*These features were observed in the field adjacent to the project area, but not delineated.
  - Field Delineated Waterway
  - Approximate Waterway\*
  - Field Delineated Waterway Area
  - Field Delineated Open Water
  - Approximate Open Water\*
  - Field Delineated Emergent Wetland
  - Approximate Wetland\*
  - FEMA Flood Hazard Area
  - 100-year Flood Zone
  - 100-year Floodway

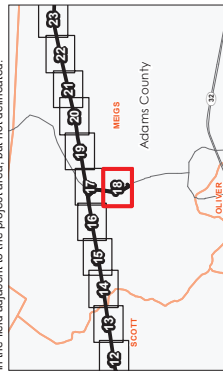

Map Data  
1. Data Source: Esri, DeLorme, GeoEye, IGN, AerIAL, USDA, NGA, etc.  
2. Data Source: Esri, DeLorme, GeoEye, IGN, AerIAL, USDA, NGA, etc.  
3. Background: 2019 NAD



Disclaimer: Stantec assumes no responsibility for data supplied in electronic format. The recipient accepts full responsibility for verifying the accuracy and completeness of the data. The recipient releases Stantec, its officers, employees, consultants and agents, from any and all claims arising in any way from the content or creation of the data.



Figure No.


2

## Erosion and Sediment Control Plan

**Client/Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project  
**Project Location**  
Adams County, Ohio  
Prepared By: JLT on 2020-10-01  
Reviewed By: JLT on 2020-10-01  
Revised By: JLT on 2020-12-09



- Legend**
- Temporary Construction Entrance
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - Proposed Structure
  - Existing 138 kV Transmission Line to be Replaced
  - Proposed 138 kV Transmission Line
  - Existing and Proposed 100' ROW
  - Proposed 50' ROW
  - Gravel Crane Pad (100'x100')
  - Timber Mat Crane Pad (100'x100')
  - Existing Access Road
  - Modified Access Road
  - New Access Road (AR)
  - Timber Mat Access Road (AR)
  - Township Boundary
  - Municipal Boundary
  - \*These features were observed in the field adjacent to the project area, but not delineated.
- Potentially Suitable Loggendorf Shrike Nesting Habitat
  - Field Collected Data
  - Culvert
  - Field Delineated Waterway
  - Approximate Waterway\*
  - Field Delineated Waterway Area
  - Field Delineated Open Water
  - Approximate Open Water\*
  - Field Delineated Emergent Wetland
  - Approximate Wetland\*
  - FEMA Flood Hazard Area
  - 100-year Flood Zone
  - 100-year Floodway

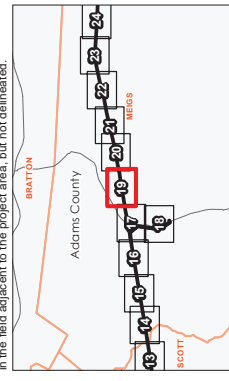

**Notes**  
1. Data source for terrain: AED 1/18/18, Seaman-Adams 138 kV S402 7'ed  
2. Data source for stream: AED 1/18/18, Lawshe 69 kV S402 7'ed  
3. Background: 2018 NADP

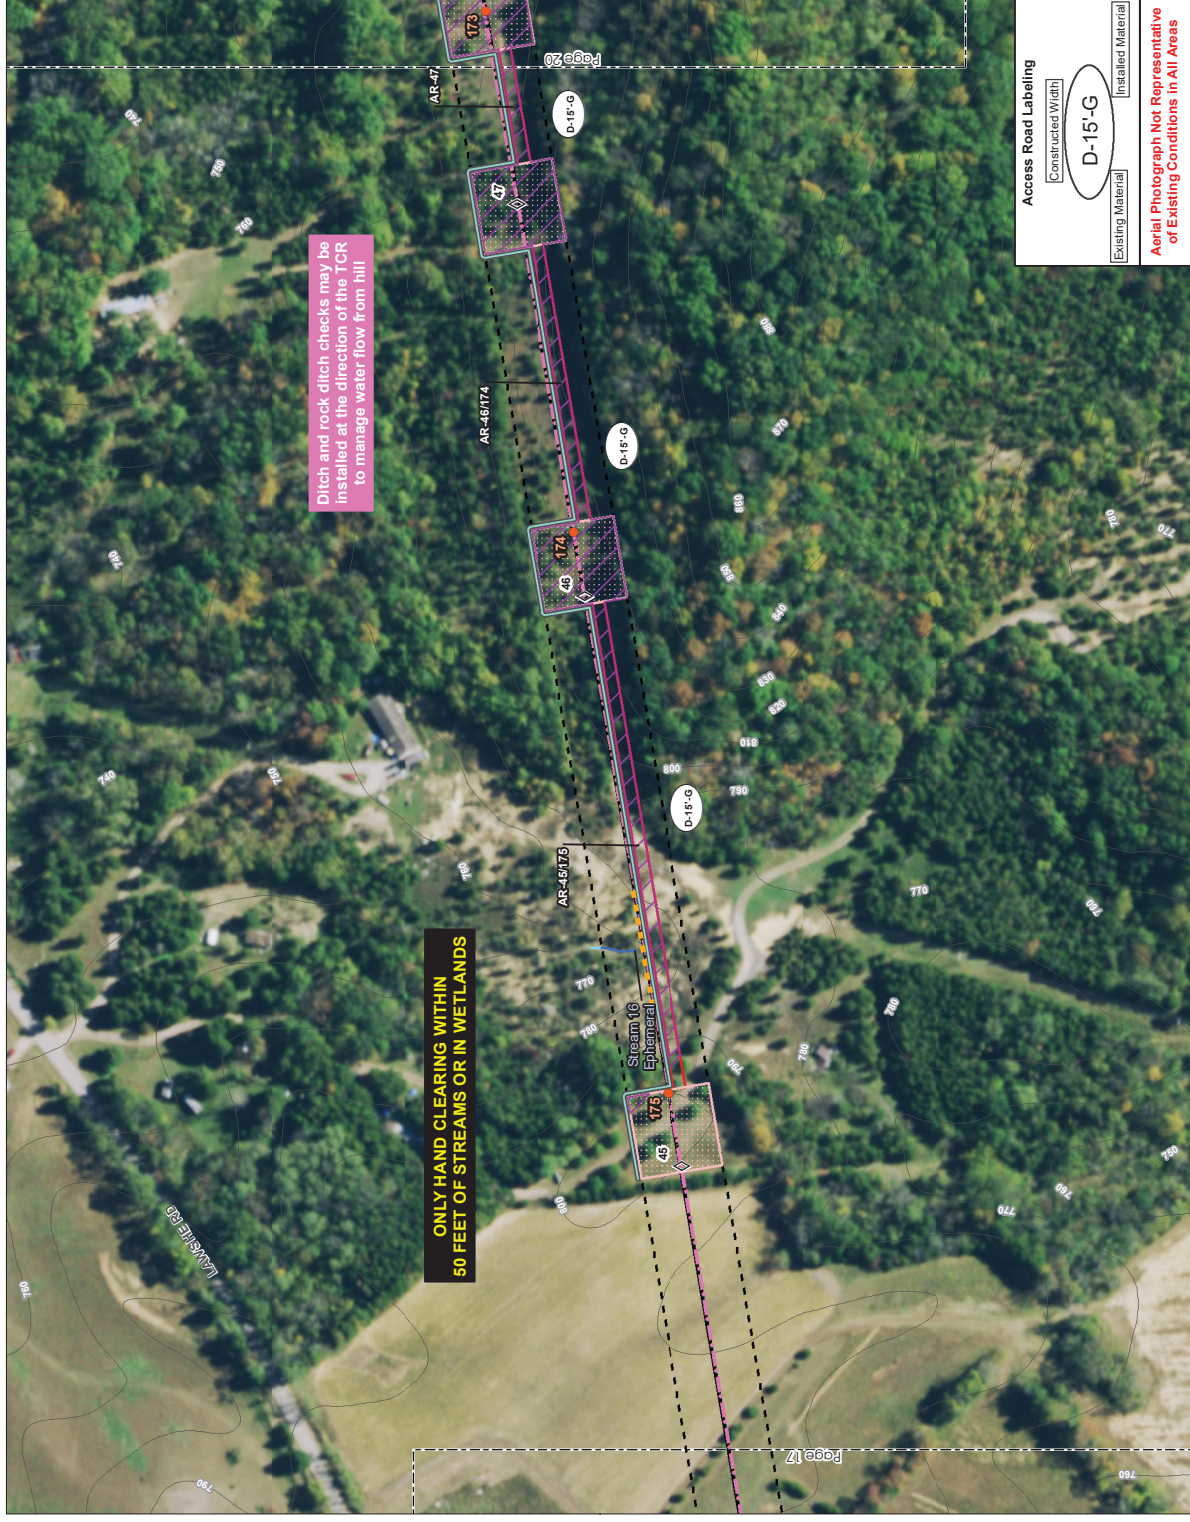




Figure No.


2

## Erosion and Sediment Control Plan

**Client/Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project  
**Project Location**  
Adams County, Ohio  
Prepared By: JLT on 2020-10-01  
Reviewed By: JLT on 2020-10-01  
Approved By: JLT on 2020-10-01  
Revised By: JLT on 2020-10-01



- Legend**
- Temporary Construction Entrance
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - Proposed Structure
  - Existing 138 kV Transmission Line to be Replaced
  - Proposed 138 kV Transmission Line
  - Existing and Proposed 100' ROW
  - Proposed 50' ROW
  - Gravel Crane Pad (100'x100')
  - Timber Mat Crane Pad (100'x100')
  - Existing Access Road (AR)
  - Modified Access Road (AR)
  - New Access Road (AR)
  - Timber Mat Access Road (AR)
  - Township Boundary
  - Municipal Boundary
  - \*These features were observed in the field adjacent to the project area, but not delineated.
- Potentially Suitable Loggerhead Shrike Nesting Habitat
  - Field Collected Data
  - Culvert
  - Field Delineated Waterway
  - Approximate Waterway\*
  - Field Delineated Waterway Area
  - Field Delineated Open Water
  - Approximate Open Water\*
  - Field Delineated Emergent Wetland
  - Approximate Wetland\*
  - FEMA Flood Hazard Area
  - 100-year Flood Zone
  - 100-year Floodway

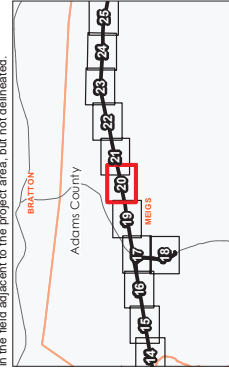

**Notes**  
1. Data source for terrain: AED 1:25,000 Scale Ohio State 3402 Feet  
2. Data source for FEMA Flood Hazard Area: FEMA 3402 Feet  
3. Background: 2019 NADP

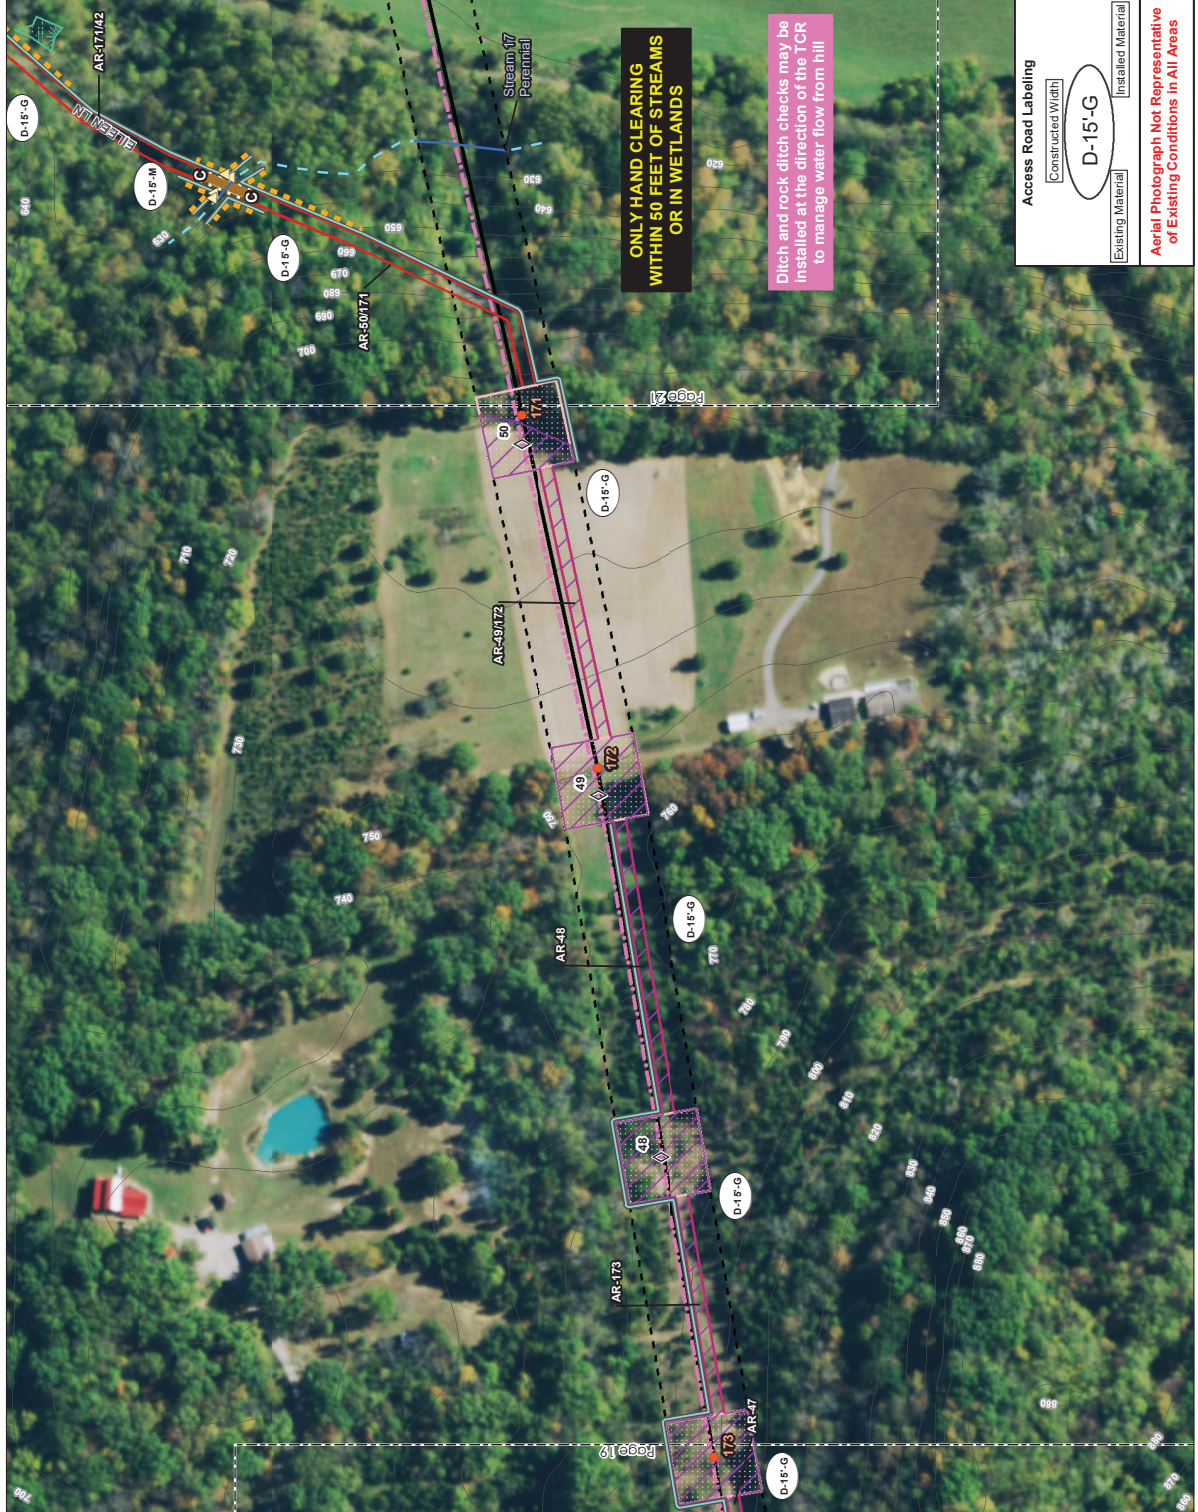




Figure No.


2

## Erosion and Sediment Control Plan

**Client/Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawsie 69 kV Line Extension Project  
**Project Location**  
Adams County, Ohio  
Prepared by J.H. on 2020-10-01  
Reviewed by J.H. on 2020-10-01  
Approved by J.H. on 2020-12-09  
Revised by J.H. on 2020-12-09



- Legend**
- Temporary Construction Entrance
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - Proposed Structure
  - Existing 138 kV Transmission Line to be Replaced
  - Proposed 138 kV Transmission Line
  - Existing and Proposed 100' ROW
  - Proposed 50' ROW
  - Gravel Crane Pad (100'x100')
  - Timber Mat Crane Pad (100'x100')
  - Existing Access Road
  - Modified Access Road
  - New Access Road (AR)
  - Timber Mat Access Road (AR)
  - Township Boundary
  - Municipal Boundary
  - These features were observed in the field adjacent to the project area, but not delineated.
  - Potentially Suitable Loggerhead Shrike Nesting Habitat
  - Field Collected Data
  - Culvert
  - Field Delineated Waterway
  - Approximate Waterway\*
  - Field Delineated Waterway Area
  - Field Delineated Open Water
  - Approximate Open Water\*
  - Field Delineated Emergent Wetland
  - Approximate Wetland\*
  - FEMA Flood Hazard Area
  - 100-year Flood Zone
  - 100-year Floodway

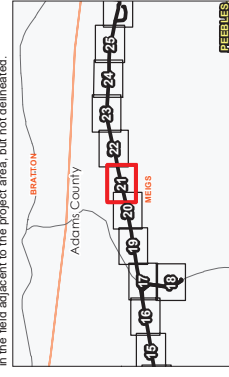

**Notes**  
1. Data source: USGS, NAD 83, 1:250,000 Scale, 30'x30' S402 7-ee  
2. Data source: USGS, NAD 83, 1:250,000 Scale, 30'x30' S402 7-ee  
3. Background: 2019 NADP



Disclaimer: User assumes all responsibility for data supplied in electronic format. The recipient accepts full responsibility for verifying the accuracy and completeness of the data. The recipient releases Stantec, its officers, employees, consultants and agents, from any and all claims arising in any way from the content or provision of the data.





## Erosion and Sediment Control Plan

**Client/Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project

**Project Location**  
Adams County, Ohio

Prepared by J.L.H. on 2020-10-01  
Reviewed by J.L.H. on 2020-10-01  
IR by PG on 2020-12-09

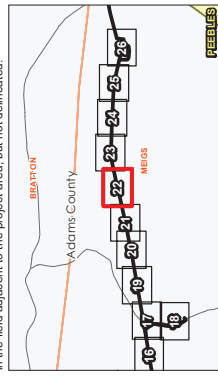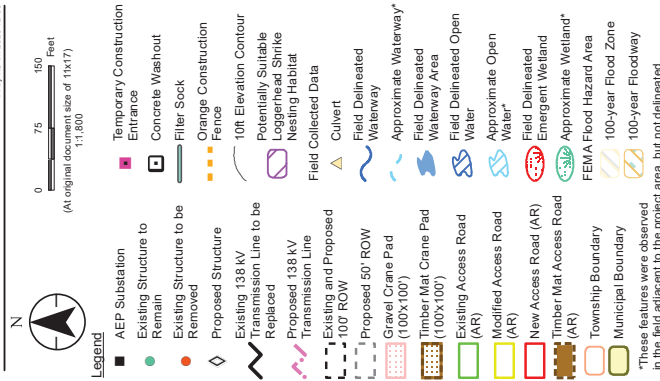

**Notes**

1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet
2. Data Sources: Stantec, AEP, USGS, FEMA, OGRIP, NADS
3. Background: 2019 NAIP



Disclaimer: Stanton assumes no responsibility for data supplied in electronic format. The recipient accepts full responsibility for verifying the accuracy and completeness of the data. The recipient releases Stanton, its officers, employees, consultants and agents, from any and all claims arising in any way from the content or provision of the data.



Figure No.


2

## Erosion and Sediment Control Plan

**Client/Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project  
**Project Location**  
Seaman-Adams 138 kV Transmission Line  
Adams County, Ohio  
Prepared By: JAT on 2020-10-01  
Reviewed By: JAT on 2020-10-01  
Approved By: JAT on 2020-12-09  
Project No.: 19037014800



- Legend**
- Temporary Construction Entrance
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - Proposed Structure
  - Existing 138 kV Transmission Line to be Replaced
  - Proposed 138 kV Transmission Line
  - Existing and Proposed 100' ROW
  - Proposed 50' ROW
  - Gravel Crane Pad (100'x100')
  - Timber Mat Crane Pad (100'x100')
  - Existing Access Road (AR)
  - Modified Access Road (AR)
  - New Access Road (AR)
  - Timber Mat Access Road (AR)
  - Township Boundary
  - Municipal Boundary
  - FEMA Flood Hazard Area
  - 100-year Flood Zone
  - 100-year Floodway
  - \*These features were observed in the field adjacent to the project area, but not delineated.
- Potentially Suitable Loggerhead Shrike Nesting Habitat
  - Field Collected Data
  - Culvert
  - Field Delineated Waterway
  - Approximate Waterway\*
  - Field Delineated Waterway Area
  - Field Delineated Open Water
  - Approximate Open Water\*
  - Field Delineated Emergent Wetland
  - Approximate Wetland\*
  - 100-year Flood Zone
  - 100-year Floodway

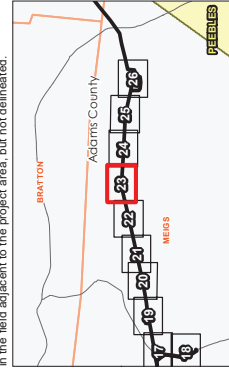

**Notes**  
1. Data source: Aerial Imagery, 2019, Google Earth Pro, 30m resolution.  
2. Data source: FEMA Flood Hazard Area, 100-year Flood Zone, 100-year Floodway, 100-year Flood Zone, 100-year Floodway, 100-year Flood Zone, 100-year Floodway.  
3. Background: 2019 NAD83

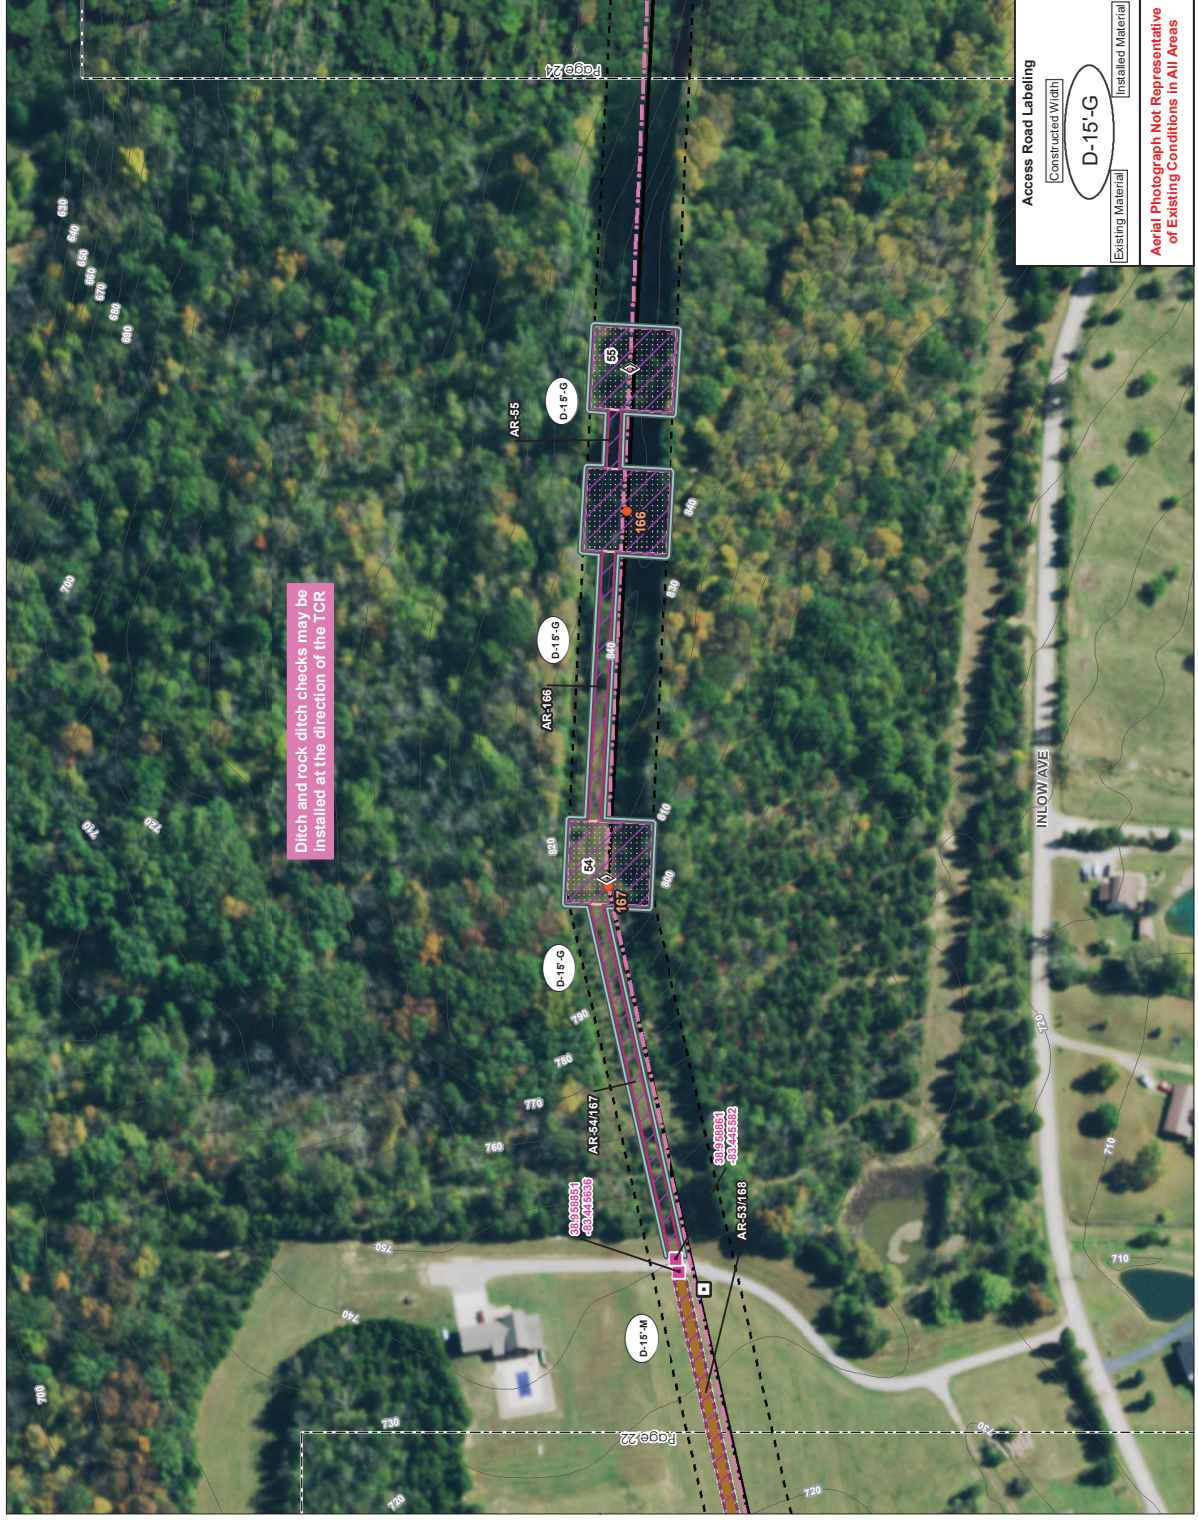




Figure No.


2

## Erosion and Sediment Control Plan


**Client/Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project  
**Project Location**  
Adams County, Ohio  
Prepared by JLT on 2020-10-01  
Reviewed by JLT on 2020-10-01  
Approved by JLT on 2020-12-09  
Revised by JLT on 2020-12-09



- Legend**
- Temporary Construction Entrance
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - Proposed Structure
  - Existing 138 kV Transmission Line to be Replaced
  - Proposed 138 kV Transmission Line
  - Existing and Proposed 100' ROW
  - Proposed 50' ROW
  - Gravel Crane Pad (100'x100')
  - Timber Mat Crane Pad (100'x100')
  - Existing Access Road (AR)
  - Modified Access Road (AR)
  - New Access Road (AR)
  - Timber Mat Access Road (AR)
  - Township Boundary
  - Municipal Boundary
  - These features were observed in the field adjacent to the project area, but not delineated.
- Potentially Suitable Loggerhead Shrike Nesting Habitat
  - Field Collected Data
  - Culvert
  - Field Delineated Waterway
  - Approximate Waterway\*
  - Field Delineated Waterway Area
  - Field Delineated Open Water
  - Approximate Open Water\*
  - Field Delineated Emergent Wetland
  - Approximate Wetland\*
  - FEMA Flood Hazard Area
  - 100-year Flood Zone
  - 100-year Floodway

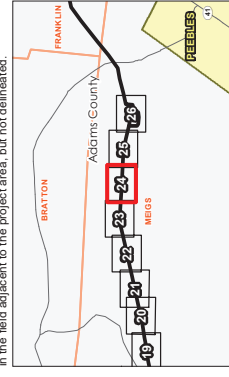

**Notes**  
1. Seaman-Adams 138 kV Transmission Line, Ohio State Route 3402 Fwd  
2. Lawshe 69 kV Line Extension Project, Adams County, Ohio  
3. Background 2019 NADP

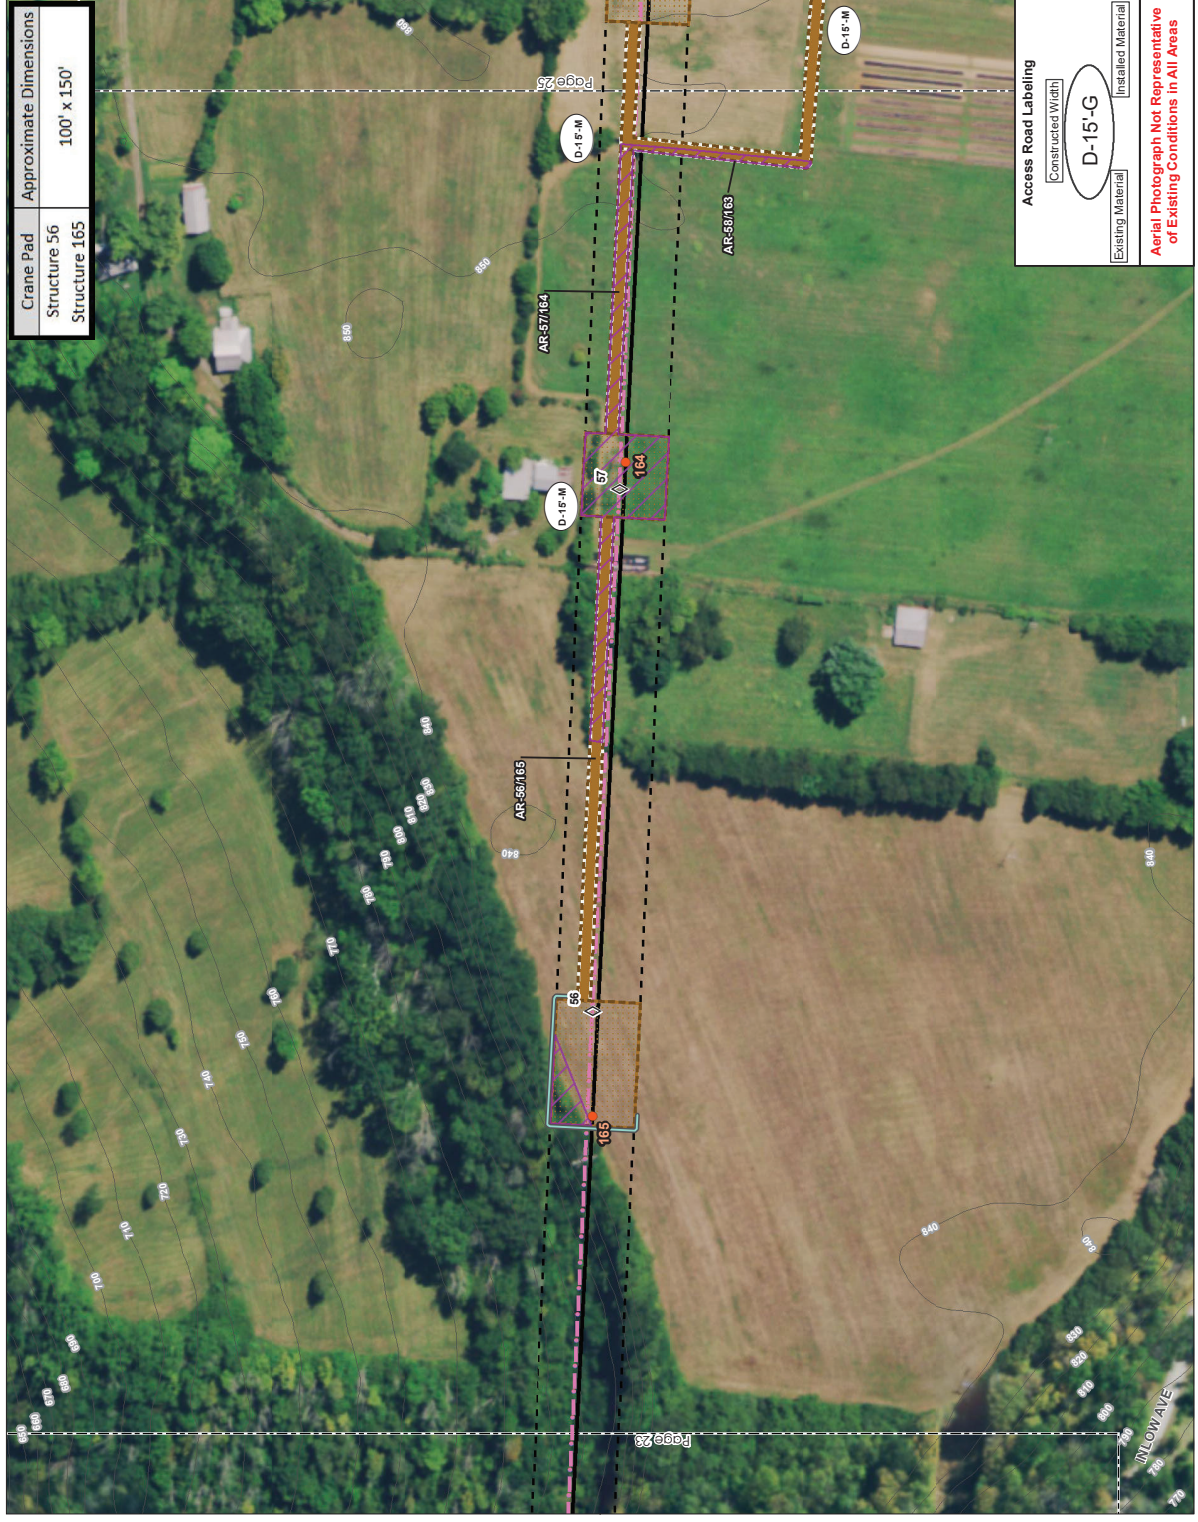

Crane Pad	Approximate Dimensions
Structure 56	100' x 150'
Structure 165	

Access Road Labeling	
Constructed Width	D-15'-G
Existing Material	Installed Material

**Aerial Photograph Not Representative of Existing Conditions in All Areas**

Disclaimer: Stantec does not warrant the accuracy or completeness of the data. The recipient accepts full responsibility for utilizing the accuracy and completeness of the data. The recipient releases Stantec, its officers, employees, consultants and agents, from any and all claims arising in any way from the content or creation of the data.



Figure No.


2

## Erosion and Sediment Control Plan

**Client/Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project  
**Project Location**  
Adams County, Ohio  
Prepared by JAL on 2020-10-01  
Reviewed by JAL on 2020-10-01  
Revised by JAL on 2020-12-09



- Legend**
- Temporary Construction Entrance
  - Concrete Washout
  - Filter Sock
  - Orange Construction Fence
  - Proposed Structure
  - Existing 138 kV Transmission Line to be Replaced
  - Proposed 138 kV Transmission Line
  - Existing and Proposed 100' ROW
  - Proposed 50' ROW
  - Gravel Crane Pad (100'x100')
  - Timber Mat Crane Pad (100'x100')
  - Existing Access Road (AR)
  - Modified Access Road (AR)
  - New Access Road (AR)
  - Timber Mat Access Road (AR)
  - Township Boundary
  - Municipal Boundary
  - \*These features were observed in the field adjacent to the project area, but not delineated.
- Potentially Suitable Loggerhead Shrike Nesting Habitat
  - Field Collected Data
  - Culvert
  - Field Delineated Waterway
  - Approximate Waterway\*
  - Field Delineated Waterway Area
  - Field Delineated Open Water
  - Approximate Open Water\*
  - Field Delineated Emergent Wetland
  - Approximate Wetland\*
  - FEMA Flood Hazard Area
  - 100-year Flood Zone
  - 100-year Floodway

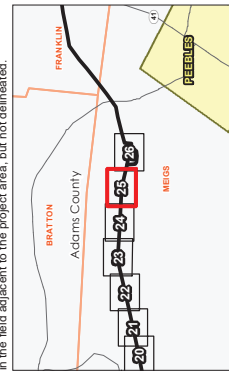

**Notes**  
1. Data Source: AEP Ohio, 138 kV Transmission Line, Ohio State, 2018 S402 File  
2. Data Source: AEP Ohio, 69 kV Line Extension, Ohio State, 2018 S402 File  
3. Background: 2018 NADP









Figure No. 3

UPDATED: 01/13/2021


### NRCS Soils

**Client/Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project  
**Project Location**  
Seaman, Adams County, Ohio  
Prepared by JLT on 2020-10-01  
Reviewed by JLT on 2020-10-01  
Revised by JLT on 2020-12-09


1803704800



- Legend**
- AEP Substation
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - ◇ Proposed Structure
  - Existing 138 kV Transmission Line to be Replaced
  - Existing 138 kV Transmission Line
  - - - Existing and Proposed 100' ROW
  - - - Proposed 50' ROW
  - ▨ Crane Pad
  - Access Road - AR
  - NRCS Soils

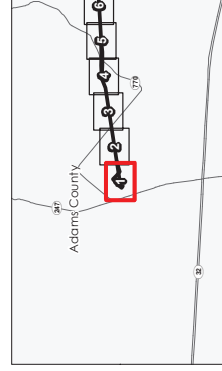

**Notes**  
1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet  
2. Data Sources: Stantec, AEP, USGS, NRCS, OGRIP, NADs  
3. Background: 2019 NIP

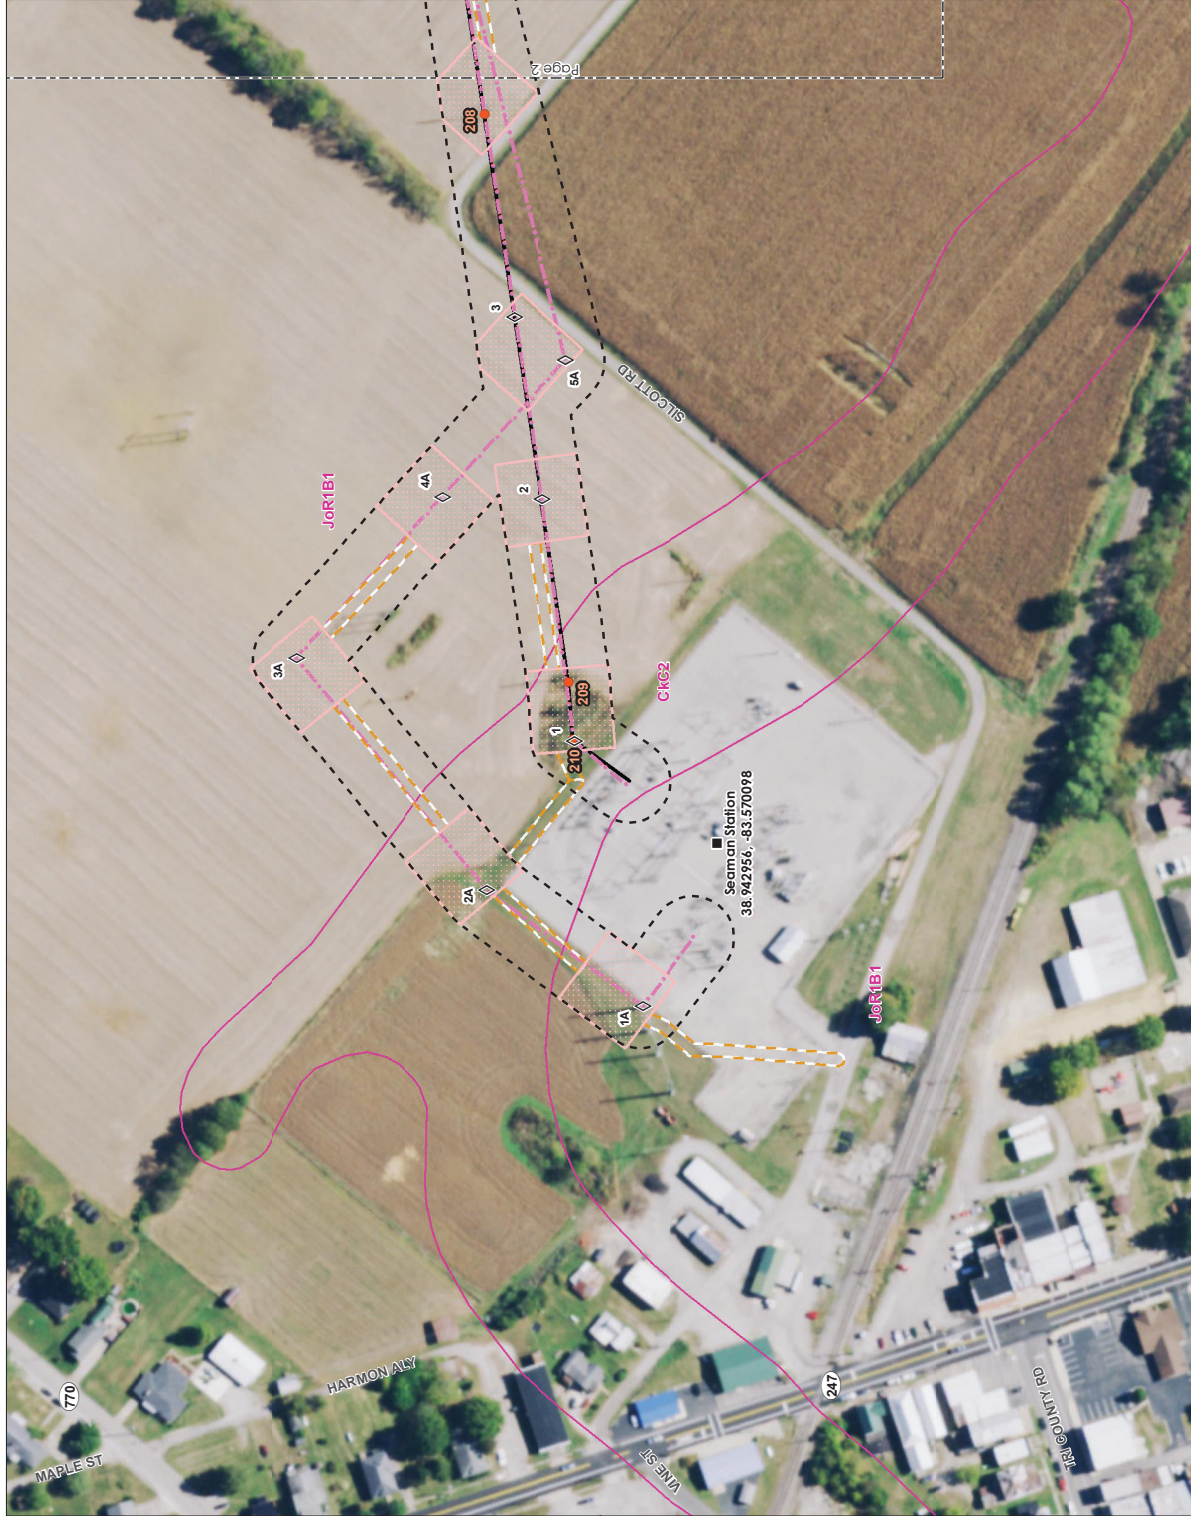




**NRCS Soils**

**Client/Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project  
**Project Location**  
Adams County, Ohio  
Prepared by JAL on 2020-10-01  
Reviewed by JAL on 2020-10-01  
Revised by JAL on 2020-12-09  
Revised by JAL on 2020-12-09



- Legend**
- AEP Substation
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - ◇ Proposed Structure
  - ⚡ Existing 138 kV Transmission Line to be Replaced
  - ⚡ Proposed 138 kV Transmission Line
  - ⚡ Existing and Proposed 100' ROW
  - ⚡ Proposed 50' ROW
  - ▢ Crane Pad
  - ⚡ Access Road - AR
  - NRCS Soils

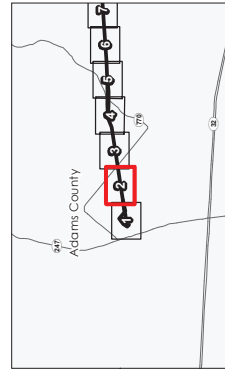

**Notes**  
1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet  
2. Data Source: Stantec, AEP, USGS, NRCS, OGRIP, NADIS  
3. Background: 2019 N/A






NRCS Soils

County Project  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project  
Project Location: Adams County, Ohio  
Prepared by JAT on 2020-10-01  
Reviewed by JAT on 2020-10-01  
Approved by JAT on 2020-12-09  
Revised by JAT on 2020-12-09



- Legend
- AEP Substation
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - ◇ Proposed Structure
  - ⚡ Existing 138 kV Transmission Line to be Replaced
  - ⚡ Proposed 138 kV Transmission Line
  - ⚡ Existing and Proposed 100' ROW
  - ⚡ Proposed 50' ROW
  - ▢ Crane Pad
  - ⚡ Access Road - AR
  - NRCS Soils

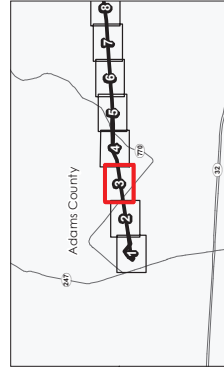

Notes:  
1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet  
2. Data Source: Stantec, AEP, USGS, NRCS, OGRIP, NADIS  
3. Background: 2019 NHD



Disclaimer: Stantec does not warrant the accuracy or completeness of the data. The recipient accepts full responsibility for verifying the accuracy and completeness of the data. The recipient releases Stantec, its officers, employees, consultants and agents, from any and all claims arising in any way from the content or provision of the data.



**NRCS Soils**


**Client/Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project

**Project Location**  
Adams County, Ohio

Prepared by: J.H. on 2020-10-01  
TR by JC on 2020-12-07  
IR by KC on 2020-12-09



- Legend**
- AEP Substation
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - ◇ Proposed Structure
  - ⚡ Existing 138 kV Transmission Line to be Replaced
  - ⚡ Proposed 138 kV Transmission Line
  - ⚡ Existing and Proposed 100' ROW
  - ⚡ Proposed 50' ROW
  - ▭ Crane Pad
  - ▭ Access Road - AR
  - ▭ NRCS Soils

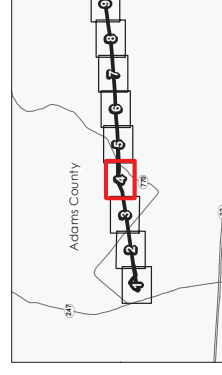

**Notes**

1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet
2. Data Sources: Stanlec, AEP, USGS, NRCS, OGRIP, NADS
3. Background: 2019 NA IP





**NRCS Soils**


**Client/Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project

**Project Location**  
Adams County, Ohio

**Prepared By, Date, and Scale**  
JLH on 2020-10-01  
Scale: 1" = 1,000'  
Reviewed By, Date, and Scale  
R on 2020-12-09  
Scale: 1" = 1,000'



- Legend**
- AEP Substation
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - ◇ Proposed Structure
  - ⚡ Existing 138 kV Transmission Line to be Replaced
  - ⚡ Proposed 138 kV Transmission Line
  - - - Existing and Proposed 100' ROW
  - - - Proposed 50' ROW
  - ▤ Crane Pad
  - Access Road - AR
  - NRCS Soils

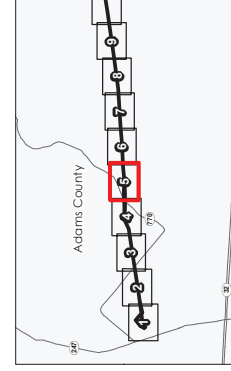

**Notes**

1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet
2. Data Sources: Stantec, AEP, USGS, NRCS, GORP, NADIS
3. Background: 2019 NIP



**NRCS Soils**



**Client/Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project

**Project Location**  
Adams County, Ohio

**Prepared By** JLT on 2020-10-01  
**Reviewed By** JLT on 2020-10-01  
**Approved By** JLT on 2020-12-09  
**Revised By** JLT on 2020-12-09



- Legend**
- AEP Substation
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - ◇ Proposed Structure
  - Existing 138 kV Transmission Line to be Replaced
  - Proposed 138 kV Transmission Line
  - Existing and Proposed 100' ROW
  - Proposed 50' ROW
  - Crane Pad
  - Access Road - AR
  - NRCS Soils

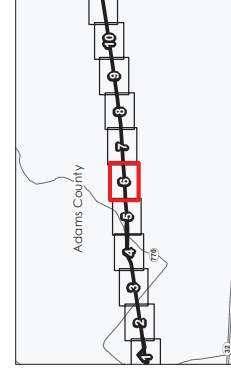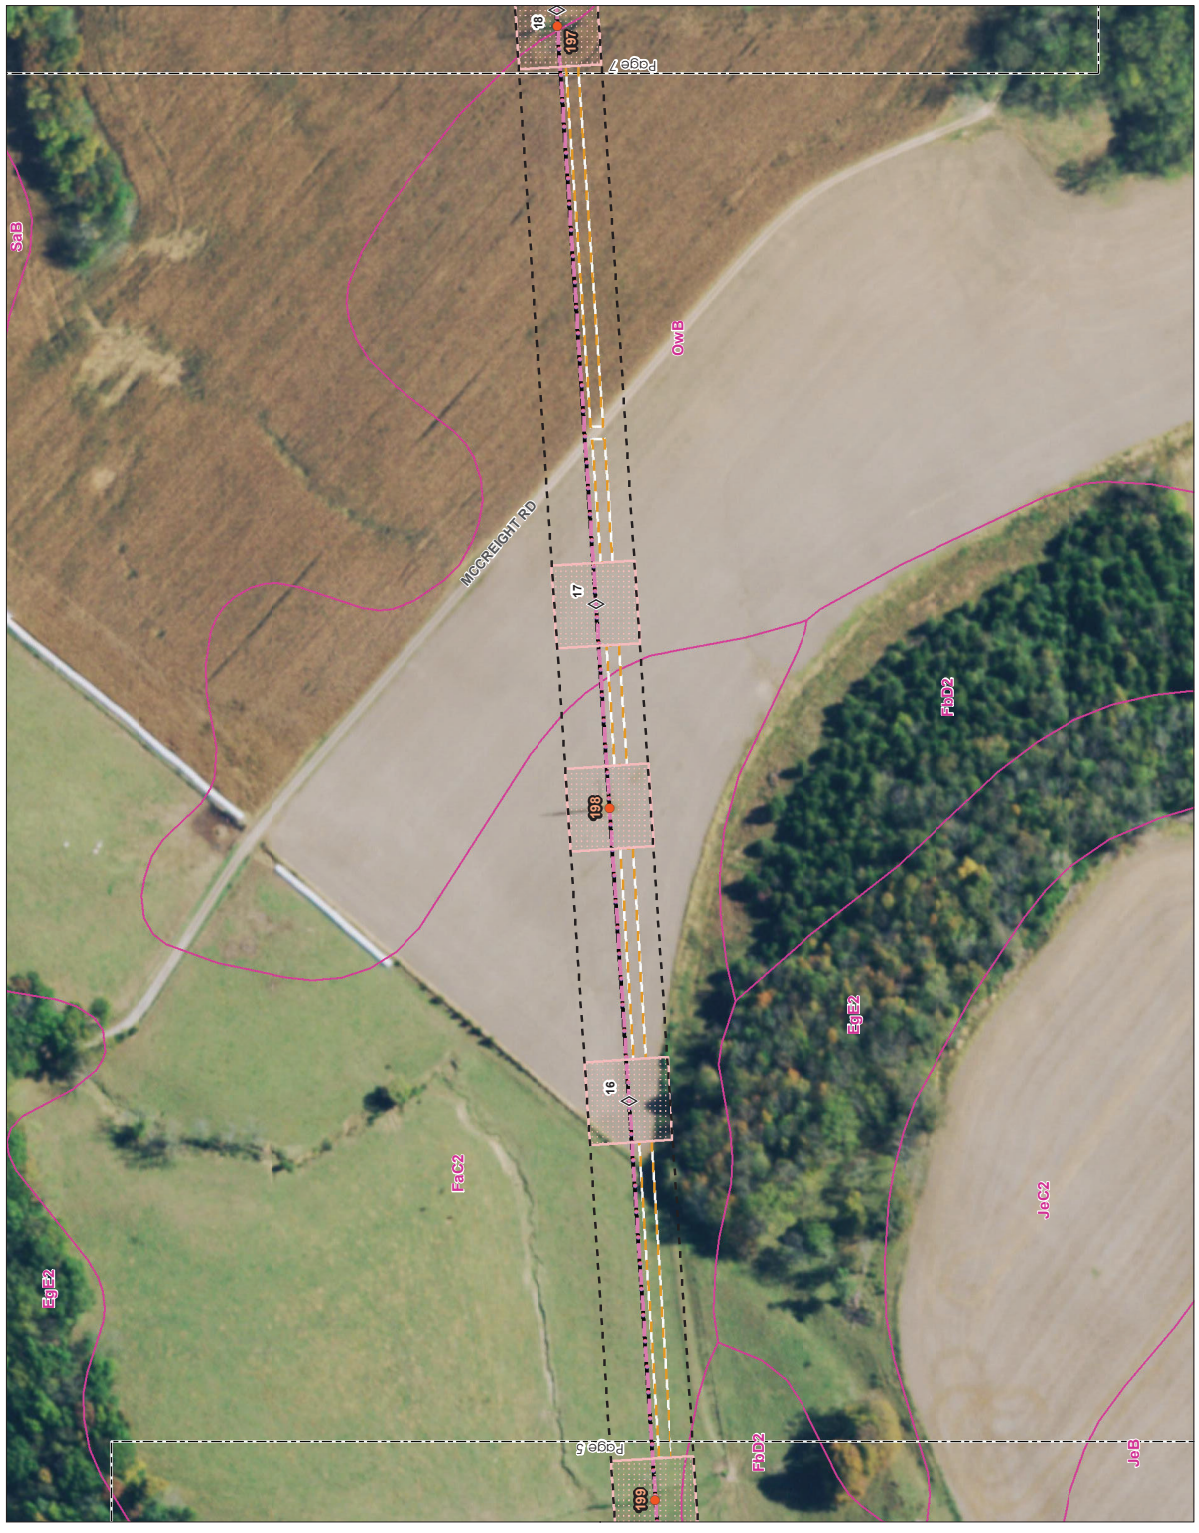

**Notes**

1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet
2. Data Source: Stantec, AEP, USGS, NRCS, OGRIP, NADIS
3. Date: 2021-01-13





### NRCS Soils

**Client/Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project  
**Project Location**  
Adams County, Ohio  
Prepared by JAH on 2020-10-01  
Reviewed by JAH on 2020-10-01  
Approved by JAH on 2020-12-09  
Revised by JAH on 2020-12-09

1937544800



- Legend**
- AEP Substation
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - ◇ Proposed Structure
  - ⚡ Existing 138 kV Transmission Line to be Replaced
  - ⚡ Proposed 138 kV Transmission Line
  - ⚡ Existing and Proposed 100' ROW
  - ⚡ Proposed 50' ROW
  - ▨ Crane Pad
  - ⚡ Access Road - AR
  - NRCS Soils

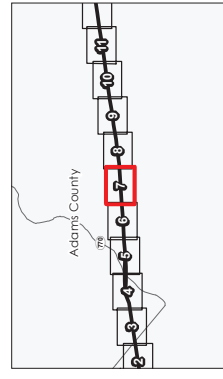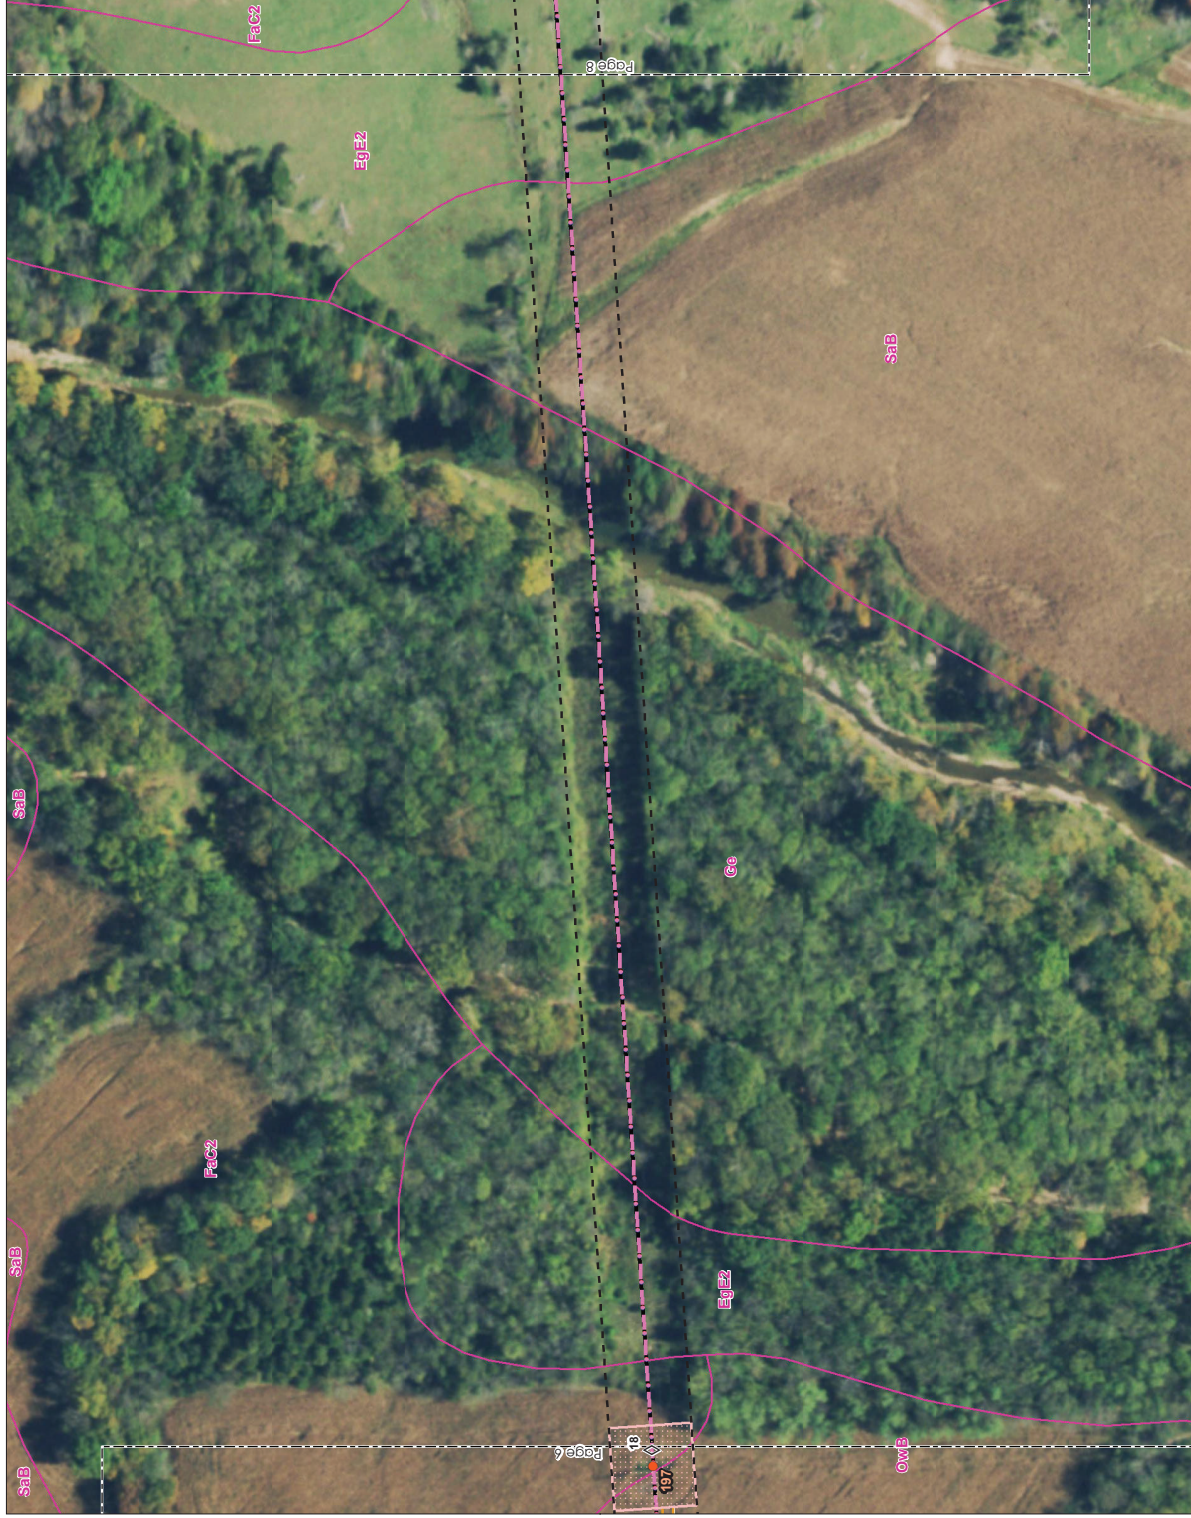

**Notes**  
1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet  
2. Data Sources: Stantec, AEP, USGS, NRCS, OGRIP, NAD5  
3. Background: 2019 N/A

















**NRCS Soils**



**Client/Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project

**Project Location**  
Adams County, Ohio

**Prepared by:** JLT on 2020-10-01  
Reviewed by: JLT on 2020-10-01  
Approved by: JLT on 2020-12-09  
Revised by: JLT on 2020-12-09



- Legend**
- AEP Substation
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - ◇ Proposed Structure
  - ⚡ Existing 138 kV Transmission Line to be Replaced
  - ⚡ Proposed 138 kV Transmission Line
  - ⚡ Existing and Proposed 100' ROW
  - ⚡ Proposed 50' ROW
  - 🏠 Crane Pad
  - 🚧 Access Road - AR
  - 🌿 NRCS Soils

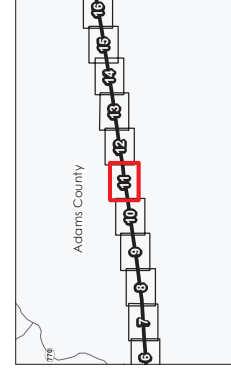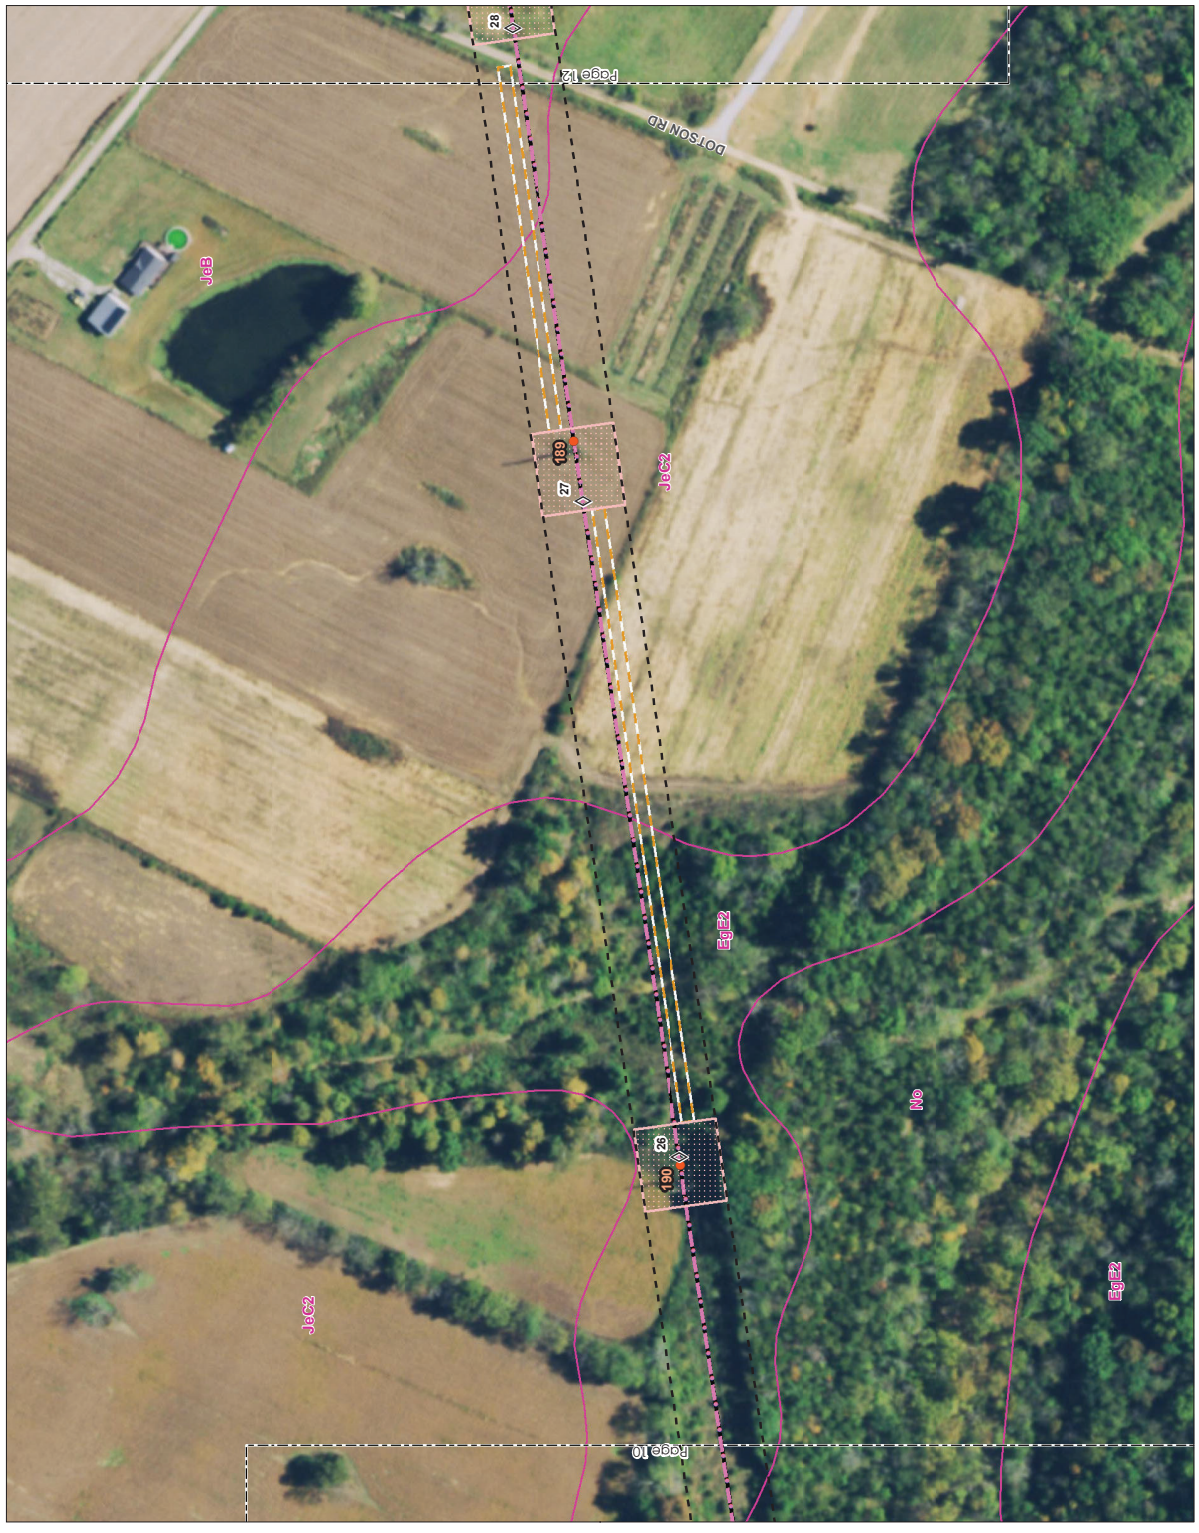

**Notes**

1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet
2. Data Sources: Stantec, AEP, USGS, NRCS, OGRIP, NADIS
3. Background: 2019 NIP



Disclaimer: Stantec does not warrant the accuracy or completeness of the data. The recipient accepts full responsibility for verifying the accuracy and completeness of the data. The recipient releases Stantec, its officers, employees, consultants and agents, from any and all claims arising in any way from the content or provision of the data.



**NRCS Soils**


**Client/Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project

**Project Location**  
Adams County, Ohio

**Prepared by:** JLT on 2020-10-01  
**Reviewed by:** JLT on 2020-10-01  
**Approved by:** JLT on 2020-12-09  
**Revised by:** JLT on 2020-12-09




- Legend**
- AEP Substation
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - ◇ Proposed Structure
  - ⚡ Existing 138 kV Transmission Line to be Replaced
  - ⚡ Existing 138 kV Transmission Line
  - ⚡ Existing and Proposed 100' ROW
  - ⚡ Proposed 50' ROW
  - 🏠 Crane Pad
  - 🚧 Access Road - AR
  - 🌿 NRCS Soils

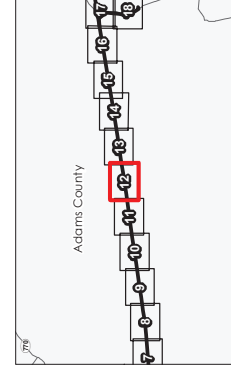

**Notes**

1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet
2. Data Sources: Stantec, AEP, USGS, NRCS, OGRIP, NADs
3. Background: 2019 N/A

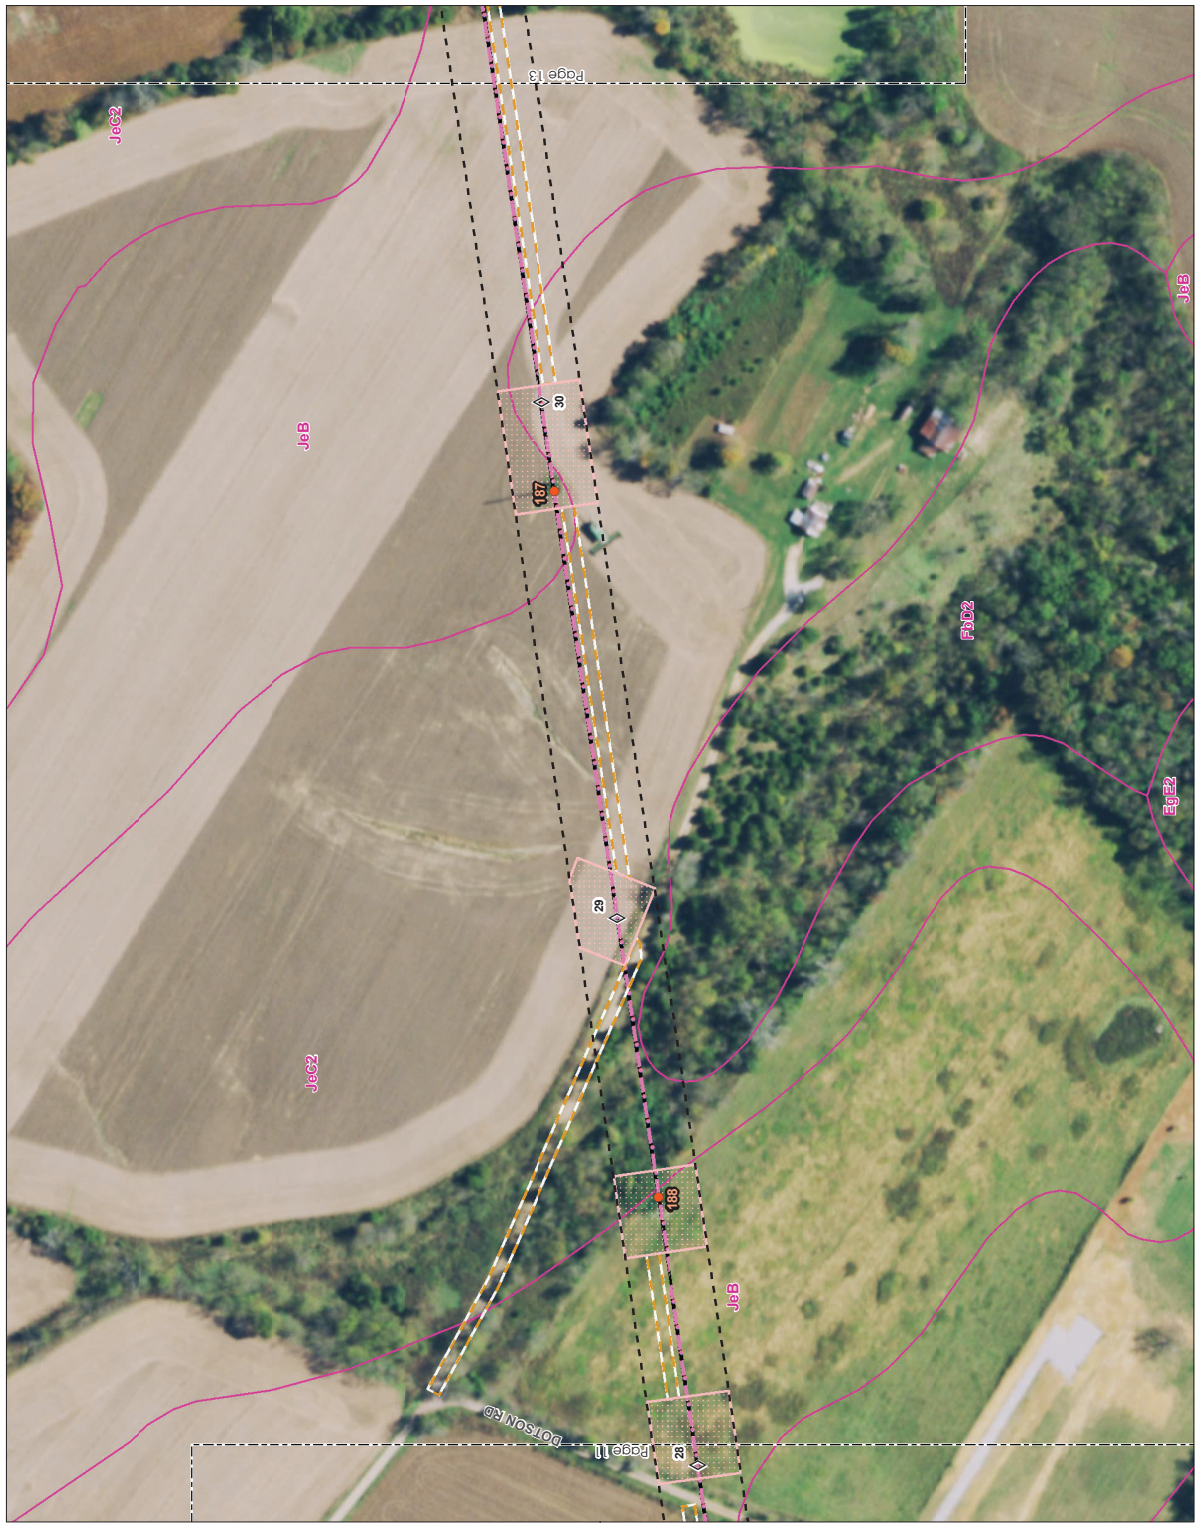

Disclaimer: Stantec does not warrant, represent, or guarantee the accuracy or completeness of the data. The recipient accepts full responsibility for verifying the accuracy and completeness of the data. The recipient releases Stantec, its officers, employees, consultants and agents, from any and all claims arising in any way from the content or provision of the data.




**NRCS Soils**

**County Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project  
Project Location:  
Adams County, Ohio  
Prepared by JLT on 2020-10-01  
Reviewed by JLT on 2020-10-01  
Revised by JLT on 2020-12-09  
1807344800



- Legend**
- AEP Substation
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - ◇ Proposed Structure
  - ⚡ Existing 138 kV Transmission Line to be Replaced
  - ⚡ Existing 138 kV Transmission Line
  - ⚡ Existing and Proposed 100' ROW
  - ⚡ Proposed 50' ROW
  - ▨ Crane Pad
  - Access Road - AR
  - NRCS Soils

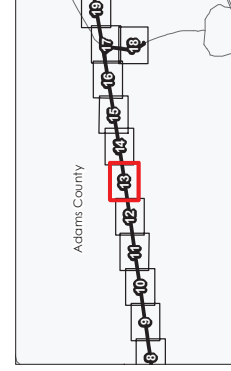

**Notes**  
1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet  
2. Data Sources: Stantec, AEP, USGS, NRCS, OGRIP, NADIS  
3. Background: 2019 NHD





**Project Title**  
**NRCS Soils**


**Client/Project**  
 AEP Ohio Transmission Company, Inc.  
 Seaman-Adams 138 kV Transmission Line Rebuild Project  
 and Lawshe 69 kV Line Extension Project

**Project Location**  
 Adams County, Ohio

**Prepared By** JLT on 2020-10-01  
**Reviewed By** JLT on 2020-10-01  
**Approved By** JLT on 2020-12-09



- Legend**
- AEP Substation
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - ◇ Proposed Structure
  - ⚡ Existing 138 kV Transmission Line to be Replaced
  - ⚡ Existing 138 kV Transmission Line
  - ⚡ Existing and Proposed 100' ROW
  - ⚡ Proposed 50' ROW
  - ▤ Crane Pad
  - ▤ Access Road - AR
  - NRCS Soils

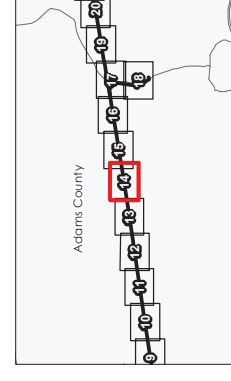

**Notes**

1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet
2. Data Sources: Stantec, AEP, USGS, NRCS, GORP, NADs
3. Background: 2019 N/A



Disclaimer: Stantec does not warrant the accuracy or completeness of the data. The recipient accepts full responsibility for verifying the accuracy and completeness of the data. The recipient releases Stantec, its officers, employees, consultants and agents, from any and all claims arising in any way from the content or provision of the data.











**NRCS Soils**

**Client/Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshs 69 kV Line Extension Project


**Project Location**  
Adams County, Ohio

Prepared by J.L.H on 2020-10-01  
TR by J.C on 2020-12-07  
IR by K.C on 2020-12-09

193704800



- Legend**
- AEP Substation
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - ◇ Proposed Structure
  - Existing 138 kV Transmission Line
  - Proposed 138 kV Transmission Line
  - Existing and Proposed 100' ROW
  - Proposed 50' ROW
  - Crane Pad
  - Access Road - AR
  - NRCS Solls

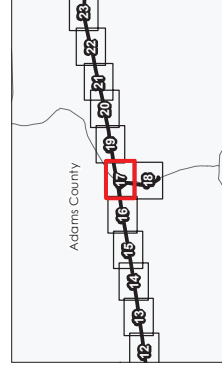

**Notes**

1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet
2. Data Sources: Stanlec, AEP, USGS, NRCS, OGRIP, NADS
3. Background: 2019 NA IP










NRCS Soils

County Project  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project  
Project Location  
Adams County, Ohio  
Prepared by JAL on 2020-10-01  
Reviewed by JAL on 2020-10-01  
Revised by JAL on 2020-12-09



- Legend
- AEP Substation
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - ◇ Proposed Structure
  - ⚡ Existing 138 kV Transmission Line to be Replaced
  - ⚡ Proposed 138 kV Transmission Line
  - ⚡ Existing and Proposed 100' ROW
  - ⚡ Proposed 50' ROW
  - ▨ Crane Pad
  - Access Road - AR
  - NRCS Soils

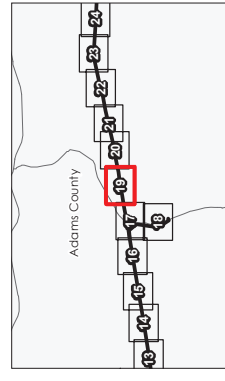

Notes  
1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet  
2. Data Sources: Stantec, AEP, USGS, NRCS, GORP, NADIS  
3. Background: 2019 NIP





**NRCS Soils**


**County Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project

**Project Location**  
Adams County, Ohio

Prepared by JAT on 2020-10-01  
Reviewed by JAT on 2020-10-01  
Approved by JAT on 2020-10-01  
Revised by JAT on 2020-12-09



- Legend**
- AEP Substation
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - ◇ Proposed Structure
  - ⚡ Existing 138 kV Transmission Line to be Replaced
  - ⚡ Proposed 138 kV Transmission Line
  - ⚡ Existing and Proposed 100' ROW
  - ⚡ Proposed 50' ROW
  - 🏠 Crane Pad
  - 🚗 Access Road - AR
  - 🌿 NRCS Soils

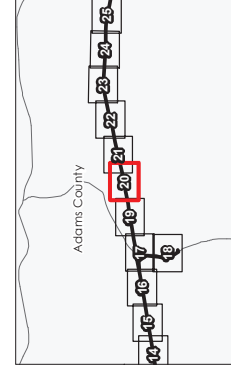

**Notes**

1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet
2. Data Source: Stantec, AEP, USGS, NRCS, GORP, NADIS
3. Background: 2019 NINE



NRCS Soils

Client/Project  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project  
Project Location  
Seaman-Adams, Adams County, Ohio  
Prepared By: JLT on 2020-10-01  
Reviewed By: JLT on 2020-10-01  
Revised By: JLT on 2020-12-09

193704680

11,800

(At original document size of 11x17)

0 75 150 Feet

11,800

Legend

■ AEP Substation

● Existing Structure to Remain

● Existing Structure to be Removed

◇ Proposed Structure

— Existing 138 kV Transmission Line to be Replaced

— Existing 138 kV Transmission Line


— Existing and Proposed 100' ROW

— Proposed 50' ROW

— Crane Pad

— Access Road - AR

○ NRCS Soils

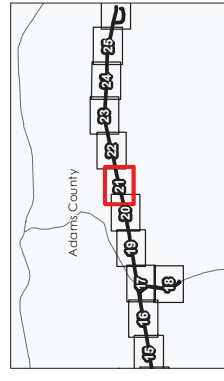

Notes:  
1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet  
2. Data Sources: Stantec, AEP, USGS, NRCS, OGRIP, NAD83  
3. Background: 2019 N/A






**NRCS Soils**

**Client/Project**  
 AEP Ohio Transmission Company, Inc.  
 Seaman-Adams 138 kV Transmission Line Rebuild Project  
 and Lawshe 69 kV Line Extension Project  
**Project Location**  
 Adams County, Ohio  
 Prepared by JAH on 2020-10-01  
 Reviewed by JAH on 2020-10-01  
 Approved by JAH on 2020-12-09  
 R by JAH on 2020-12-09



- Legend**
- AEP Substation
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - ◇ Proposed Structure
  - ⚡ Existing 138 kV Transmission Line to be Replaced
  - ⚡ Existing 138 kV Transmission Line
  - ⚡ Existing and Proposed 100' ROW
  - ⚡ Proposed 50' ROW
  - 🚧 Crane Pad
  - 🚧 Access Road - AR
  - NRCS Soils

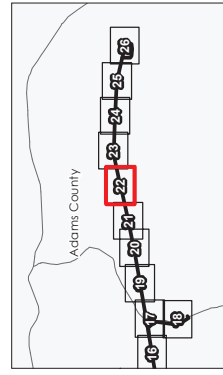



**NRCS Soils**

Client/Project	193704860
----------------	-----------

AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project


Project Location  
Adams County, Ohio



0 75 150 Feet  
(At original document size of 11x17)  
1:1,800

Legend

- AEP Substation  
 ● Existing Structure to Remain  
 ● Existing Structure to be Removed  
 ◇ Proposed Structure  
 ~ Existing 138 kV Transmission Line to be Replaced  
 ~ Proposed 138 kV Transmission Line  
 ~ Existing and Proposed 100' ROW  
 ~ Proposed 50' ROW  
 Crane Pad  
 Access Road - AR  
 NRCS Soils

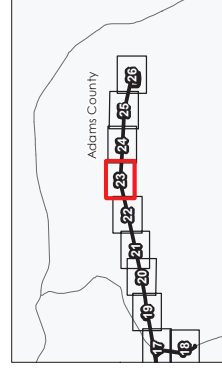

**Notes**

1. Coordinate System : NAD 1983 StatePlane Ohio South FIPS 3402 Feet
2. Data Sources: Stantec, AEP, USGS, NRCS, OGRIP, NADS
3. Background: 2010 NAD ID





**NRCS Soils**


**County Project**  
AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line Rebuild Project  
and Lawshe 69 kV Line Extension Project

**Project Location**  
Adams County, Ohio

Prepared by JAT on 2020-10-01  
Reviewed by JAT on 2020-10-01  
Revised by JAT on 2020-12-09



- Legend**
- AEP Substation
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - ◇ Proposed Structure
  - ⚡ Existing 138 kV Transmission Line to be Replaced
  - ⚡ Proposed 138 kV Transmission Line
  - ⚡ Existing and Proposed 100' ROW
  - ⚡ Proposed 50' ROW
  - ▨ Crane Pad
  - ⚡ Access Road - AR
  - NRCS Soils

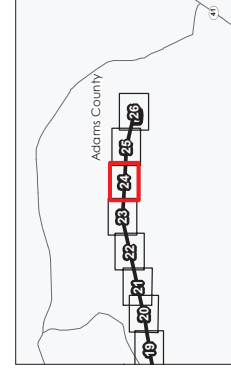

**Notes**

1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet
2. Data Sources: Stantec, AEP, USGS, NRCS, OGRIP, NADIS
3. Background: 2019 NINE










# NRCS Soils

**County Project**  
 AEP Ohio Transmission Company, Inc.  
 Seaman-Adams 138 kV Transmission Line Rebuild Project  
 and Lawshe 69 kV Line Extension Project  
**Project Location**  
 Adams County, Ohio  
 Prepared by JAH on 2020-10-01  
 Reviewed by JAH on 2020-10-01  
 Drawn by JAH on 2020-10-01  
 Checked by JAH on 2020-10-01  
 Approved by JAH on 2020-10-01



- Legend**
- AEP Substation
  - Existing Structure to Remain
  - Existing Structure to be Removed
  - ◇ Proposed Structure
  - ⚡ Existing 138 kV Transmission Line to be Replaced
  - ⚡ Existing 138 kV Transmission Line
  - ⚡ Proposed 100' ROW
  - ⚡ Proposed 50' ROW
  - ▭ Crane Pad
  - ▭ Access Road - AR
  - NRCS Soils

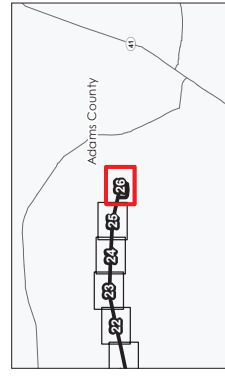

**Notes**  
 1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet  
 2. Data Sources: Stantec, AEP, USGS, NRCS, GORP, NAD5  
 3. Background: 2019 N/A





Figure No.

4

UPDATED: 01/13/2021

## Watershed (HUC 12) Boundary

Client/Project

AEP Ohio Transmission Company, Inc.

Seaman-Adams 138 kV Transmission Line

Rebuild Project

Project Location

Adams County, Ohio

Prepared By: JLT on 2020-10-01

Reviewed By: JLT on 2020-12-09

IR by JLT on 2020-12-09

180704800



### Legend

■ AEP Substation

● Existing Structure to Remain

● Existing Structure to be Removed

◇ Proposed Structure

~ Existing 138 kV Transmission Line to be Replaced

~ Proposed 138 kV Transmission Line



~ Existing and Proposed 100' ROW

~ Proposed 50' ROW

~ Crane Pad

~ Access Road - AR

○ Watershed Boundary

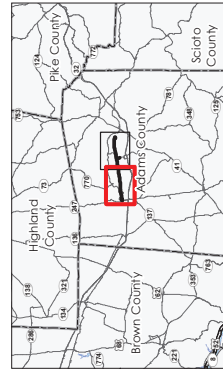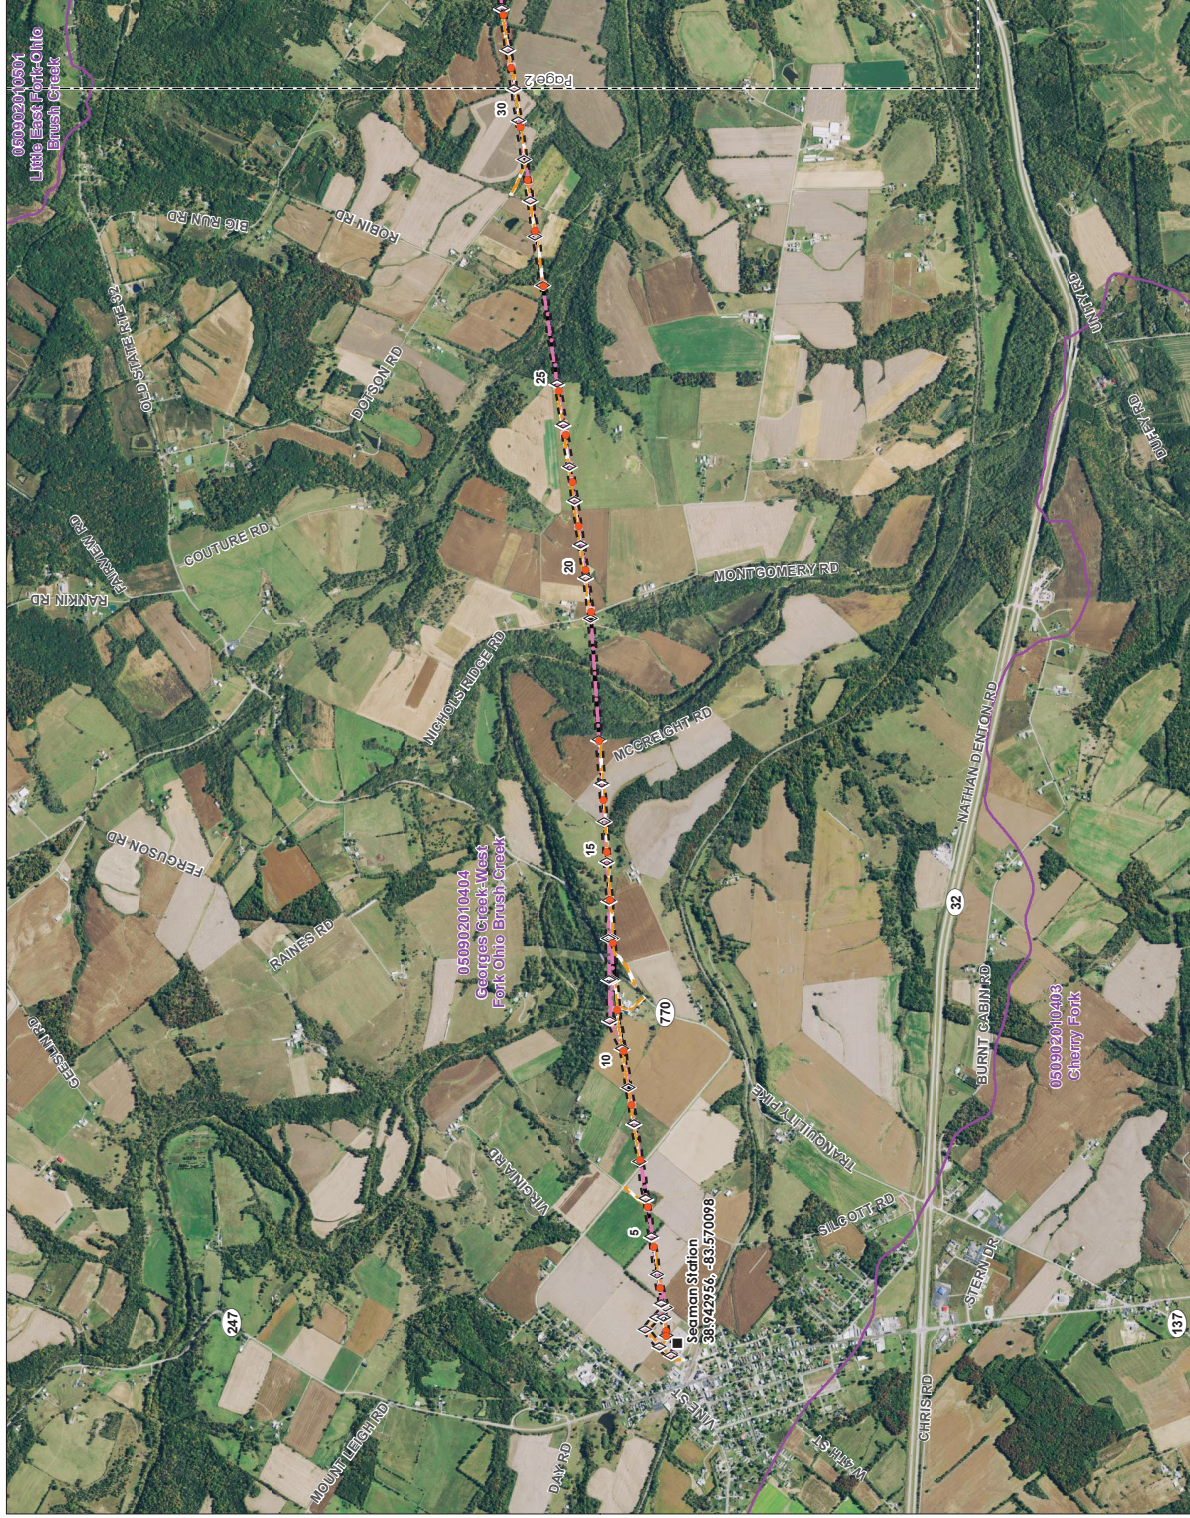

Notes:  
1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet  
2. Data Sources: Stantec, AEP USGS, DOGRIP, NAD83  
3. Background: 2019 N/A





Figure No.

4

UPDATED: 01/13/2021

# Watershed (HUC 12) Boundary

Client/Project

183704800

AEP Ohio Transmission Company, Inc.  
Seaman-Adams 138 kV Transmission Line  
Rebuild Project

Project Location


Adams County, Ohio

Prepared By: JLT on 2020-10-01  
Reviewed By: JLT on 2020-10-01  
Revised By: JLT on 2020-12-09



## Legend

- AEP Substation
- Existing Structure to Remain
- Existing Structure to be Removed
- ◇ Proposed Structure
- Existing 138 kV Transmission Line to be Replaced
- - - Proposed 138 kV Transmission Line
- - - Existing and Proposed 100' ROW
- - - Proposed 50' ROW
- Crane Pad
- Access Road - AR
- Watershed Boundary

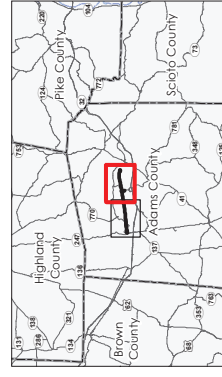

Map  
1. Coordinate System: NAD 1983 StatePlane Ohio South FIPS 3402 Feet  
2. Data Source: Stantec, AEP USGS, OGRIP, MADS  
3. Background: 2019 N/A



Disclaimer: Stantec assumes no responsibility for data supplied in electronic format. The recipient accepts full responsibility for verifying the accuracy and contents of the data. The recipient releases Stantec, its officers, employees, consultants and agents, from any and all claims arising in any way from the content or provision of the data.





## BMP Detail Sheets

Construction Entrance

Filter Sock

Mulching

Temporary Seeding

Permanent Seeding

Concrete Washout

Dust Control



## 7.4 Construction Entrance

---



### Description

A construction entrance is a stabilized pad of stone underlain with a geotextile and is used to reduce the amount of mud tracked off-site with construction traffic. Located at points of ingress/egress, the practice is used to reduce the amount of mud tracked off-site with construction traffic.

### Conditions Where Practice Applies

A construction entrance is applicable where:

- Construction traffic leaves active construction areas and enters public roadways or areas unchecked by effective sediment controls;
- Areas where frequent vehicle and equipment access is expected and likely to contribute sediment to runoff, such as at the entrance to individual building lots.

### Planning Considerations

Construction entrances address areas that contribute significant amounts of mud to runoff by providing a stable area for traffic. Although they allow some mud to be removed from construction vehicle tires before they enter a public roads, they should not be the only practice relied upon to manage off-site tracking. Since most mud is flung from tires as they reach higher speeds, restricting traffic to stabilized construction roads, entrances and away from muddy areas is necessary.



If a construction entrance is not sufficient to remove the majority of mud from wheels or there is an especially sensitive traffic situation on adjacent roads, wheel wash areas may be necessary. This requires an extended width pad to avoid conflicts with traffic, a supply of wash water and sufficient drainage to assure runoff is captured in a sediment pond or trap.

Proper installation of a construction entrance requires a geotextile and proper drainage to insure construction site runoff does not leave the site. The use of geotextile under the stone helps to prevent potholes from developing and will save the amount of stone needed during the life of the practice. Proper drainage may include culverts to direct water under the roadway or water bars to direct muddy water off the roadway toward sediment traps or ponds.

### **Design Criteria**

The area of the entrance must be cleared of all vegetation, roots, and other objectionable material. Geotextile will then be placed the full width and length of the entrance.

Stone shall be placed to a depth of at least 6 inches. Roads subject to heavy duty loads should be increased to a minimum of 10 inches. Surface water shall be conveyed under the entrance, through culverts, or diverted via a water bars or mountable berms (minimum 5:1 slopes) so as to convey sediment laden runoff to sediment control practices or to allow clean water to pass by the entrance.

The stabilized construction entrance shall meet the specifications that follow.

### **Maintenance**

The entrance shall be maintained in a condition that will prevent tracking or flow of mud onto public rights-of-way. This may require periodic top dressing with additional stone or the washing and reworking of existing stone as conditions demand and repair and/or cleanout of any structures used to trap sediment. All materials spilled, dropped, washed, or tracked from vehicles onto roadways or into storm drains must be removed immediately. The use of water trucks to remove materials dropped, washed, or tracked onto roadways will not be permitted under any circumstances.

### **Common Problems / Concerns**


Mud is allowed to accumulate and is tracked on to public right-of-ways. The entrance and associated construction roads may need dressing with additional stone.

Soft depression areas develop in entrance area. Stone may not have been underlain with geotextile or insufficient stone base has been provided.



Specifications  
for  
**Construction Entrance**

---

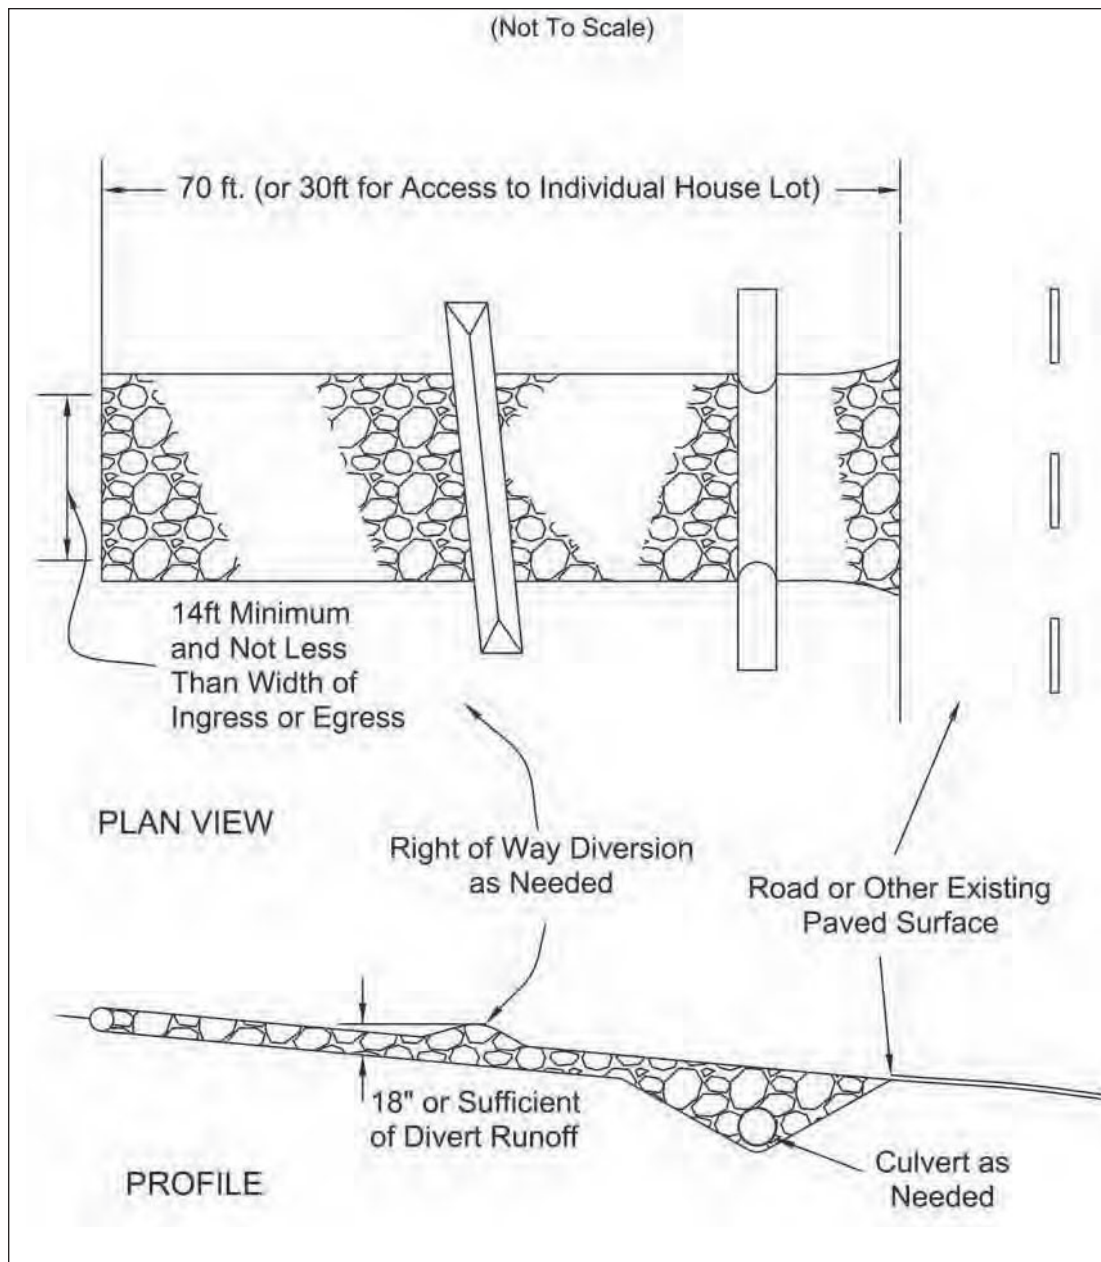



# Specifications for **Construction Entrance**

---

1. **Stone Size**—ODOT # 2 (1.5-2.5 inch) stone shall be used, or recycled concrete equivalent.
2. **Length**—The Construction entrance shall be as long as required to stabilize high traffic areas but not less than 70 ft. (exception: apply 30 ft. minimum to single residence lots).
3. **Thickness** -The stone layer shall be at least 6 inches thick for light duty entrances or at least 10 inches for heavy duty use.
4. **Width** -The entrance shall be at least 14 feet wide, but not less than the full width at points where ingress or egress occurs.
5. **Geotextile** -A geotextile shall be laid over the entire area prior to placing stone. It shall be composed of strong rot-proof polymeric fibers and meet the following specifications:
  6. **Timing**—The construction entrance shall be installed as soon as is practicable before major grading activities.
  7. **Culvert** -A pipe or culvert shall be constructed under the entrance if needed to prevent surface water from flowing across the entrance or to prevent runoff from being directed out onto paved surfaces.
  8. **Water Bar** -A water bar shall be constructed as part of the construction entrance if needed to prevent surface runoff from flowing the length of the construction entrance and out onto paved surfaces.
  9. **Maintenance** -Top dressing of additional stone shall be applied as conditions demand. Mud spilled, dropped, washed or tracked onto public roads, or any surface where runoff is not checked by sediment controls, shall be removed immediately. Removal shall be accomplished by scraping or sweeping.
  10. Construction entrances shall not be relied upon to remove mud from vehicles and prevent off-site tracking. Vehicles that enter and leave the construction-site shall be restricted from muddy areas.
  11. **Removal**—the entrance shall remain in place until the disturbed area is stabilized or replaced with a permanent roadway or entrance.

**Figure 7.4.1**

Geotextile Specification for Construction Entrance	
Minimum Tensile Strength	200 lbs.
Minimum Puncture Strength	80 psi.
Minimum Tear Strength	50 lbs.
Minimum Burst Strength	320 psi.
Minimum Elongation	20%
Equivalent Opening Size	EOS < 0.6 mm.
Permittivity	1×10 <sup>-3</sup> cm/sec.



## 6.6 Filter Sock

---



### Description

Filter socks are sediment-trapping devices using compost inserted into a flexible, permeable tube with a pneumatic blower device or equivalent. Filter socks trap sediment by filtering water passing through the berm and allowing water to pond, creating a settling of solids.

### Conditions where practice applies

Filter socks are appropriate for limited drainage areas, requiring sediment control where runoff is in the form of sheet flow or in areas that silt fence is normally considered acceptable. The use of filter socks is applicable to slopes up to 2:1 (H:V), around inlets, and in other disturbed areas of construction sites requiring sediment control. Filter socks also may be useful in areas, where migration of aquatic life such as turtles, salamanders and other aquatic life would be impeded by the use of silt fence.

### Planning Considerations

Filter socks are sediment barriers, capturing sediment by ponding and filtering water through the device during rain events. They may be a preferred alternative where equipment may drive near or over sediment barriers, as they are not as prone to complete failure as silt fence if this occurs during construction. Driving over filter socks is not recommended; but if it should occur, the filter sock should be inspected immediately, repaired and moved back into place as soon as possible.



## Design Criteria

Typically, filter socks can handle the same water flow or slightly more than silt fence. For most applications, standard silt fence is replaced with 12" diameter filter socks. However, proper installation is especially important for them to work effectively.

**Materials** – Compost/mulch used for filter socks shall be weed free and derived from a well-decomposed source of organic matter. The compost shall be produced using an aerobic composting process meeting CFR 503 regulations, including time and temperature data indicating effective weed seed, pathogen and insect larvae kill. The compost shall be free of any refuse, contaminants or other materials toxic to plant growth. Non-composted products are not acceptable.

Materials should meet the following requirements: pH between 5.0-8.0; 100% passing a 2" sieve and a minimum of 70% greater than the 3/8" sieve; moisture content is less than 60%; material shall be relatively free (<1% by dry weight) of inert or foreign man made materials.

**Level Contour** – Place filter socks on the level contour of the land so that flows are dissipated into uniform sheet flow. Flow coming to filter socks must not be concentrated and the filter sock should lie perpendicular to flows.

**Flat Slopes** – When possible, place filter socks at a 5' or greater distance away from the toe of the slopes in order for the water coming from the slopes to maximize space available for sediment deposit (see the illustration). When this is not possible due to construction limitations, additional filter socks may be required upslope of the initial filter sock (see the chart below for appropriate slope lengths and spacing).

**Flow Around Ends** – In order to prevent water flowing around the ends of filter socks, the ends of the filter socks must be constructed pointing upslope so the ends are at a higher elevation.

**Vegetation** – For permanent areas, seeding filter socks is recommended to establish vegetation directly in the sock and immediately in front and back of the sock at a distance of 5 feet. Vegetating on and around the filter socks will assist in slowing down water for filtration creating a more effective longer-term sediment control.

**Drainage Area:** Generally filter socks are limited to ¼ to ½ acre drainage area per 100 foot of the sediment barrier. Specific guidance is given in the chart below.

**Table 6.6.1 Maximum Slope Length Above Filter Sock and Recommended Diameter**

Slope	Ratio (H:V)	8"	12"	18"	24"
0% - 2%	10% - 20%	125	250	300	350
10% - 20%	50:1 - 10:1	100	125	200	250
2% - 10%	10:1 - 5:1	75	100	150	200
20% - 33%	5:1 - 2:1		50	75	100
>50%	>2:1		25	50	75

Note: For larger drainage areas, see standards for temporary diversions, sediment traps and sediment basins.



*Dispersing flow* – Sheet flow and runoff should not exceed berm height or capacity in most storm events. If overflow of the berm is a possibility, a larger filter sock should be installed or an alternative sediment control should be used.

*Maintenance* – Filter socks should be regularly inspected to make sure they hold their shape, are ponding, and allowing adequate flow through. If ponding becomes excessive, filter socks should be replaced. Used filter socks may be cut and the compost dispersed and seeded to prevent captured sediment from being resuspended.

*Removal* – When construction is completed on site, the filter socks may be cut and dispersed with a loader, rake, bulldozer or other device to be incorporated into the soil or left on top of the soil for final seeding. The mesh netting material will be disposed of in normal trash container or removed by the contractor.


## References

Standard Specification for Compost for Erosion/Sediment Control (Filter Berms) AASHTO Designation: MP-9 <http://www.iaasla.org/NEWS/FILES/AASHTO-Filterberm6.doc>



Specifications  
for  
**Filter Sock**

---

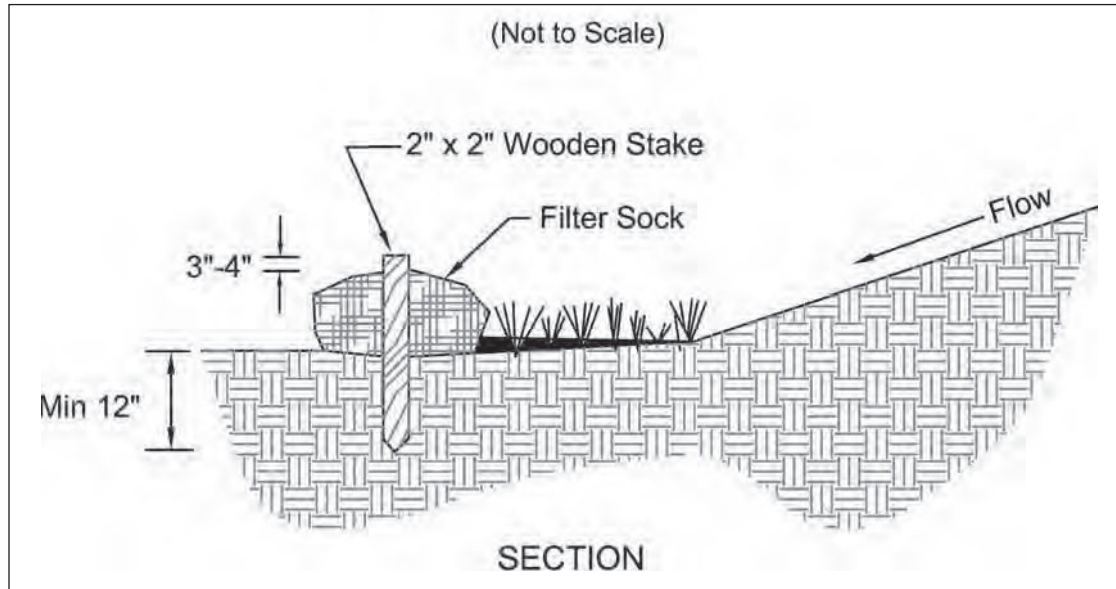

1. Materials – Compost used for filter socks shall be weed, pathogen and insect free and free of any refuse, contaminants or other materials toxic to plant growth. They shall be derived from a well-decomposed source of organic matter and consist of a particles ranging from 3/8" to 2".
2. Filter Socks shall be 3 or 5 mil continuous, tubular, HDPE 3/8" knitted mesh netting material, filled with compost passing the above specifications for compost products.

**INSTALLATION:**

3. Filter socks will be placed on a level line across slopes, generally parallel to the base of the slope or other affected area. On slopes approaching 2:1, additional socks shall be provided at the top and as needed mid-slope.
4. Filter socks intended to be left as a permanent filter or part of the natural landscape, shall be seeded at the time of installation for establishment of permanent vegetation.

5. Filter Socks are not to be used in concentrated flow situations or in runoff channels.

**MAINTENANCE:**


6. Routinely inspect filter socks after each significant rain, maintaining filter socks in a functional condition at all times.
7. Remove sediments collected at the base of the filter socks when they reach 1/3 of the exposed height of the practice.
8. Where the filter sock deteriorates or fails, it will be repaired or replaced with a more effective alternative.
9. Removal – Filter socks will be dispersed on site when no longer required in such as way as to facilitate and not obstruct seedings.




## Slope Stability Specifications

On hillside areas with slopes of 3:1 or steeper, fiber rolls shall be used as slope interruption devices. Fiber rolls consist of biodegradable materials such as, wood excelsior, rice or wheat straw or coconut fibers rolled and bound into a tight tubular roll and placed on slopes to intercept runoff, and reduce flow velocity. The rolls shall be installed on the contour of the land so that they are perpendicular to the flow. The ends of the rolls shall extend into an area of stable vegetation and be pointed upslope into an area of to discourage flow. For slopes of 2:1 or greater and 12" diameter rolls should be installed on 25' intervals down the slope for slopes of 3:1, 9" diameter rolls should be installed on 50' intervals. The rolls should be installed prior to seeding and can remain as a permanent slope stability feature.

Disturbed areas are to be seeded and mulched as soon as possible. This will prevent soil erosion and the possible slope instability. For slopes of 2:1 or greater or if seeding is taking place early spring or after October 15, it will be necessary to utilize erosion control blankets over the seeding. The erosion control blankets shall be coconut fiber with jute netting. Another option is use of a high performance hydraulic mulch designed for steep slopes such as HydraCX2™ Extreme Slope Matrix , Flexterra® High Performance-Flexible Growth Medium™ or equivalent product should be used for the seeding.

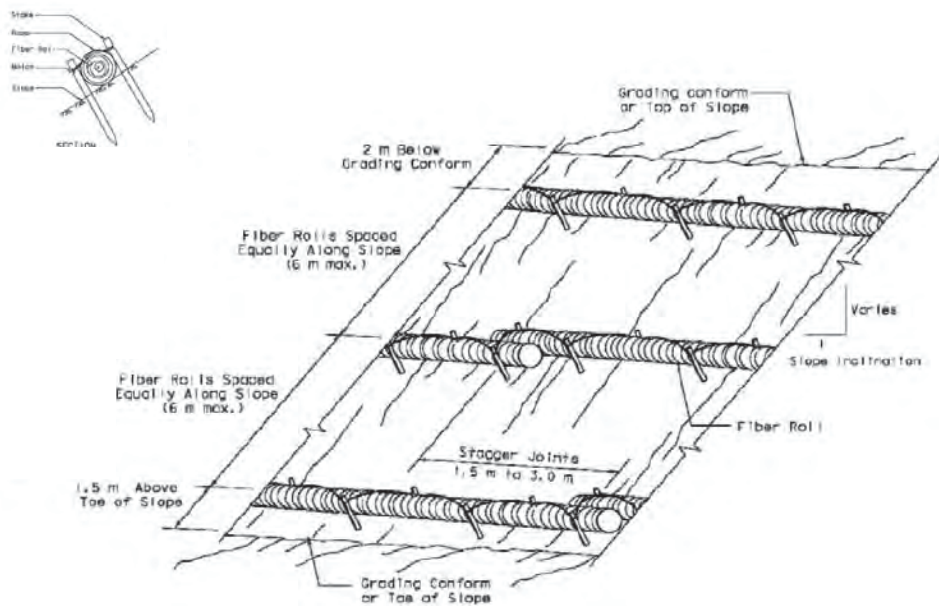




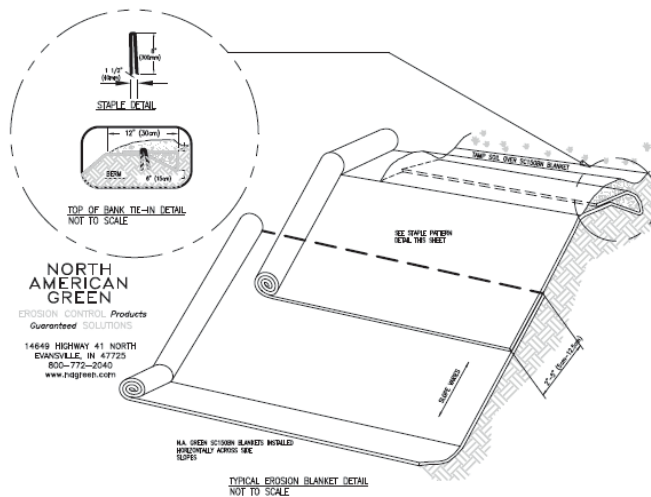

1. PREPARE SOIL BEFORE INSTALLING ROLLED EROSION CONTROL PRODUCTS (RECP's), INCLUDING ANY NECESSARY APPLICATION OF LIMES, FERTILIZER, AND SEED.  
NOTE: WHEN USING CELL-O-SEED DO NOT SEED PREPARED AREA. CELL-O-SEED MUST BE INSTALLED WITH PAPER SIDE DOWN.
2. BEGIN AT THE TOP OF THE SLOPE BY ANCHORING THE RECP's IN A 6" (15 CM) DEEP X 6" (15 CM) WIDE TRENCH WITH APPROXIMATELY 12" (30 CM) OF RECP'S EXTENDED BEYOND THE UP-SLOPE PORTION OF THE TRENCH. ANCHOR THE RECP's WITH A ROW OF STAPLES/STAKES APPROXIMATELY 12" (30 CM) APART IN THE BOTTOM OF THE TRENCH. BACKFILL AND COMPACT THE TRENCH AFTER STAPLING. APPLY SEED TO COMPACTED SOIL AND FOLD REMAINING 12" (30 CM) PORTION OF RECP'S BACK OVER SEED AND COMPACTED SOIL. SECURE RECP'S OVER COMPACTED SOIL WITH A ROW OF STAPLES/STAKES SPACED APPROXIMATELY 12" (30 CM) APART ACROSS THE WIDTH OF THE RECP's.
3. ROLL THE RECP's (A) DOWN OR (B) HORIZONTALLY ACROSS THE SLOPE. RECP's WILL UNROLL WITH APPROPRIATE SIDE AGAINST THE SOIL SURFACE. ALL RECP's MUST BE SECURELY FASTENED TO SOIL SURFACE BY PLACING STAPLES/STAKES IN APPROPRIATE LOCATIONS AS SHOWN IN THE STAPLE PATTERN GUIDE. WHEN USING THE DOT SYSTEM™ - STAPLES/STAKES SHOULD BE PLACED THROUGH EACH OF THE COLORED DOTS CORRESPONDING TO THE APPROPRIATE STAPLE PATTERN.
4. THE EDGES OF PARALLEL RECP's MUST BE STAPLED WITH APPROXIMATELY 2" - 5" (5 CM - 12.5 CM) OVERLAP DEPENDING ON RECP's TYPE.
5. CONSECUTIVE RECP's SPICED DOWN THE SLOPE MUST BE PLACED END OVER END (SHINGLE STYLE) WITH AN APPROXIMATE 3" (7.5 CM) OVERLAP. STAPLE THROUGH OVERLAPPED AREA, APPROXIMATELY 12" (30 CM) APART ACROSS ENTIRE RECP's WIDTH.  
NOTE:  
\*IN LOOSE SOIL CONDITIONS, THE USE OF STAPLE OR STAKE LENGTHS GREATER THAN 6" (15 CM) MAY BE NECESSARY TO PROPERLY SECURE THE RECP's.

## DOT SYSTEM™ STAPLE PATTERN GUIDE

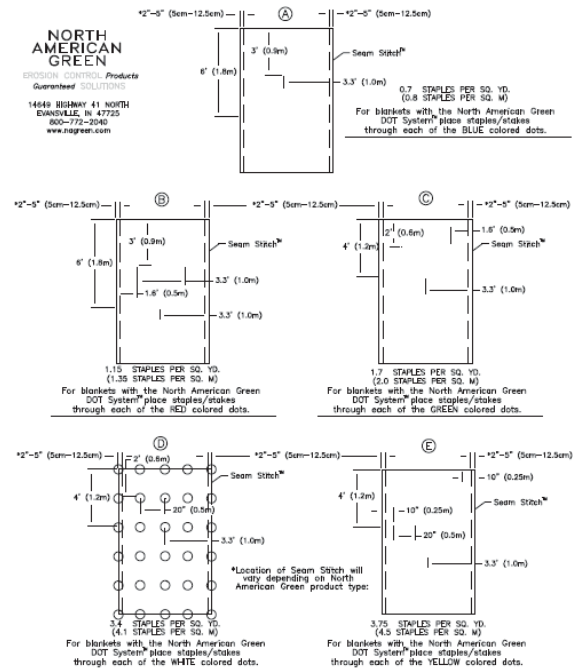

## EROSION CONTROL BLANKET NOT TO SCALE



## 7.9 Mulching

---



### Description

A protective layer of mulch, usually of straw, applied to bare soil is used to abate erosion by shielding it from raindrop impact. Mulch also helps establish vegetation by conserving moisture and creating favorable conditions for seeds to germinate.

### Conditions Where Practice Applies

Mulch should be used liberally throughout construction to limit the areas that are bare and susceptible to erosion. Mulch can be used in conjunction with seeding to establish vegetation or by itself to provide erosion control when the season does not allow grass to grow. Mulch and other vegetative practices must be applied on all disturbed portions of construction-sites that will not be re-disturbed for more than 21 days.

### Design Criteria

See specifications for Mulching.

### Maintenance

Additional mulching is necessary to cover exposed soil conditions when observed during routine maintenance inspections.



### **Common Problems / Concerns**

The application of synthetic binders must be conducted in such a manner as to not be introduced into watercourses.

Weather considerations must be addressed to ensure the application of synthetic binders are not washed away and introduced into watercourses.

The use of a mulch cover is not recommended for areas, which will exhibit higher velocities than 3.5 feet/second. An erosion control matting is recommended for areas which will exhibit higher velocities.

Areas which have been mulched should be inspected and maintained if necessary every 7 days or within 24 hours of a rain event greater than or equal to 0.5 inches to ensure adequate protection.



Specifications  
for  
**Mulching**

---

1. Mulch and other appropriate vegetative practices shall be applied to disturbed areas within 7 days of grading if the area is to remain dormant (undisturbed) for more than 21 days or on areas and portions of the site which can be brought to final grade.
2. Mulch shall consist of one of the following:
  - Straw - Straw shall be unrotted small grain straw applied at the rate of 2 tons/ac. or 90 lb./1,000 sq. ft. (two to three bales). The straw mulch shall be spread uniformly by hand or mechanically so the soil surface is covered. For uniform distribution of hand-spread mulch, divide area into approximately 1,000 sq.ft. sections and place two 45-lb. bales of straw in each section.
  - Hydroseeders - Wood cellulose fiber should be used at 2,000 lb./ac. or 46 lb./1,000 sq. ft.
  - Other - Acceptable mulches include mulch mattings and rolled erosion control products applied according to manufacturer's recommendations or wood mulch/chips applied at 10-20 tons/ac.
3. Mulch Anchoring - Mulch shall be anchored immediately to minimize loss by wind or runoff. The following are acceptable methods for anchoring mulch.
  - Mechanical - Use a disk, crimper, or similar type tool set straight to punch or anchor the mulch material into the soil. Straw mechanically anchored shall not be finely chopped but be left generally longer than 6 inches.
  - Mulch Nettings - Use according to the manufacturer's recommendations, following all placement and anchoring requirements. Use in areas of water concentration and steep slopes to hold mulch in place.
  - Synthetic Binders - For straw mulch, synthetic binders such as Acrylic DLR (Agri-Tac), DCA-70, Petroset, Terra Tack or equal may be used at rates recommended by the manufacturer. All applications of Sythetic Binders must be conducted in such a manner where there is no contact with waters of the state.
  - Wood Cellulose Fiber - Wood cellulose fiber may be used for anchoring straw. The fiber binder shall be applied at a net dry weight of 750 lb./acre. The wood cellulose fiber shall be mixed with water and the mixture shall contain a maximum of 50 lb./100 gal. of wood cellulose fiber.



## 7.8 Temporary Seeding

---



### Description

Temporary seedings establish temporary cover on disturbed areas by planting appropriate rapidly growing annual grasses or small grains. Temporary seeding provides erosion control on areas in between construction operations. Grasses, which are quick growing, are seeded and usually mulched to provide prompt, temporary soil stabilization. It effectively minimizes the area of a construction site prone to erosion and should be used everywhere the sequence of construction operations allows vegetation to be established.

### Conditions Where the Practice Applies

Temporary seeding should be applied on exposed soil where additional work (grading, etc.) is not scheduled for more than 21 days. Permanent seeding should be applied if the areas will be idle for more than one year.

### Planning Considerations

This practice has the potential to drastically reduce the amount of sediment eroded from a construction site. Erosion control efficiencies greater than 90% will be achieved with proper applications of temporary seeding. Because practices used to trap sediment are usually much less effective, temporary seeding is to be used even on areas where runoff is treated by sediment trapping practices. Because temporary seeding is highly effective and practical on construction sites, its liberal use is highly recommended.



## Design Criteria

Specifications follow these explanations of important aspects of temporary seeding.

**Plant Selection:** Select the plants appropriate from the table in the Specifications for Temporary seeding. Choose varieties of tall fescue that are endophyte free or have non-toxic endophytes. Seeding rates for dormant seedings are increased by 50 percent. More information on dormant seedings is given in the permanent seeding section.

The length of time the area will idle and the season in which seeding occurs should influence the selection of seeding species. For areas remaining idle for over a year, a mixture containing perennial ryegrass is recommended. Cereal grains (rye, oats and wheat) are included in some of the mixtures as cover crops. These are annual plants that will die after producing seed. Realize that oats will not over-winter and continue to grow as wheat and rye do.

**Site preparation:** Temporary seeding is best done on a prepared soil seedbed of loose pulverized soil. However, seedings should not be delayed, if additional grading operations are not possible. At a minimum, remove large rock or debris that will interfere with seeding operations. If the ground has become crusted, a disk or a harrow should be used to loosen the soil. Overall the best soil conditions will exist immediately after grading operations cease, when soils remain loose and moist.

**Soil amendments:** A soil test is necessary to adequately predict the need for lime and fertilizer. Seedings that are expected to be long lasting (over 1-3 months), should have lime and fertilizer applied as recommended by a soil test. In lieu of a soil test, fertilizer can be broadcast and worked into the top inch of soil at the rate of 6 pounds/1000 ft<sup>2</sup> or 250 pounds per acre of 10-10-10 or 12-12-12.

**Seeding Methods:** Seed shall be applied uniformly with a cyclone spreader, drill, culti-packer seeder, or hydroseeder. When feasible, seed that has been broadcast shall be covered by raking or dragging and then lightly tamped into place using a roller or cultipacker. If hydroseeding is used, the seed and fertilizer will be mixed on-site and the seeding shall be done immediately and without interruption.

## Maintenance

Areas failing to establish vegetative cover adequate to prevent erosion shall be reseeded as soon as such areas are identified.

Seeding performed during hot and dry summer months shall be watered at a rate of 1 inch per week.

## Common Problems / Concerns

- Insufficient topsoil or inadequately tilled, limed, and/ or fertilized seedbed results in poor establishment of vegetation.
- An overly high seeding rate of nurse crop (oat, rye or wheat) in the seed mixture results in over competition with the perennials.
- Seeding outside of seeding dates results in poor vegetation establishment and a decrease in plant hardiness.
- An inadequate rate of mulch results in poor germination and failure.



# Specifications for **Temporary Seeding**

**Table 7.8.1 Temporary Seeding Species Selection**

Seeding Dates	Species	Lb./1000 ft2	Lb/Acre
March 1 to August 15	Oats	3	128 (4 Bushel)
	Tall Fescue	1	40
	Annual Ryegrass	1	40
	Perennial Ryegrass	1	40
	Tall Fescue	1	40
	Annual Ryegrass	1	40
	Annual Ryegrass	1.25	55
	Perennial Ryegrass	3.25	142
	Creeping Red Fescue	0.4	17
	Kentucky Bluegrass	0.4	17
	Oats	3	128 (3 bushel)
	Tall Fescue	1	40
	Annual Ryegrass	1	40
August 16th to November	Rye	3	112 (2 bushel)
	Tall Fescue	1	40
	Annual Ryegrass	1	40
	Wheat	3	120 (2 bushel)
	Tall Fescue	1	40
	Annual Ryegrass	1	40
	Perennial Rye	1	40
	Tall Fescue	1	40
	Annual Ryegrass	1	40
	Annual Ryegrass	1.25	40
	Perennial Ryegrass	3.25	40
	Creeping Red Fescue	0.4	40
	Kentucky Bluegrass	0.4	
November 1 to Feb. 29	Use mulch only or dormant seeding		

Note: Other approved species may be substituted.

1. Structural erosion and sediment control practices such as diversions and sediment traps shall be installed and stabilized with temporary seeding prior to grading the rest of the construction site.
2. Temporary seed shall be applied between construction operations on soil that will not be graded or reworked for 21 days or greater. These idle areas shall be seeded within 7 days after grading.
3. The seedbed should be pulverized and loose to ensure the success of establishing vegetation. Temporary seeding should not be postponed if ideal seedbed preparation is not possible.
4. Soil Amendments—Temporary vegetation seeding rates shall establish adequate stands of vegetation, which may require the use of soil amendments. Base rates for lime and fertilizer shall be used.
5. Seeding Method—Seed shall be applied uniformly with a cyclone spreader, drill, cultipacker seeder, or hydroseeder. When feasible, seed that has been broadcast shall be covered by raking or dragging and then lightly tamped into place using a roller or cultipacker. If hydroseeding is used, the seed and fertilizer will be mixed on-site and the seeding shall be done immediately and without interruption.



Specifications  
for  
**Temporary Seeding**

---

### Mulching Temporary Seeding

1. Applications of temporary seeding shall include mulch, which shall be applied during or immediately after seeding. Seedings made during optimum seeding dates on favorable, very flat soil conditions may not need mulch to achieve adequate stabilization.
2. Materials:
  - Straw—If straw is used, it shall be unrotted small-grain straw applied at a rate of 2 tons per acre or 90 lbs./ 1,000 sq. ft. (2-3 bales)
  - Hydroseeders—If wood cellulose fiber is used, it shall be used at 2000 lbs./ ac. or 46 lb./ 1,000-sq.-ft.
  - Other—Other acceptable mulches include mulch mattings applied according to manufacturer's recommendations or wood chips applied at 6 ton/ ac.
3. Straw Mulch shall be anchored immediately to minimize loss by wind or water. Anchoring methods:
  - Mechanical—A disk, crimper, or similar type tool shall be set straight to punch or anchor the mulch material into the soil. Straw mechanically anchored shall not be finely chopped but left to a length of approximately 6 inches.
  - Mulch Netting—Netting shall be used according to the manufacturers recommendations. Netting may be necessary to hold mulch in place in areas of concentrated runoff and on critical slopes.
  - Synthetic Binders—Synthetic binders such as Acrylic DLR (Agri-Tac), DCA-70, Petroset, Terra Track or equivalent may be used at rates recommended by the manufacturer.
  - Wood-Cellulose Fiber—Wood-cellulose fiber binder shall be applied at a net dry wt. of 750 lb./ac. The wood-cellulose fiber shall be mixed with water and the mixture shall contain a maximum of 50 lb. / 100 gal.

## 7.10 Permanent Seeding

---



### Description

Perennial vegetation is established on areas that will not be re-disturbed for periods longer than 12 months. Permanent seeding includes site preparation, seedbed preparation, planting seed, mulching, irrigation and maintenance.

Permanent vegetation is used to stabilize soil, reduce erosion, prevent sediment pollution, reduce runoff by promoting infiltration, and provide stormwater quality benefits offered by dense grass cover.

### Conditions Where Practice Applies

Permanent seeding should be applied to:

- Any disturbed areas or portions of construction sites at final grade. Permanent seeding should not be delayed on any one portion of the site at final grade while construction on another portion of the site is being completed. Permanent seeding shall be completed in phases, if necessary.
- Areas subject to grading activities but will remain dormant for a year or more.

### Planning Considerations

Vegetation controls erosion by reducing the velocity and the volume of overland flow and protects bare soil surface from raindrop impact. A healthy, dense turf promotes infiltration and reduces the amount of runoff. The establishment of quality vegetation requires selection of the right plant materials for the site, adequate soil amendments, careful seedbed preparation, and maintenance.



**Soil Compaction**—Storm water quality and the amount of runoff both vary significantly with soil compaction. Non-compacted soils improve stormwater infiltration by promoting:

- dense vegetative growth;
- high soil infiltration & lower runoff rates;
- pollutant filtration, deposition & absorption; and
- beneficial biologic activity in the soil.

Construction activity creates highly compacted soils that restrict water infiltration and root growth. The best time for improving soil condition is during the establishment of permanent vegetation. It is highly recommended that subsoilers, plows, or other implements are specified as part of final seedbed preparation. Use discretion in slip-prone areas.

**Minimum Soil Conditions**—Vegetation cannot be expected to stabilize soil that is unstable due to its texture, structure, water movement or excessively steep slope. The following minimum soil conditions are needed for the establishment and maintenance of a long-lived vegetative cover. If these conditions cannot be met, see the standards and specifications for Topsoiling.

- Soils must include enough fine-grained material to hold at least a moderate amount of available moisture.
- The soil must be free from material that is toxic or otherwise harmful to plant growth.

## **Design Criteria**

See specifications for permanent seeding below.

## **Maintenance**

1. Expect emergence within 4 to 28 days after seeding, with legumes typically following grasses. Check permanent seedlings within 4 to 6 weeks after planting. Look for:
  - Vigorous seedlings;
  - Uniform ground surface coverage with at least 30% growth density;
  - Uniformity with legumes and grasses well intermixed;
  - Green, not yellow, leaves. Perennials should remain green throughout the summer, at least at the plant bases.
2. Permanent seeding shall not be considered established for at least 1 full year from the time of planting. Inspect the seeding for soil erosion or plant loss during this first year. Repair bare and sparse areas. Fill gullies. Re-fertilize, re-seed, and re-mulch if required. Consider no-till planting. A minimum of 70% growth density, based on a visual inspection, must exist for an adequate permanent vegetative planting.
  - If stand is inadequate or plant cover is patchy, identify the cause of failure and take corrective action: choice of plant materials, lime and fertilizer quantities, poor seedbed preparation, or weather. If vegetation fails to grow, have the soil tested to determine whether pH is in the correct range or nutrient deficiency is a problem.
  - Depending on stand conditions, repair with complete seedbed preparation, then over-seed or re-seed.
  - If it is the wrong time of year to plant desired species, over-seed with small grain cover crop to thicken the stand until timing is right to plant perennials or use temporary seeding. See Temporary Seeding standard.

Specifications  
for  
**Permanent Seeding**

---

### **Site Preparation**

1. Subsoiler, plow, or other implement shall be used to reduce soil compaction and allow maximum infiltration. (Maximizing infiltration will help control both runoff rate and water quality.) Subsoiling should be done when the soil moisture is low enough to allow the soil to crack or fracture. Subsoiling shall not be done on slip-prone areas where soil preparation should be limited to what is necessary for establishing vegetation.
2. The site shall be graded as needed to permit the use of conventional equipment for seedbed preparation and seeding.
3. Topsoil shall be applied where needed to establish vegetation.

### **Seedbed Preparation**

1. Lime—Agricultural ground limestone shall be applied to acid soil as recommended by a soil test. In lieu of a soil test, lime shall be applied at the rate of 100 pounds per 1,000-sq. ft. or 2 tons per acre.
2. Fertilizer—Fertilizer shall be applied as recommended by a soil test. In place of a soil test, fertilizer shall be applied at a rate of 25 pounds per 1,000-sq. ft. or 1000 pounds per acre of a 10-10-10 or 12-12-12 analyses.
3. The lime and fertilizer shall be worked into the soil with a disk harrow, spring-tooth harrow, or other suitable field implement to a depth of 3 inches. On sloping land, the soil shall be worked on the contour.

### **Seeding Dates and Soil Conditions**

Seeding should be done March 1 to May 31 or August 1 to September 30. If seeding occurs outside of the above-specified dates, additional mulch and irrigation may be required to ensure a minimum of 80% germination. Tillage for seedbed preparation should be done when the soil is dry enough to crumble and not form ribbons when compressed by hand. For winter seeding, see the following section on dormant seeding.

### **Dormant Seedings**

1. Seedings should not be made from October 1 through November 20. During this period, the seeds are likely to germinate but probably will not be able to survive the winter.
2. The following methods may be used for “Dormant Seeding”:

- From October 1 through November 20, prepare the seedbed, add the required amounts of lime and fertilizer, then mulch and anchor. After November 20, and before March 15, broadcast the selected seed mixture. Increase the seeding rates by 50% for this type of seeding.
- From November 20 through March 15, when soil conditions permit, prepare the seedbed, lime and fertilize, apply the selected seed mixture, mulch and anchor. Increase the seeding rates by 50% for this type of seeding.
- Apply seed uniformly with a cyclone seeder, drill, cultipacker seeder, or hydro-seeder (slurry may include seed and fertilizer) on a firm, moist seedbed.
- Where feasible, except when a cultipacker type seeder is used, the seedbed should be firmed following seeding operations with a cultipacker, roller, or light drag. On sloping land, seeding operations should be on the contour where feasible.

### **Mulching**

1. Mulch material shall be applied immediately after seeding. Dormant seeding shall be mulched. 100% of the ground surface shall be covered with an approved material.
2. Materials
  - Straw—If straw is used it shall be unrotted small-grain straw applied at the rate of 2 tons per acre or 90 pounds (two to three bales) per 1,000-sq. ft. The mulch shall be spread uniformly by hand or mechanically applied so the soil surface is covered. For uniform distribution of hand-spread mulch, divide area into approximately 1,000-sq.-ft. sections and spread two 45-lb. bales of straw in each section.
  - Hydroseeders—If wood cellulose fiber is used, it shall be applied at 2,000 lb./ac. or 46 lb./1,000 sq. ft.
  - Other—Other acceptable mulches include rolled erosion control mattings or blankets applied according to manufacturer's recommendations or wood chips applied at 6 tons per acre.



### 3. Straw and Mulch Anchoring Methods

Straw mulch shall be anchored immediately to minimize loss by wind or water.

- **Mechanical**—A disk, crimper, or similar type tool shall be set straight to punch or anchor the mulch material into the soil. Straw mechanically anchored shall not be finely chopped but, generally, be left longer than 6 inches.
- **Mulch Netting**—Netting shall be used according to the manufacturer's recommendations. Netting may be necessary to hold mulch in place in areas of concentrated runoff and on critical slopes.
- **Asphalt Emulsion**—Asphalt shall be applied as recommended by the manufacture or at the rate of 160 gallons per acre.

- **Synthetic Binders**—Synthetic binders such as Acrylic DLR (Agri-Tac), DCA-70, Petroset, Terra Tack or equivalent may be used at rates specified by the manufacturer.
- **Wood Cellulose Fiber**—Wood cellulose fiber shall be applied at a net dry weight of 750 pounds per acre. The wood cellulose fiber shall be mixed with water with the mixture containing a maximum of 50 pounds cellulose per 100 gallons of water.

#### **Irrigation**

Permanent seeding shall include irrigation to establish vegetation during dry weather or on adverse site conditions, which require adequate moisture for seed germination and plant growth.

Irrigation rates shall be monitored to prevent erosion and damage to seeded areas from excessive runoff.

AEP PERMANENT SEED MIXES

Slope Stability & Natural Corridors Seed Mix

Temporary Matrix	
oz/lac	Grasses
512	<i>Avena sativa</i>
160	<i>Lolium multiflorum</i>
Permanent Matrix	
oz/acre	Grasses
16	<i>Andropogon gerardii</i>
16	<i>Bouteloua curtipendula</i>
48	<i>Elymus canadensis</i>
48	<i>Elymus virginicus</i>
32	<i>Schizachyrium scoparium</i>
16	<i>Sorghastrum nutans</i>
oz/acre	Forbs
1	<i>Monarda fistulosa</i>
2	<i>Coreopsis lanceolata</i>
4	<i>Rudbeckia hirta</i>
2	<i>Solidago nemoralis</i>
2	<i>Solidago spectiosa</i>

Lawn Mix – Sun to partial shade

lbs/acre	Grasses
20	<i>Lolium multiflorum</i>
100	<i>Poa pratensis</i>
100	<i>Lolium perenne</i>

Lawn Mix –Shade

lbs/acre	Grasses
20	<i>Lolium multiflorum</i>
100	<i>Poa pratensis</i>
100	<i>Festuca rubra</i>

Swale and Retention Area Seed Mix

Temporary Matrix	
oz/lac	Grasses
512	<i>Avena sativa</i>
160	<i>Lolium multiflorum</i>
Permanent Matrix	
oz/acre	Grasses
8	<i>Carex frankii</i>
2	<i>Eleocharis obtusa</i>
8	<i>Carex vulpinoidea</i>
32	<i>Panicum virgatum</i>
2	<i>Scirpus acutus</i>
oz/acre	Forbs
2	<i>Asclepias incarnata</i>
2	<i>Aster novae-angliae</i>
2	<i>Eupatorium perfoliatum</i>
1	<i>Helenium autumnale</i>
2	<i>Monarda fistulosa</i>
2	<i>Ratibida pinnata</i>
2	<i>Rudbeckia subtomentosa</i>

Farm Lane Area Seed Mix

Temporary Matrix	
oz/lac	Grasses
512	<i>Avena sativa</i>
160	<i>Lolium multiflorum</i>
Permanent Matrix	
oz/acre	Grasses
64	<i>Tritolium pratense</i>
32	<i>Tritolium repens</i>



## SITE MANAGEMENT MEASURES

---

### Concrete Washout



*Concrete washout areas are designated locations within a construction site that are either a prefabricated unit or a designed measure that is constructed to contain concrete washout. Concrete washout systems are typically used to contain washout water when chutes and hoppers are rinsed following delivery.*

### Purpose

---

Concrete washout systems are implemented to reduce the discharge of pollutants that are associated with concrete washout waste through consolidation of solids and retention of liquids. Uncured concrete and associated liquids are highly alkaline which may leach into the soil and contaminate ground water or discharge to a waterbody or wetland which can elevate the pH and be harmful to aquatic life. Performing concrete washout in designated areas and into specifically designed systems reduces the impact concrete washout will have on the environment.

### Specifications

---

#### Site Management

- Complete construction/installation of the system and have washout locations operational prior to concrete delivery.
- Do not wash out concrete trucks or equipment into storm drains, wetlands, streams, rivers, creeks, ditches, or streets.
- Never wash out into a storm sewer drainage system. These systems are typically connected to a natural conveyance system.
- Where necessary, provide stable ingress and egress (see **Temporary Construction Ingress/Egress Pad** on page 17).
- It is recommended that washout systems be restricted to washing concrete from mixer and pump trucks and not used to dispose of excess concrete or

residual loads due to potential to exceed the design capacity of the washout system. Small amounts of excess or residual concrete (not washout water) may be disposed of in areas that will not result in flow to an area that is to be protected.

- Install systems at strategic locations that are convenient and in close proximity to work areas and in sufficient number to accommodate the demand for disposal.
- Install signage identifying the location of concrete washout systems.

### Location

- Locate concrete washout systems at least 50 feet from any creeks, wetlands, ditches, karst features, or storm drains/manmade conveyance systems.
- To the extent practical, locate concrete washout systems in relatively flat areas that have established vegetative cover and do not receive runoff from adjacent land areas.
- Locate in areas that provide easy access for concrete trucks and other construction equipment.
- Locate away from other construction traffic to reduce the potential for damage to the system.

### General Design Considerations

- The structure or system shall be designed to contain the anticipated washout water associated with construction activities.
- The system shall be designed, to the extent practical, to eliminate runoff from entering the washout system.
- Runoff from a rainstorm or snowmelt should not carry wastes away from the washout location.
- Washout will not impact future land uses (i.e., open spaces, landscaped areas, home sites, parks).
- Washout systems/containment measures may also be utilized on smaller individual building sites. The design and size of the system can be adjusted to accommodate the expected capacity.

### Prefabricated Washout Systems/Containers

- Self-contained sturdy containment systems that are delivered to a site and located at strategic locations for concrete disposal.



- These systems are manufactured to resist damage from construction equipment and protect against leaks or spills.
- Manufacturer or supplier provides the containers. The project site manager maintains the system or the supplier provides complete service that includes maintenance and disposal.
- Units are often available with or without ramps. Units with ramps lend themselves to accommodate pump trucks.
- Maintain according to the manufacturer's recommendations.

### Designed and Installed Units

These units are designed and installed on site. They tend to be less reliable than prefabricated systems and are often prone to failure. Concrete washout systems can be constructed above or below grade. It is not uncommon to have a system that is partly below grade with an additional containment structure above grade.

- Washout systems shall utilize a pit or bermed area designed and maintained at a capacity to contain all liquid and concrete waste generated by washout operations.
- The volume of the system must also be designed to contain runoff that drains to the system and rainfall that enters the system for a two-year frequency, 24-hour storm event.

#### ■ Below Grade System

- ◆ A washout system installed below grade should be a minimum of ten feet wide by ten feet long, but sized to contain all liquid and waste that is expected to be generated between scheduled cleanout periods. The size of the pit may be limited by the size of polyethylene available. The polyethylene lining should be of adequate size to extend over the entire excavation.
- ◆ Include a minimum 12-inch freeboard to reasonably ensure that the structure will not overtop during a rain event.
- ◆ Line the pit with ten millimeter polyethylene lining to control seepage.
- ◆ The bottom of excavated pit should be above the seasonal high water table.

#### ■ Above Grade System

- ◆ A system designed and built above grade should be a minimum of ten feet wide by ten feet long, but sized to contain all liquid and waste that is expected to be generated between scheduled cleanout periods. The size of the containment system may be limited by the size of

polyethylene available. The polyethylene lining should be of adequate size to extend over the berm or containment system.

- ◆ The system design may utilize an earthen berm, straw bales, sandbags, or other acceptable barriers that will maintain its shape and integrity and support the polyethylene lining.
- ◆ Include a minimum four-inch freeboard as part of the design.

### Washout Procedures

- Do not leave excess mud in the chutes or hopper after the pour. Every effort should be made to empty the chutes and hopper at the pour. The less material left in the chutes and hopper, the quicker and easier the cleanout. Small amounts of excess concrete (not washout water) may be disposed of in areas that will not result in flow to an area that is to be protected.
- At the washout location, scrape as much material from the chutes as possible before washing them. Use non-water cleaning methods to minimize the chance for waste to flow off site.
- Remove as much mud as possible when washing out.
- Stop washing out in an area if you observe water running off the designated area or if the containment system is leaking or overflowing and ineffective.
- Do not back flush equipment at the project site. Back flushing should be restricted to the plant as it generates large volumes of waste that more than likely will exceed the capacity of most washout systems. If an emergency arises, back flush should only be performed with the permission of an on-site manager for the project.
- Do not use additives with wash water. Do not use solvents or acids that may be used at the target plant.

### Materials

- Minimum of ten millimeter polyethylene sheeting that is free of holes, tears, and other defects. The sheeting selected should be of an appropriate size to fit the washout system without seams or overlap of the lining (**designed and installed systems**).
- Signage.
- Orange safety fencing or equivalent.
- Straw bales, sandbags (bags should be ultraviolet-stabilized geotextile fabric), soil material, or other appropriate materials that can be used to construct a containment system (**above grade systems**).



- Metal pins or staples at a minimum of six inches in length, sandbags, or alternative fastener to secure polyethylene lining to the containment system.
- Non-collapsing and non-water holding cover for use during rain events (optional).

### Installation

---

#### Prefabricated Washout Systems/Containers

- Install and locate according to the manufacturer's recommendations.

#### Designed and Installed Systems

- Utilize and follow the design in the storm water pollution prevention plan to install the system.
- Dependent upon the type of system, either excavate the pit or install the containment system.
- A base shall be constructed and prepared that is free of rocks and other debris that may cause tears or punctures in the polyethylene lining.
- Install the polyethylene lining. For excavated systems, the lining should extend over the entire excavation. The lining for bermed systems should be installed over the pooling area with enough material to extend the lining over the berm or containment system. The lining should be secured with pins, staples, or other fasteners.
- Place flags, safety fencing, or equivalent to provide a barrier to construction equipment and other traffic.
- Place a non-collapsing, non-water holding cover over the washout facility prior to a predicted rainfall event to prevent accumulation of water and possible overflow of the system (optional).
- Install signage that identifies concrete washout areas.
- Post signs directing contractors and suppliers to designated locations.
- Where necessary, provide stable ingress and egress (see **Temporary Construction Ingress/Egress Pad** on page 17) or alternative approach pad for concrete washout systems.

## Maintenance

---

- Inspect daily and after each storm event.
- Inspect the integrity of the overall structure including, where applicable, the containment system.
- Inspect the system for leaks, spills, and tracking of soil by equipment.
- Inspect the polyethylene lining for failure, including tears and punctures.
- Once concrete wastes harden, remove and dispose of the material.
- Excess concrete should be removed when the washout system reaches 50 percent of the design capacity. Use of the system should be discontinued until appropriate measures can be initiated to clean the structure. Prefabricated systems should also utilize this criterion, unless the manufacturer has alternate specifications.
- Upon removal of the solids, inspect the structure. Repair the structure as needed or construct a new system.
- Dispose of all concrete in a legal manner. Reuse the material on site, recycle, or haul the material to an approved construction/demolition landfill site. Recycling of material is encouraged. The waste material can be used for multiple applications including but not limited to roadbeds and building. The availability for recycling should be checked locally.
- The plastic liner should be replaced after every cleaning; the removal of material will usually damage the lining.
- The concrete washout system should be repaired or enlarged as necessary to maintain capacity for concrete waste.
- Concrete washout systems are designed to promote evaporation. However, if the liquids do not evaporate and the system is near capacity it may be necessary to vacuum or remove the liquids and dispose of them in an acceptable method. Disposal may be allowed at the local sanitary sewer authority provided their National Pollutant Discharge Elimination System permits allow for acceptance of this material. Another option would be to utilize a secondary containment system or basin for further dewatering.
- Prefabricated units are often pumped and the company supplying the unit provides this service.
- Inspect construction activities on a regular basis to ensure suppliers, contractors, and others are utilizing designated washout areas. If concrete waste is being disposed of improperly, identify the violators and take appropriate action.



## **CONCRETE WASHOUT**

---

- When concrete washout systems are no longer required, the concrete washout systems shall be closed. Dispose of all hardened concrete and other materials used to construct the system.
- Holes, depressions and other land disturbances associated with the system should be backfilled, graded, and stabilized.

## 7.5 Dust Control

---



### Description

Dust control involves preventing or reducing dust from exposed soils or other sources during land disturbing, demolition and construction activities to reduce the presence of airborne substances which may present health hazards, traffic safety problems or harm animal or plant life.

### Conditions Where Practice Applies

In areas subject to surface and air movement of dust where on-site and off-site damage is likely to occur if preventive measures are not taken.

### Planning Considerations

Construction activities inevitably result in the exposure and disturbance of soil. Fugitive dust results from both construction activities and as a result of wind erosion over the exposed earth surfaces. Large quantities of dust are typically generated in heavy construction activities, such as road construction and subdivision, commercial or industrial development, which involve disturbing significant areas of the soil surface. Research of construction sites has established an average dust emission rate of 1.2 tons/acre/month for active construction. Earth-moving activities comprise the major source of construction dust emissions, but traffic and general disturbance of the soil also generate significant dust emissions.

Planning for dust control involves limiting the amount of soil disturbance at any one time as a key objective. Therefore, phased clearing and grading operations (minimize disturbance-phasing) and the utilization of other stabilization practices can significantly reduce dust emissions. Undisturbed vegetative buffers (minimum 50-foot widths) left between graded areas and protected areas can also be very helpful in dust control by providing windbreaks and non-erosive areas.



## Design Criteria

A number of measures can be utilized to limit dust either during or between construction stages or once construction is complete. Generally the same methods that are used to limit erosion by limiting exposure of soils to rainfall can be used to limit dust including: stabilizing exposed soils with mulch, vegetation or permanent cover. Additional methods particular to dust control include managing vehicles and construction traffic, road treatment and treatment of exposed soil with chemical stabilizers.

**Vegetative Cover** – The most effective way to prevent dust from exposed soil is to provide a dense cover of vegetation. In areas subject to little or no construction traffic, vegetative stabilization reduces dust drastically. Timely temporary and permanent seedings must be utilized to accomplish this. See TEMPORARY SEEDING & PERMANENT SEEDING.

**Mulch** - When properly applied, mulch offers a fast, effective means of controlling dust. Mulching is not recommended for areas within heavy traffic pathways. Binders or tackifiers should be used to tack organic mulches. See MULCHING.

**Rough Graded Soils** – Leaving the soil in a temporary state of rough grade, where clods rather than flattened soils predominate the surface can reduce the amount of dust generated from areas during periods of higher winds. This must be balanced by the need to reach a stage where the soil can be stabilized and may be only be necessary when high winds are predicted.

**Watering** - This is the most commonly used dust control practice. The site is sprinkled with water until the surface is wet before and during grading and is repeated as needed. It offers fast protection for haul roads and other heavy traffic routes. Watering should be done at a rate that prevents dust but does not cause soil erosion. Wetting agents are also available to increase the effectiveness of watering and must follow manufacturers instructions.

**Chemical Stabilizers/Wetting Agents** – Many products of this type are available and are usually most effective on typical mineral soils but may not be on predominantly organic soils such as muck. Users are advised to pay attention to the limitations and instructions regarding each product. The following table lists various adhesives and provides corresponding information on mixing and application:

Table 7.5.1 Adhesives for Dust Control

Adhesive	Water Dilution (Adhesive: Water)	Nozzle Type	Application Rate Gallon/Acre
Latex Emulsion	12.5:1	Fine	235
Resin in Water	4:1	Fine	300
Acrylic Emulsion (No-traffic)	7:1	Coarse	450
Acrylic Emulsion (Traffic)	3.5:1	Coarse	350

**Stone** - Stone can be used to stabilize roads or other areas during construction using crushed stone or coarse gravel. Research has shown the addition of bentonite to limestone roads (not igneous gravel) has shown benefits in reducing dust.

***Windbreaks and Barriers*** – Where dust is a known problem, existing windbreak vegetation should be preserved. Maintaining existing rows of trees or constructing a wind fence, sediment fence, or similar barrier can help to control air currents and blowing soil. Place barriers perpendicular to prevailing air currents at intervals of about 15 times the barrier height.

***Calcium Chloride*** - This chemical may be applied by mechanical spreader as loose, dry granules or flakes at a rate that keeps the surface moist but not so high as to cause water pollution or plant damage. Liquid application of a 35% calcium chloride solution is common. Note: application rates should be strictly in accordance with suppliers' specified rates.

***Street Cleaning*** - Paved areas that have accumulated sediment from construction sites should be cleaned daily, or as needed, utilizing a street sweeper or bucket -type loader or scraper.

### **Operation and Maintenance**

Most dust control measures, such as applications of water or road treatments will require monitoring and repeat applications as needed to accomplish good control.

### **Common Problems / Concerns**

Vegetation is removed from large areas of the construction site and left barren for long periods of time.

Continuous, scheduled monitoring of the construction site conditions is not made.



# Specifications for **Dust Control**

---

1. Vegetative Cover and/mulch – Apply temporary or permanent seeding and mulch to areas that will remain idle for over 21 days. Saving existing trees and large shrubs will also reduce soil and air movement across disturbed areas. See Temporary Seeding; Permanent Seeding; Mulching Practices; and Tree and Natural Area Protection practices.
2. Watering – Spray site with water until the surface is wet before and during grading and repeat as needed, especially on haul roads and other heavy traffic routes. Watering shall be done at a rate that prevents dust but does not cause soil erosion. Wetting agents shall be utilized according to manufacturers instructions.
3. Spray-On Adhesives – Apply adhesive according to the following table or manufacturers' instructions.
4. Stone – Graded roadways and other suitable areas will be stabilized using crushed stone or coarse gravel as soon as practicable after reaching an interim or final grade. Crushed stone or coarse gravel can be used as a permanent cover to provide control of soil emissions.
5. Barriers – Existing windbreak vegetation shall be marked and preserved. Snow fencing or other suitable barrier may be placed perpendicular to prevailing air currents at intervals of about 15 times the barrier height to control air currents and blowing soil.
6. Calcium Chloride - This chemical may be applied by mechanical spreader as loose, dry granules or flakes at a rate that keeps the surface moist but not so high as to cause water pollution or plant damage. Application rates should be strictly in accordance with suppliers' specified rates.
7. Operation and Maintenance - When Temporary Dust Control measures are used; repetitive treatment should be applied as needed to accomplish control.

**Table 7.5.1 Adhesives for Dust Control**

Adhesive	Water Dilution (Adhesive: Water)	Nozzle Type	Application Rate Gal./Ac.
Latex Emulsion	12.5:1	Fine	235
Resin in Water Acrylic Emulsion (No-traffic)	4:1	Fine	300
Acrylic Emulsion (No-traffic)	7:1	Coarse	450
Acrylic Emulsion (Traffic)	3.5:1	Coarse	350

Street Cleaning - Paved areas that have accumulated sediment from construction should be cleaned daily, or as needed, utilizing a street sweeper or bucket -type endloader or scraper.

## **APPENDIX 3**

SWP3 Inspection Forms and SWP3 Amendments, Grading, and  
Stabilization Log



**AEP OHIO TRANSMISSION COMPANY, INC.**  
**SEAMAN-ADAMS 138 KV LINE REBUILD AND LAWSHE 69 KV LINE EXTENSION PROJECT**  
**STORM WATER POLLUTION PREVENTION PLAN (SWP3) INSPECTION FORM**

Date: \_\_\_\_\_ Inspector's Name/Title: \_\_\_\_\_

Inspector's Company: \_\_\_\_\_

Inspector Qualified in accordance with Part VII.BB of Permit: ☐ Yes ☐ No (Document Qualifications in Appendix 3 of SWP3)

Inspection Type: ☐ Weekly (once every seven calendar days)

☐ Storm Event (0.5 inch or greater) Date: \_\_\_\_\_ Amount: \_\_\_\_\_ Duration: \_\_\_\_\_

Rain Event(s) Since Last Inspection:

Date: _____ Amount: _____ Duration: _____	Date: _____ Amount: _____ Duration: _____
Date: _____ Amount: _____ Duration: _____	Date: _____ Amount: _____ Duration: _____

Did any discharges occur during these events? ☐ No ☐ Yes, Location: \_\_\_\_\_

Current Weather: ☐ Clear ☐ Cloudy ☐ Fog ☐ Rain ☐ Snow ☐ Sleet ☐ High Winds ☐ Other: \_\_\_\_\_ Temp: \_\_\_\_\_

Current Discharges: ☐ No ☐ Yes, Location: \_\_\_\_\_

Evidence of Sediment/Pollutants Leaving the Site? ☐ No ☐ Yes, Location: \_\_\_\_\_

Has Seeding Taken Place? ☐ No ☐ Yes, Location/Seed tag photo included: \_\_\_\_\_

**Erosion and Sediment Control Features / BMPs Inspected:**

☐ **Filter Sock**

Location(s) (Structure # (STR#)): \_\_\_\_\_

Properly anchored/installed: ☐ Yes ☐ No Repairs Needed: ☐ Yes ☐ No

Sediment Removal Required (Sediment one-third height for sock): ☐ Yes ☐ No

Action Required/Taken/Location(s): \_\_\_\_\_

☐ **Orange Barrier Fence**

Location(s) (Wetland / Access Road / STR#): \_\_\_\_\_

Properly anchored/installed: ☐ Yes ☐ No Repairs Needed: ☐ Yes ☐ No

Action Required/Taken/Location(s): \_\_\_\_\_

☐ **Construction Entrance**

Location(s) (Reference intersection of road and nearest STR#): \_\_\_\_\_

Entrance Stabilized: ☐ Yes ☐ No Evidence of mud tracked on roadway: ☐ Yes ☐ No

Action Required/Taken/Location(s): \_\_\_\_\_

☐ **Material Storage Areas (Including waste containers, fuel areas)**

Material Storage Areas located on site and shown on the SWP3: ☐ Yes ☐ No

Materials properly contained and labeled: ☐ Yes ☐ No Evidence of spills or releases: ☐ Yes ☐ No

Action Required/Taken/Location(s): \_\_\_\_\_

☐ **Concrete Washouts**

Location(s) (Access Road / STR#): \_\_\_\_\_

Properly installed and located at least 50 feet from wetlands/streams/ditches/storm drains: ☐ Yes ☐ No

Replacement needed (concrete reaches 50 percent of the system): ☐ Yes ☐ No

Action Required/Taken/Location(s): \_\_\_\_\_

\_\_\_\_\_

**Comments / Additional Control Measures Recommended:** \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

**If BMP modifications are made, you must update the SWP3 drawings and document changes on the SWP3 amendment log.**

Inspector's Signature: \_\_\_\_\_

Date: \_\_\_\_\_

\_\_\_\_\_



**AEP OHIO TRANSMISSION COMPANY, INC.**  
**SEAMAN-ADAMS 138 KV LINE REBUILD AND LAWSHE 69 KV LINE EXTENSION PROJECT**

**STORM WATER POLLUTION PREVENTION PLAN**  
**AMENDMENTS, GRADING, AND STABILIZATION LOG**

Date: \_\_\_\_\_ Inspector's Name/Title: \_\_\_\_\_

Location and Description of Grading and Stabilization Activities

---

---

---

---

Amendments to SWP3:

---

---

---

Date: \_\_\_\_\_ Inspector's Name/Title: \_\_\_\_\_

Location and Description of Grading and Stabilization Activities

---

---

---

---

Amendments to SWP3:

---

---

---

Date: \_\_\_\_\_ Inspector's Name/Title: \_\_\_\_\_

Location and Description of Grading and Stabilization Activities

---

---

---

---

Amendments to SWP3:

---

---

---

**AEP OHIO TRANSMISSION COMPANY, INC.**  
**SEAMAN-ADAMS 138 KV LINE REBUILD AND LAWSHE 69 KV LINE EXTENSION PROJECT**

**SUMMARY SWP3 INSPECTION RECORDS – FOR TCRs**

I have completed a review of the SWP3 inspections completed on the project for the period of \_\_\_\_\_ to \_\_\_\_\_.

The following major observations were made relating to the implementation of the SWP3 and review of the inspection log.

**Inspector Qualifications:**

☐ The inspections were performed by “qualified inspection personnel” knowledgeable in the principles of erosion and sediment control and skilled in assessing the effectiveness of control measures.

☐ The inspections were NOT performed by “qualified inspection personnel” knowledgeable in the principles of erosion and sediment control and skilled in assessing the effectiveness of control measures.

☐ Corrective Measures were taken on \_\_\_\_\_ to provide “qualified inspection personnel” at the site.

**Permit Compliance Observations:**

☐ The project was in compliance with the SWP3 and permit during the review period.

☐ The project was NOT in compliance with the SWP3 and permit during the review period as noted below:

☐ Non-compliance issues included:

---

---

---

---

---

---

---

---

☐ Corrective Measures were taken on \_\_\_\_\_ to correct the above non-compliance issues.

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

**Name:** \_\_\_\_\_

**Title:** \_\_\_\_\_

**Signature:** \_\_\_\_\_

**Date:** \_\_\_\_\_

---



## **APPENDIX 4**

Duty to Inform Contractors and Subcontractors Signature Form

**AEP OHIO TRANSMISSION COMPANY, INC.**  
**SEAMAN-ADAMS 138 KV LINE REBUILD AND LAWSHE 69 KV LINE EXTENSION PROJECT**

## DUTY TO INFORM CONTRACTORS AND SUBCONTRACTORS SIGNATURE FORM

By signing below, I acknowledge that I have been informed of the terms and conditions of the Ohio Environmental Protection Agency's General NPDES Permit for Storm Water Associated with Construction Activity, and have reviewed and understand the conditions and responsibilities of the Storm Water Pollution Prevention Plan for the AEP Ohio Transmission Company, Inc. Seaman-Adams 138 kV Line Rebuild and Lawshe 69 kV Line Extension Project. I understand that Inspectors shall meet the qualifications outlined in Part VII.BB. of Ohio EPA Permit No.: OHC000005.

[illegible]



**This foregoing document was electronically filed with the Public Utilities**

**Commission of Ohio Docketing Information System on**

**2/26/2021 5:31:41 PM**

**in**

**Case No(s). 20-1495-EL-BLN**

Summary: Notice Proof of Compliance with Condition (3) and associated exhibit for the Seaman-Adams 138 kV Transmission Line Rebuild Project electronically filed by Tanner Wolfram on behalf of AEP Ohio Transmission Company, Inc.