



Legal Department

American Electric Power
1 Riverside Plaza
Columbus, OH 43215-2373
AEP.com

January 7, 2022

Ms. Tanowa Troupe, Secretary
Ohio Power Siting Board
180 East Broad Street
Columbus, Ohio 43215-3793

Hector Garcia
Senior Counsel –
Regulatory Services
(614) 716-3410 (P)
hgarcia1@aep.com

**RE: Proof of Compliance with Condition
Case No. 20-0946-EL-BLN
Amlin-Dublin 138 kV Transmission Line Project**

Dear Ms. Troupe:

In satisfaction of Condition (4) of the Staff Report for this Project, AEP Ohio Transmission Company Inc. submits this notice and attachment to inform you that the floodplain permit with the City of Dublin has been approved for the above-referenced Project.

If you have any questions regarding this information, please do not hesitate to contact me.

Respectfully submitted,

/s/ Hector Garcia

Hector Garcia (0084517), Counsel of Record
Counsel for AEP Ohio Transmission Company, Inc.

cc: John Jones, Counsel OPSB Staff
Jon Pawley, OPSB Staff



6555 Shier-Rings Road, Dublin, OH 43016

Office: 614-410-4740

PERMIT TO WORK WITHIN THE PUBLIC RIGHT OF WAY AND/OR EASEMENT

THIS PERMIT AND APPROVED PLANS ARE REQUIRED ON THE JOB SITE AT ALL TIMES.

**Contractors must notify inspector at 614-496-5604
at least 2 business days prior to start of work.**

Issue Date: 12/23/2021 Expiration Date: 6/23/2021
Job Number: **21-549**
Location: Shier Rings Rd. & University Blvd. from Emerald Pkwy. to Houchard Rd.
Description: Amlin-Dublin 138Kv Transmission Line
Applicant: AEP Transmission
Contractor: New River Electric
Work Order #:

SPECIAL NOTES & COMMENTS

- ONLY work from Amlin Substation through pole 50 and pole 59 through Dublin Substation is approved at this time.
- NO WORK shall be allowed for poles 51-58 until approved by Dublin in writing.
- Right of Way permit fees will need to be paid prior to final permit approval.
- This permit does NOT include the relocation of electric distribution lines at this time
- Special Flood Hazard Permit is approved within phased approval limits, documentation is forthcoming.
- One lane of traffic shall be maintained at all times.
- When needed during construction, flaggers shall be provided by the contractor at each end of work zone to direct traffic.
- Maintain a 10' offset from existing storm, water and sanitary pipes unless approved otherwise by Dublin in writing.
- Prior to work, hand dig to verify conflicting conduit locations. (i.e. water, sewer, gas, electric, phone, communication lines)
- Restore all areas affected to a like or better condition.

FEES

FEE FOR BILLING = \$425.00

AUTHORIZATION TO COMMENCE WORK


Authorized By: *Brian Gable* Date: 12/23/2021
City of Dublin Deputy Director of Engineering

*Applicant/Contractor assumes responsibility for all work and shall meet all applicable standards.

*The City of Dublin reserves the right to revoke the permit at any time as deemed necessary.

Sheet Location Key

NOTE: SITE RESTORATION REQUIRED FOR DISCUTTED AREAS. IMPACTS TO LANDSCAPING AND ANY TREE REMOVAL (ON PUBLIC AND PRIVATE PROPERTY) NEED TO BE MITIGATED. CONTACT BRIAN MARTIN (614-410-4660) FOR COORDINATION.

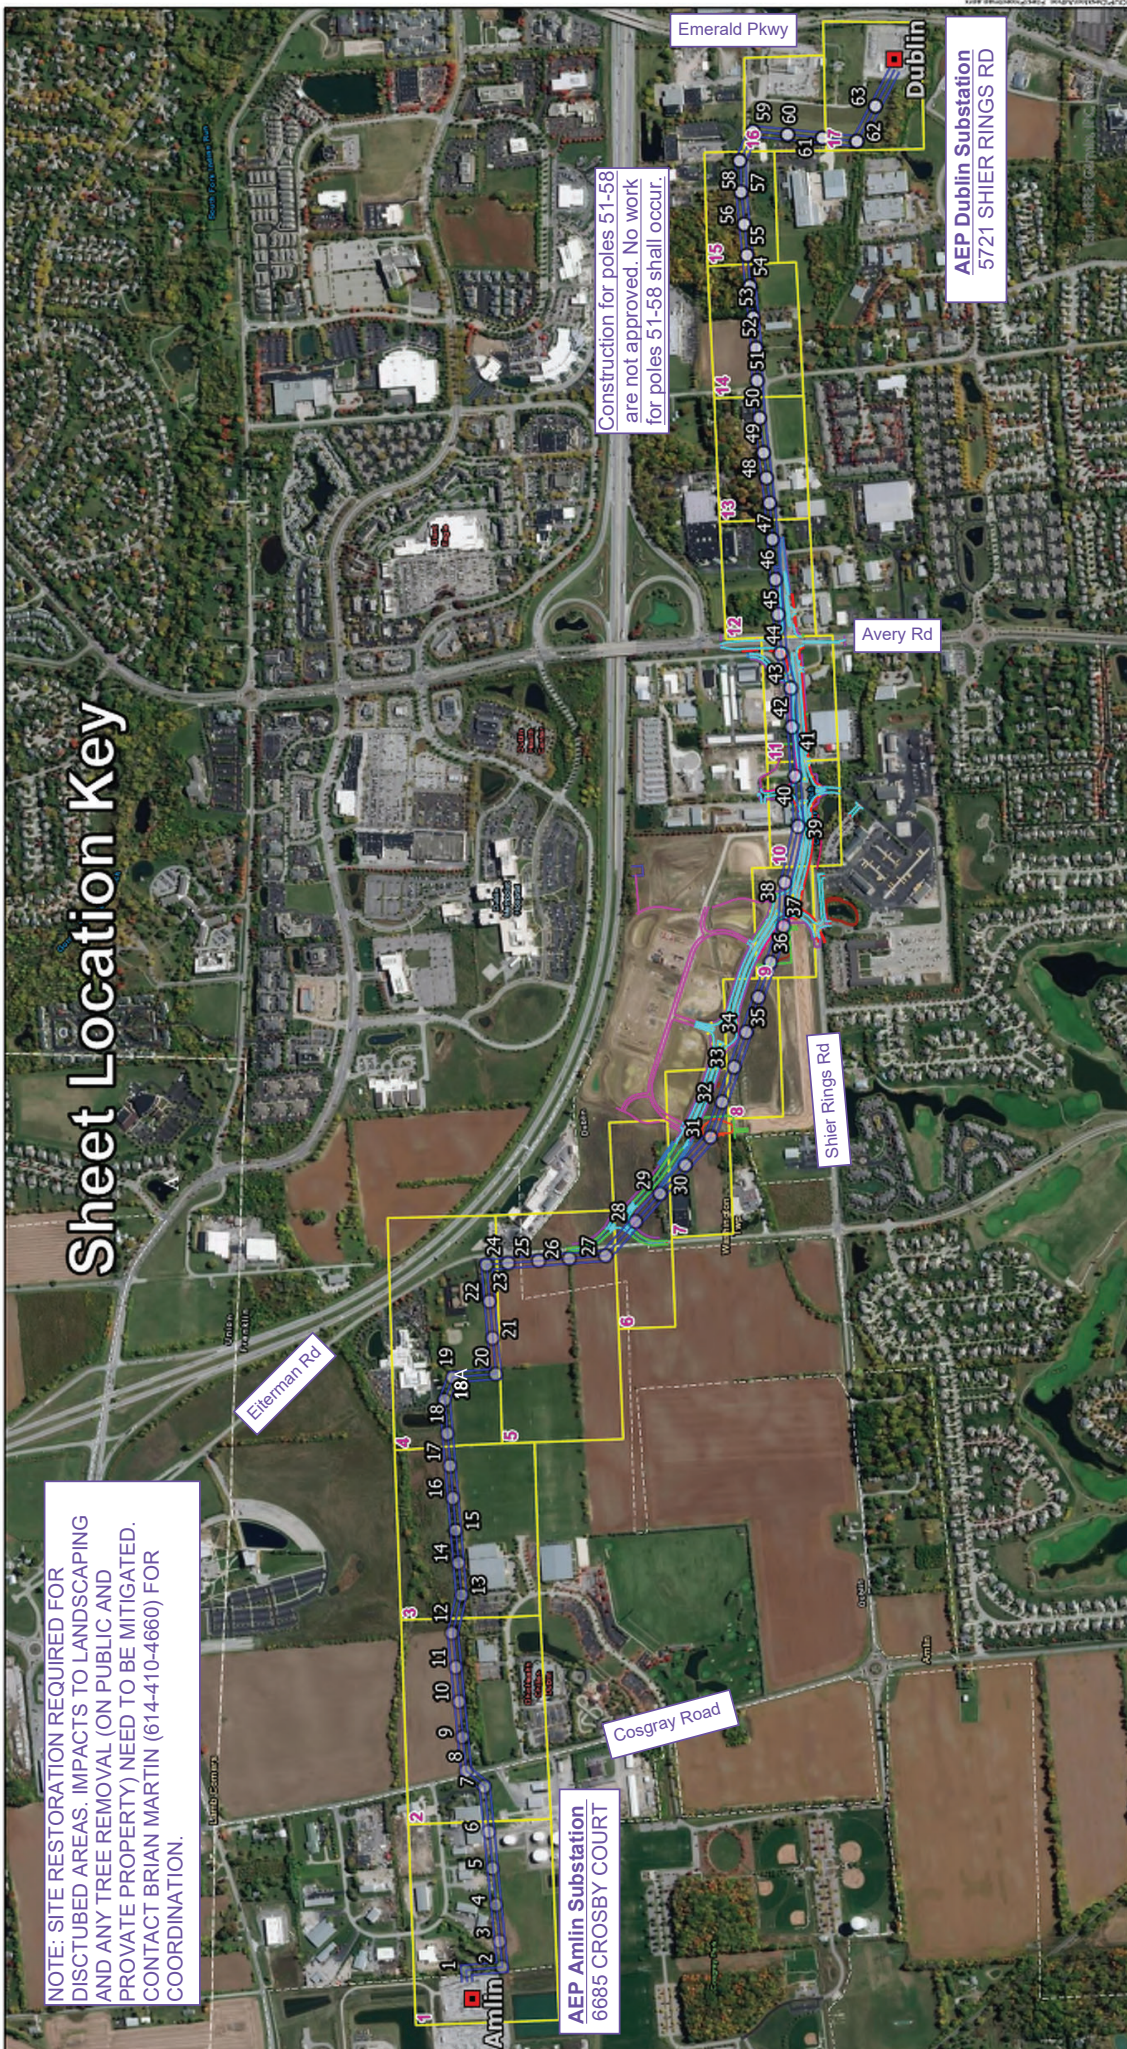

Construction for poles 51-58 are not approved. No work for poles 51-58 shall occur.

Amlin - Dublin 138 kV Line ROW Permit Map

Transmission Line Engineering Group

Source: American Electric Power, ES&S
 Drawn By: J. Smith
 Date: 12/2/2021

Comments: This drawing from the Transmission Line Projects Engineering Group of American Electric Power is for the sole use of the intended recipient(s) and may contain confidential and privileged information. Any unauthorized review, use, disclosure, or distribution is prohibited. If you are not the intended recipient, please contact the sender and destroy all copies of this original document.

AMERICAN ELECTRIC POWER
 800.445.5555
 5500 Shaker's Mill Rd.
 New Albany, OH 43105
 PH: (614) 417-2221

- Proposed/New Structures
- Right of Way Permit Lines
- Existing Station
- Sheet Locations

AEP Amlin Substation
6685 CROSBY COURT

AEP Dublin Substation
5721 SHIER RINGS RD

Ellerman Rd

Cosgray Road

Avery Rd

Emerald Pkwy

Dublin

Shier Rings Rd





Proposed/New Structures
○ Existing Station
■ Right of Way Permit Lines

Amlin - Dublin 138 kV Line ROW Permit Map

Transmission Line Engineering Group


Source: American Electric Power, ©2007
Drawn By: Amanda
Date: 12/20/21

Comments: Any unauthorized review, sale, disclosure, or distribution is prohibited. If you are not the intended recipient, please contact the sender and destroy all copies of this original document.

Coordinate System:

AMERICAN ELECTRIC POWER
800.425.5557
10000 North High Street
Columbus, OH 43240
PIN: 600-47-2221

SH. 1

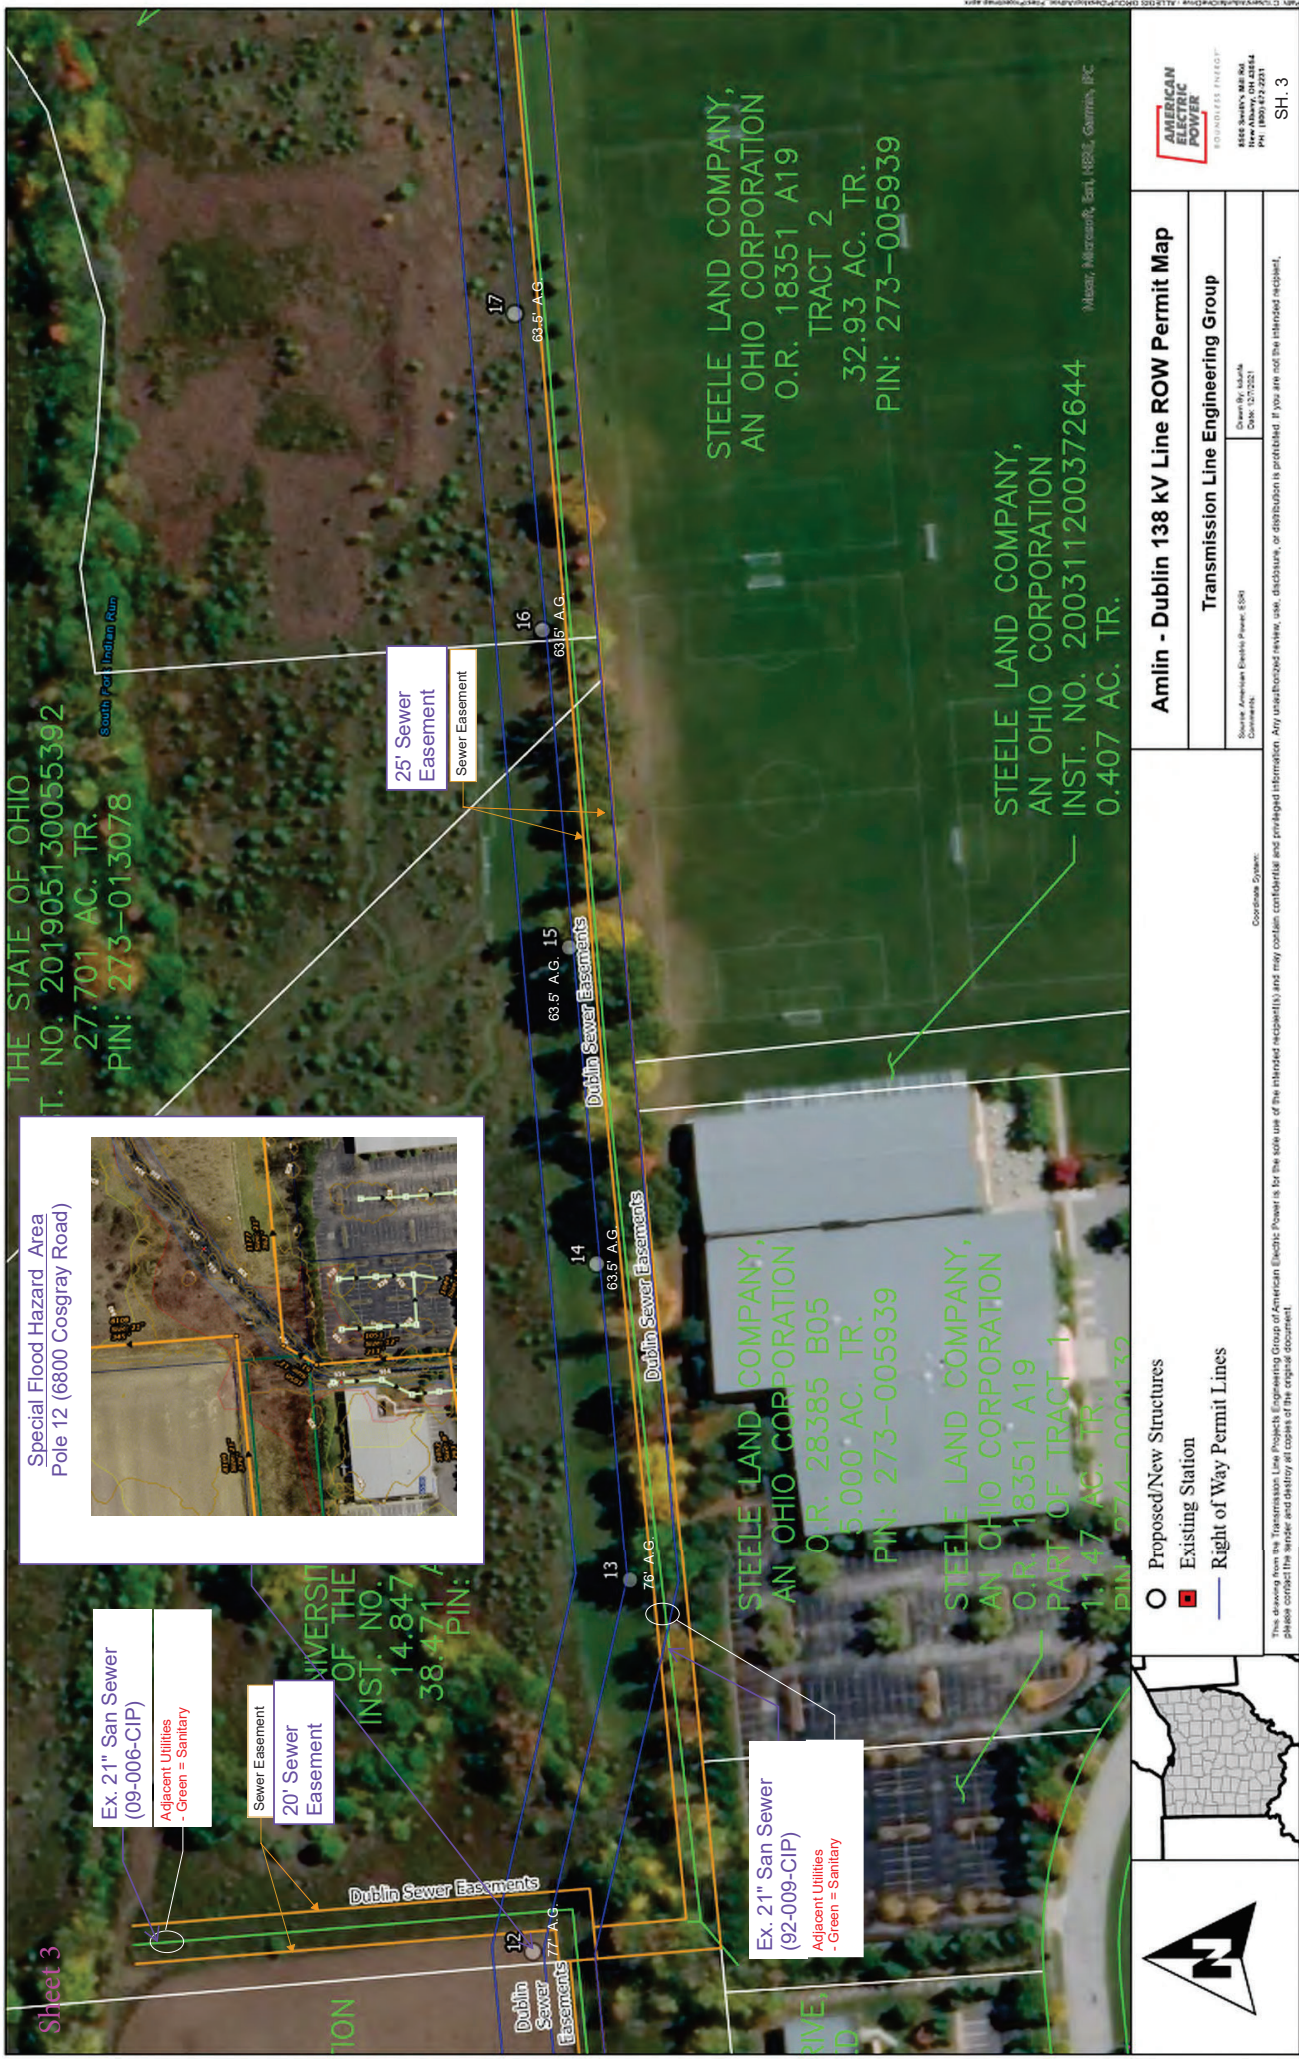

THE STATE OF OHIO
T. NO. 201905130055392
27.701 AC. TR.
PIN: 273-013078



Ex. 21" San Sewer
(09-006-CIP)
Adjacent Utilities
- Green = Sanitary

Sewer Easement
20' Sewer
Easement

25' Sewer
Easement

Sewer Easement

Ex. 21" San Sewer
(92-009-CIP)
Adjacent Utilities
- Green = Sanitary

STEELE LAND COMPANY,
AN OHIO CORPORATION
O.R. 18351 A19
TRACT 2
32.93 AC. TR.
PIN: 273-005939

STEELE LAND COMPANY,
AN OHIO CORPORATION
INST. NO. 200311200372644
0.407 AC. TR.

Missor, Missouri, San, 1835, Garmen, R.C.



- Proposed/New Structures
- Existing Station
- Right of Way Permit Lines

Amlin - Dublin 138 kV Line ROW Permit Map

Transmission Line Engineering Group

Source: American Electric Power, ESR
Comments:
Drawn By: skunk
Date: 12/20/21



AMERICAN
ELECTRIC
POWER
800 NORTH 1000 EAST
Cedar Rapids, IA 52401
www.aep.com

This drawing is for the use of the intended recipient(s) and may contain confidential and privileged information. Any unauthorized review, use, disclosure, or distribution is prohibited. If you are not the intended recipient, please contact the sender and destroy all copies of this original document.



**This foregoing document was electronically filed with the Public Utilities
Commission of Ohio Docketing Information System on**

1/7/2022 1:45:27 PM

in

Case No(s). 20-0946-EL-BLN

Summary: Notice Proof of Compliance with Condition 4 electronically filed by
Hector Garcia-Santana on behalf of AEP Ohio Transmission Company, Inc.