

A.7 Groundwater Recharge Mitigation.

If the post-development recharge volume is less than the pre-development recharge volume, then mitigation will be required. Two options are available for most applications:

- i. The preferred method is to convert additional land to land use with higher recharge potential. The difference in groundwater recharge between the existing and converted land use recharge is the amount which can be used as recharge credit. Off-site Groundwater Recharge Mitigation shall occur within the same Watershed Assessment Unit (12-digit HUC scale) as the permitted site and preferably up-gradient and within a 2-mile radius.

Mitigation shall be protected in perpetuity by binding conservation easements or environmental covenants which must be recorded within 6 months of receiving permit authorization. Granting of binding conservation easements or environmental covenants protected in perpetuity for land outside of the disturbed area, but within a required riparian setback counts towards required mitigation.

Mitigation may also be satisfied by approved pooled mitigation areas and in-lieu fee sponsored mitigation areas.

- ii. On-site structural and non-structural practices may also be used to achieve groundwater mitigation requirements by retaining and infiltrating on-site a minimum volume of storm water runoff based on the area and hydrologic soil groups of disturbed soils. If these infiltrating practices are incorporated upstream of the water quality volume treatment practice, the volume of groundwater being infiltrated may be subtracted from the water quality volume for the purpose of meeting post-construction requirements. The on-site retention requirement is determined by the following formula:

$$V_{\text{retention}} = A_{\text{HSG-A}} * 0.90 \text{ in} + A_{\text{HSG-B}} * 0.75 \text{ in} + A_{\text{HSG-C}} * 0.50 \text{ in} + A_{\text{HSG-D}} * 0.25 \text{ in}$$

(Equation 3, Appendix A)

Where,

$V_{\text{retention}}$ = volume of runoff retained onsite using an approved infiltration practice

$A_{\text{HSG-x}}$ = area of each hydrologic soil group within the disturbed area

Table A-4: Hydrologic Soil Groups and On-site Retention Depth per Acre

Hydrologic Soil Group	HSG A	HSG B	HSG C	HSG D
Retention Depth (inches)	0.90	0.75	0.50	0.25

Retention volume ($V_{\text{retention}}$) provided by selected practices shall be determined using the runoff reduction method criteria as outlined in Part III.G.2.e, Ohio EPA's Runoff Reduction spreadsheet and supporting documentation in the Rainwater and Land Development manual. Hydrologic soil group (HSG) areas are to be determined by using the current version of SURRGO or Web Soil Survey soils information.

Appendix A Attachment A: Big Darby Creek Watershed



A more detailed map can be viewed at:
http://www.epa.state.oh.us/dsw/permits/GP_ConstructionSiteStormWater_Darby.aspx

Appendix A Attachment B

Part 1 Stream Assessment

This assessment will determine if a stream is considered a previously channelized, low-gradient headwater stream (a drainage ditch) which would be applicable for stream restoration in lieu of protecting a setback as per Appendix A. A.4.i and ii.

In the event the assessment of the stream, meets all the criteria listed below, restoration (provided 401/404 permits are authorized) as depicted in Part 2 of this attachment, may be a means of reducing the setback distance required by A.4.i. (Appendix A).

Previously Channelized Low-Gradient Headwater Streams (drainage ditches) shall for the purposes of this permit be defined as having all of the following characteristics:

- Less than 10 square miles of drainage area
- Low gradient and low stream power such that despite their straightened and entrenched condition incision (down-cutting) is not evident
- Entrenched, entrenchment ratio < 2.2
- Straight, sinuosity of the bankfull channel < 1.02

Part 2 Restoration

Restoration shall be accomplished by any natural channel design approach that will lead to a self-maintaining reach able to provide both local habitat and watershed services (e.g. self-purification and valley floodwater storage).

- a. Construction of a floodplain, channel and habitat via natural channel design;
- b. Floodplain excavation necessary to promote interaction between stream and floodplain;
- c. Include a water quality setback of 100 feet from top of the streambank on each side.

The primary target regardless of design approach shall be the frequently flooded width, which shall be maximized, at 10 times the channel's self-forming width. Five times the self-forming channel width may still be acceptable particularly on portions of the site if greater widths are achieved elsewhere.

Appendix B Olentangy River Watershed

CONTENTS OF THIS APPENDIX

- B.1 Permit Area
- B.2 TMDL Conditions
- B.3 Riparian Setback Requirements
- B.4 Riparian Setback Mitigation

Attachment B-A: Area of Applicability for the Olentangy Watershed (Map)

Attachment B-B: Stream Assessment and Restoration

B.1 Permit Area.

This appendix to Permit OHC00005 applies to specific portions of the Olentangy River Watershed located within the State of Ohio. The permit area includes the following 12-digit Hydrologic Unit Codes (HUC-12) within the Olentangy River Watershed:

12-Digit Hydrologic Unit Codes

12-Digit Hydrologic Unit Codes (HUC)	Narrative Description of Sub-Watershed
05060001 09 01	Shaw Creek
05060001 09 02	Headwaters Whetstone Creek
05060001 09 03	Claypool Run-Whetstone Creek
05060001 10 07	Delaware Run-Olentangy River
05060001 11 01	Deep Run-Olentangy River
05060001 11 02 (Only portion as depicted in Attachment A)	Rush Run-Olentangy River

Please see Attachment A (Appendix B) for permit area boundaries. An electronic version of Attachment A can be viewed at

http://epa.ohio.gov/dsw/permits/GP_ConstructionSiteStormWater_Olentangy.aspx

B.2 TMDL Conditions.

This general permit requires control measures/BMPs for construction sites that reflect recommendations set forth in the U.S. EPA approved Olentangy TMDL.

B.3 Riparian Setback Requirements.

The permittee shall comply with the riparian setback requirements of this permit or alternative riparian setback requirements established by a regulated MS4 and approved by Ohio EPA. The SWP3 shall clearly delineate the boundary of required stream setback distances. The stream setback shall consist of a streamside buffer and an outer buffer. No construction activity shall occur, without appropriate mitigation, within the streamside buffer except activities associated with storm water conveyances from permanent treatment practices, approvable utility crossings and restoration or recovery of floodplain and channel form characteristics as described in Attachment B. Storm water conveyances must be designed to minimize the width of disturbance.

Construction activities requiring mitigation for intrusions within the outer buffer for the Olentangy River mainstem and perennial streams are described in Appendix B.4.

If intrusion within the delineated setback boundary is necessary to accomplish the purposes of a project, then mitigation shall be required in accordance with Appendix B.3. of this permit. Streams requiring protection under this section have a defined bed and bank or channel and are defined as follows:

- The Olentangy River mainstem;
- Perennial streams have continuous flow on either the surface of the stream bed or under the surface of the stream bed;
- Intermittent streams flow for extended periods of time seasonally of a typical climate year; and
- Ephemeral streams are normally dry and only flow during and after precipitation runoff (episodic flow).

National Resources Conservation Service (NRCS) soil survey maps should be used as one reference and the presence of a stream requiring protection should also be confirmed in the field. Any required setback distances shall be clearly displayed in the field prior to any construction related activity.

Riparian setbacks shall be delineated based upon one of the following two methods:

- i. The required setback distances shall vary with stream type as follows:
 - a. The setback distances associated with the mainstem of the Olentangy River shall consist of:
 - (1) A streamside buffer width of 100 feet as measured horizontally from the ordinary high water mark per side; and
 - (2) An outer buffer width sized to the regulatory 100-year floodplain based on FEMA mapping. No impervious surfaces shall be constructed without appropriate mitigation and moderate to substantial fill activities with no impervious surface may require appropriate mitigation pending an individual approval by Ohio EPA.
 - b. The setback distance associated with perennial streams, other than the Olentangy mainstem, shall consist of:
 - (1) A streamside buffer width of 80 feet per side measured horizontally from the ordinary high water mark; and
 - (2) An outer buffer width sized to the regulatory 100-year floodplain based on FEMA mapping. In the event the regulatory 100-year floodplain is not established, the outer buffer width shall be calculated using the following equation and measured horizontally from the ordinary high water mark. No impervious surfaces, structure, fill, or activity that would impair the floodplain or stream stabilizing ability of the outer buffer shall occur without appropriate mitigation:

$$W = 143DA^{0.41} \quad \text{(Equation 1 Appendix B)}$$

where:

DA = drainage area (mi²)

W = total width of riparian setback (ft)

W shall be centered over the meander pattern of the stream such that a line representing the setback width would evenly intersect equal elevation lines on either side of the stream.

If the DA remains relatively constant throughout the stretch of interest, then the DA of the downstream edge of the stretch should be used. Where there is a significant increase in the DA from the upstream edge to the downstream edge of the area of interest, the setback width shall increase accordingly.

c. The setback distance associated with intermittent streams and ephemeral streams shall be a streamside buffer width of 30 feet per side measured horizontally from the centerline of the stream. No outer buffer is required for intermittent and ephemeral streams.

- ii. Stream Restoration with 100 feet (each side) Riparian Setback. Each stream segment within the proposed site boundaries can be assessed in accordance with Attachment B. In the event the stream segment is classified as a "Previously Modified Low Gradient Headwater Stream", the permittee has the option to restore the stream segment in accordance with Attachment B and include a 100 feet water quality setback distance from the top of the streambank on each side. In the event the stream segment exceeds the minimum criteria in Attachment B to be classified as a "Previously Modified Low Gradient Headwater Stream", this may be considered on a case-by-case basis.

No structural sediment controls (e.g., the installation of sediment barriers or a sediment settling pond) or structural post-construction controls shall be used in a stream or the streamside buffer. Activities and controls that would not impair the floodplain or stream stabilizing ability of the outer buffer can be considered.

Redevelopment projects (i.e., developments on previously developed property) located within the delineated setback boundary is exempt from Riparian Setback Mitigation (B.3) provided the proposed project does not further intrude the delineated setback boundary.

B.4 Riparian Setback Mitigation.

The mitigation required for intrusion into the riparian setback of the **Olentangy River mainstem or perennial streams** shall be determined by the horizontal distance the intrusion is from the stream. Up to three zones will be used in determining the required mitigation. Zone 1 extends from 0 to 30 feet from the stream edge. Zone 2 extends

from 30 feet to the outer edge of the streamside buffer. Zone 3 extends from the outer edge of the streamside buffer to the outer edge of the outer buffer. Intrusion into these zones will require the following mitigation within the same Watershed Assessment Unit (12-digit HUC scale). Alternative mitigation, within the permit area, may be considered on a case-by-case basis:

1. Four (4) times the total area disturbed in the stream within Zone 1 of the site being developed shall be mitigated; or, two (2) times the total area disturbed in the stream within Zone 1 shall be mitigated within the watershed of the immediate receiving stream, and the entire required setback of the site shall be protected by binding conservation easements or environmental covenants.
2. Three (3) times the area disturbed within Zone 2 of the site being developed shall be mitigated within Zones 1 and/or 2 of the mitigation location; or, one and one-half (1.5) times the total area disturbed within Zone 2 shall be mitigated within the watershed of the immediate receiving stream, and the entire required setback of the site shall be protected in perpetuity by binding conservation easements or environmental covenants.
3. Two (2) times the area to be mitigated within Zone 3 of the site being developed shall be mitigated within any Zone of the mitigation location; or, one (1) times the total area to be mitigated within any zone shall be mitigated within the watershed of the immediate receiving stream, and the entire required setback of the site shall be protected in perpetuity by binding conservation easements or environmental covenants.


The mitigation required for intrusion into the riparian setback of an **intermittent stream** shall be four (4) times the total area disturbed within the riparian setback of the site being developed shall be mitigated; or two (2) times the total area disturbed within the riparian setback shall be mitigated within the watershed of the immediate receiving stream, and the entire required setback of the site shall be protected in perpetuity by binding conservation easements or environmental covenants.

The mitigation required for intrusion into the streamside buffer of an **ephemeral stream** shall be two (2) times the total area disturbed within the riparian setback of the site being developed shall be mitigated; or one (1) times the total area disturbed within the riparian setback shall be mitigated within the watershed of the immediate receiving stream, and the entire required setback of the site shall be protected in perpetuity by binding conservation easements or environmental covenants.

All mitigation shall, at a minimum, include conserved or restored setback zone, and should be designed to maximize the ecological function of the mitigation. Including mitigation at the stream edge along with associated setback areas is one way to maximize ecological function. Mitigation shall be protected in perpetuity by binding conservation easements or environmental covenants which must be recorded within 6 months of permit authorization. Granting of binding conservation easements or environmental covenants protected for land outside of disturbed area, but within a required riparian setback counts towards required mitigation.

Mitigation may also be satisfied by approved pooled mitigation areas and in-lieu fee sponsored mitigation areas. Mitigation resulting from State or Federal environmental regulations may be adjusted in recognition of these requirements.

Appendix B Attachment A Applicable Portions of the Olentangy Watershed

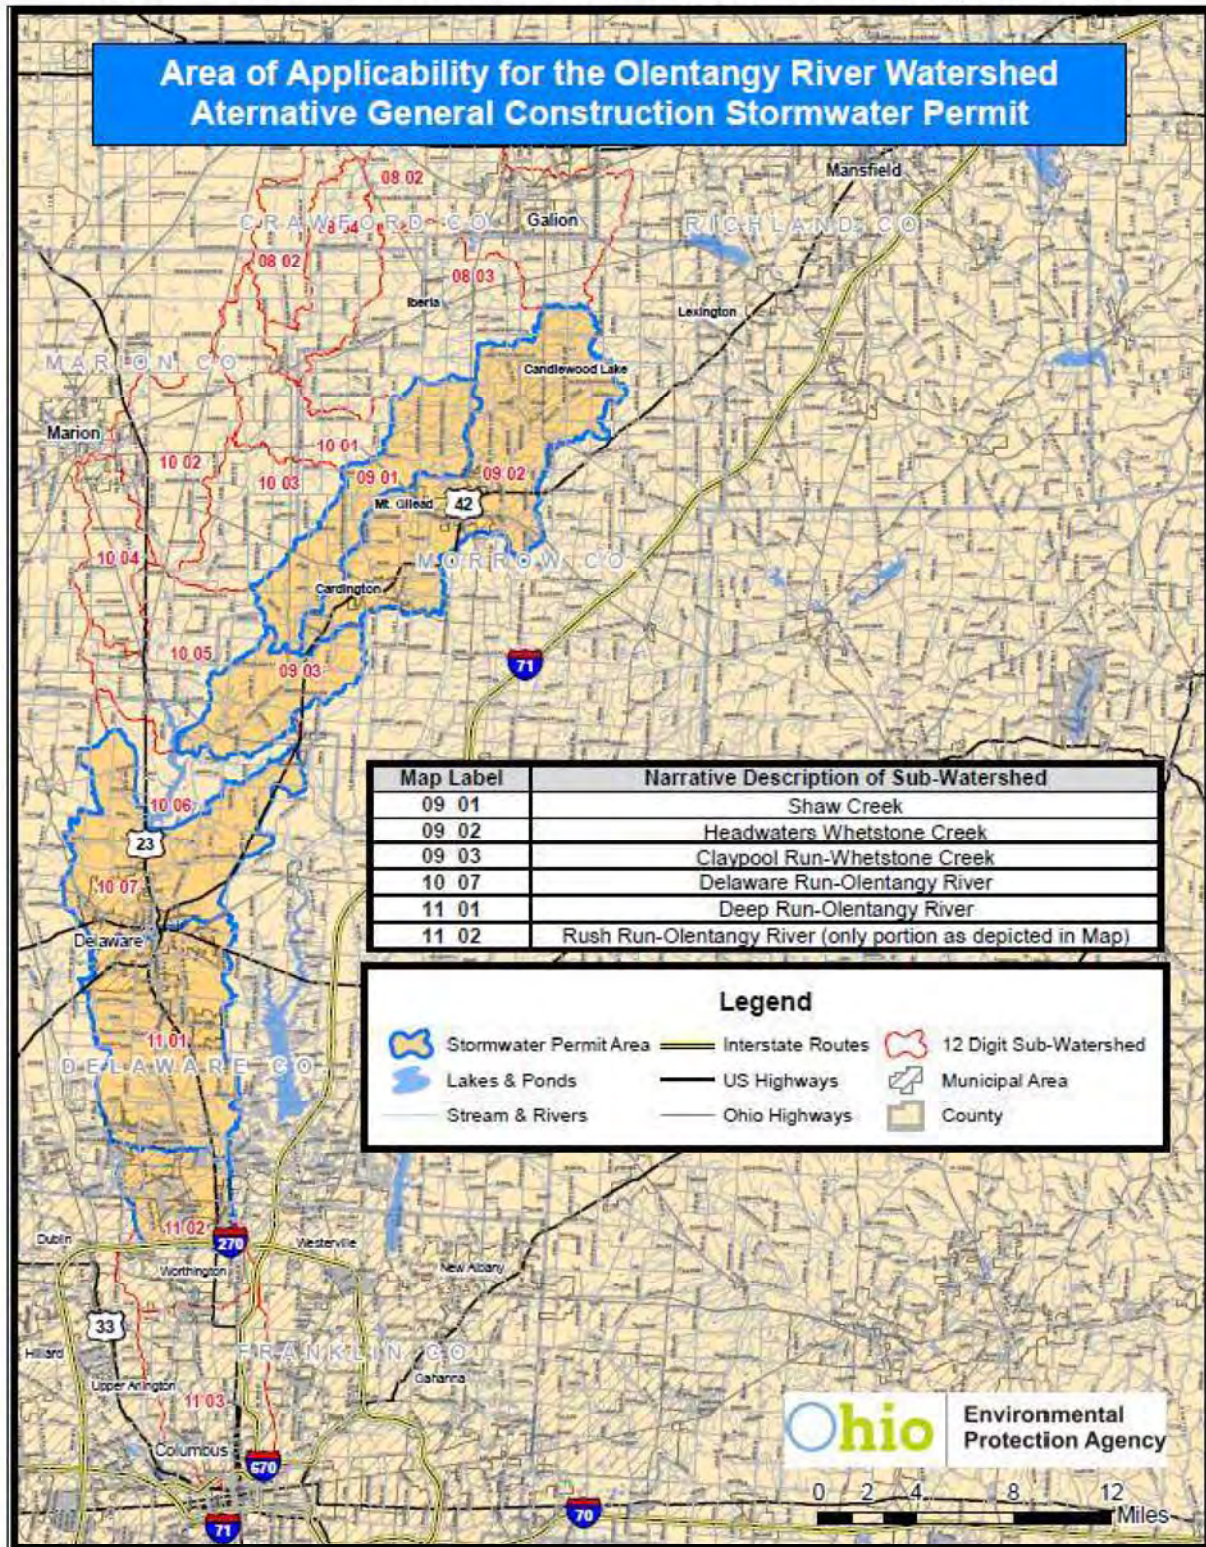

A more detailed map can be viewed at:
http://epa.ohio.gov/dsw/permits/GP_ConstructionSiteStormWater_Olentangy.aspx

Appendix B Attachment B

Part 1 Stream Assessment

This assessment will determine if a stream is considered a previously channelized, low-gradient headwater stream (a drainage ditch) which would be applicable for stream restoration in lieu of protecting an outer 'no build' setback as per Appendix B B.2i. and ii.

In the event the assessment of the stream meets all the criteria listed below, restoration as depicted in Part 2 of this attachment or natural channel design could be performed, provided 401/404 permits are authorized, and may be a means of reducing the setback distance required by B.2.i. (Appendix B).

Previously Modified, Low-Gradient Headwater Streams shall, for the purposes of this permit, be defined as having all of the following characteristics:

- Less than 10 square miles of drainage area;
- Low gradient and low stream power such that incision (down-cutting) is not evident;
- Entrenched such that the ratio of the frequently flooded width to the bankfull width is less than 2.2; and
- Straight with little or no sinuosity present such that the ratio of the bankfull channel length to the straight-line distance between two points is less than 1.02.

Part 2 Restoration

Restoration shall be accomplished by any natural channel design approach that will lead to a self-maintaining reach able to provide both local habitat and watershed services (e.g. self-purification and valley floodwater storage).

- a. Construction of a floodplain, channel and habitat via natural channel design;
- b. Floodplain excavation necessary to promote interaction between stream and floodplain;
- c. Include a water quality setback of 100 feet from top of the streambank on each side.

The primary target shall be a frequently flooded width of 10 times the channel's self-forming width. Five times the self-forming channel width may be acceptable if sufficient elements of natural channel design are included in the restoration project.

Appendix C Rainfall Intensity for Calculation of Water Quality Flow (WQF)


DURATION t_c (minutes)	WATER QUALITY INTENSITY [i_{wq}] (inches/hour)	DURATION t_c (minutes)	WATER QUALITY INTENSITY [i_{wq}] (inches/hour)
5	2.37	33	0.95
6	2.26	34	0.93
7	2.15	35	0.92
8	2.04	36	0.90
9	1.94	37	0.88
10	1.85	38	0.86
11	1.76	39	0.85
12	1.68	40	0.83
13	1.62	41	0.82
14	1.56	42	0.80
15	1.51	43	0.78
16	1.46	44	0.77
17	1.41	45	0.76
18	1.37	46	0.75
19	1.33	47	0.74
20	1.29	48	0.73
21	1.26	49	0.72
22	1.22	50	0.71
23	1.19	51	0.69
24	1.16	52	0.68
25	1.13	53	0.67
26	1.10	54	0.66
27	1.07	55	0.66
28	1.05	56	0.65
29	1.03	57	0.64
30	1.01	58	0.64
31	0.99	59	0.63
32	0.97	60	0.62

Note: For $t_c < 5$ minutes, use $i = 2.37$ in/hr; for $t_c > 60$ minutes, use $i = 0.62$ in/hr. For all other t_c , use the appropriate value from this table.

APPENDIX B – FIGURES AND RUNOFF COEFFICIENT ESTIMATE

PROJECT FIGURES

Path: Z:\Clients\TND\JukeEr\90786_DukeC314VStudies\Geospatial\DataFiles\AcDoc\SWPPP\Doc\SWPPP_Fig_1_Overview.mxd mihogan 9/17/2020
Service Layer Credits: Sources: Esri, HERE, Garmin, USGS, Intermap, INCREMENT P, NRCan, METI, Esri, China (Hong Kong), Esri Korea, Esri (Thailand), NGCC, (c) OpenStreetMap contributors, and the GIS User Community

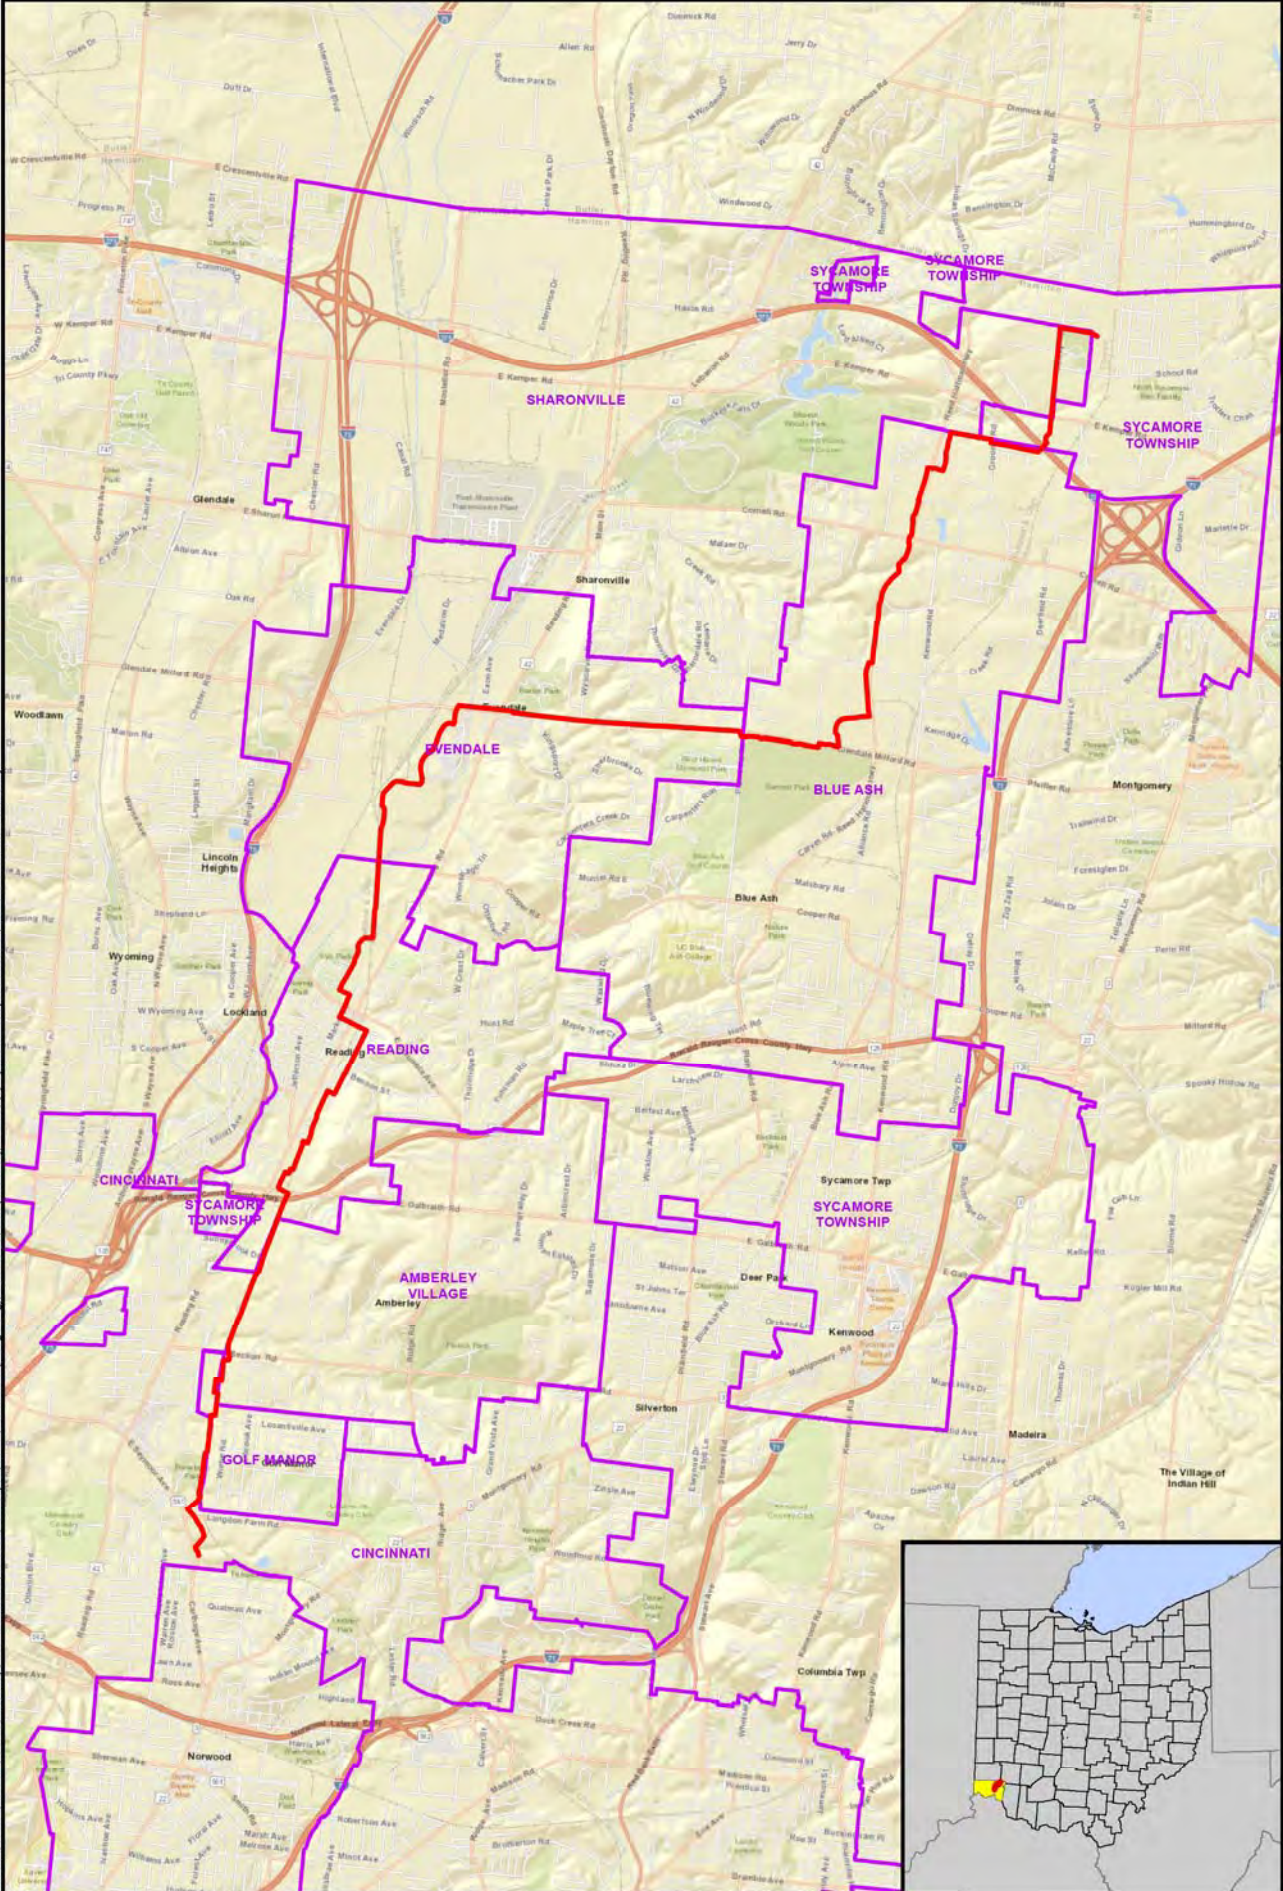

- Alignment
- Municipal Boundary


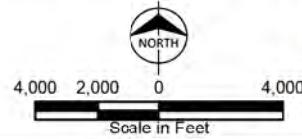


Figure 1
Vicinity Map
C350

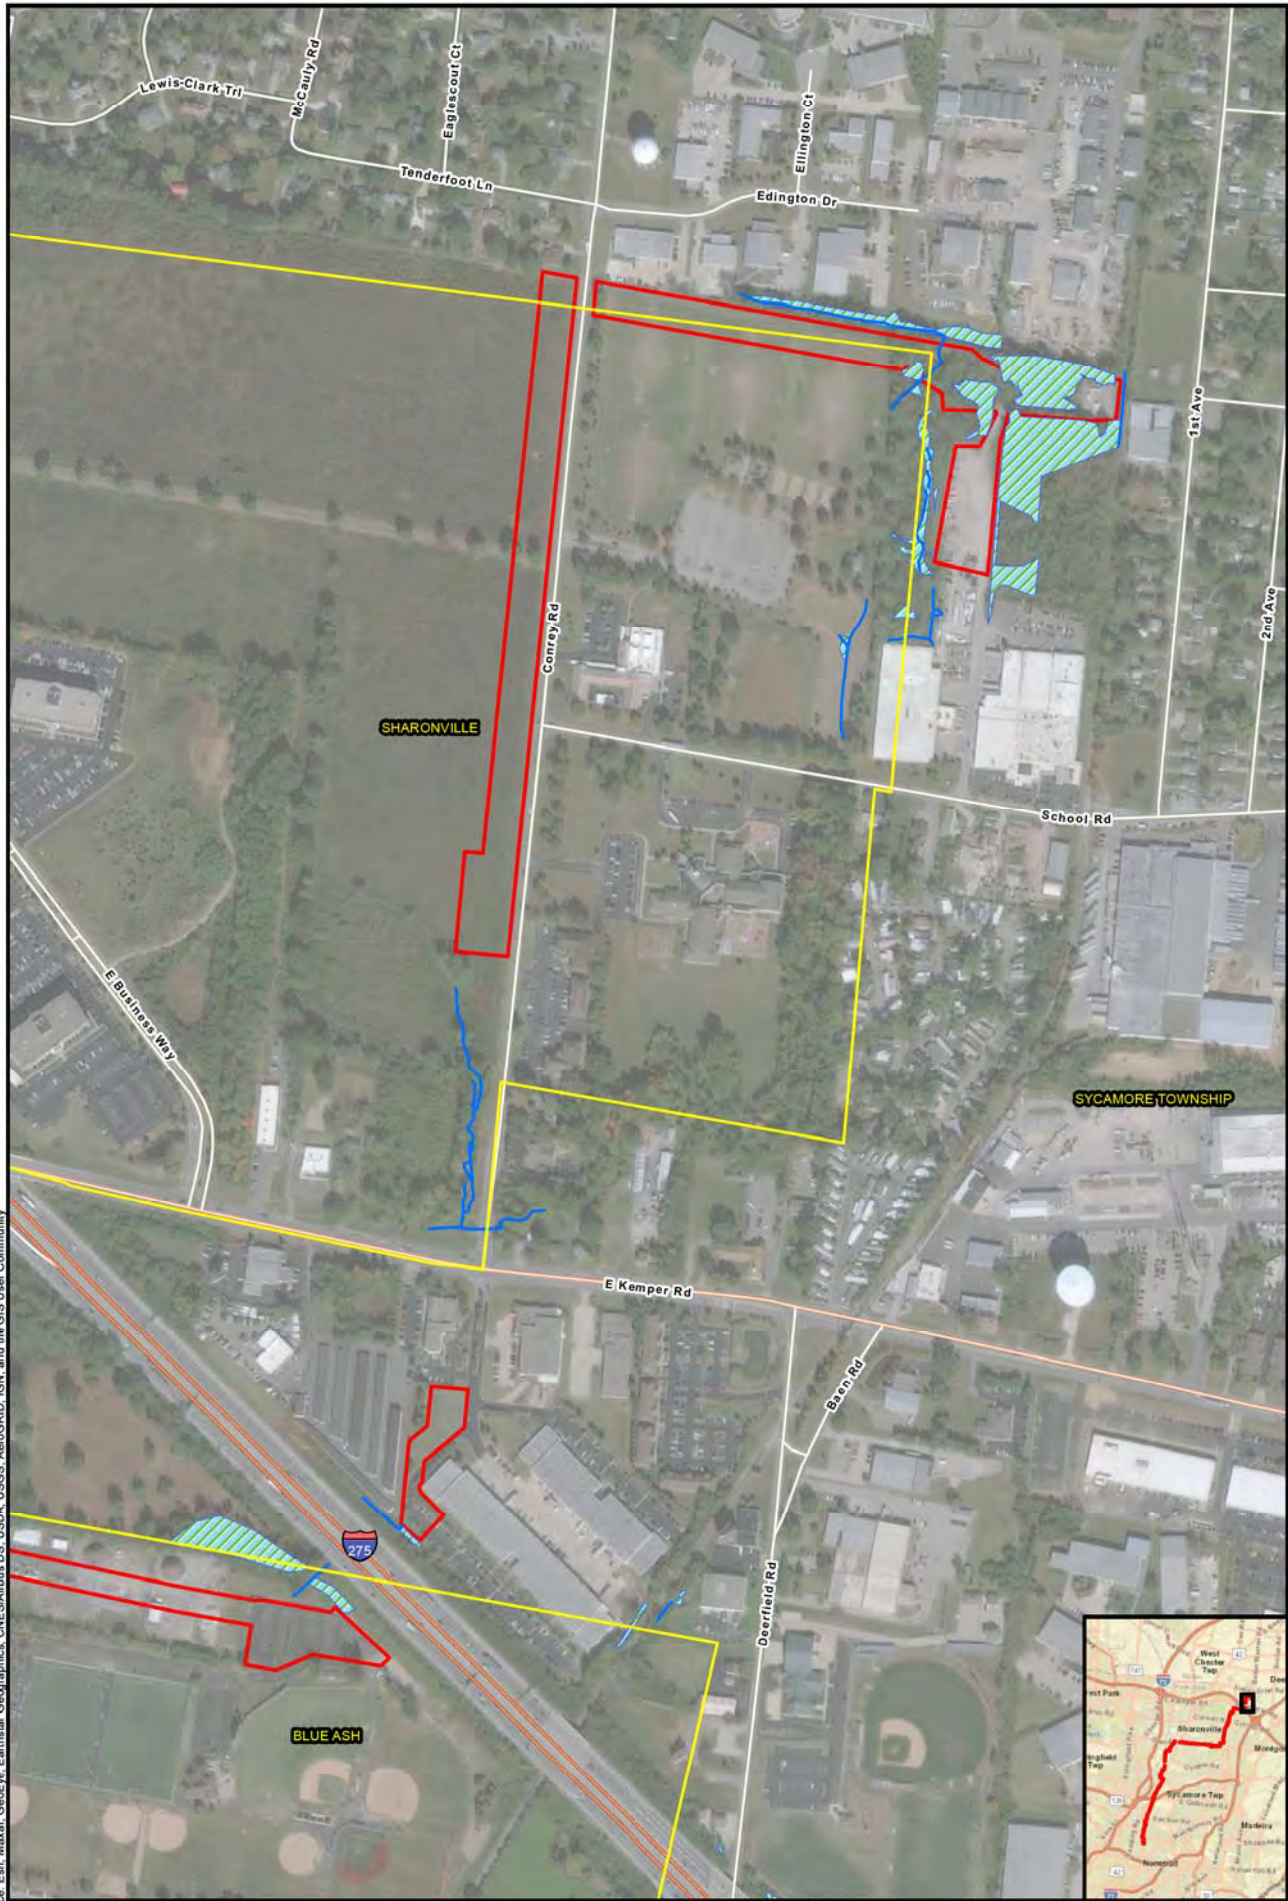

Path: Z:\Clients\TND\JukeEmr\90786_DukeC314\Studies\Geospatial\DataFiles\AcDoc\SWPPP\DPDukeC314V_SWPPP_Fig2_Site.mxd mihogan 9/18/2020
 Service Layer Credits: Source: Esri, Maxar, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

- Construction Footprint
- City Limits
- Stream
- Wetland
- Floodplain
- Floodway






Figure 2
 Site Map
 C350
 Page 1 of 2

Path: Z:\Clients\TND\JukeEr\90786_DukeC314\Studies\Geospatial\DataFiles\AcDoc\SWPPP\DPDukeC314V_SWPPP_Fig2_Site.mxd mihogan 9/18/2020
 Service Layer Credits: Source: Esri, Maxar, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

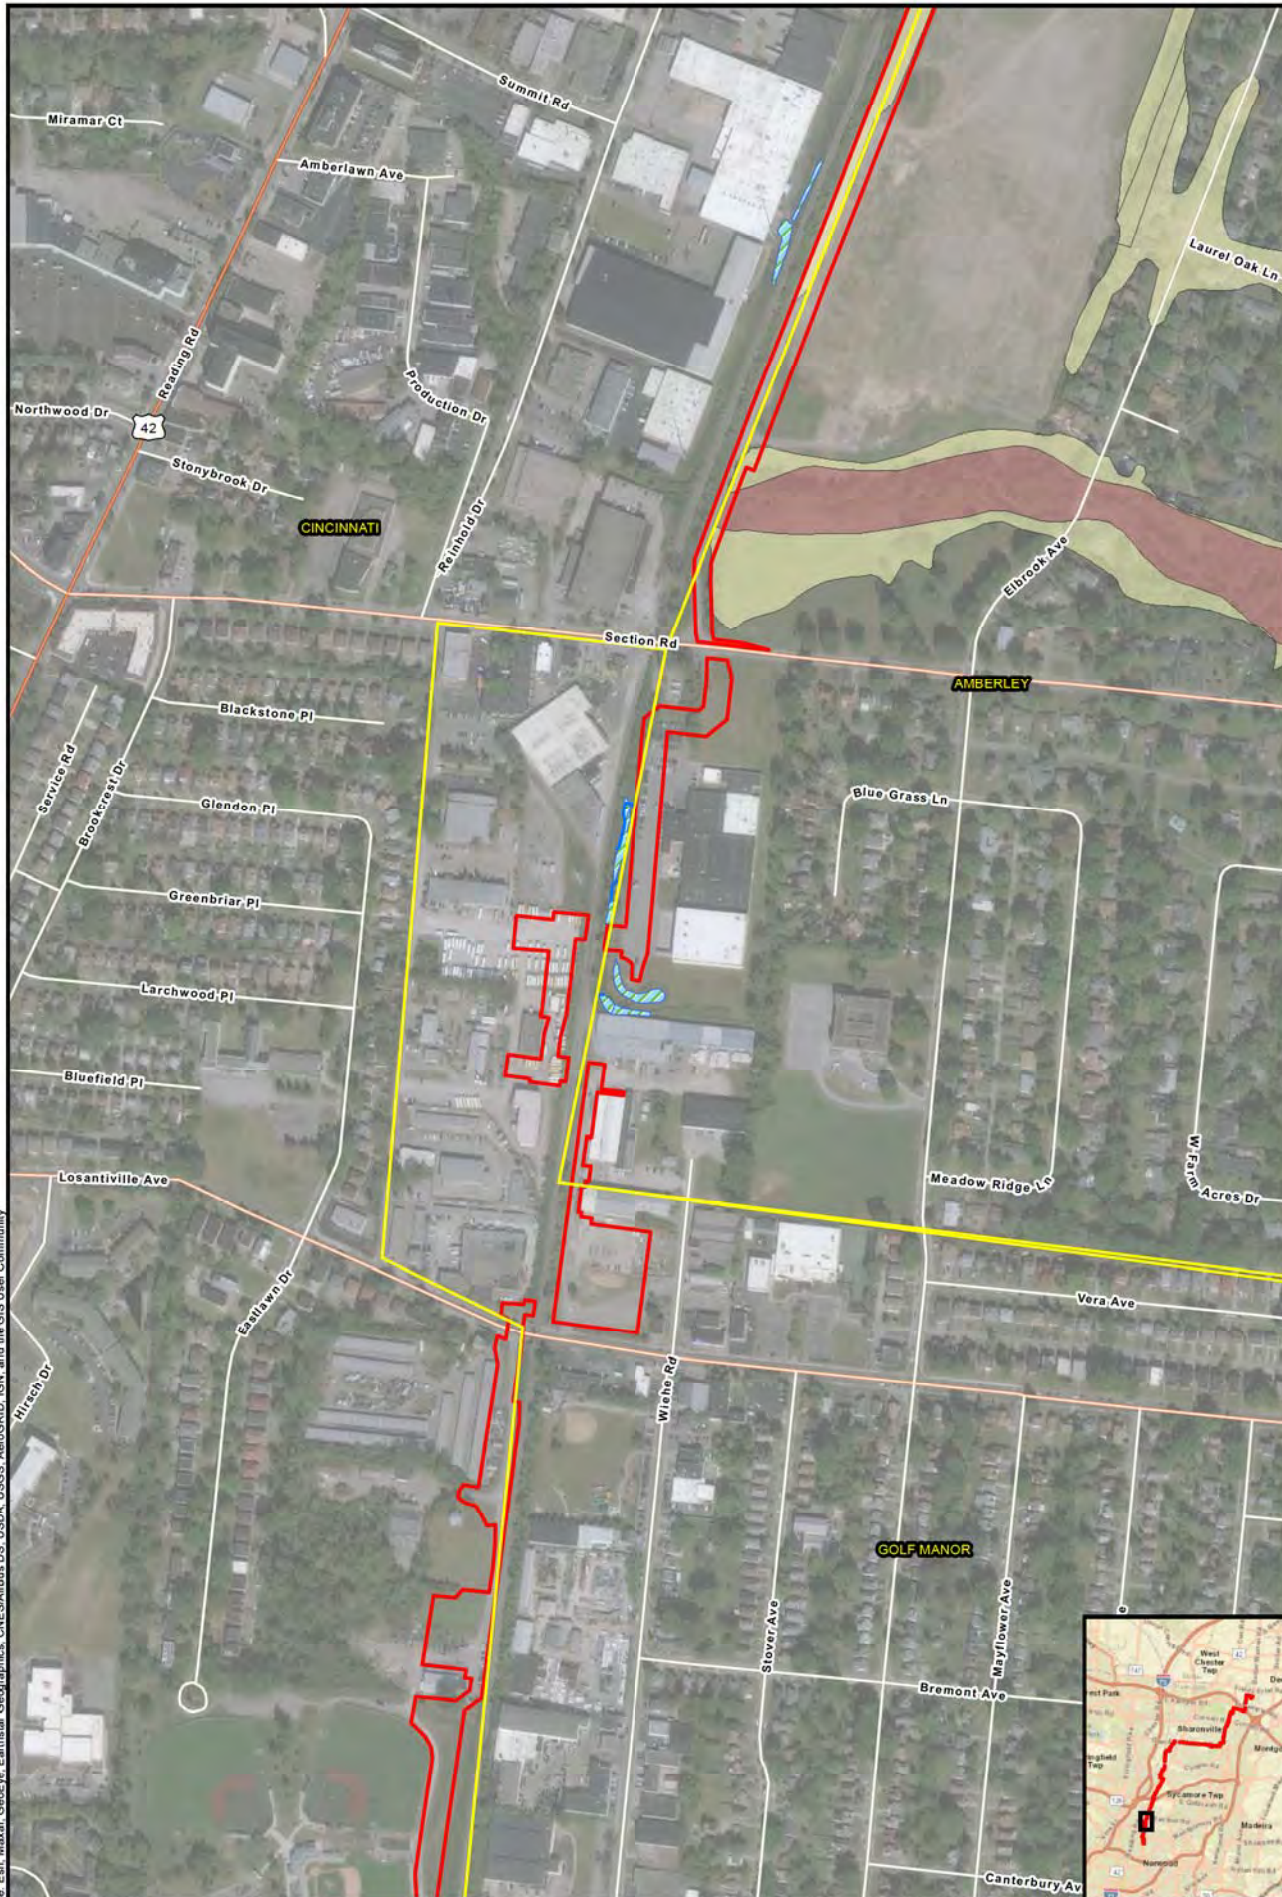

- Construction Footprint
- City Limits
- Stream
- Wetland
- Floodplain
- Floodway





Figure 2
 Site Map
 C350
 Page 2 of 2

Map Unit Symbol & Name

JoR1A1- Jonesboro-Rossmoyne silt loams, 0 to 2 % slopes*

JoR1B2- Jonesboro-Rossmoyne silt loams, 2 to 6 % slopes, eroded

UAGXC- Urban land-Alicic Udarents-Rossmoyne complex, 0 to 12 % slopes

UAVXC- Urban land-Alicic Udarents-Avonburg complex, 0 to 12 % slopes*

UFAXC- Urban land-Alicic Udarents complex, fragipan substratum over till, 0 to 12 % slopes

Ur- Urban land

UrUXC- Urban land-Udorhents complex, 0 to 12 % slopes

UsUXF- Urban land-Udorhents complex, smoothed, 0 to 50 % slopes

W- Water

WsS1A1- Westboro-Schaffer silt loams, 0 to 2 % slopes*



Path: Z:\Clients\TND\JukeEm\90786_DukeC314V\Studies\Geospatial\DataFiles\AcDoc\SWPPP\Fig3_Soils.mxd mihogan 9/18/2020
 Service Layer Credits: Source: Esri, Maxar, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

- Construction Footprint
- City Limits
- SSURGO Soils Map Unit





Figure 3
 Soils Map
 C350
 Page 1 of 2

Map Unit Symbol & Name
 Gn- Genesee loam, occasionally flooded*
 UAGXC- Urban land-Alicic Udarents-Rossmoyne complex, 0 to 12 % slopes
 UATXD- Urban land-Alicic Udarents-Pate complex, 12 to 25 % slopes
 UfAXC- Urban land-Alicic Udarents complex, fragipan substratum over till, 0 to 12 % slopes
 Ur- Urban land
 UrUXC- Urban land-Udorhents complex, 0 to 12 % slopes

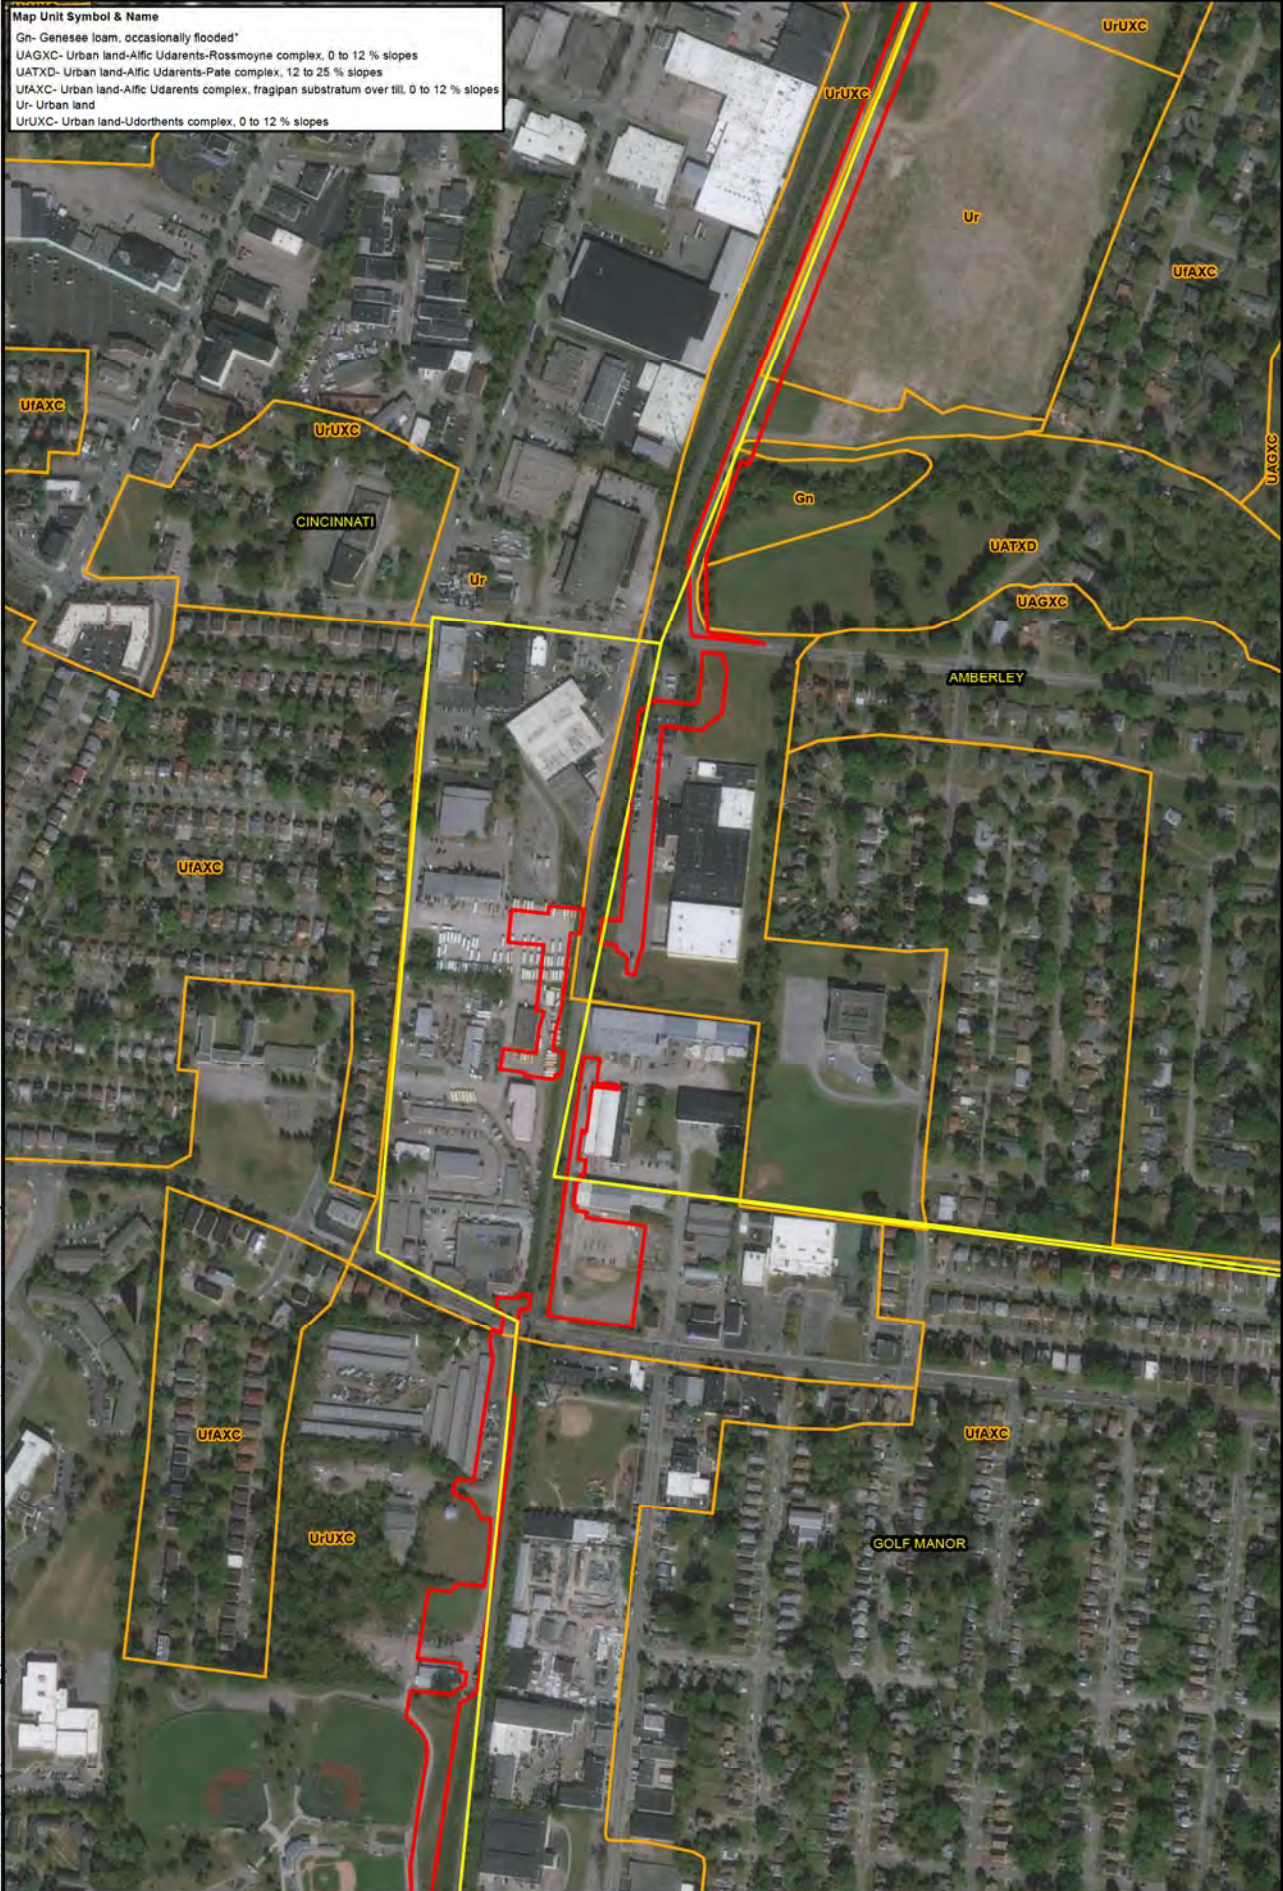

Path: Z:\Clients\TND\DUKE\Emr\90786_DukeC314V\Studies\Geospatial\DataFiles\AcDoc\SWPPP\DUKEC314V_SWPPP_Fig3_Soils.mxd mihogan 9/16/2020
 Service Layer Credits: Esri, Maxar, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

- Construction Footprint
- City Limits
- SSURGO Soils Map Unit




Figure 3
 Soils Map
 C350
 Page 2 of 2

HIGHPOINT STATION WATER QUALITY VOLUME CALCULATION

Project Information & Summary

v1.1 2018-10-31

Project Name:	C350 Highpoint Station	Date:	5/11/2020
Project Location:	Sycamore Township		
Project Latitude:	39°17'18.17"N	Longitude:	84°21'18.16"W
NPDES Permit Applicant:	Duke Energy, Ohio Inc.		
Submitted by:		Phone Number:	

Area A	Drainage Area ID:	Highpoint Station		
	Drainage Area, A_A =	1.14	acres	= 49,658 ft ²
	Impervious Area, A_{Aimp} =	0.07	acres	= 3,049 ft ²
	Imperviousness Fraction, i_A =	0.06		= 6 %
	Volumetric Runoff Coefficient, Rv_A =	0.11		
	Water Quality Volume, WQV_A =	392	ft ³	
	Runoff Reduction Volume, RRV_A =	434	ft ³	
	Remaining Water Quality Volume, WQV_{AR} =	-42	ft ³	

Area B	Drainage Area ID:			
	Drainage Area, A_B =	0.00	acres	= 0 ft ²
	Impervious Area, A_{Bimp} =	0.00	acres	= 0 ft ²
	Imperviousness Fraction, i_B =			= %
	Volumetric Runoff Coefficient, Rv_B =			
	Water Quality Volume, WQV_B =		ft ³	
	Runoff Reduction Volume, RRV_B =	0	ft ³	
	Remaining Water Quality Volume, WQV_{BR} =		ft ³	

Area C	Drainage Area ID:			
	Drainage Area, A_C =	0.00	acres	= 0 ft ²
	Impervious Area, A_{Cimp} =	0.00	acres	= 0 ft ²
	Imperviousness Fraction, i_C =			= %
	Volumetric Runoff Coefficient, Rv_C =			
	Water Quality Volume, WQV_C =		ft ³	
	Runoff Reduction Volume, RRV_C =	0	ft ³	
	Remaining Water Quality Volume, WQV_{CR} =		ft ³	

Area D	Drainage Area ID:			
	Drainage Area, A_D =	0.00	acres	= 0 ft ²
	Impervious Area, A_{Dimp} =	0.00	acres	= 0 ft ²
	Imperviousness Fraction, i_D =			= %
	Volumetric Runoff Coefficient, Rv_D =			
	Water Quality Volume, WQV_D =		ft ³	
	Runoff Reduction Volume, RRV_D =	0	ft ³	
	Remaining Water Quality Volume, WQV_{DR} =		ft ³	

Project Totals	Drainage Area, A_{total} =	1.14	acres	= 49,658 ft ²
	Impervious Area, A_{imp} =	0.07	acres	= 3,049 ft ²
	Imperviousness Fraction, i =	0.06		= 6 %
	Volumetric Runoff Coefficient, Rv =	0.11		
	Water Quality Volume, WQV =	392	ft ³	
	Runoff Reduction Volume, RRV =	434	ft ³	
	Remaining Water Quality Volume, WQV_R =	-42	ft ³	

**APPENDIX C – EROSION AND SEDIMENT CONTROL PLANS AND BMP
DETAILS**

HIGHPOINT STATION ESC PLAN AND BMP DETAILS

ACCESS AND STAGING

1. ACCESS AND HALL ROUTES FOR ALL CONTRACTOR PERSONNEL, VEHICLES, EQUIPMENT, AND DELIVERIES ARE ILLUSTRATED ON THIS DRAWING AND ARE SUBJECT TO CHANGE WITHOUT NOTICE. THE CONTRACTOR SHALL MAINTAIN THE APPROPRIATE OWNER WHO HAS JURISDICTION OVER THE AFFECTED ROUTE. ACCESS ROUTES AND HALL ROUTES ARE SUBJECT TO CHANGE AT THE DISCRETION OF THE CLIENT REPRESENTATIVE AND MAY CHANGE BASED ON OPERATIONAL REQUIREMENTS OF THE SITE.
2. CONTRACTOR SHALL COORDINATE ACTIVITIES AND MAINTAIN ALL ACCESS AND HALL ROUTES IN A MANNER THAT ALLOWS UNOBSTRUCTED EMERGENCY ACCESS TO ALL PROJECT AREAS AND EXISTING ROADWAYS AT ALL TIMES WITHOUT DELAY TO EMERGENCY AND SECURITY VEHICLE RESPONSE TIME.
3. IF ANY EMERGENCY ROUTES REQUIRE CLOSURE DUE TO CONSTRUCTION ACTIVITIES, CONTRACTOR SHALL NOTIFY THE CLIENT REPRESENTATIVE, POLICE, LOCAL FIRE AUTHORITY, AND ALL OTHER EMERGENCY SERVICES OF THE CLOSURE.
4. CONTRACTOR SHALL MAINTAIN ACCESS AND HALL ROUTES TO BE FREE FROM DEBRIS CAUSED FROM CONSTRUCTION ACTIVITIES ON A DAILY BASIS.
5. CONTRACTOR SHALL RESTRICT ALL OPERATIONS TO AREAS WITHIN THE CONSTRUCTION LIMITS UNLESS COORDINATED OTHERWISE WITH THE CLIENT REPRESENTATIVE.
6. CONTRACTOR SHALL PROVIDE TEMPORARY CONSTRUCTION FENCING AROUND THE ENTIRE SITE DURING CONSTRUCTION.
7. CONTRACTOR IS RESPONSIBLE FOR ESTABLISHING A STAGING AND STORAGE AREA FOR MATERIALS AND EQUIPMENT. LOCATION OF CONTRACTOR'S STAGING SHALL BE AS ILLUSTRATED ON THIS DRAWING, AND IS SUBJECT TO THE APPROVAL OF THE CLIENT REPRESENTATIVE. CONTRACTOR MAY SUBMIT ALTERNATIVES TO THE STAGING AREA LOCATIONS AS SHOWN. CONTRACTOR'S STAGING AREA IS SUBJECT TO CHANGE AT THE DISCRETION OF THE CLIENT REPRESENTATIVE. CONTRACTOR SHALL MAINTAIN ACCESS AND HALL ROUTES TO BE FREE FROM DEBRIS CAUSED FROM CONSTRUCTION ACTIVITIES ON A DAILY BASIS.
8. WHEN NOT ENGAGED IN CONSTRUCTION ACTIVITIES, CONTRACTOR'S EQUIPMENT AND VEHICLES SHALL BE PARKED IN THE STAGING AREA.
9. ACCESS POINTS, HALL ROUTES, STAGING AREA, AND ANY OTHER AREAS DISTURBED BY THE CONTRACTOR SHALL BE RESTORED TO THEIR ORIGINAL CONDITION OR BETTER TO THE SATISFACTION OF THE CLIENT REPRESENTATIVE.
10. CONTRACTOR SHALL IMPROVE THE EXISTING ACCESS ROAD AS REQUIRED AND AS DIRECTED BY AND APPROVED BY CLIENT REPRESENTATIVE.

TRAFFIC CONTROL

1. PRIOR TO CONSTRUCTION, CONTRACTOR SHALL CORRECT OFF THE EXISTING ROADWAY SURFACE ANY DEFECTS IDENTIFIED BY USING BARRIAGES APPROVED BY THE CLIENT REPRESENTATIVE.
2. ALL CONSTRUCTION EQUIPMENT AND VEHICLES SHALL BE MARKED WITH COMPANY DESIGNERS, INSURERS, OR OTHER MARKINGS WHICH ARE CLEARLY VISIBLE.
3. CONSTRUCTION EQUIPMENT SHALL HAVE AUTOMATIC SIGNALING DEVICES TO SOUND IN ALARM WHEN MOVING IN REVERSE.
4. NO PEDESTRIAN TRAFFIC SHALL BE ALLOWED INSIDE THE CONSTRUCTION LIMITS.
5. ANY DAMAGE TO ROADS AND PAVEMENTS TO REMAIN DUE TO CONSTRUCTION EQUIPMENT OR TRAFFIC SHALL BE REPAIRED TO RESTORE THE ROADS AND PAVEMENTS TO THEIR ORIGINAL CONDITION TO THE SATISFACTION OF THE CLIENT REPRESENTATIVE.



SHEETS	4 OF 66	DWG SCALE	AS NOTED
DWG DATE	07/26/2019	SUPERSEDED	
DRAWING NUMBER	PNG -C-004-0001258		
REVISION	B		

C-350 PROJECT
HIGHPOINT PARK STATION
ACCESS & CONSTRUCTION STAGING
 HAMILTON COUNTY, OHIO



REGIONAL ENGINEER	DATE	APPROVALS
MUR, TECH REC & STD	07/26/2020	CONF

DATE	BY	CHK	DESCRIPTION
07/24/2020	JTG	CNS	ISSUED FOR 40% REVIEW
07/24/2020	JTG	CNS	ISSUED FOR RD

NO.	DATE	BY	CHK	DESCRIPTION
A	08/17/2020	JTG	CNS	ISSUED FOR 40% REVIEW
B	07/24/2020	JTG	CNS	ISSUED FOR RD

PROFESSIONAL ENGINEER'S STAMP

NOTES:

- THE EXISTING SITE UTILITIES AND FEATURES SHOWN ARE BASED ON A FIELD SURVEY CONDUCTED BY THE CONSULTANT ON 07/26/2019. THE 2020 COORDINATES ARE IN OHIO STATE PLANE SOUTH ZONE, 17E2, NAVD83 HORIZONTAL DATUM AND NAVD83 VERTICAL DATUM.
- SEE SHEET C-004-0001267 FOR CIVIL GENERAL NOTES AND ABBREVIATIONS.
- SEE SHEET C-004-0001269 FOR GENERAL EROSION CONTROL NOTES.
- SEE SHEET C-004-0001269 FOR TEMPORARY AND PERMANENT STABILIZATION REQUIREMENTS AND SEEDING SCHEDULES.
- ALL DIMENSIONS SHOWN ARE IN FEET UNLESS NOTED OTHERWISE.


WETLANDS CONSTRUCTION NOTES

- CONSTRUCTION OCCURS WITHIN WOODED WETLANDS. CONTRACTOR MUST LIMIT ALL CONSTRUCTION ACTIVITIES AND DISTURBANCE TO WITHIN THE LIMITS OF DISTURBANCE AS SHOWN IN THE PLANS.
- CONTRACTOR MUST INSTALL ORANGE CONSTRUCTION FENCING IMMEDIATELY OUTSIDE OF THE PERIMETER EROSION CONTROL MEASURES ALONG THE PERIMETER OF WETLAND AREAS NOT TO BE DISTURBED.
- SIGNS MUST BE INSTALLED EVERY 75' ON THE ORANGE CONSTRUCTION. SIGNS MUST READ 'WETLANDS - DO NOT ENTER OR DISTURB'.
- DO NOT PLACE CONCRETE WASHOUTS WITHIN 125 FEET OF A WETLAND OR STREAM. CONCRETE WASHOUT FOR STATION CONSTRUCTION SHALL BE PLACED ALONG THE PIPELINE ALIGNMENT WORKSPACE OR ACCESS AREA. CONCRETE WASHOUTS SHALL BE PLACED WITHIN THE BUFFER ZONE WITHIN THE EQUIPMENT OF THE HIGHPOINT PARK STATION. DO NOT PLACE THE CONCRETE WASHOUT WITHOUT APPROVAL BY DAE ENVIRONMENTAL. UNDER NO CIRCUMSTANCES SHALL UNHARDENED CONCRETE BE ALLOWED TO LEAVE THE WASHOUT AREA AND/OR DISCHARGE TOWARDS WETLANDS.

KEY NOTES:

- FIBER ROLL - C-004-0001266
- TEMPORARY CONSTRUCTION ENTRANCE - C-004-0001266
- CONCRETE WASHOUT (SEE WETLANDS CONSTRUCTION NOTE 4) - C-004-0001266
- ROCK CHECK DAM - C-004-0001266
- EROSION CONTROL BLANKET - C-004-0001266
- SILT FENCE - C-004-0001266
- CONSTRUCTION BARRIER FENCING - C-004-0001266

LEGEND:

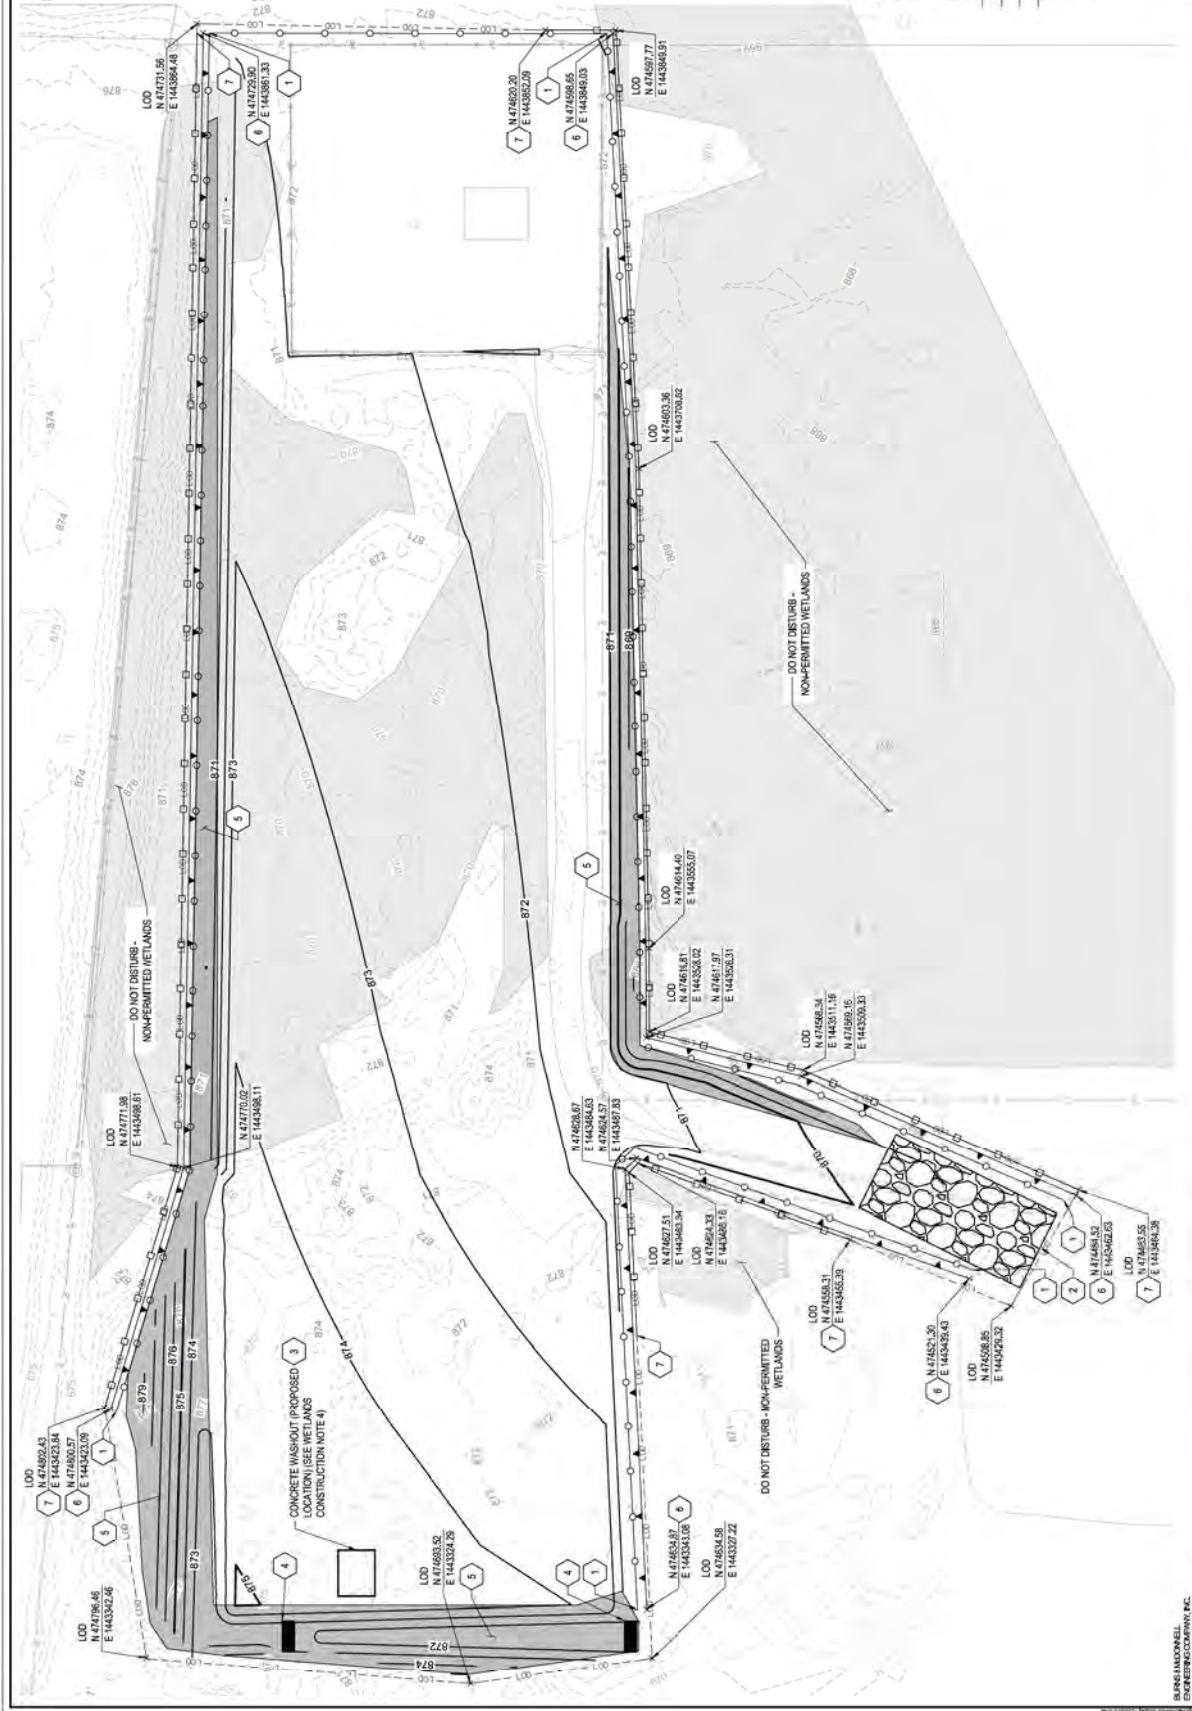

SHEETS: 6 OF 68	DWG SCALE	AS NOTED
DWG DATE: 07/26/2019	ISSUED FOR 40% REVIEW	REVISION
DRAWING NUMBER:		B
PROJECT NUMBER:		C-004-0001260
HAMILTON COUNTY, OHIO		

**C350 PROJECT
HIGHPOINT PARK STATION
ES&PC PLAN**



REGIONAL ENGINEER	DATE
MGR. TECH REC & STD	
PRINCIPAL ENGINEER	DATE

APPROVALS	
BY	DATE
JTG	07/26/2019
JTG	07/26/2019
JTG	07/26/2019
JTG	07/26/2019

DATE	DESCRIPTION
07/26/2019	ISSUED FOR 40% REVIEW
07/26/2019	ISSUED FOR BID

PROFESSIONAL ENGINEER'S STAMP

NOTES:


1. THE EXISTING SITE UTILITIES AND FEATURES SHOWN ARE BASED ON A FIELD SURVEY. ALL COORDINATES ARE IN OHIO STATE PLANE SOUTH ZONE, 1702, NAD83 HORIZONTAL DATUM AND NAVD83 VERTICAL DATUM.
2. SEE SHEET C-004-0001261 FOR CIVIL GENERAL NOTES AND ABBREVIATIONS.
3. ALL DIMENSIONS SHOWN ARE IN FEET UNLESS NOTED OTHERWISE.
4. OVEREXCAVATE AND REPLACE WETLANDS SOILS IN AREAS SHOWN ON DRAWING C-004-0001261 AND PER DETAILS ON C-004-0001268.

KEY NOTES:

- 1 CLEAR AND GRUB VEGETATION (SEE NOTE 4)
- 2 DEMOLISH AND REMOVE GRAVEL ROAD. ASSUME #87 STONE AT 4" DEPTH
- 3 DEMOLISH AND REMOVE CHAIN LINK FENCE

LEGEND:

-  CLEAR AND GRUB AREA
-  DEMOLISH AND REMOVE GRAVEL ROAD. ASSUME #87 STONE AT 4" DEPTH
-  DEMOLISH AND REMOVE CHAIN LINK FENCE
-  JIMTS OF DISTURBANCE
-  WETLAND AREA

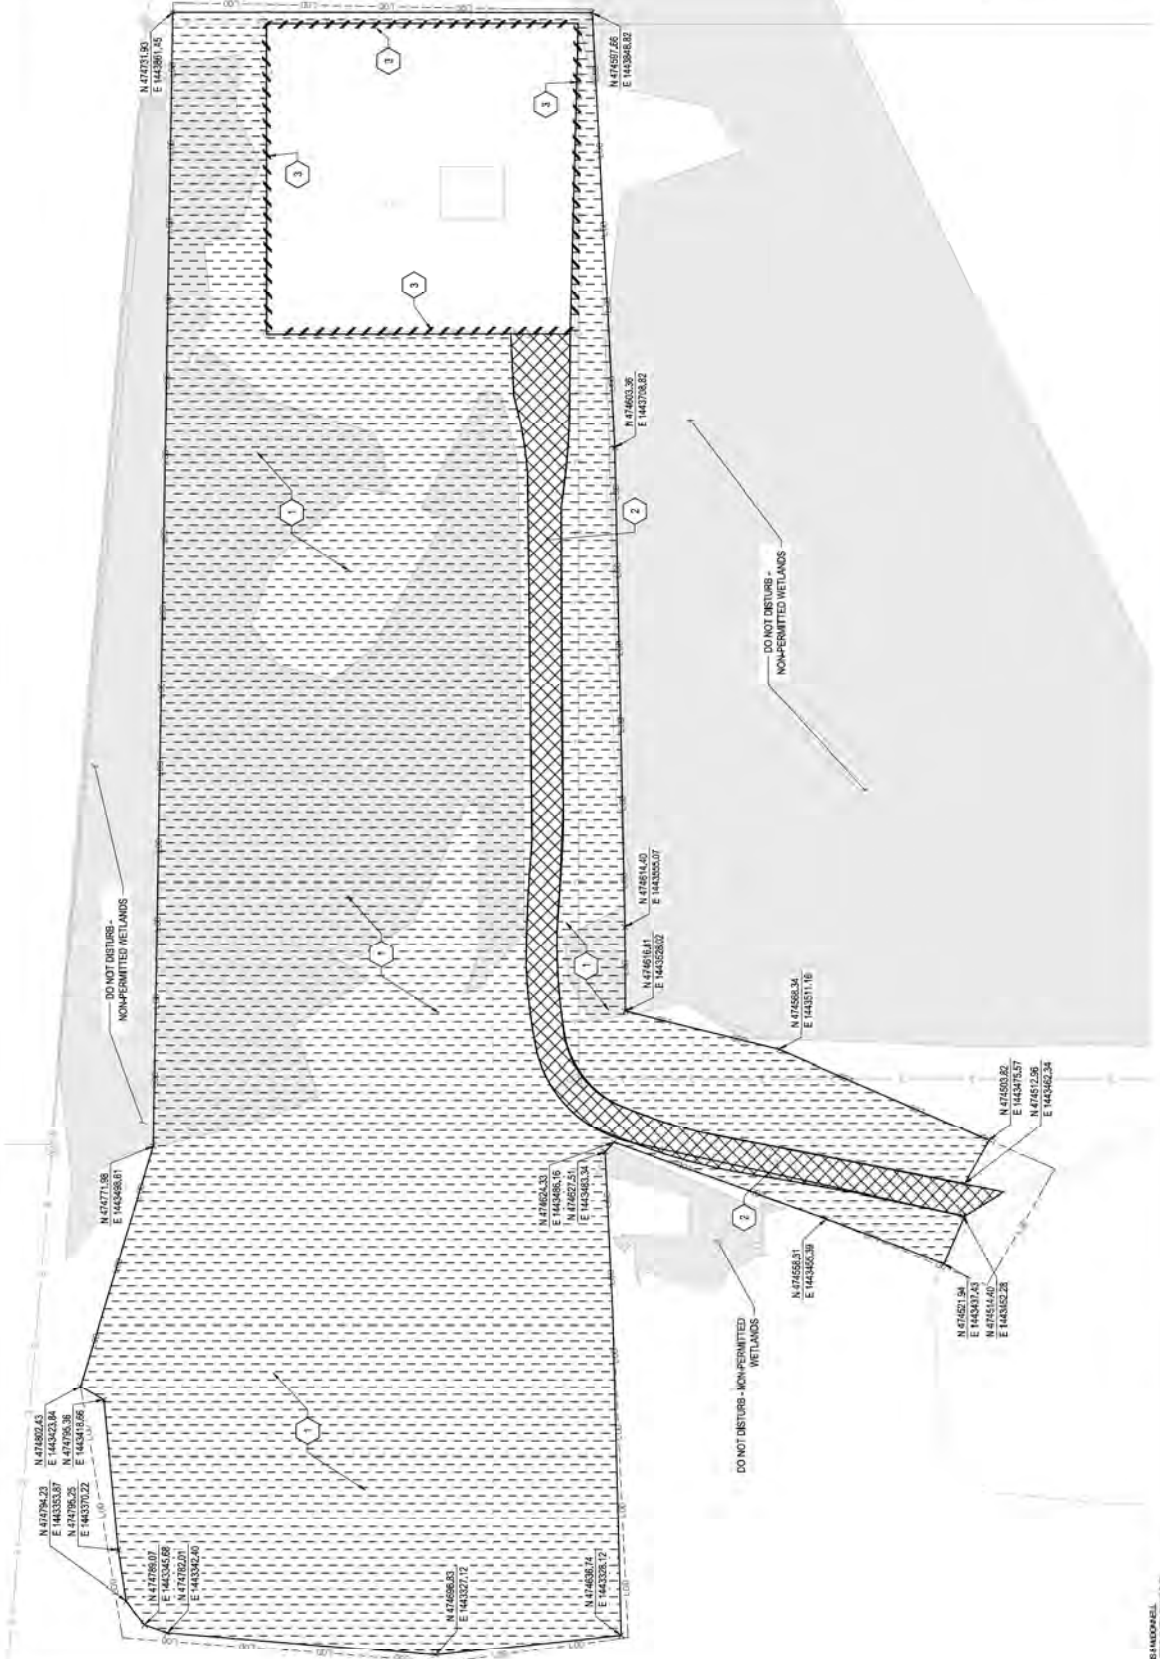

SHEETS: 7 OF 68	DWG SCALE	AS NOTED
DWG DATE: 07/26/2019	ISSUED FOR 0% REVIEW	
DRAWING NUMBER:	PNG -C-004-0001261	REVISION:
DRAWING NUMBER:		B
C:\HAMILTON\COUNTY\7.50		

**C-350 PROJECT
HIGHPOINT PARK STATION
DEMOLITION PLAN**
HAMILTON COUNTY, OHIO



REVISION	DATE	BY	DESCRIPTION
REC'D			
CHK'D			
APP'D			

DATE	BY	CHK	APP'D
07/26/2019	JTG		
07/26/2019	JTG		
07/26/2019	JTG		

DATE	BY	CHK	APP'D
07/26/2019	JTG		
07/26/2019	JTG		
07/26/2019	JTG		

PROFESSOR: EDWARD SWAMP

NOTES:


1. THE EXISTING SITE UTILITIES AND FEATURES SHOWN ARE BASED ON A FIELD SURVEY OF THE PROPERTY. ALL COORDINATES ARE IN OHIO STATE PLANE SOUTH ZONE, 1702, NAD83 HORIZONTAL DATUM AND NAVD83 VERTICAL DATUM.
2. SEE SHEET C-004-0001267 FOR CIVIL GENERAL NOTES AND ABBREVIATIONS.
3. ALL DIMENSIONS SHOWN ARE IN FEET UNLESS NOTED OTHERWISE.
4. SEE ODOT DESIGN STANDARDS, LATEST EDITION, AS INDICATED. ALL SUBSEQUENT AND RELEVANT STANDARDS AND SPECIFICATIONS SHALL APPLY.

KEY NOTES:

- 1 LAUNCHER CONCRETE PAD
- 2 PRESSURE CONTROL CONCRETE PAD
- 3 HEATER CONCRETE PAD
- 4 FLOW METER CONCRETE PAD
- 5 OODRBER CONCRETE PAD
- 6 CHAIN-LINK SECURITY FENCE WITH OPAQUE SCREENING
- 7 25' MANUAL SLIDE GATE
- 8 16' DOUBLE SWING GATE

LEGEND:

	REMOVABLE PAVEMENT BMP		1
	PROPOSED GRAVEL SURFACE COURSE		2
	PROPOSED ACCESS ROAD SURFACE COURSE		3
	CUTOFF TRENCH		4
	CONCRETE PAD		N
	WETLAND AREA		1" = 20'

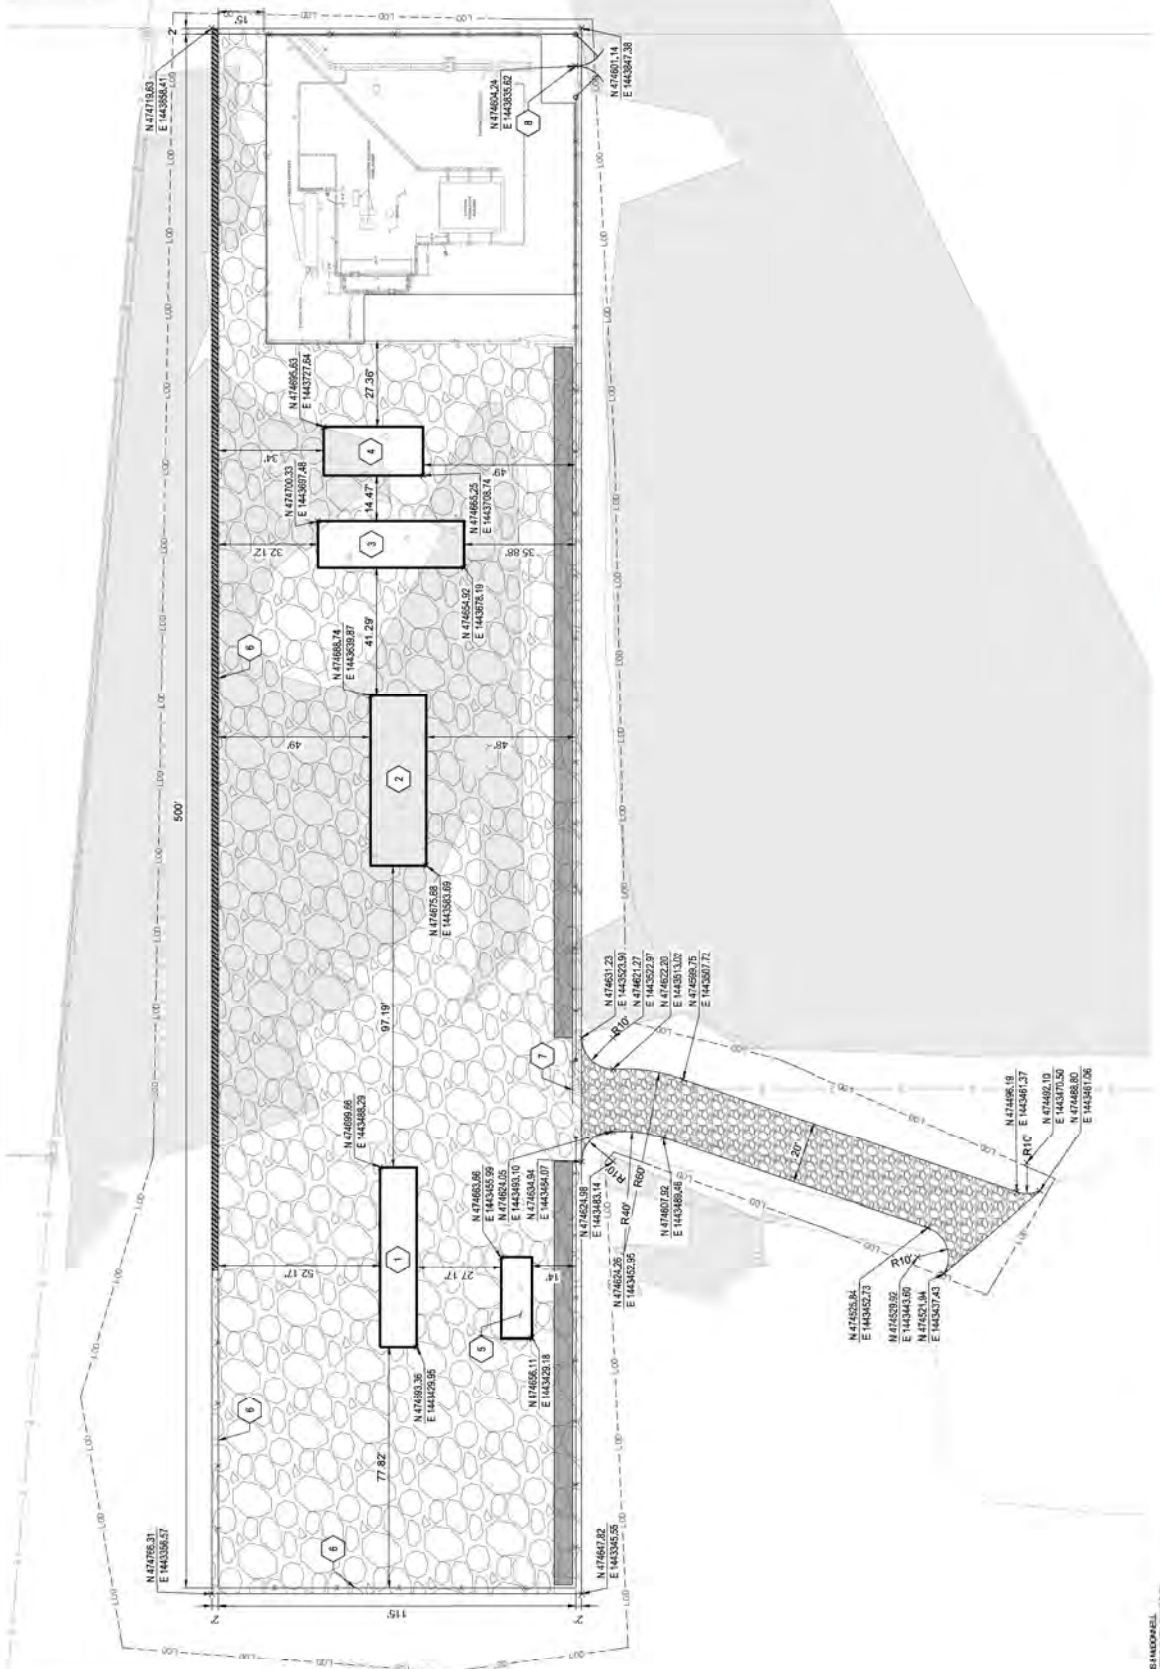

**C350 PROJECT
HIGHPOINT PARK STATION
SITE PLAN**



HAMILTON COUNTY, OHIO

DATE	BY	CHK	APPROVALS
07/24/2020	JTG	NA	REVISION
07/24/2020	JTG	NA	REVISION

DATE	DESCRIPTION	BY	CHK	APPROVALS
07/24/2020	ISSUED FOR 40% REVIEW	JTG	NA	REVISION
07/24/2020	ISSUED FOR BID	JTG	NA	REVISION


PROFESSIONAL ENGINEER
STATE LICENSE # 0000000000

PROJECT: C-004-0001267


SHEETS: 8 OF 68	DWG SCALE	AS NOTED
DWG DATE: 06/11/2016	ISSUED BY	REVISION
DRAWING NUMBER		
PNG - C-004-0001262		B
© 2016 HAMILTON COUNTY, OHIO		

NOTES:

- THE EXISTING SITE UTILITIES AND FEATURES SHOWN ARE BASED ON A FIELD SURVEY. ALL COORDINATES ARE IN OHIO STATE PLANE SOUTH ZONE, 1702, NAD83 HORIZONTAL DATUM AND NAVD83 VERTICAL DATUM.
 - SEE SHEET C-004-0001267 FOR CIVIL GENERAL NOTES AND ABBREVIATIONS.
 - ALL DIMENSIONS SHOWN ARE IN FEET UNLESS NOTED OTHERWISE.
- WETLANDS CONSTRUCTION NOTES**
- CONSTRUCTION OCCURS WITHIN WETLANDS. CONTRACTOR MUST LIMIT ALL CONSTRUCTION ACTIVITIES AND DISTURBANCE TO WITHIN THE LIMITS OF DISTURBANCE AS SHOWN IN THE PLANS.
 - CONTRACTOR MUST INSTALL ORANGE CONSTRUCTION FENCING IMMEDIATELY UPON DETERMINATION OF WETLANDS. CONTRACTOR SHALL CONTROL THE PERIMETER OF WETLANDS AND AREAS NOT TO BE DISTURBED. SEE DETAILS ON CIVIL DETAILS SHEET 2.
 - DO NOT PLACE CONCRETE WASHOUTS WITHIN 125 FEET OF A WETLAND OR STREAM. CONCRETE WASHOUT FOR STATION CONSTRUCTION SHALL BE PLACED WITHIN THE FOOTPRINT OF STATION CONSTRUCTION. CONCRETE WASHOUT FOR STATION CONSTRUCTION SHALL NOT BE PLACED WITHIN THE FOOTPRINT OF THE HIGHPOINT PARK STATION. DO NOT PLACE THE CONCRETE WASHOUT WITHOUT APPROVAL BY DUKE ENVIRONMENTAL.
 - CONTRACTOR SHALL OVEREXCAVATE AND REPLACE WETLANDS SOILS PER DETAILS ON CIVIL DETAILS SHEET 4.
 - CONTRACTOR SHALL INSTALL WETLANDS CUTOFF TRENCH ON THE NORTHERN EDGE OF THE STATION PER DETAILS ON CIVIL DETAILS SHEET 2.

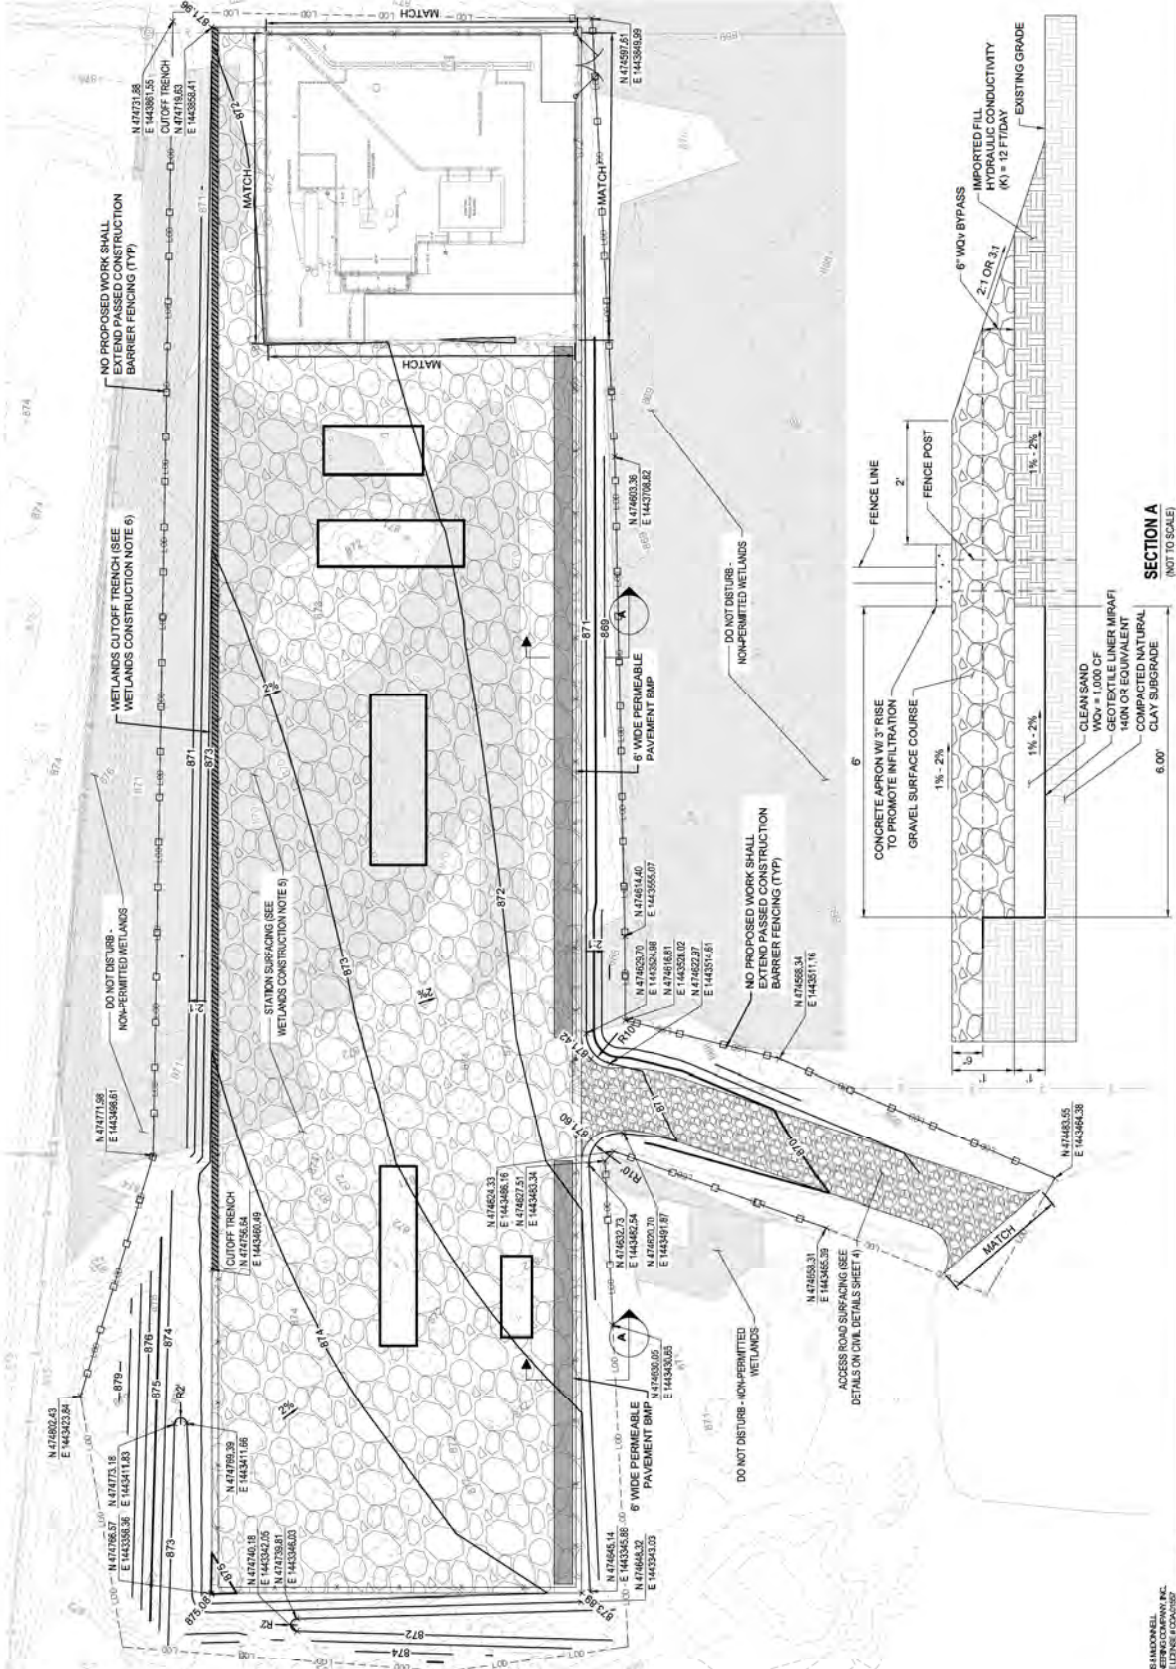

- LEGEND:**
- LIMITS OF DISTURBANCE
 - RENEWABLE PAVEMENT BMP
 - PROPOSED GRAVEL SURFACE COURSE
 - PROPOSED ACCESS ROAD SURFACE COURSE
 - CUTOFF TRENCH
 - CONCRETE PAD
 - WETLAND AREA

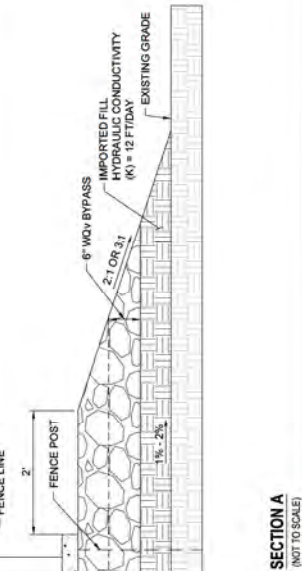

SHEETS	9 OF 68	DWS SCALE	AS NOTED
DWG DATE	07/26/2020	ISSUED	
DRAWING NUMBER	PNG - C-004-0001263		
REVISION	B		

**C350 PROJECT
HIGHPOINT PARK STATION
GRADING PLAN**




APPROVALS	DATE	BY	DESCRIPTION
REVISIONAL ENGINEER			
MARK TECH REC & STD			
PRINCIPAL ENGINEER			

BY	DATE	DESCRIPTION
JTG (CNS) AREA CODE		
JTG (CNS) ACCOUNT NUMBER		
PROJECT NUMBER	1880115	
DRAWING BY	JTG	
STATION ID	5088701	
CHECKER INITIALS	DJM	

DATE	DESCRIPTION
07/27/2020	ISSUED FOR 40% REVIEW
07/24/2020	ISSUED FOR BID


DUKE ENVIRONMENTAL ENGINEERING COMPANY, INC.
STATE LICENSE #049092

PROFESSIONAL ENGINEER'S STAMP

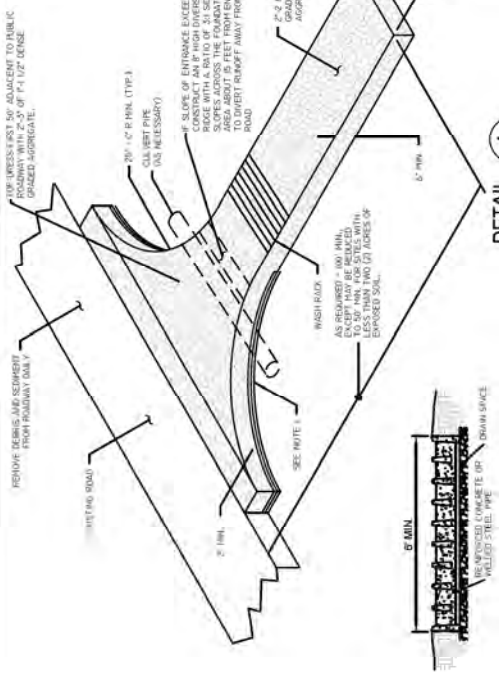

DETAIL 1
SCALE: 1/8" = 1'-0"


TEMPORARY CONSTRUCTION ENTRANCE



TYPICAL SECTION

SPACING TABLE	MAXIMUM SPACING
1'-0"	10'-0"
2'-0"	20'-0"
3'-0"	30'-0"
4'-0"	40'-0"

INSTALL FIRST ROW AT TOP OF BANK.
INSTALL LAST ROW W/ FROM TOP OF SLOPE.

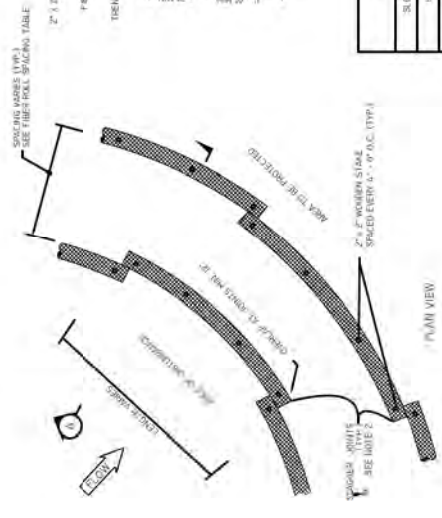


DETAIL 3
SCALE: 1/8" = 1'-0"

FIBER ROLL

- NOTES:**
- PLACE 8 OZ/5Y NON-WOVEN GEOTEXTILE FABRIC UNDER/NEAR TO STABILIZE FOUNDATION (ESPECIALLY FOR INCREASED STABILITY). GEOTEXTILE CAN ALSO BE AIDED.
 - COURT OR STATE HIGHWAY ACCESS PAVING MAY BE REQUIRED FOR PLACEMENT OF ENTRANCE.
 - CAULVERT PLACEMENT MAY BE REQUIRED TO MAINTAIN FLOW.
 - WASH RACK SHALL BE 20 FEET (MIN) WIDE OR TOTAL WIDTH OF ACCESS.
 - WASH RACK SHALL BE DESIGNED AND CONSTRUCTED TO ACCOMMODATE ANTICIPATED CONSTRUCTION VEHICULAR TRAFFIC.
 - A WATER SUPPLY SHALL BE MADE AVAILABLE TO WASH THE WHEELS OF ALL VEHICLES EXITING THE SITE.
 - MAINTAINING RACK UNDER CONSTRUCTION THROUGHOUT SHALL BE CONSIDERED AN OBSTACLE TO THE SPECIFIED DIMENSIONS BY ADDING BLOCKS/STAPLES OF BLOCK MATERIAL SHALL BE MAINTAINED ON THE ROADWAY SURFACE. ROADWAY SURFACE SHALL BE MAINTAINED TO THE CONSTRUCTION SITE IMMEDIATELY WASHING. ROADWAY SURFACE DEPOSITS IN ROADWAY DITCHES, SEAMERS, CAULVERTS, OR OTHER DRAINAGE COURSES IS NOT ACCEPTABLE.

PROVIDE FULL WIDTH OF 10'-0" MIN.

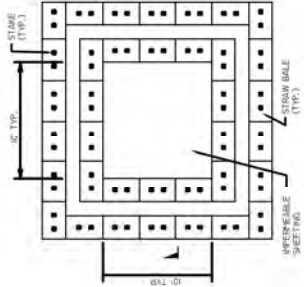


PLAN VIEW

- NOTES:**
- CONCRETE WASHOUT STRUCTURE SHALL BE 10 FEET AWAY FROM PERM CHANNELS, EXISTING DRAIN SLEETS, SENSITIVE AREAS, RETRADES, BUFFERS AND WATER COURSES AND AWAY FROM CONSTRUCTION TRAFFIC.
 - SIZE WASHOUT STRUCTURE PER VALUE NECESSARY TO CONTAIN WASHOUT AND SOLIDS AND MAINTAIN AT LEAST 1 INCHES OF FREEBOARD. TYPICAL DIMENSIONS ARE 10 FEET X 10 FEET X 1.5 FEET DEEP.
 - INCREASE SOIL BASE FREE OF ROCKS OR OTHER DEBRIS THAT MAY CAUSE TEARS OR HOLES IN THE LINER. PER LINER, USE 10 MIL OR THICKER LV RESISTANT IMPERMEABLE SHEETING. FREE OF HOLES AND TEARS OR OTHER DEFECTS THAT COMPROMISE IMPERMEABILITY OF THE MATERIAL.
 - PROVIDE A SIGN FOR THE WASHOUT IN CLOSE PROXIMITY TO THE FACILITY.
 - KEEP CONCRETE WASHOUT STRUCTURE WATER TIGHT. REPLACE IMPERMEABLE LINER IF DAMAGED (E.G. BURNED OR PUNCTURED). EMPTY OR REPLACE WASHOUT STRUCTURE THAT IS 75 PERCENT FULL, AND DISPOSE OF ACCUMULATED MATERIAL PROPERLY. DO NOT REUSE PLASTIC LINER, WET-ALUMINUM STORED LIQUIDS THAT HAVE NOT EVAPORATED AND PRESIDENT OVERLAYS. REMOVE HARDENED SOLIDS, WHOLE OR BROKEN UP, FOR DISPOSAL OR RECYCLING. MAINTAIN RUNOFF INVERSION AROUND EXCAVATED WASHOUT STRUCTURE UNTIL STRUCTURE IS REMOVED.
 - BALES CAN BE TWO STACKED OR PARTIALLY EXCAVATED TO REACH 3 FT DEPTH (MIN).
 - PRE-FABRICATED UNITS MAY BE USED WITH APPROVAL.

DETAIL 2
SCALE: 1/8" = 1'-0"

CONCRETE WASHOUT

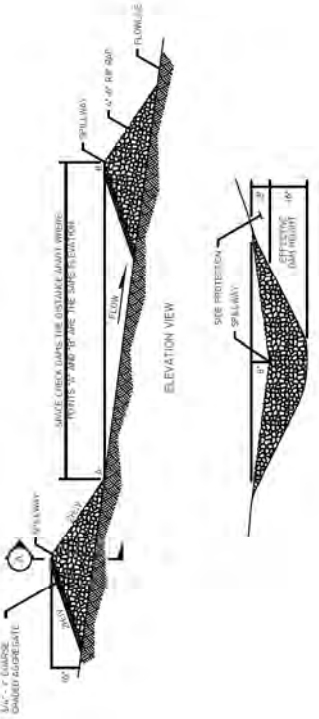

ELEVATION VIEW


SECTION A

DETAIL 4
SCALE: 1/8" = 1'-0"

ROCK CHECK DAM

		C-350 PROJECT HIGHPOINT PARK STATION CIVIL DETAILS - 1		SHEETS: 10 OF 06 DWG SCALE: AS NOTED DWG DATE: 07/26/2020 (SUPERSEDED) DRAWING NUMBER: PNG-C-004-0001265 REVISION: B HAMILTON COUNTY, OHIO
DATE: 07/27/2020 ISSUED FOR 40% REVIEW	BY: JTG (JTS) JTG (JTS)	DESCRIPTION: CIVIL AREA CODE ACCOUNT NUMBER: 180115 PROJECT NUMBER: JTG DRAWING BY: JTG STATION ID: S060701 CHECKER INITIALS: DJM	DATE: 07/26/2020 BY: JTG (JTS) JTG (JTS)	DESCRIPTION: CIVIL AREA CODE ACCOUNT NUMBER: 180115 PROJECT NUMBER: JTG DRAWING BY: JTG STATION ID: S060701 CHECKER INITIALS: DJM
PROFESSIONAL ENGINEER'S SEAL AND SIGNATURE		APPROVALS		REVISION

INSTALLATION OF FENCE ADDITION SHALL BE ALIGNED AND TRUE TO THE CHAIN LINK FABRIC SHALL BE TIGHT AND PROPERLY SECURED. CORNER BRACES AND DIAGONAL BRACES SHALL BE PROPERLY PLACED TO PREVENT SAGGING. THE COMPLETE INSTALLATION SHALL BE IN ACCORDANCE WITH ALL LOCAL, STATE AND FEDERAL REQUIREMENTS AND ALL APPLICABLE LOCAL, APPLICABLE CODES.

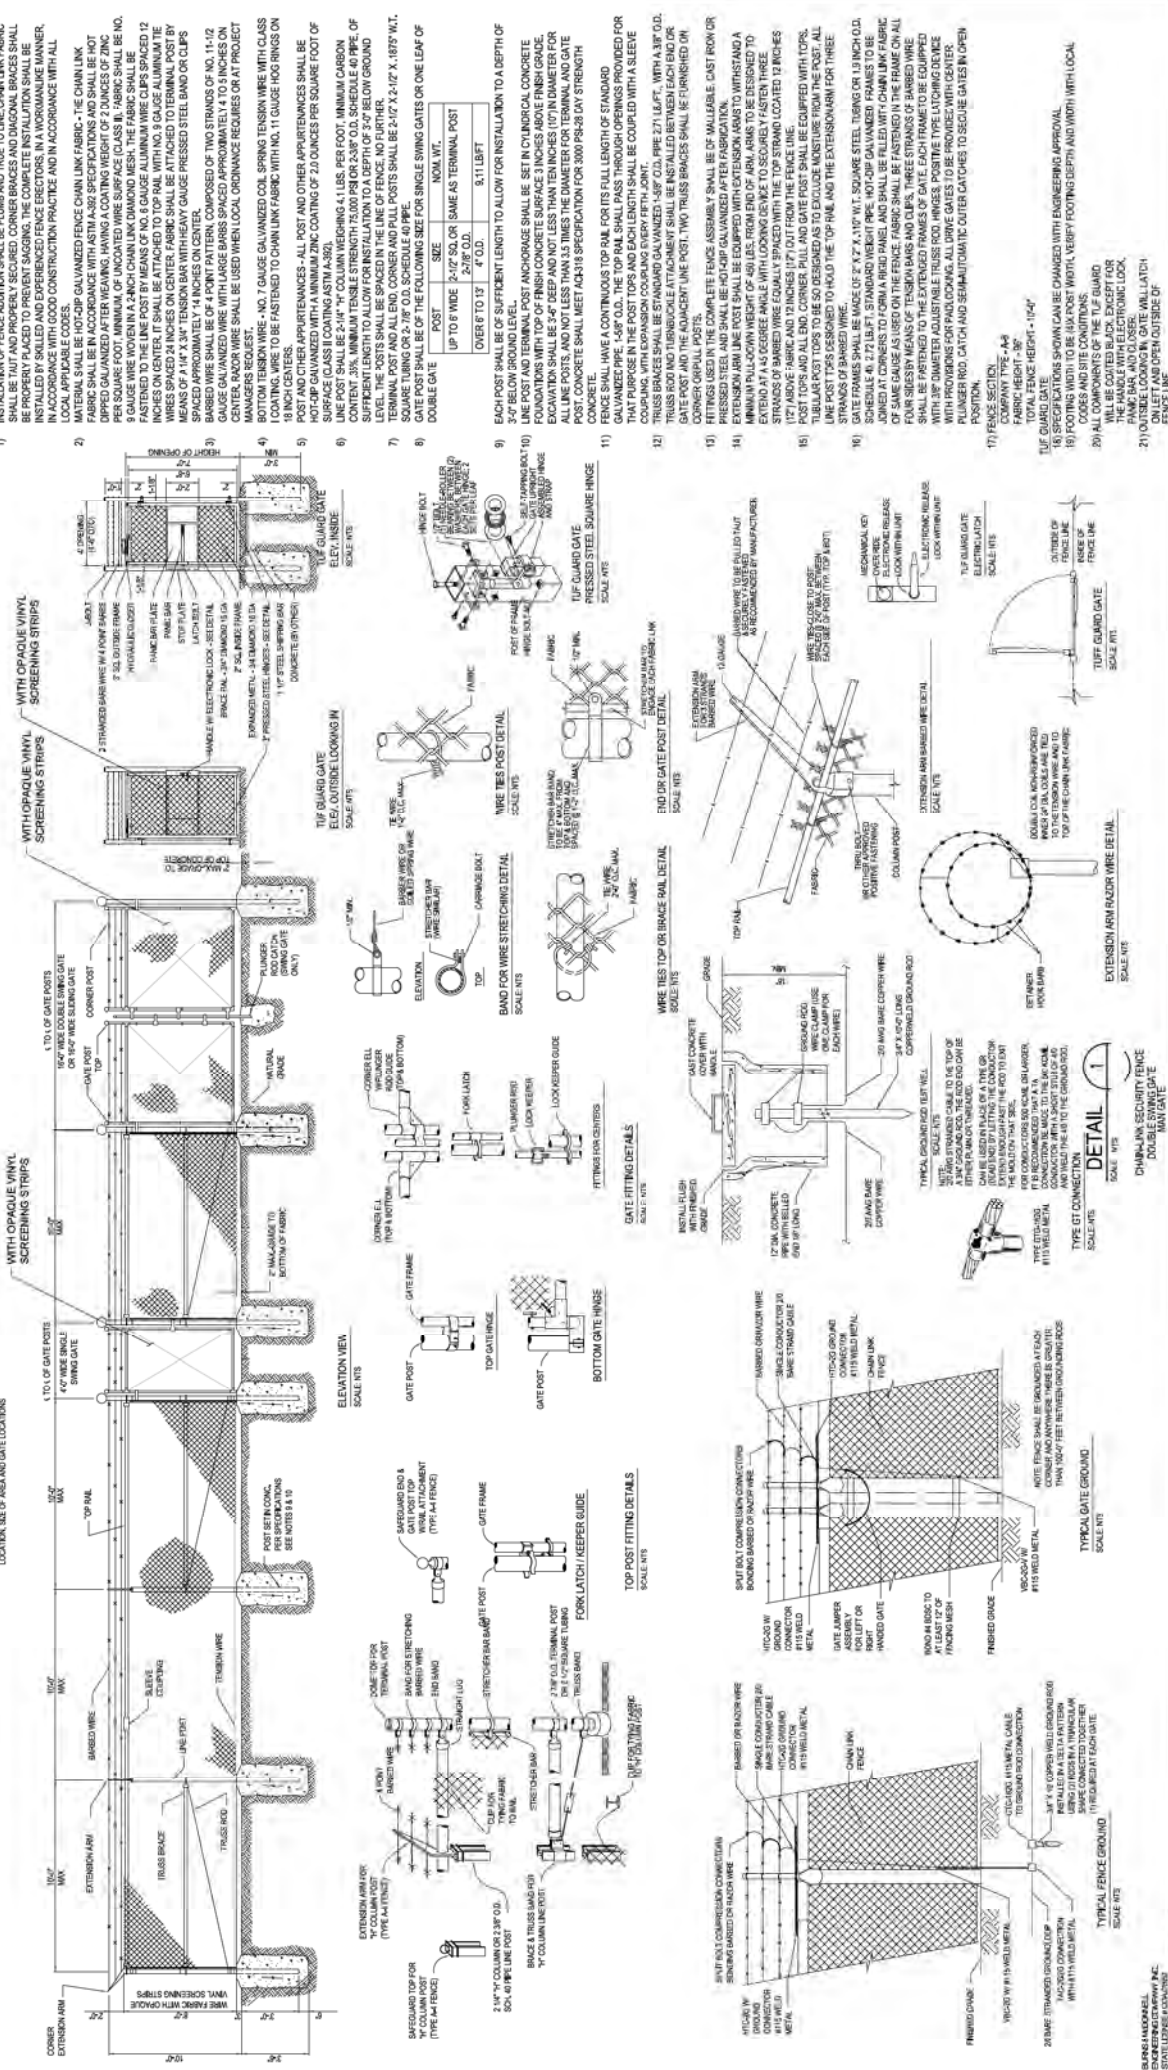

NO.	DATE	BY	CHK	APP	DESCRIPTION
A	10/17/2020	JTG	CNS	EDM	AREA CODE
B	07/24/2020	JTG	CNS	EDM	ACCOUNT NUMBER

NO.	DATE	BY	CHK	APP	DESCRIPTION
1	07/24/2020	JTG	CNS	EDM	PROJECT NUMBER: 180115
2	07/24/2020	JTG	CNS	EDM	DRAWING BY: JTG
3	07/24/2020	JTG	CNS	EDM	STATION ID: SMT01
4	07/24/2020	JTG	CNS	EDM	CHECKER INITIALS: DJM

NO.	DATE	BY	CHK	APP	DESCRIPTION
1	07/24/2020	JTG	CNS	EDM	REVISION
2	07/24/2020	JTG	CNS	EDM	MOD. TECH
3	07/24/2020	JTG	CNS	EDM	REC'A STD
4	07/24/2020	JTG	CNS	EDM	PRINCIPAL
5	07/24/2020	JTG	CNS	EDM	ENGINEER

NO.	DATE	BY	CHK	APP	DESCRIPTION
1	07/24/2020	JTG	CNS	EDM	REVISION
2	07/24/2020	JTG	CNS	EDM	MOD. TECH
3	07/24/2020	JTG	CNS	EDM	REC'A STD
4	07/24/2020	JTG	CNS	EDM	PRINCIPAL
5	07/24/2020	JTG	CNS	EDM	ENGINEER

NO.	DATE	BY	CHK	APP	DESCRIPTION
1	07/24/2020	JTG	CNS	EDM	REVISION
2	07/24/2020	JTG	CNS	EDM	MOD. TECH
3	07/24/2020	JTG	CNS	EDM	REC'A STD
4	07/24/2020	JTG	CNS	EDM	PRINCIPAL
5	07/24/2020	JTG	CNS	EDM	ENGINEER

NO.	DATE	BY	CHK	APP	DESCRIPTION
1	07/24/2020	JTG	CNS	EDM	REVISION
2	07/24/2020	JTG	CNS	EDM	MOD. TECH
3	07/24/2020	JTG	CNS	EDM	REC'A STD
4	07/24/2020	JTG	CNS	EDM	PRINCIPAL
5	07/24/2020	JTG	CNS	EDM	ENGINEER

NO.	DATE	BY	CHK	APP	DESCRIPTION
1	07/24/2020	JTG	CNS	EDM	REVISION
2	07/24/2020	JTG	CNS	EDM	MOD. TECH
3	07/24/2020	JTG	CNS	EDM	REC'A STD
4	07/24/2020	JTG	CNS	EDM	PRINCIPAL
5	07/24/2020	JTG	CNS	EDM	ENGINEER

NO.	DATE	BY	CHK	APP	DESCRIPTION
1	07/24/2020	JTG	CNS	EDM	REVISION
2	07/24/2020	JTG	CNS	EDM	MOD. TECH
3	07/24/2020	JTG	CNS	EDM	REC'A STD
4	07/24/2020	JTG	CNS	EDM	PRINCIPAL
5	07/24/2020	JTG	CNS	EDM	ENGINEER

NO.	DATE	BY	CHK	APP	DESCRIPTION
1	07/24/2020	JTG	CNS	EDM	REVISION
2	07/24/2020	JTG	CNS	EDM	MOD. TECH
3	07/24/2020	JTG	CNS	EDM	REC'A STD
4	07/24/2020	JTG	CNS	EDM	PRINCIPAL
5	07/24/2020	JTG	CNS	EDM	ENGINEER

NO.	DATE	BY	CHK	APP	DESCRIPTION
1	07/24/2020	JTG	CNS	EDM	REVISION
2	07/24/2020	JTG	CNS	EDM	MOD. TECH
3	07/24/2020	JTG	CNS	EDM	REC'A STD
4	07/24/2020	JTG	CNS	EDM	PRINCIPAL
5	07/24/2020	JTG	CNS	EDM	ENGINEER

NO.	DATE	BY	CHK	APP	DESCRIPTION
1	07/24/2020	JTG	CNS	EDM	REVISION
2	07/24/2020	JTG	CNS	EDM	MOD. TECH
3	07/24/2020	JTG	CNS	EDM	REC'A STD
4	07/24/2020	JTG	CNS	EDM	PRINCIPAL
5	07/24/2020	JTG	CNS	EDM	ENGINEER

NO.	DATE	BY	CHK	APP	DESCRIPTION
1	07/24/2020	JTG	CNS	EDM	REVISION
2	07/24/2020	JTG	CNS	EDM	MOD. TECH
3	07/24/2020	JTG	CNS	EDM	REC'A STD
4	07/24/2020	JTG	CNS	EDM	PRINCIPAL
5	07/24/2020	JTG	CNS	EDM	ENGINEER

NO.	DATE	BY	CHK	APP	DESCRIPTION
1	07/24/2020	JTG	CNS	EDM	REVISION
2	07/24/2020	JTG	CNS	EDM	MOD. TECH
3	07/24/2020	JTG	CNS	EDM	REC'A STD
4	07/24/2020	JTG	CNS	EDM	PRINCIPAL
5	07/24/2020	JTG	CNS	EDM	ENGINEER

NO.	DATE	BY	CHK	APP	DESCRIPTION
1	07/24/2020	JTG	CNS	EDM	REVISION
2	07/24/2020	JTG	CNS	EDM	MOD. TECH
3	07/24/2020	JTG	CNS	EDM	REC'A STD
4	07/24/2020	JTG	CNS	EDM	PRINCIPAL
5	07/24/2020	JTG	CNS	EDM	ENGINEER


NO.	DATE	BY	CHK	APP	DESCRIPTION
1	07/24/2020	JTG	CNS	EDM	REVISION
2	07/24/2020	JTG	CNS	EDM	MOD. TECH
3	07/24/2020	JTG	CNS	EDM	REC'A STD
4	07/24/2020	JTG	CNS	EDM	PRINCIPAL
5	07/24/2020	JTG	CNS	EDM	ENGINEER

NO.	DATE	BY	CHK	APP	DESCRIPTION
1	07/24/2020	JTG	CNS	EDM	REVISION
2	07/24/2020	JTG	CNS	EDM	MOD. TECH
3	07/24/2020	JTG	CNS	EDM	REC'A STD
4	07/24/2020	JTG	CNS	EDM	PRINCIPAL
5	07/24/2020	JTG	CNS	EDM	ENGINEER

NO.	DATE	BY	CHK	APP	DESCRIPTION
1	07/24/2020	JTG	CNS	EDM	REVISION
2	07/24/2020	JTG	CNS	EDM	MOD. TECH
3	07/24/2020	JTG	CNS	EDM	REC'A STD
4	07/24/2020	JTG	CNS	EDM	PRINCIPAL
5	07/24/2020	JTG	CNS	EDM	ENGINEER

C-350 PROJECT
 HIGHPOINT PARK STATION
 CIVIL DETAILS - 3



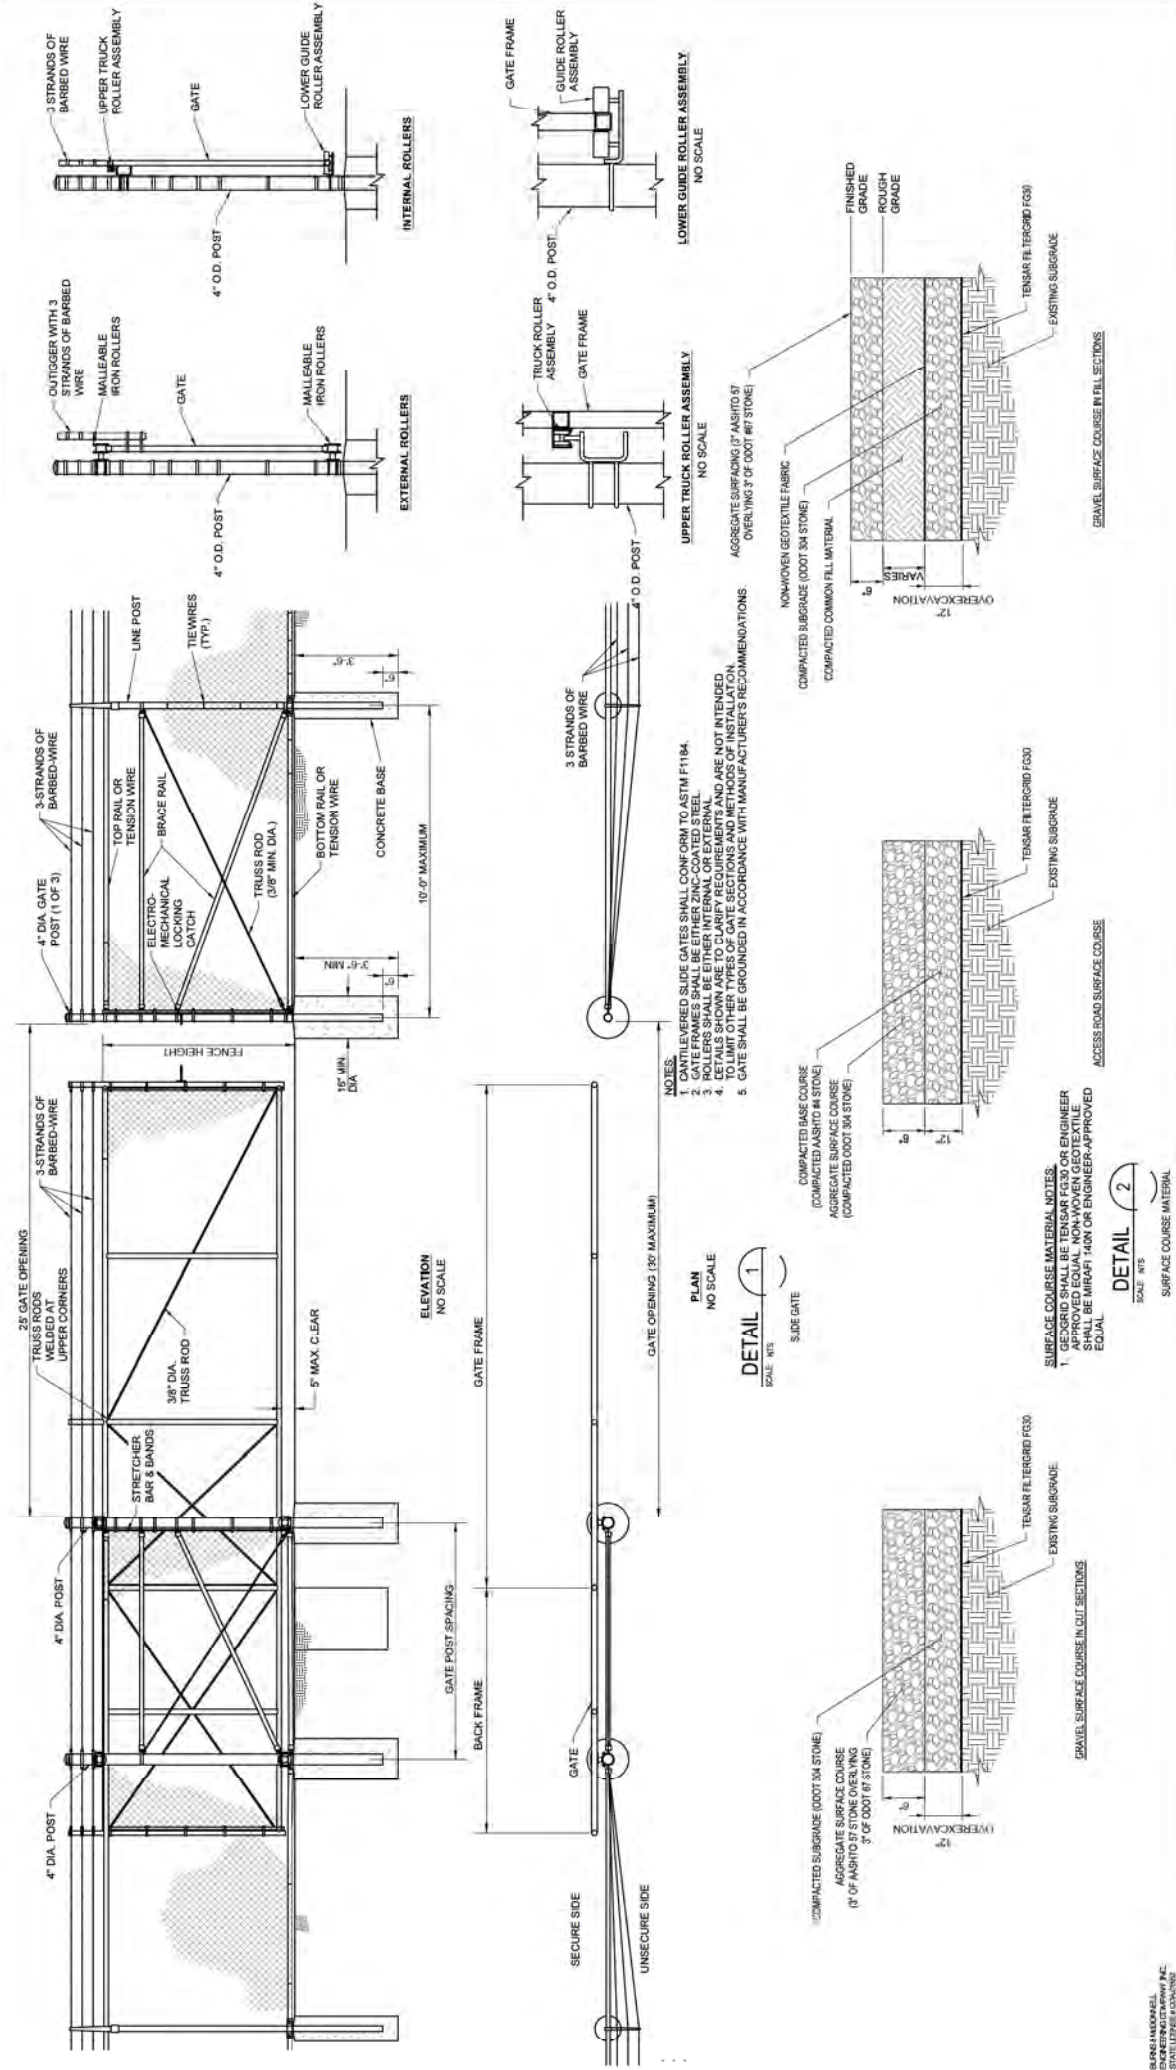

- NOTES:
1. CANTILEVERED SLIDE GATES SHALL CONFORM TO ASTM F1184.
 2. GATE FRAMES SHALL BE EITHER ZINC-COATED STEEL.
 3. ROLLERS SHALL BE EITHER INTERNAL OR EXTERNAL.
 4. GATE FRAMES SHALL BE EITHER INTERNAL OR EXTERNAL.
 5. TO LIMIT OTHER TYPES OF GATE SECTIONS AND METHODS OF INSTALLATION.
 6. GATE SHALL BE GROUNDED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.

PLAN
NO SCALE
DETAIL 1
SCALE: NTS

SLIDE GATE
NO SCALE
DETAIL 2
SCALE: NTS

DATE	DESCRIPTION	BY	CHK	APP	DESCRIPTION	DATE	APP	DATE	DESCRIPTION
07/24/2020	ISSUED FOR 40% REVIEW	JTG	CNS	EDW	AREA CODE	N/A	N/A	N/A	N/A
07/24/2020	ISSUED FOR BID	JTG	CNS	EDW	ACCOUNT NUMBER	180115	DEF	DEF	DEF
		JTG			PROJECT NUMBER	180115			
		JTG			DRAWING BY	JTG			
		JTG			STATION ID	S080701	DEF	DEF	DEF
		JTG			CHECKER INITIALS	DJM			
		JTG			CHECKER DATE	07/29/2020			

REVISION	DATE	DESCRIPTION
1		ISSUED FOR 40% REVIEW
2		ISSUED FOR BID

APPROVALS	DATE
REVISION ENGINEER	
MARK TECH REC & STD	
PRINCIPAL ENGINEER	

DATE	SCALE	DWG SCALE	AS NOTED
07/24/2020	1/8" = 1'-0"	AS NOTED	AS NOTED

PROFESSOR: EDWARD STAMP

C350 PROJECT
HIGHPOINT PARK STATION
CIVIL DETAILS - 4
HAMILTON COUNTY, OHIO



SHEETS: 13 OF 66
DWG DATE: 07/26/2019 (SUPERSEDED)
DRAWING NUMBER: PNG-C-004-0001268
REVISED BY: B

ESC PLANS AND BMP DETAILS FOR PIPELINE CONSTRUCTION



C350 20" PIPELINE
SCALE 1:250

PAGE #	DRAWING NUMBER	SHEET DESCRIPTION	REV.
1	PNG-C-350-000109	COVER PAGE	
2	PNG-C-350-000110	GENERAL NOTES SHEET 1	
3	PNG-C-350-000111	GENERAL NOTES SHEET 2	
4	PNG-C-350-000112	GENERAL NOTES SHEET 3	
5	PNG-C-350-000113	GENERAL NOTES SHEET 4	
6	PNG-C-350-000114	GENERAL NOTES SHEET 5	
7	PNG-C-350-000115	GENERAL NOTES SHEET 6	
8	PNG-C-350-000116	GENERAL NOTES SHEET 7	
9	PNG-C-350-000117	GENERAL NOTES SHEET 8	
10	PNG-C-350-000118	GENERAL NOTES SHEET 9	
11	PNG-C-350-000119	GENERAL NOTES SHEET 10	
12	PNG-C-350-000120	GENERAL NOTES SHEET 11	
13	PNG-C-350-000121	GENERAL NOTES SHEET 12	
14	PNG-C-350-000122	GENERAL NOTES SHEET 13	
15	PNG-C-350-000123	GENERAL NOTES SHEET 14	
16	PNG-C-350-000124	GENERAL NOTES SHEET 15	
17	PNG-C-350-000125	GENERAL NOTES SHEET 16	
18	PNG-C-350-000126	GENERAL NOTES SHEET 17	
19	PNG-C-350-000127	GENERAL NOTES SHEET 18	
20	PNG-C-350-000128	GENERAL NOTES SHEET 19	
21	PNG-C-350-000129	GENERAL NOTES SHEET 20	
22	PNG-C-350-000130	GENERAL NOTES SHEET 21	
23	PNG-C-350-000131	GENERAL NOTES SHEET 22	
24	PNG-C-350-000132	GENERAL NOTES SHEET 23	
25	PNG-C-350-000133	GENERAL NOTES SHEET 24	
26	PNG-C-350-000134	GENERAL NOTES SHEET 25	
27	PNG-C-350-000135	GENERAL NOTES SHEET 26	
28	PNG-C-350-000136	GENERAL NOTES SHEET 27	
29	PNG-C-350-000137	GENERAL NOTES SHEET 28	
30	PNG-C-350-000138	GENERAL NOTES SHEET 29	
31	PNG-C-350-000139	GENERAL NOTES SHEET 30	
32	PNG-C-350-000140	GENERAL NOTES SHEET 31	
33	PNG-C-350-000141	GENERAL NOTES SHEET 32	
34	PNG-C-350-000142	GENERAL NOTES SHEET 33	
35	PNG-C-350-000143	GENERAL NOTES SHEET 34	
36	PNG-C-350-000144	GENERAL NOTES SHEET 35	
37	PNG-C-350-000145	GENERAL NOTES SHEET 36	
38	PNG-C-350-000146	GENERAL NOTES SHEET 37	
39	PNG-C-350-000147	GENERAL NOTES SHEET 38	
40	PNG-C-350-000148	GENERAL NOTES SHEET 39	
41	PNG-C-350-000149	GENERAL NOTES SHEET 40	
42	PNG-C-350-000150	GENERAL NOTES SHEET 41	
43	PNG-C-350-000151	GENERAL NOTES SHEET 42	
44	PNG-C-350-000152	GENERAL NOTES SHEET 43	
45	PNG-C-350-000153	GENERAL NOTES SHEET 44	
46	PNG-C-350-000154	GENERAL NOTES SHEET 45	
47	PNG-C-350-000155	GENERAL NOTES SHEET 46	
48	PNG-C-350-000156	GENERAL NOTES SHEET 47	
49	PNG-C-350-000157	GENERAL NOTES SHEET 48	
50	PNG-C-350-000158	GENERAL NOTES SHEET 49	
51	PNG-C-350-000159	GENERAL NOTES SHEET 50	
52	PNG-C-350-000160	GENERAL NOTES SHEET 51	
53	PNG-C-350-000161	GENERAL NOTES SHEET 52	
54	PNG-C-350-000162	GENERAL NOTES SHEET 53	
55	PNG-C-350-000163	GENERAL NOTES SHEET 54	
56	PNG-C-350-000164	GENERAL NOTES SHEET 55	
57	PNG-C-350-000165	GENERAL NOTES SHEET 56	
58	PNG-C-350-000166	GENERAL NOTES SHEET 57	
59	PNG-C-350-000167	GENERAL NOTES SHEET 58	

PAGE #	DRAWING NUMBER	SHEET DESCRIPTION	REV.
60	PNG-C-350-000127	ALIGNMENT PLAN AND PROFILE SHT 29	B
61	PNG-C-350-000128	ALIGNMENT PLAN AND PROFILE SHT 30	B
62	PNG-C-350-000129	ALIGNMENT PLAN AND PROFILE SHT 31	B
63	PNG-C-350-000130	ALIGNMENT PLAN AND PROFILE SHT 32	B
64	PNG-C-350-000131	ALIGNMENT PLAN AND PROFILE SHT 33	B
65	PNG-C-350-000132	ALIGNMENT PLAN AND PROFILE SHT 34	B
66	PNG-C-350-000133	ALIGNMENT PLAN AND PROFILE SHT 35	B
67	PNG-C-350-000134	ALIGNMENT PLAN AND PROFILE SHT 36	B
68	PNG-C-350-000135	ALIGNMENT PLAN AND PROFILE SHT 37	B
69	PNG-C-350-000136	ALIGNMENT PLAN AND PROFILE SHT 38	B
70	PNG-C-350-000137	ALIGNMENT PLAN AND PROFILE SHT 39	B
71	PNG-C-350-000138	ALIGNMENT PLAN AND PROFILE SHT 40	B
72	PNG-C-350-000139	ALIGNMENT PLAN AND PROFILE SHT 41	B
73	PNG-C-350-000140	ALIGNMENT PLAN AND PROFILE SHT 42	B
74	PNG-C-350-000141	ALIGNMENT PLAN AND PROFILE SHT 43	B
75	PNG-C-350-000142	ALIGNMENT PLAN AND PROFILE SHT 44	B
76	PNG-C-350-000143	ALIGNMENT PLAN AND PROFILE SHT 45	B
77	PNG-C-350-000144	ALIGNMENT PLAN AND PROFILE SHT 46	B
78	PNG-C-350-000145	ALIGNMENT PLAN AND PROFILE SHT 47	B
79	PNG-C-350-000146	ALIGNMENT PLAN AND PROFILE SHT 48	B
80	PNG-C-350-000147	ALIGNMENT PLAN AND PROFILE SHT 49	B
81	PNG-C-350-000148	ALIGNMENT PLAN AND PROFILE SHT 50	B
82	PNG-C-350-000149	ALIGNMENT PLAN AND PROFILE SHT 51	B
83	PNG-C-350-000150	ALIGNMENT PLAN AND PROFILE SHT 52	B
84	PNG-C-350-000151	ALIGNMENT PLAN AND PROFILE SHT 53	B
85	PNG-C-350-000152	ALIGNMENT PLAN AND PROFILE SHT 54	B
86	PNG-C-350-000153	ALIGNMENT PLAN AND PROFILE SHT 55	B
87	PNG-C-350-000154	ALIGNMENT PLAN AND PROFILE SHT 56	B
88	PNG-C-350-000155	ALIGNMENT PLAN AND PROFILE SHT 57	B
89	PNG-C-350-000156	ALIGNMENT PLAN AND PROFILE SHT 58	B
90	PNG-C-350-000157	ALIGNMENT PLAN AND PROFILE SHT 59	B
91	PNG-C-350-000158	ALIGNMENT PLAN AND PROFILE SHT 60	B
92	PNG-C-350-000159	ALIGNMENT PLAN AND PROFILE SHT 61	B
93	PNG-C-350-000160	ALIGNMENT PLAN AND PROFILE SHT 62	B
94	PNG-C-350-000161	ALIGNMENT PLAN AND PROFILE SHT 63	B
95	PNG-C-350-000162	ALIGNMENT PLAN AND PROFILE SHT 64	B
96	PNG-C-350-000163	CROSSING DETAILS 1	B
97	PNG-C-350-000164	CROSSING DETAILS 2	B
98	PNG-C-350-000165	CROSSING DETAILS 3	B
99	PNG-C-350-000166	CROSSING DETAILS 4	B
100	PNG-C-350-000167	CROSSING DETAILS 5	B
101	PNG-C-350-000168	CROSSING DETAILS 6	B
102	PNG-C-350-000169	CROSSING DETAILS 7	B
103	PNG-C-350-000170	CROSSING DETAILS 8	B
104	PNG-C-350-000171	CROSSING DETAILS 9	B
105	PNG-C-350-000172	CROSSING DETAILS 10	B
106	PNG-C-350-000173	CROSSING DETAILS 11	B
107	PNG-C-350-000174	CROSSING DETAILS 12	B
108	PNG-C-350-000175	CROSSING DETAILS 13	B
109	PNG-C-350-000176	CROSSING DETAILS 14	B
110	PNG-C-350-000177	CROSSING DETAILS 15	B
111	PNG-C-350-000178	CROSSING DETAILS 16	B
112	PNG-C-350-000179	CROSSING DETAILS 17	B
113	PNG-C-350-000180	CROSSING DETAILS 18	B
114	PNG-C-350-000181	CROSSING DETAILS 19	B
115	PNG-C-350-000182	CROSSING DETAILS 20	B
116	PNG-C-350-000183	CROSSING DETAILS 21	B
117	PNG-C-350-000184	CROSSING DETAILS 22	B
118	PNG-C-350-000185	CROSSING DETAILS 23	B
119	PNG-C-350-000186	CROSSING DETAILS 24	B
120	PNG-C-350-000187	CROSSING DETAILS 25	B

NO.	DATE	REVISION DESCRIPTION	BY	CHK	APP
A	10/17/2020	ISSUED FOR 40% REVIEW			
B	07/24/2020	ISSUED FOR BID			

NO.	DATE	REVISION DESCRIPTION	BY	CHK	APP
A	10/17/2020	ISSUED FOR 40% REVIEW			
B	07/24/2020	ISSUED FOR BID			

FOR BID - NOT FOR CONSTRUCTION

PROPOSED REROUTE SUPPLEMENTAL SKETCHES
STATE OF OHIO HAMILTON COUNTY COMMISSIONERS PROPOSED REROUTE EXHIBIT
REGISTRY FILE #H-PROPOSED REROUTE EXHIBIT
CITY OF READING FUTURE RAIL SPUR PROPOSED REROUTE EXHIBIT

NOTE: PROPOSED REROUTE SUPPLEMENTAL SKETCHES SHALL BE USED FOR BIDDING PURPOSES ONLY. THESE SKETCHES ARE NOT TO BE USED FOR CONSTRUCTION. AGREEMENT AND SHALL NOT BE USED FOR CONSTRUCTION.

C-350 PROJECT COVER SHEET HAMILTON COUNTY, OHIO

HAMILTON COUNTY, OHIO

REVISION B

DWG DATE: 08-25-2018 SUPERSEDED: PNC - G-350-0001009

DWG DATE: 08-25-2018 SUPERSEDED: PNC - G-350-0001009

DRAWING NUMBER: PNC - G-350-0001009

SHEET(S) 1 OF 5 DWS SCALE AS NOTED

REVISION B

APPROVALS

NO.	DATE	REVISION DESCRIPTION	BY	CHK	APP
A	10/17/2020	ISSUED FOR 40% REVIEW			
B	07/24/2020	ISSUED FOR BID			

PROJECT NUMBER: 180115
DRAWING BY: AKT
STATION ID: C350
CHECKER INITIALS: JMP

REVISION B

DWG DATE: 08-25-2018 SUPERSEDED: PNC - G-350-0001009

DWG DATE: 08-25-2018 SUPERSEDED: PNC - G-350-0001009

DRAWING NUMBER: PNC - G-350-0001009

SHEET(S) 1 OF 5 DWS SCALE AS NOTED

REVISION B

DUKE ENERGY
Piedmont Natural Gas
COMMITMENT 2018

BURNS & MCDONNELL
ENGINEERING COMPANY, INC.
STATE LICENSE # COL 0157

CONSTRUCTION ENGINEERING PERMIT REQUIRED FOR ALL DISCHARGE CONTACT GAS OPERATION REGULATORY COMPLIANCE TO ARRANGE FOR DISCHARGE PERMIT. SAMPLING AND CONTACT LOCAL POTW FOR OFFSITE DISCHARGE REQUIREMENTS AND LOCAL WATER DISTRICT. HYDROSTATIC TEST WATER DISCHARGE SHALL BE PER GAS STANDARD 103.

HYDROSTATIC PRESSURE TEST
 ALL LINES OPERATING ABOVE 50 PSIG REQUIRE STRENGTH TESTING BEFORE PLACING INTO SERVICE. PRESSURE CHARTS AND FORMS SHOULD BE FORWARDED TO GAS ENGINEERING. TEST PER PROCEDURE GD10 1003-1
 REQUIRED TEST PRESSURE RANGE: _____
 MIN. _____ PSIG TO MAX. _____ PSIG
 HOURS: _____ MEDIUM WATER
 SIGNATURE: _____ DATE: _____

HYDROSTATIC TEST WATER DISCHARGE REQUIREMENTS
 PERMIT REQUIRED FOR ALL DISCHARGE CONTACT GAS OPERATION REGULATORY COMPLIANCE TO ARRANGE FOR DISCHARGE PERMIT. SAMPLING AND CONTACT LOCAL POTW FOR OFFSITE DISCHARGE REQUIREMENTS AND LOCAL WATER DISTRICT. HYDROSTATIC TEST WATER DISCHARGE SHALL BE PER GAS STANDARD 103.

WALL THICKNESS	GRADE	% SYMS
0.438"	X60	19.0%
0.500"	X60	15.7%

CONSTRUCTION MANAGER: MATT WEBER (C) 513-310-9881
 CONTRACTOR CONSTRUCTION MANAGEMENT SUPERVISOR: JAMIE OLBERG (C) 513-544-9692
 PROJECT MANAGER: JAMIE OLBERG (C) 513-544-9692
 CORROSION ENGINEER: MICKY HARGROVE (C) 615-472-2362
 CONSTRUCTION & MAINTENANCE (CKM) MANAGER: JAMIE OLBERG (C) 513-544-9692

DESIGN MAOP PER CLASS 4, 500 PSIG. OPERATING OF LINE _____ PSIG.
 MIN. PRESSURE RATING OF VALVE, FLANGE OR FITTING _____ PSIG.
 I HEREBY CERTIFY THAT ALL MATERIAL INSTALLED IS RATED HIGHER THAN THE MAOP AND THAT THE MATERIAL WAS INSTALLED AS DESIGNED UNLESS NOTED ON MATERIAL LIST.
 MAOP ENGINEER SIGNATURE: _____ DATE: _____

PIPE SIZE	KIND	EST. PIPE LENGTH	ACTUAL PIPE LENGTH	ACTUAL FITTING BY-VALVE LENGTH	TOTAL
20"	ERW	67,179 FT			
24"	ERW	100 FT			
					TOTAL 67,279 FT

CONFORMING TO THE OFFICE OF PIPELINE SAFETY'S REGULATIONS (49 CFR 192.101), ALL PIPELINES SHALL BE MAINTAINED AS A PART OF THE PIPELINE'S PERMANENT RECORD.

TO MEET THIS REQUIREMENT, THE INSPECTOR SHALL IDENTIFY EACH WELD OF THIS PIPELINE BY NUMBERING AND LOCATING THE WELD ON THE CONSTRUCTION AND LOCATION BLOCK BELOW. ALL WELDS MUST BE IN ACCORDANCE WITH COMPANY SPECIFICATION GD 55.500.

PIPE SIZE	WALL THK	GRADE	SYMS PER MAOP	WELDING SPEC.	% XRAY
20"	0.438"	X60	19.0%		100%
24"	0.500"	X60	16.7%		100%
TO BE FILLED OUT BY DESIGN ENGINEER					
TO BE FILLED OUT BY INSPECTOR					
TOTAL NO. OF WELDS MADE					
TOTAL NO. OF WELDS X-RAYED					
TOTAL NO. OF WELDS REJECTED					
TOTAL NO. OF WELDS REPAIRED					
TOTAL NO. OF WELDS REPLACED					

NOTE: TOTAL OF REPAIRED PLUS REPLACED WELDS SHOULD EQUAL AMOUNT OF REJECTED WELDS

Agency	Permit/Approval	Location
Hamilton County	Building Permit	Hightpoint Park Station
Hamilton County	Road Bore	Comery Rd.
Hamilton County	Road HDD	Kemper Rd.
Sharonville	Road HDD	Kemper Rd.
OTOT	Road Bore	L-275
Blue Ash	Road Open Cut	Greene Rd.
Blue Ash	Road Open Cut	Reed Hartman Hwy
Blue Ash	Road Bore	Cornell Rd.
Blue Ash	Road Bore	Reed Hartman Hwy
Blue Ash	Road Bore	Osborne Blvd
Blue Ash	Parallel & Road Open Cut	Reed Hartman Hwy
Blue Ash	Road Open Cut	Creek Rd.
Blue Ash	Road Open Cut	Lake Forest Dr
Blue Ash	Road Open Cut	Lake Forest Dr
Blue Ash	Road Bore	Glenade Millford Rd
Blue Ash	Road Bore	Painfield Rd
Everdale	Road Open Cut	Glenade Millford Rd
Everdale	Road HDD	US 42 (Reading Rd)
Everdale	Road Open Cut	Glenade Millford Rd
Reading	Road Open Cut	Everdale Commons Dr
OOT	work under Hwy ROW	West St., W. Pleasant St., Market St., W. Columbia Ave, Market St., W. Mechanic St., 3rd St., I. Vine St., E. Benson St., E. Vorhies St., I. Galbraith Rd. (bore), US42 (open cut)
Amberley Village	Road Open Cut	Ronald Reagan Cross Country Hwy
Cincinnati	Road Bore	Summitbrook Dr
Cincinnati	Road Open Cut	Section Rd.
Cincinnati	Road Open Cut	Louisville Ave
Cincinnati	Road Open Cut	Engler Ct
Cincinnati	Road Open Cut	Langan Farm Rd
Cincinnati	Road Open Cut	Centridge Ct
Hamilton County	Building Permit	Northwood Station

ROW PERMIT SUMMARY

DESIGN REVIEW OF COMPLETED CONSTRUCTION JOB	BY (DATE)	DESCRIPTION
SPONSOR: _____ DATE: _____	AKT (DATE)	AKT (DATE)
FIELD CHANGE REQUEST DOCUMENT REQUIRED: YES <input type="checkbox"/> NO <input type="checkbox"/>	AKT (DATE)	AKT (DATE)
TRANSMISSION DESIGN SYSTEMS OPERATION SUPERVISOR VALVES AND NUMBERS REVIEWED: YES <input type="checkbox"/> NO <input type="checkbox"/>	AKT (DATE)	AKT (DATE)
SUPERVISOR OR CONTRACTOR RECORDED BY: _____ DATE: _____	AKT (DATE)	AKT (DATE)
DATE STARTED: _____ DATE IN SERVICE: _____	AKT (DATE)	AKT (DATE)
VALVES THAT HAVE BEEN ABANDONED AND REMOVED: _____	AKT (DATE)	AKT (DATE)
CORROSION ENGINEERING CONDITION OF COATING WHEN DELIVERED TO JOB: NO PROPOSED <input type="checkbox"/> NO INSTALLED <input type="checkbox"/> NO TESTED OK (P'S INDICATOR) <input type="checkbox"/> POOR <input type="checkbox"/>	AKT (DATE)	AKT (DATE)
COATING TYPE: _____ GOOD <input type="checkbox"/> FAIR <input type="checkbox"/>	AKT (DATE)	AKT (DATE)
INSPECTOR: _____ INSULATION CHECKED: _____	AKT (DATE)	AKT (DATE)
VISUAL <input type="checkbox"/> JEOP <input type="checkbox"/> NO CHECKED <input type="checkbox"/>	AKT (DATE)	AKT (DATE)
TYPE PATCH MATERIAL: _____	AKT (DATE)	AKT (DATE)
SUPERVISOR BLOCK	AKT (DATE)	AKT (DATE)
SUPERVISOR OR CONTRACTOR RECORDED BY: _____ DATE: _____	AKT (DATE)	AKT (DATE)
DATE STARTED: _____ DATE IN SERVICE: _____	AKT (DATE)	AKT (DATE)
VALVES THAT HAVE BEEN ABANDONED AND REMOVED: _____	AKT (DATE)	AKT (DATE)

GENERAL NOTES:

- INSTALLER SHALL FURNISH ALL MATERIALS NOT PROVIDED BY THE COMPANY INCLUDING EQUIPMENT, TRANSPORTATION SERVICES, AND PERFORM ALL NECESSARY WORKS SHOWN ON THE DRAWINGS AND SPECIFIED HEREIN.
- IT SHALL BE THE RESPONSIBILITY OF THE INSTALLER TO VERIFY ALL DIMENSIONS GIVEN ON THE DRAWINGS. ANY ITEM IN QUESTION SHALL BE BROUGHT TO THE ATTENTION OF THE PROJECT MANAGER IN WRITING VIA RFI PROCESS PRIOR TO PROCEEDING WITH THE WORK.
- INSTALLER SHALL BE RESPONSIBLE FOR PROTECTION OF ALL SURROUNDING AREAS. CONTRACTOR SHALL NOT UNNECESSARILY DISTURB EXISTING CONDITIONS WITHIN CONSTRUCTION LIMITS. DISCRETION SHALL BE PER COMPANY REPRESENTATIVE.
- PROPOSED ELEVATIONS AND DIMENSIONS INDICATE TOP OF PIPE UNLESS OTHERWISE NOTED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING DEPTH AND LOCATION OF ALL UTILITIES PRIOR TO COMMENCING WORK.
- ALL BELOW GROUND WELDS SHALL BE COATED WITH DENSO 7000 PER PERTINENT DESIGN AND CONSTRUCTION STANDARDS OR AS APPROVED OTHERWISE. SURFACE PREPARATION AND BLASTING SHALL ADHERE TO PERTINENT DESIGN AND CONSTRUCTION STANDARDS AND COATING MATERIAL SPECIFICATIONS.
- UPON BACKFILLING IN AREAS OF ROCK, BURIED PIPE SHALL HAVE MINIMUM 6" OF SAND PAD FILL PLACED AROUND THE PIPES CIRCUMFERENCE.
- PRESSURE TESTING SHALL MEET THE REQUIREMENTS OF DUGES PRESSURE TESTING STANDARD, PER PERTINENT DESIGN AND CONSTRUCTION STANDARDS.
- INSTALLER SHALL Dewater ALL HYDROSTATICALLY TESTED PIPING USING CLEANING PIGS AS REQUIRED, AND DRY TO A DEWPOINT OF -40° F PER PERTINENT DESIGN AND CONSTRUCTION STANDARDS.
- ALL DISTANCES SHOWN ARE GRID DISTANCES BASED ON OHIO STATE PLANE COORDINATE SOUTH ZONE (GAD) AND 83.
- EXISTING CONDITIONS AND CONTOURS PROVIDED BY A-RAS, LLC FROM SURVEY DATA SHALL BE USED BY ALL DESIGNING SURVEYING FROM THE FORM, OH 45103. SURVEY SLABS INCLUDE RAIL BULLIES FROM CINCINNATI, OH 45215 AND THE UNDERGROUND DETECTOR FROM CINCINNATI, OH 45251.
- ANY CHANGES TO THE DESIGN SHOWN ON DRAWINGS SHALL BE APPROVED BY COMPANY REPRESENTATIVE IN WRITING VIA RFI PROCESS.

CONSTRUCTION NOTES:

- EXISTING OVERHEAD AND BELOW GROUND FACILITIES MAY BE IN THE WORK AREA. CONTRACTOR SHALL BE RESPONSIBLE FOR HAVING SUCH FACILITIES LOCATED AND IS RESPONSIBLE FOR MAINTENANCE AND PRESERVATION OF THESE FACILITIES.
- PER PERTINENT DESIGN AND CONSTRUCTION STANDARDS, INSTALLER IS REQUIRED TO CALL 811 FOR UTILITY LOCATES A MINIMUM OF 72 HOURS PRIOR TO COMMENCEMENT OF WORK. NO EXTRA COMPENSATION WILL BE ALLOWED FOR DELAYS FROM ANY WORK PROVIDED BY OTHER UTILITIES.
- IF EXISTING UTILITIES OF ANY TYPE ARE ENCOUNTERED IN THE FIELD AND DEEMED TO BE IN CONFLICT WITH INSTALLATION OF FACILITIES, INSTALLER SHALL NOTIFY THE PROJECT MANAGER IN WRITING VIA RFI PROCESS IMMEDIATELY. SUCH CONFLICT MAY BE RESOLVED.
- WHERE EXISTING DRAINAGE FACILITIES ARE DISTURBED, INSTALLER SHALL PROVIDE AND MAINTAIN TEMPORARY FACILITIES AND CONNECTIONS FOR PRIVATE DRAINS OR SEWERS. RESTORATION OF THESE FACILITIES IS TO BE PERFORMED ONCE CONSTRUCTION IS COMPLETE AND ARE CONSIDERED INCIDENTAL COSTS OF THE PROJECT.
- ALL DRAWING MEASUREMENTS ARE TO BE TAKEN FROM EXISTING GRADE. FINAL GRADE SHALL BE MATCHED TO SURROUNDING GRADE AS PER PERTINENT DESIGN AND CONSTRUCTION STANDARDS.
- INSTALLER TO REMAIN WITHIN CONSTRUCTION WORKING LIMITS. ACCESS TO DRIVEWAYS OR ADJACENT AREAS MUST BE COORDINATED WITH THE OWNER OR DUKES ENERGY PROJECT MANAGER.
- ALL EXCESS EXCAVATION, CONSTRUCTION REMOVAL DEBRIS AND UNSUITABLE MATERIALS THAT DO NOT MEET ASBESTOS SHALL BE REMOVED FROM THE SITE AND PROPERLY DISPOSAL.
- STANDARD SPECIFICATIONS REFERENCED ON THIS SHEET AND CONSTRUCTION PLANS OR ACCESSORIES NECESSARY TO COMPLETE THIS WORK MAY NOT BE SPECIFICALLY NOTED, BUT ARE CONSIDERED TO BE A PART OF THIS CONTRACT.
- BEFORE ACCEPTANCE BY THE OWNER AND FINAL PAYMENT, ALL WORK SHALL BE INSPECTED AND APPROVED BY DUKES OR COMPANY REPRESENTATIVE. FINAL ACCEPTANCE SHALL BE IN WRITING AND IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.
- DURING CONSTRUCTION, ALL LOOSE MATERIAL THAT ARE DESCRIBED IN THE BLOW LINE OF CUTTERS, DRAINAGE STRUCTURES, DITCHES, ETC., SUCH THAT THE NATURAL FLOW LINE OF WATER IS OBSTRUCTED, SHALL BE REMOVED AT THE END OF EACH WORK DAY.
- ALL FIELD TILE ENCOUNTERED DURING CONSTRUCTION SHALL BE EXTENDED TO OUTLET INTO AN EXISTING DRAINAGE WAY. A RECORD OF ALL FIELD TILE FOR DIGITE DOWN THE ENCOUNTERED SHALL BE KEPT BY THE INSTALLER AND TURNED OVER TO THE PROJECT MANAGER UPON COMPLETION OF THE PROJECT.

SURVEY INVESTIGATION NOTES:

- BEARINGS AND COORDINATES ARE RELATIVE TO NAD83 OHIO STATE PLANE. SOUTH ZONE (GAD), US FOOT. VERTICAL DATUM IS NAVD83.
- THE GEOTECHNICAL INFORMATION PROVIDED ON THIS DRAWING IS A GENERAL SUMMARY. REFER TO THE APPLICABLE GEOTECHNICAL REPORT IN THE CONTRACT DOCUMENTS FOR MORE DETAILED INFORMATION INCLUDING:
 - GEOTECHNICAL ENGINEERING REPORT C350 CENTRAL CORRIDOR PIPELINE REVISED JULY 1, 2020, TERRACON PROJECT NUMBER N172584.
 - LETTER REGARDING GEOTECHNICAL SERVICES K/L NEW CONSTRUCTION SITE EVALUATION, READING, OHIO, TERRACON PROJECT NUMBER N172584, ADDRESSED TO MR. JAMES OLBERING DATED MAY 22, 2020.
 - LETTER REGARDING GEOTECHNICAL SERVICES AA REAL ESTATE SITE EVALUATION, BLUE ASH, OHIO, TERRACON PROJECT NUMBER N172584, ADDRESSED TO MR. JAMES OLBERING DATED JUNE 22, 2020.

CATWALK, PROTECTION & ACUTIZATION NOTES:

- CONTRACTOR SHALL PROVIDE AND INSTALL ALL NON-STOCK CP AC MATERIALS AND STANDARDS, INCLUDING ELECTRICAL CODES, STATE AND LOCAL CODES AND STANDARDS, AND LOCAL ELECTRICAL DISTRIBUTION COMPANY REQUIREMENTS. CONTRACTOR SHALL ALSO INSTALL ALL OWNER PROVIDED CP AND AC MATERIALS AND EQUIPMENT PARTS INCLUDE BUT ARE NOT LIMITED TO: WIRING AND MOUNTING MATERIALS, METER SOCKET, DISCONNECT EQUIPMENT, ENCLOSURES, TRANSIENT VOLTAGE SURGE SUPPRESSORS, AC MAIN BUS TERMINATION, CIRCUIT BREAKERS, AND OTHER ELECTRICAL EQUIPMENT REQUIRED. ACTUAL LENGTH OF WIRING IS DEPENDENT ON DISTANCE FROM INSTALLATION.

DESIGN NOTES:

- DESIGN MAP: 500 PSIG.
- FOR 20" PIPE, FIELD BEND SHALL BE LIMITED TO 25 DEGREES OR LESS PER 40' STICK OF PIPE. FITTINGS SHALL BE LIMITED TO 45 DEGREES. CUT SEAMWELVE FITTINGS REQUIRED FOR ALL ANGLES ABOVE 45 DEGREES.
- MINIMUM NOTED RADII FOR 20" PIPE: 120' BASED ON 3-JOINT RADII.
- UNLESS NOTED OTHERWISE MINIMUM DESIGN CLEARANCE BETWEEN PIPELINE AND EXISTING UTILITIES SHALL BE 10 FEET. MINIMUM DESIGN CLEARANCE SHALL BE LESS THAN 1' (17').
- CONTRACTOR SHALL ADHERE TO DUKES OHIO HDD GUIDELINES AS APPLIES TO HDD DRILLING WASTES AND PROTECTION OF WATER RESOURCES.

PERMITTING AND WORK HOURS:

- SPECIFIC PERMIT REQUIREMENTS ARE LARGELY OMITTED FROM THESE DRAWINGS. FOR DETAILED REQUIREMENTS REFER TO INDIVIDUAL PERMITS AND THE "DUKE ENERGY CON PROJECT PERMIT MATRIX".
- TWO WEEKS NOTIFICATION SHALL BE PROVIDED TO ALL LANDOWNERS PRIOR TO COMMENCING CONSTRUCTION ACTIVITY.
- WORKING HOURS SHALL BE 7AM TO 5PM UNLESS OTHERWISE SPECIFIED. WORK HOURS SPECIFIED IN THE APPLICABLE PERMITS SHALL GOVERN.

TRAFFIC CONTROL AND TRAFFIC MANAGEMENT:

- TRAFFIC CONTROL AND TRAFFIC MANAGEMENT IS OMITTED FROM THESE DRAWINGS. FOR DETAILED REQUIREMENTS REFER TO ACCOMPANYING HD DOCUMENT "DUKE ENERGY C350 PROJECT TRAFFIC MANAGEMENT PLAN".

RESTORATION:

- RESTORATION SHALL BE CONTROLLED BY APPLICABLE PERMITS AND AS DIRECTED BY COMPANY'S INSPECTOR.
- RESTORATION LIMITS AND DETAILS PROVIDED IN THE DRAWINGS SHALL BE SUBJECT TO FIELD MODIFICATIONS TO MEET VARYING CONDITIONS.
- ADDITIONAL RESTORATION REQUIREMENTS AND QUALIFICATIONS SHALL BE AS DESCRIBED IN THE BID DOCUMENTS.
- MATERIAL REQUIREMENTS SHALL MEET GOOD CONSTRUCTION AND MATERIAL SPECIFICATIONS, WHERE CONFLICT EXISTS BETWEEN THESE DRAWINGS, GOOD CONSTRUCTION LOCAL REQUIREMENTS, OR OTHER BID DOCUMENT REQUIREMENTS. SPECIFICATIONS SHALL BE OBTAINED THROUGH INQUIRY FROM THE PROJECT MANAGER IN WRITING VIA RFI PROCESS.

BURNS & MCDONWELL
ENGINEERING COMPANY, INC.
STATE LICENSE # 00011001

NO.	DATE	REVISION DESCRIPTION	BY	CHK	APP	DESCRIPTION
1	07/17/2020	ISSUED FOR 90% REVIEW	AKT	CNS	JMP	AKT AREA CODE
2	07/24/2020	ISSUED FOR BID	AKT	CNS	JMP	PROJECT NUMBER: 03680 DRAWING BY: 180115 STATION ID: C350 CHECKER INITIALS: JMP

APPROVALS	
DESIGNER	PROJECT MANAGER
CHECKER	INSPECTOR
DATE	DATE

DUKE ENERGY **Piedmont Natural Gas**

CONTRACT # 2018

C350 PROJECT
GENERAL NOTES SHEET 1
HAMILTON COUNTY, OHIO
HAMILTON COUNTY, OHIO

REF: DWG(S) - PNG-G-350-000101009

SHEETS	3 OF 5	DWG SCALE	AS NOTED
DWG DATE	09-05-2018	SUPERSEDED	
DRAWING NUMBER	PNG - G-350-0001011		
REVISION	B		

CIVIL AND STRUCTURAL NOTES:

- 1. ADDITIONAL EXCAVATION BELOW FOOTINGS MAY BE NECESSARY TO REACH UNDISTURBED SOIL. ANY SURGRADES FOR ANY PAVING, GRADING, FILLS REQUIRED TO GRADE THE M.V. SITES, OR THE EXCAVATION SHALL BE BROUGHT TO THE BOTTOM OF THE FOOTING ELEVATION WITH COMPACTED SAND FILL MEETING THE REQUIREMENTS OF APPROVED PROCTOR COMPACTION TEST (ASTM D1557) TO 90% IN 6 INCH LIFTS.
- 2. ALL EXPOSED CONCRETE EDGES SHALL HAVE A 1" X 1/8" CHAMFER.
- 3. CONCRETE SHALL BE MIXED AND POURED PER PREPARED DESIGN AND CONSTRUCTION STANDARDS. TESTING SHALL CONFORM TO ASTM 118. INSTALLER TO SUPPLY ALL CONCRETE FORMWORK.
- 4. ALL REINFORCING SHALL BE CONFORM TO ASTM AS SPECIFICATION STEEL. REINFORCING BARS SHALL CONFORM TO ASTM AS GRADE 60 AND HELD END BARS SHALL CONFORM TO ASTM A18. THE WIRE SHALL CONFORM TO ASTM A42. UNSUITABLE OR EXCESS EARTH SOIL SHALL BE DISPOSED OF AT AN APPROVED WASTE LOCATION. SOIL BEMO TRANSPORTED ONTO THE JOB SITE SHALL BE APPROVED BY EITHER THE PROJECT MANAGER OR CONSTRUCTION MANAGER.
- 5. ROCK HELD OR SIMILAR COMPANY APPROVED PRODUCT MUST BE INSTALLED BETWEEN ALL PIPE AND FITTINGS THAT COME INTO CONTACT WITH CONCRETE. A LAYER OF NON-ABRASIVE MATERIAL SUCH AS FPP SHALL BE INSTALLED BETWEEN ALL PIPE SUPPORTS AND PIPING.
- 6. ALL FIELD PAVING OF REBAR SHALL BE DONE COLL.
- 7. ALL GRADING, PAVEMENT WORK, AND ANY OTHER MISCELLANEOUS WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE CURRENT (DOT) STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION AND SUPPLEMENTAL SPECIFICATIONS.
- 8. THE GRAVEL SURFACE COURSE SHALL BE CONSTRUCTED IN ACCORDANCE WITH ITEM 41 OF THE COOT CONSTRUCTION AND MATERIAL SPECIFICATIONS.
- 9. THE CONTRACTOR SHALL BE RESPONSIBLE FOR GRADING INCLUDING EXCAVATION AND BACKFILL TO THE PROPOSED FINISH GRADES AND TO THE PROPOSED FINISH ACCESS ROADS, AS OUTLINED IN THESE TECHNICAL SPECIAL PROVISIONS AND AS DIRECTED BY THE CLIENT REPRESENTATIVE.
- 10. THE CONTRACTOR SHALL BE HELD RESPONSIBLE FOR ANY DAMAGE DONE TO STORM MANHOLES OR OTHER UTILITIES DURING GRADING.
- 11. DISTRIBUTE EXCESS SOIL ON SITE AT THE DIRECTION OF THE CLIENT REPRESENTATIVE. DO NOT ALTER DIRECTION OF SURFACE DRAINAGE PATTERNS.
- 12. THE TOLERANCE OF THIS WORK SHALL BE TO WITHIN 0.1 FT. OF THE EXISTING GROUND SURFACE ELEVATIONS.
- 13. THE ACCESS ROAD SURGRADE SHALL HAVE SUFFICIENT STABILITY TO ACCOMMODATE CONSTRUCTION TRAFFIC WITHOUT EXCESSIVE SURGRADE RUTTING OR SHOWING. AT THE TIME OF PLACEMENT OF THE PAVEMENT, THE IN SITU SURFACE SHALL BE A CALIFORNIA BEARING RATIO (CBR) AT LEAST 100 PERCENT. THE TOP FINISH OF SURGRADE, THE CBR PERFORMANCE WILL BE ASSESSMENT BY THE CONTRACTOR.
- 14. THE QUALITY OF THE SOIL TO BE USED AS FILL MATERIAL SHALL BE AS SPECIFIED IN THE DOCUMENT. ALL BACKFILL SHALL BE SPREAD IN LIFTS NOT EXCEEDING 8 INCHES IN THICKNESS WHEN SELF-PROPELLED EQUIPMENT IS USED AND NOT EXCEEDING 6 INCHES WHEN HAND GUIDED EQUIPMENT IS USED. ALL HOOPS, WOOD, AND REINFORCING SHALL BE PROTECTED FROM WEAR AND SHALL BE PROTECTED AS SPECIFIED IN THIS DOCUMENT. SOIL COMPACTION TEST WILL BE REQUESTED BY THE OWNER AT APPROPRIATE INTERVALS DURING GRADING OPERATIONS.
- 15. ALL MOUNTAIN MATERIAL SHALL BE FREE OF ROCKS 3 INCHES IN DIAMETER AND LARGER. THE OWNERS CONSTRUCTION INSPECTOR SHALL APPROVE ALL MOUNTAIN MATERIAL TO ENSURE THE QUALITY AND THE ASSURANCE OF ENVIRONMENTAL HAZARDS.
- 16. THE FILL AREA SHALL BE CONSTRUCTED TO THE LINES AND GRADES SHOWN ON THE DESIGN DRAWINGS WITH MATERIAL SPECIFIED IN THIS DOCUMENT. THE OWNERS CONSTRUCTION INSPECTOR SHALL APPROVE ALL MOUNTAIN MATERIAL TO ENSURE THE QUALITY AND THE ASSURANCE OF ENVIRONMENTAL HAZARDS. AND BASE LINES REQUIRED FOR THE WORK. THE CONTRACTOR SHALL LAY OUT ALL LINES AND GRADES FOR THE EACH/FILL AREAS. ANY PROPOSED CHANGES TO THE SLOPES AND GRADES SHALL REQUIRE THE APPROVAL OF THE OWNERS CONSTRUCTION INSPECTOR IN ADVANCE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ANY EXISTING UTILITIES PLACED WITHIN THE APPROVED LINES OR GRADES.
- 17. SOIL MATERIAL SHALL BE TOPSOIL AND OTHER SOIL MATERIALS CONTAINING GREATER THAN 5 PERCENT ORGANIC MATERIAL. SOIL WHICH TOO WET, SOIL WHICH DOES NOT MEET THE PLASTICITY AND/OR GRADATION LIMITS OR SELECT MATERIAL AS SPECIFIED IN THIS DOCUMENT, OR OTHER SOIL MATERIAL DESIGNATED BY THE OWNERS CONSTRUCTION INSPECTOR TO BE UNSUITABLE FOR SELECT MATERIAL.
- 18. SELECT SOIL MATERIAL SHALL BE THAT MATERIAL CLASSIFIED AS SM, SP, SC, SW AND CL, OR SW AND SC IN ACCORDANCE WITH ASTM D2007, AND SHALL HAVE A MAXIMUM PERCENT PASSING THE #200 SIEVE.

20. COMPACTION TESTING WILL BE PROVIDED AT THE EXPENSE OF THE CONTRACTOR. COMPACTION REQUIREMENTS OF SOIL BACKFILL SHALL BE AS INDICATED IN THE FOLLOWING TABLE:

LOCATION OF FILL	MINIMUM REQUIRED COMPACTION LEVEL STANDARD PROCTOR
A. GENERAL YARD AREA	90% (ASTM D998)
B. UPPER 18 INCHES OF SOIL TO BE USED AS ROAD SUBGRADE MATERIAL AND EXTENDING A MINIMUM OF 5 FEET BEYOND (IMMEDIATELY UNDERBASE MATERIAL)	98% (ASTM D698)

ENVIRONMENTAL NOTES:

- 1. INSTALLERS TO CONSTRUCT ALL SOIL EROSION AND SEDIMENT CONTROL MEASURES AT THE COMMENCEMENT OF THE PROJECT. PROVIDE MAINTENANCE AND ASSURE EFFECTIVENESS THROUGHOUT THE DURATION OF THE PROJECT.
- 2. CARE SHALL BE TAKEN TO MINIMIZE DOWNSTREAM SILTATION. RAM BANKS MAY BE SPEC'D AND INCLUDED TO PREVENT EROSION.
- 3. ALL SPILLS INCLUDING ORGANIC SOILS, VEGETATION AND DEBRIS SHALL BE REMOVED FROM THE SITE AND PROPERLY DISPOSED OF IN SUCH A MANNER AS TO NOT ENTER INTO THE BODY OF WATER OR WETLAND UNLESS APPROVED OTHERWISE BY DUKE ENVIRONMENTAL INSPECTOR.
- 4. PROTECT SEDIMENT FROM THE WORK AREA.
- 5. CYCLO ALL FILTERS ARE REQUIRED AT ALL SEWER INLETS, GRATES AND MANHOLES FOR SEDIMENT CONTROL.
- 6. DITCH STOCKPILES SHALL BE LOCATED TO AVOID EROSION OF SAND STOCKPILE ONTO OFFSITE AREAS.
- 7. ALL ENVIRONMENTAL MEASURES SHALL BE PER PERTINENT DESIGN AND CONSTRUCTION STANDARDS.
- 8. NO ASPHALT SLURRY OR CUTTING MAY ENTER STORM DRAINS. MATERIALS MUST BE WAQUED OR OTHERWISE REMOVED FROM THE SITE AND PROPERLY DISPOSED OF.
- 9. THE CONSTRUCTION CONTRACTOR SHALL NOT CONDUCT BUNKER WORK IN PERENNIAL STREAMS FROM APRIL 15 THROUGH JUNE 30 TO REDUCE IMPACTS ON DUKE ENERGY SHALL CONTACT OPSB STAFF, CONR, AND USFWS WITHIN 24 HOURS IF STATE OR FEDERAL, THREATENED OR ENDANGERED SPECIES ARE ENCOUNTERED DURING CONSTRUCTION ACTIVITIES. CONSTRUCTION ACTIVITIES THAT COULD ADVERSELY IMPACT THE IDENTIFIED PLANTS OR ANIMALS SHALL BE IMMEDIATELY STOPPED. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING PERMITS BY DUKE ENERGY, OPSB STAFF, AND THE APPROPRIATE REGULATORY AGENCIES.
- 10. OPSB CUT CONSTRUCTION IN ALL PERENNIAL AND INTERMITTENT STREAMS IS TO BE CONDUCTED DURING BASE FLOW PERIODS OR PERIODS OF SLIGHTLY ABOVE NORMAL FLOW TO ALLOW ANY SLOANERS GRASSHOPPER THAT MAY BE PRESENT TO RELOCATE OUT OF THE AREAS AS IN WATER WORK BEGINS. IN ADDITION, DURING BASE FLOW CONSTRUCTION PERIODS IF THERE ARE ANY POOLS DISCONNECTED FROM THE STREAMS GRASSHOPPER BY AN OWNERS APPROVED BROADCASTING A SWEEP SENSE TECHNIQUE BEFORE ANY IMPACT OCCURS. DUKE ENERGY WILL COORDINATE THIS ADDITIONAL SURVEY EFFORT IF REQUIRED.
- 11. THE CONSTRUCTION CONTRACTOR SHALL COMPLY WITH FLUGITIVE DUST RULES BY THE USE OF WATER SPRAY OR OTHER APPROPRIATE DUST SUPPRESSANT MEASURES WHENEVER NECESSARY.
- 12. THE CONSTRUCTION CONTRACTOR SHALL NOT CROSS STREAMS BY FORCING FOR CONSTRUCTION ACCESS AND SHALL INSTEAD EMPLOY TIMBER WAITING OR OTHER METHODS THAT AVOID OR MINIMIZE STREAM BED DISTURBANCES.
- 13. AT LEAST 30 DAYS PRIOR TO THE PRE-CONSTRUCTION CONFERENCE, DUKE ENERGY SHALL PROVIDE TO THE CONTRACTOR A LIST OF THE PLANTS AND ANIMALS MONITORING, CONTAMINATION MEASURES, CLEANUP, AND RESTORATION LIKE OPERATIONS. DUKE ENERGY SHALL RETAIN AN INDEPENDENT AND QUALIFIED ENVIRONMENTAL SPECIALIST AS MUTUALLY AGREED BY OPSB STAFF AND DUKE ENERGY. THE SPECIALIST SHALL BE RESPONSIBLE FOR THE DEVELOPMENT OF THE PRE-CONSTRUCTION ACTIVITIES. THE ENVIRONMENTAL SPECIALIST SHALL HAVE THE AUTHORITY TO DIRECT DUKE ENERGY AND THE CONSTRUCTION CONTRACTORS TO REVISE OR HALT CONSTRUCTION ON THE BASIS THAT HAD CONSTRUCTION ACTIVITIES DO NOT COMPLY WITH THE REGULATIONS. DUKE ENERGY SHALL INFORM STAFF AND IF REQUIRED, THE APPROPRIATE BOARD ENTITY (DUKE, OHIO POWER, AND/OR THE ENVIRONMENTAL AGENCIES) OF ANY VIOLATIONS. CONSTRUCTION SHALL BE STOPPED AT THE POINT OF VIOLATION AND SHALL BE RESUMED WITHIN A REASONABLE PERIOD AT THE DIRECTION OF THE ENVIRONMENTAL SPECIALIST. THE ENVIRONMENTAL SPECIALIST SHALL BE FAMILIAR WITH THE LAWS AND REGULATIONS REGARDING HAD IN OHIO AND SHALL BE PRESENT AT THE PRE-CONSTRUCTION CONFERENCE WITH OPSB STAFF.
- 14. THE CONSTRUCTION CONTRACTOR SHALL REMOVE ALL TEMPORARY GRAVEL AND OTHER CONSTRUCTION ACTIVITIES AS WEATHER PERMITS. UNLESS OTHERWISE DIRECTED BY THE ANNOYER OR DUKE ENERGY, IMPACTED AREAS SHALL BE RESTORED TO PRE-CONSTRUCTION CONDITIONS IN COMPLIANCE WITH THE OHIO EPA GENERAL NUTRIENT POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES) PERMITS OBTAINED FOR THE PROJECT AND THE APPROVED STORMWATER POLLUTION PREVENTION PLAN (SWPPP) OBTAINED FOR THE PROJECT.
- 15. CONTRACTOR SHALL TEMPORARILY STABILIZE ANY UNSEEMED AREAS LEFT UNPROTECTED FOR 14 DAYS OF APRIL ON TO THEREAFTER DIRECTED BY THE PROJECT SWPPP.
- 16. CONTRACTOR SHALL MAINTAIN EROSION CONTROL MEASURES UNTIL UPLOUSE.
- 17. STABILIZATION HAS DEVELOPED AS DIRECTED IN THE PROJECT SWPPP.

DEWATERING:

- 1. ALL DEWATERING SHALL BE PERFORMED IN ACCORDANCE WITH THE SWPPP.
- 2. CONTROL GRADING AROUND EXCAVATIONS TO PREVENT SURFACE WATER FROM FLOWING INTO EXCAVATION AREAS.
- 3. DRAIN OR PUMP AS REQUIRED TO MAINTAIN, INCLUDING DAYS NOT NORMALLY WORKED. ALL EXCAVATIONS FREE OF WATER OR MUD FROM ANY SOURCE, AND DISCHARGE TO APPROVED DRAINS OR CHANNELS. COMMENCE WHEN WATER FIRST APPEARS AND CONTINUE AS REQUIRED TO KEEP EXCAVATION FREE OF STANDING WATER DURING ENTIRE TIME EXCAVATION IS OPEN.
- 4. USE PUMPS OF ADEQUATE CAPACITY TO ENSURE RAPID DRAINAGE OF AREA, AND CONSTRUCTION AND USE DRAINAGE CHANNELS TO SUBDRAINS WITH SLOPS AS VARIOUS BY GRADING OF THE AREA.
- 5. MAINTAIN PROTECTIVE CHANNELS TO PREVENT EROSION OF EXCAVATION, AND REMOVE UNSUITABLE EXCESSIVE WET SUBGRADE MATERIALS AND REPLACE WITH APPROVED COMPACTED EMBANKMENT MATERIAL AS DIRECTED BY OWNER AND AT NO ADDITIONAL COST TO OWNER.
- 6. RIVER/STREAM CROSSINGS EXIST AS INDICATED ALONG THIS PROJECT. REQUIRE EXCAVATION BELOW POTENTIAL STREAM OR RIVER PREHEATC LEVELS. DEWATERING METHODS SHALL INCORPORATE MEANS TO ACCOUNT FOR RISING AND VARYING WATER LEVELS ASSOCIATED WITH THESE BOXES OF WATER AND THEIR PREVENT THREATENING THE INTEGRITY OF THE EXCAVATION, EXISTING FACILITIES, AND WORK UNDER CONSTRUCTION.
- 7. MAINTAIN AREA DRAINAGE DURING CONSTRUCTION.
- 8. COMPLETE CHANNEL PROTECTION EXPEDITIOUSLY FOLLOWING EXCAVATION.

**C350 PROJECT
GENERAL NOTES SHEET 2
HAMILTON COUNTY, OHIO**



COMPILED BY
DUKE ENERGY
REGULATORY
ENGINEER

APPENDICES

NO.	DATE	DESCRIPTION
1	06/15/2016	AWT CNS (AWP) AREA CODE
2	07/24/2020	ISSUED FOR 60% REVIEW
3	07/24/2020	ISSUED FOR RD.

ACCOUNT INFORMATION

NO.	DATE	DESCRIPTION
1	06/15/2016	AWT CNS (AWP) AREA CODE
2	07/24/2020	ISSUED FOR 60% REVIEW
3	07/24/2020	ISSUED FOR RD.

GENERAL RESTRICTIONS

- STAY IN ROW/SEASMENTS ON WITHIN PREDETERMINED WORKSPACE AREAS.
- ONLY USE DESIGNATED POINTS OF ACCESS AS APPROVED BY DUKE.
- NO DIGGING, WORK, OR STORAGE WITHIN 25' OF POWERLINE OR EQUIPMENT INCLUDING GUY WIRES, EXCEPT AT CROSSINGS OF POWER RIGHT OF WAY DESIGNATED ON PLANS.
- ANY DOT CROSSING NOTIFICATIONS TO BE MADE AS INDICATED BY THE PERMIT OR STATE DOT PERMIT.
- INSTALLER IS RESPONSIBLE FOR KNOWING LOCATION OF ALL ENVIRONMENTALLY SENSITIVE AREA RESTRICTIONS PERTAINING TO THIS PROJECT.

ABBREVIATIONS

APPROX.	APPROXIMATE
B.C.	BLOUANCY CONTROL
CL	CENTERLINE
CD	CONTROLLED DENSITY FILL
CSM	CONTROLLED LOW STRENGTH MATERIAL
CMP	CORRUGATED METAL PIPE
COMM	COMMUNICATIONS
CP	CATHODIC PROTECTION
DI	DROP INLET
DI	DUCTILE IRON PIPE
DP	DRAIN
E	EASTING
EA	EACH
ELEV	ELEVATION
EX	EXISTING
FLC	FORBIDDEN LINE CROSSING
FM	FORCE MAIN
FT	FEET
FTG	FITTING
H/HORIZ	HORIZONTAL
HD	HORIZONTAL, DIRECTIONAL DRILL
H/L	HORIZONTAL, LEFT TURN
H/R	HORIZONTAL, RIGHT TURN
N/RV	INVERT
JAB	JACK AND AUGER BORE
L	LENGTH
LAT	LATITUDE
LF	LINEAR FEET
LONG	LONGITUDE
MAX	MAXIMUM
MIN	MINIMUM
MH	MANHOLE
N	NORTHING
N.T.S.	NOT TO SCALE
O.C.	OPEN CUT
O.D.	OUTSIDE DIAMETER
PCC	PORTLAND CEMENT CONCRETE
PIV	POST INDICATOR VALVE
PSI	POUNDS PER SQUARE INCH
PVC	POLY VINYL CHLORIDE
R	RADIUS
RD	ROAD
R/W/ROW	RIGHT-OF-WAY
RCPP	REINFORCED CONCRETE PIPE
SD	STORM DRAIN
SS	SANITARY SEWER
SSD	SOLID STATE DECOUPLER
STA	STATION
TOP	TOP OF PPT
TRK	TEMPORARY WORKSPACE
T.C.E.	TEMPORARY CONSTRUCTION EASEMENT
TYE	TYPICAL
USE	UNDERGROUND ELECTRIC
UT	UNDERGROUND TELEPHONE/COMMUNICATIONS
V	VERTICAL
W	WIDTH
W.T.	WALL THICKNESS
WANE	CROSSING

LEGEND

	PROPOSED TEMPORARY WORKSPACE
	PROPOSED PERMANENT EASEMENT
	ADDITIONAL TEMPORARY WORKSPACE
	CONSTRUCTION MATING
	TRACKING CONTROL
	UP-SLOPE RUMON CONTROL
	SLOPE BREAKER
	DELIMITED WETLAND
	FEMA 100 YEAR FLOOD AREA
	ACCESS PATH
	STREAM
	DITCH
	TREE LINE
	EX. COMMUNICATION LINE
	EX. OVERHEAD LINE
	EX. ELECTRIC LINE
	FENCE
	EX. GAS LINE
	RIGHT-OF-WAY
	RAILROAD
	EX. SANITARY SEWER
	EX. STORM WATER LINE
	EX. WATER LINE
	PROPERTY LINE
	SILT FENCE
	FLTER SOCK
	CONSTRUCTION BOUNDARY
	EX. MAJOR CONTOUR
	EX. MINOR CONTOUR
	PROPOSED MAJOR CONTOUR
	PROPOSED MINOR CONTOUR
	JURISDICTIONAL LINE
	BLOUANCY CONTROL
	PROPOSED GAS LINE
	HORIZONTAL, DIRECTIONAL DRILL
	AUGER BORE
	EXCAVATION/PT

	POTHOLE LOCATION
	BORING LOCATION
	FLUSH
	FLUSH PIPELINE MARKER
	ABOVE GRADE PIPELINE MARKER
	MALE MARKER
	WILET PROTECTION
	J-HOOK
	NO IN-WATER WORK FROM APRIL 15TH THROUGH JUNE 30TH ON PERENNIAL STREAMS
	ROCK DITCH CHECK
	CONSTRUCTION ENTRANCE
	TEST STATION (SEE EQUIPMENT SCHEDULES ON PNG-G-350-0001021)
	SOLID STATE DECOUPLER (SEE EQUIPMENT SCHEDULES ON PNG-G-350-0001024)
	COURION TEST STATION (SEE EQUIPMENT SCHEDULES ON PNG-G-350-0001024)
	MONITORING INSULATOR JUNCTION BOX (SEE EQUIPMENT SCHEDULES ON PNG-G-350-0001021)

BURNS & MCDONNELL ENGINEERING COMPANY, INC. STATE LICENSE # ACOE 015017	DATE: 07/17/2020 TIME: 10:00 AM PROJECT: 180115	BY: [Signature] CHK: [Signature] DATE: 07/24/2020	DESCRIPTION: REVISION ISSUED FOR 90% REVIEW ISSUED FOR RD	AREA CODE: 03880 ACCOUNT NUMBER: 180115 PROJECT NUMBER: 180115	DRAWING BY: AKT STATION ID: C350 CHECKER INITIALS: JAMP	APPROVALS:		PLEDMONT Natural Gas COMMITMENT 2019	C-350 PROJECT LEGEND, SYMBOLS, & ABBREVIATIONS HAMILTON COUNTY, OHIO HAMILTON COUNTY, OHIO	SHEETS: 5 OF 5 DWG DATE: 09-05-2018 DWG SCALE: AS NOTED SUPERSEDED DRAWING NUMBER: PNG -G-350-0001013 REVISION: B
						REF. DWG(S): PNG-G-350-0001009				

BILL OF MATERIAL

GROUP	MARK	QTY (FT OR EA)	SIZE	LINE	ITEM NUMBER	DESCRIPTION	AS BUILT QTY
PIPE	1	60,000	20"	C350 / CENTRAL CORRIDOR	1597626	PIPE, 20", DBL RANDOM LG, BEVELED ENDS, ELECTRIC RESISTANCE WELD, 0.438" WALL THK, STL, API 5L, PSL-2, GR X60, NO JOINTERS, W/ FUSION BONDED EPOXY COATING (16-18 MILS)	
	2	7,120	20"	C350 / CENTRAL CORRIDOR	1597627	PIPE, 20", DBL RANDOM LG, BEVELED ENDS, ELECTRIC RESISTANCE WELD, 0.438" WALL THK, STL, API 5L, PSL-2, GR X60, NO JOINTERS, W/ FUSION BONDED EPOXY (16-18 MILS)/POWDER CONCRETE COATING (40 MILS MINIMUM)	
SEGMENTABLE ELBOWS	10	43	20"	C350 / CENTRAL CORRIDOR	1597631	ELBOW, PIPE, 20", BW, 90 DEG, 5D RADIUS, 0.438" WALL, CS, MSS SP-75, GR Y60, FULLY SEGMENTABLE, FBE (16-18 MILS), MACHINE BEVEL ENDS PER ASME B31.8 APPENDIX I, FIGURE I-4	
	11	67	20"	C350 / CENTRAL CORRIDOR	1597629	ELBOW, PIPE, 20", BW, 45 DEG, 5D RADIUS, 0.438" WALL, CS, MSS SP-75, GR Y60, FULLY SEGMENTABLE, FBE (16-18 MILS), MACHINE BEVEL ENDS PER ASME B31.8 APPENDIX I, FIGURE I-4	
	-	SEE NOTE 5	20"	C350 / CENTRAL CORRIDOR	1597633	ELBOW, PIPE, 20", BW, 90 DEG, 3D RADIUS, 0.438" WALL, CS, MSS SP-75, GR Y60, FULLY SEGMENTABLE, FBE (16-18 MILS), MACHINE BEVEL ENDS PER ASME B31.8 APPENDIX I, FIGURE I-4	
	-	SEE NOTE 5	20"	C350 / CENTRAL CORRIDOR	1597632	ELBOW, PIPE, 20", BW, 45 DEG, 3D RADIUS, 0.438" WALL, CS, MSS SP-75, GR Y60, FULLY SEGMENTABLE, FBE (16-18 MILS), MACHINE BEVEL ENDS PER ASME B31.8 APPENDIX I, FIGURE I-4	

NOTES:

- 1 THE 20" FBE PIPE INCLUDES 0% CONTINGENCY. THE PIPE LENGTH HAS BEEN ROUNDED UP TO THE NEAREST FORTY FOOT INCREMENT.
- 2 THE 20" FBE + ARO PIPE INCLUDES 0% CONTINGENCY. THE PIPE LENGTH HAS BEEN ROUNDED UP TO THE NEAREST FORTY FOOT INCREMENT.
- 3 DOMESTIC MATERIALS ONLY.
- 4 FITTING QUANTITIES SHOWN DO NOT INCLUDE CONTINGENCY.
- 5 NO 3D FITTINGS ARE REQUIRED BY DESIGN. WHERE VARYING FIELD CONDITIONS REQUIRE USE OF 3D FITTINGS FOR SPACE OR SAFETY CONSTRAINTS, CONTRACTOR MUST RECEIVE ADVANCE APPROVAL FROM COMPANY PRIOR TO INSTALLATION.

C350 POWERCRETE SUMMARY				C350 POWERCRETE SUMMARY			
Length	Start Station	End Station	Crossing Type	Length	Start Station	End Station	Crossing Type
100	21+45	22+45	BORE	200	381+95	383+95	BORE
1471	41+82	56+53	HDD	1406	416+72	430+78	HDD
360	60+75	64+35	BORE	134	440+34	441+68	BORE
130	137+89	139+19	BORE	36	473+10	473+46	BORE
180	148+26	150+06	BORE	63	480+24	480+87	BORE
140	160+39	161+79	BORE	120	526+97	528+17	BORE
160	184+08	185+68	BORE	295	546+33	549+28	BORE
125	228+51	229+76	BORE	120	604+19	605+39	BORE
140	253+97	255+37	BORE	160	615+10	616+70	BORE
1556	331+26	346+82	HDD	90	621+74	622+64	BORE
190	348+59	350+49	BORE	105	630+00	631+05	BORE

POWERCRETE SUMMARY TABLE PRESENTED FOR CONVENIENCE AND PLANNING PURPOSES ONLY. TRUE LENGTHS SHOWN ON DRAWINGS SHALL CONTROL.

BURNS & MCDONNELL ENGINEERING COMPANY, INC. STATE LICENSE # ACOE 01507	DATE: 07/24/2020 ISSUED FOR 0% REVIEW	REVISIONS DESCRIPTION: 1. 07/27/2020 ISSUED FOR 0% REVIEW 2. 07/24/2020 ISSUED FOR BID	BY: [Signature] AXT: [Signature] AXT: [Signature]	REGIONAL ENGINEER: MGR: [Signature] REC: [Signature]	APPROVALS: PROJECT NUMBER: 180115 DRAWING BY: AXT STATION ID: C350 CHECKER INITIALS: [Signature]	DUNE ENERGY PLD MONT Natural Gas	C350 PROJECT PIPELINE BILL OF MATERIAL HAMILTON COUNTY, OHIO	SHEETS: 1 OF 1 DWG SCALE: NONE DWG DATE: 06-05-2018 SUPERSEDED DRAWING NUMBER: PNG -C-350-0001337 REVISION: B
	REF: DWG(S) PNG-C-350-0001008 HAMILTON COUNTY, OHIO							

OWNER	STYAMORE TOWNSHIP	ROW	1020.00	1020.00	1020.00	1020.00	1020.00
JURISDICTION	STYAMORE TOWNSHIP	ROW	1020.00	1020.00	1020.00	1020.00	1020.00
ADDRESS	0.677 ACRES	BLUE ASH	0.479 ACRES	0.337 ACRES	0.479 ACRES	0.337 ACRES	0.479 ACRES
EASEMENTS	57' EASEMENT	57' EASEMENT	57' EASEMENT	57' EASEMENT	57' EASEMENT	57' EASEMENT	57' EASEMENT
REF. DWG. NO.	PNG-C-350-0001184						

DATE	01/13/2020	BY	AKT	DESCRIPTION	ISSUED FOR REMITTING
PROJECT NO.	03680	ACCOUNT NUMBER	03680	PROJECT NUMBER	180115
DRAWING NUMBER	C350	DRAWING BY	AKT	STATION ID	C350
CHECKER INITIALS	DNS	CHECKER			



SEE DWG PNG-C-350-0001283 THROUGH PNG-C-350-0001285 FOR RESTORATION TYPE DETAIL.



DATE	01/13/2020	BY	AKT	DESCRIPTION	ISSUED FOR REMITTING
PROJECT NO.	03680	ACCOUNT NUMBER	03680	PROJECT NUMBER	180115
DRAWING NUMBER	C350	DRAWING BY	AKT	STATION ID	C350
CHECKER INITIALS	DNS	CHECKER			

CLASS #1 MAP# 5075HG

APPROVALS

DATE	BY	DESCRIPTION
	AKT	PROJECT NUMBER: 180115
	AKT	DRAWING BY: AKT
	AKT	STATION ID: C350
	DNS	CHECKER INITIALS: DNS


DUKE ENERGY
Piedmont Natural Gas

C350 PIPELINE
ALIGNMENT PLAN & PROFILE
HAMILTON COUNTY, OH

HAMILTON COUNTY, OH

REVISION

REVISION	0	AS NOTED
DWG DATE	01/13/2020	SUPERSEDED
DWG SCALE	6 OF 84	AS NOTED
DWG NUMBER	C-350-0001184	
DRAWING NUMBER	C-350-0001184	
DRAWING NUMBER	C-350-0001184	

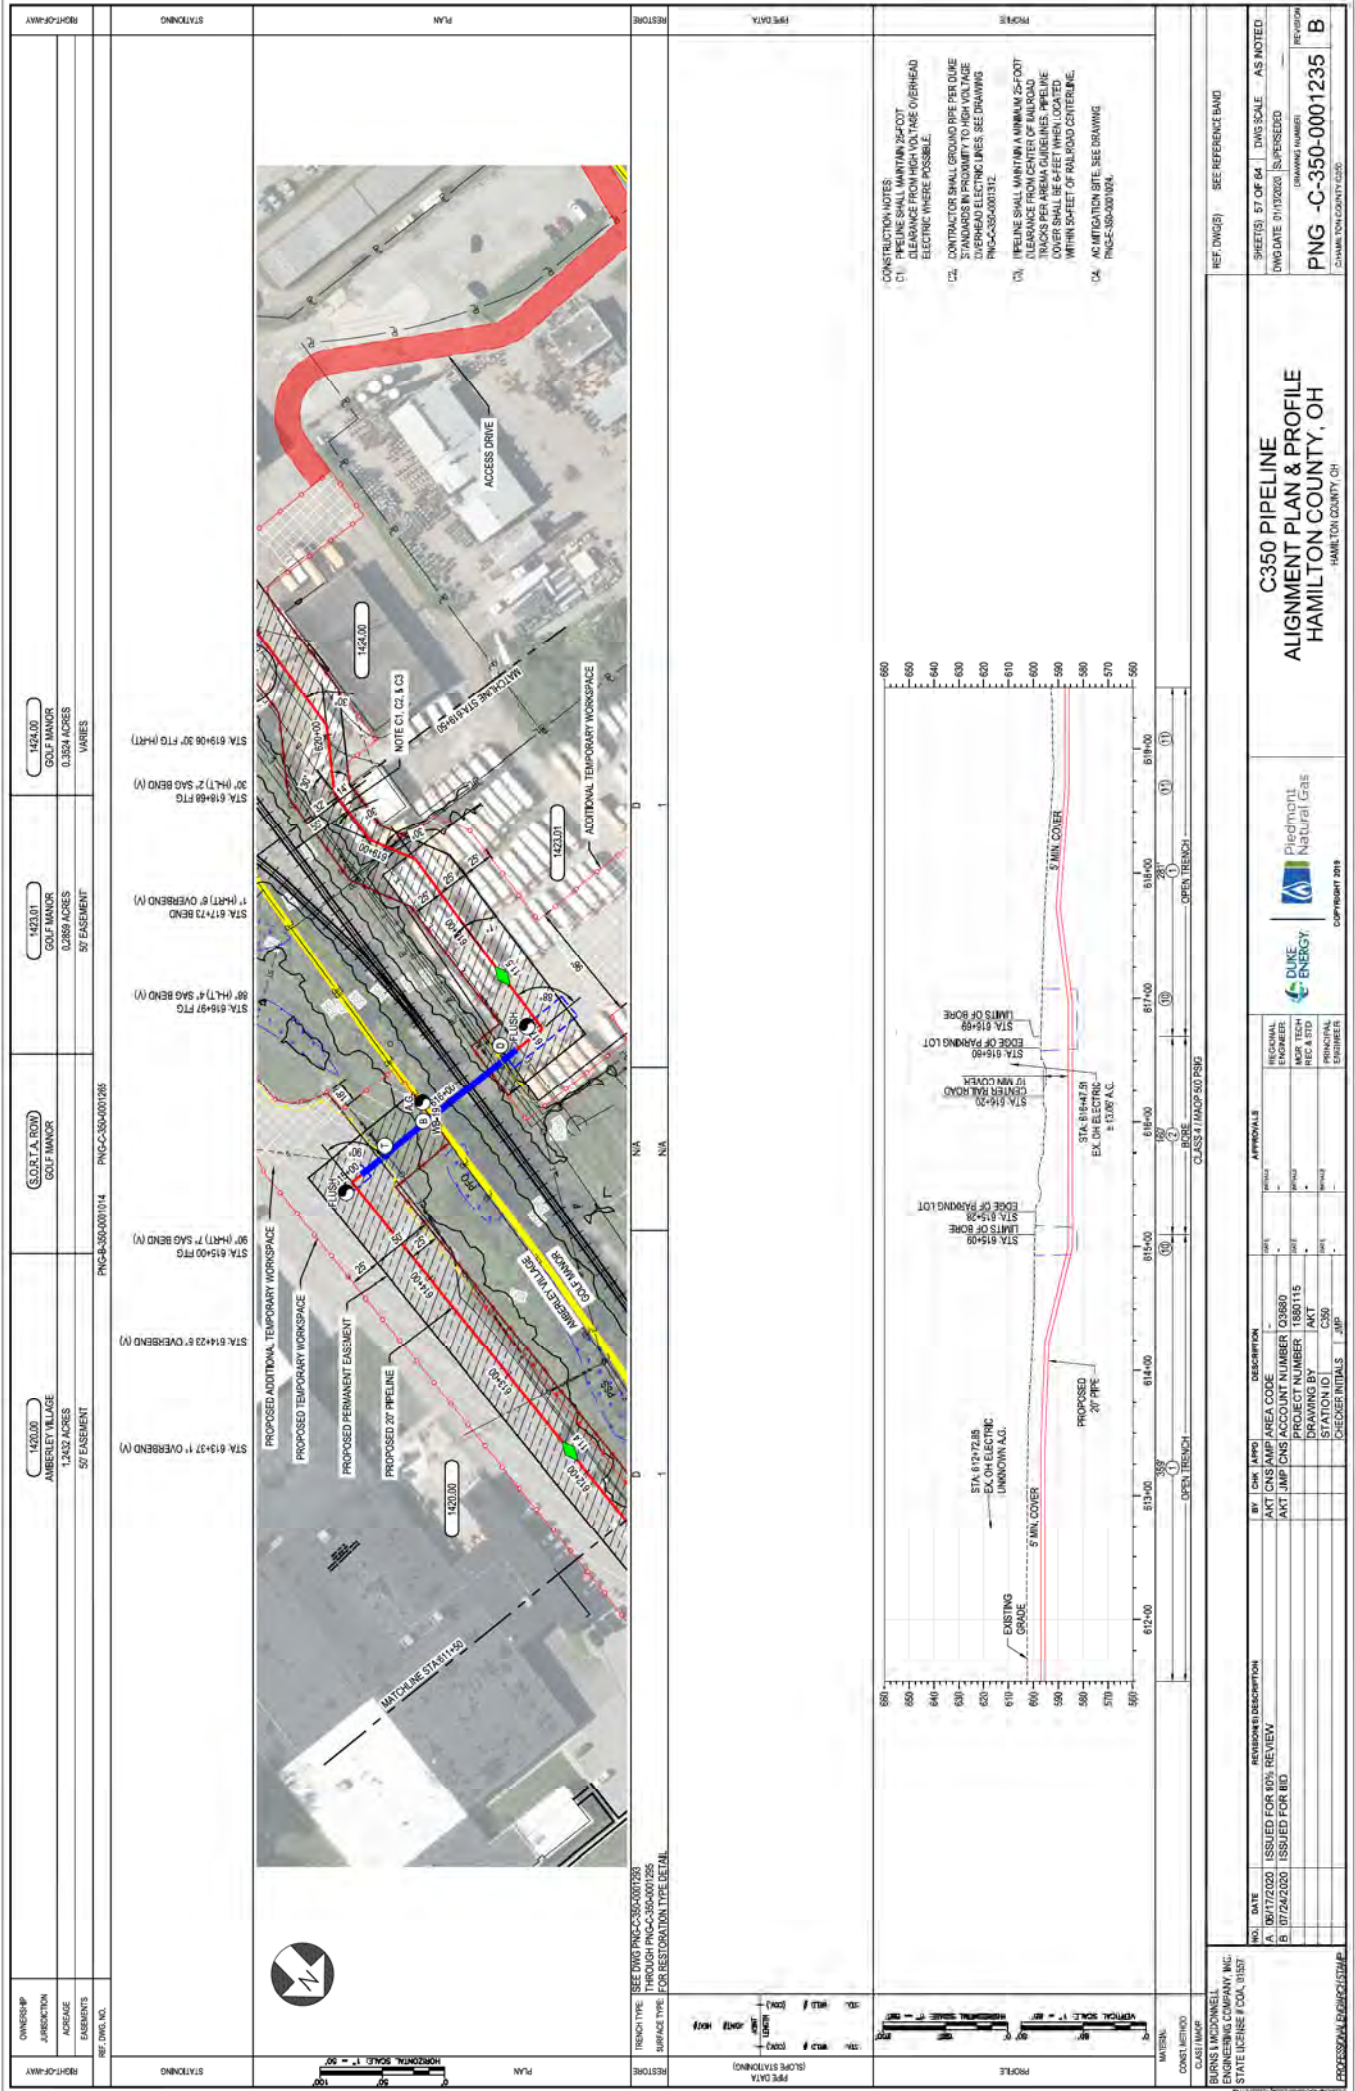

OWNER	1420.00 AMBERLEY VILLAGE GOLF MANOR	1420.00 AMBERLEY VILLAGE GOLF MANOR	1420.00 AMBERLEY VILLAGE GOLF MANOR	1420.00 AMBERLEY VILLAGE GOLF MANOR	1420.00 AMBERLEY VILLAGE GOLF MANOR
JURISDICTION	1.2452 ACRES	1.2452 ACRES	1.2452 ACRES	1.2452 ACRES	1.2452 ACRES
ADJACENT EASEMENTS	57' EASEMENT	57' EASEMENT	57' EASEMENT	57' EASEMENT	57' EASEMENT
REF. DWG. NO.	PNG-C-350-0001235				

STATIONING	STATIONING	STATIONING	STATIONING	STATIONING	STATIONING
STA. 613+37.1 OVERBEND (N)	STA. 614+23.5 OVERBEND (N)	STA. 615+00 FTG	STA. 616+00 FTG	STA. 617+00 OVERBEND (N)	STA. 618+00 FTG

RESTORE	RESTORE	RESTORE	RESTORE	RESTORE	RESTORE
RESTORE	RESTORE	RESTORE	RESTORE	RESTORE	RESTORE

PREP DATA	PREP DATA	PREP DATA	PREP DATA	PREP DATA	PREP DATA
PREP DATA	PREP DATA	PREP DATA	PREP DATA	PREP DATA	PREP DATA

PROFILE	PROFILE	PROFILE	PROFILE	PROFILE	PROFILE
PROFILE	PROFILE	PROFILE	PROFILE	PROFILE	PROFILE

CONSTRUCTION NOTES	CONSTRUCTION NOTES	CONSTRUCTION NOTES	CONSTRUCTION NOTES	CONSTRUCTION NOTES	CONSTRUCTION NOTES
C1. PRELINES SHALL MAINTAIN 25-FOOT CLEARANCE FROM HIGH VOLTAGE OVERHEAD ELECTRIC WHERE POSSIBLE.	C2. CONDUIT FOR SMALL GROUND RISE PIPE DUE TO LIMITED SPACING SHALL BE INSTALLED OVERHEAD ELECTRIC LINES. SEE DRAWING PNG-C-350-0001235.	C3. PIPELINE SHALL MAINTAIN A MINIMUM 25-FOOT CLEARANCE FROM ALL EXISTING AND PROPOSED TRACKS PER AREA GUIDELINES. PIPELINE COVER SHALL BE 6-FEET WHEN LOCATED WITHIN 50-FOET OF RAILROAD CENTERLINE.	C4. AS NOTATION SITE. SEE DRAWING PNG-C-350-0001235.	C5. SEE REFERENCE BAND	C6. SEE REFERENCE BAND

SEE DWG PNG-C-350-0001235 THROUGH PNG-C-350-0001235 FOR RESTORATION TYPE DETAIL.

APPROVALS

DATE	BY	CHK	DESCRIPTION
07/24/2020	AKT	ENS	AREA CODE
07/24/2020	AKT	JMP	PROJECT NUMBER: 180115
			DRAWING BY: AKT
			STATION ID: C350
			CHECKER INITIALS: JBP

C350 PIPELINE ALIGNMENT PLAN & PROFILE
HAMILTON COUNTY, OH

PIEDMONT NATURAL GASES
 DUKE ENERGY

COMPILED BY: [Name]

SHEETS: 57 OF 64

DWG DATE: 01/13/2020

DWG SCALE: AS NOTED

DRAWING NUMBER: PNG-C-350-0001235

REVISION B

HAMILTON COUNTY, OH

NO.	DATE	REVISION DESCRIPTION	BY	CHK	APP	DESCRIPTION
A	10/17/2020	ISSUED FOR 40% REVIEW	AKT	JMS		AKT (JMS) AREA CODE
B	07/24/2020	ISSUED FOR BID	AKT	JMS		AKT (JMS) ACCOUNT NUMBER: 03680 PROJECT NUMBER: 180115 DRAWING BY: AKT STATION ID: C350 CHECKER INITIALS: JMS


C350 PIPELINE ALIGNMENT PLAN & PROFILE

HAMILTON COUNTY, OH

HAMILTON COUNTY, OH
COMPLIANT 2019

NO.	DATE	REVISION DESCRIPTION	BY	CHK	APP	DESCRIPTION
APPROVALS						
REVISION ENGINEER	DATE	DATE	DATE	DATE	DATE	DATE
MAP TECH REC & STD	DATE	DATE	DATE	DATE	DATE	DATE
PRINCIPAL ENGINEER	DATE	DATE	DATE	DATE	DATE	DATE

REF. DWG(S) SEE REFERENCE BAND
 SHEETS: 59 OF 64 DWS SCALE AS NOTED
 DWG DATE: 01/13/2020 SUPERSEDED
 DRAWING NUMBER: PNG -C-350-0001237
 REV: 001 B
 HAMILTON COUNTY, OH

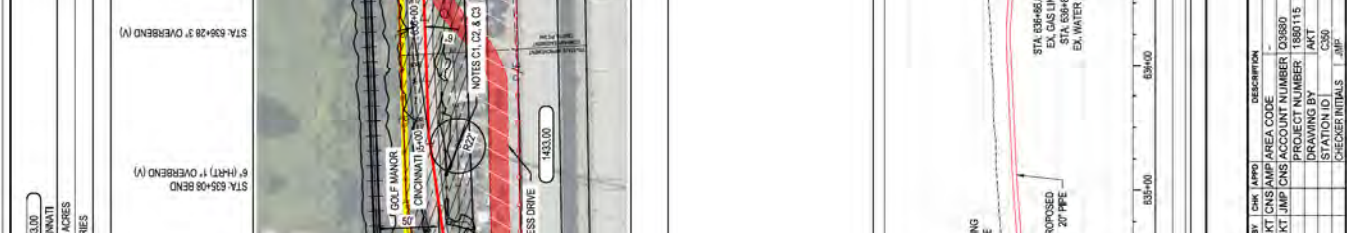


RESTORE TYPE: SEE DWG PNG-C-350-0001235
 SHIELD TYPE: UNRESTRICTED TYPE DETAIL
 RESTORE: SEE DWG PNG-C-350-0001235
 PREP DATE: 10/17/2020
 SCALE: (SLOPE STATIONING)
 MATERIAL: CONCRETE PIPE
 CLASS: 1500

ENGINEERING COMPANY, INC.
 STATE LICENSE # 0001237
 PROFESSIONAL ENGINEER

OWNER #	1402.00	CINCINNATI
JURISDICTION	CINCINNATI	1441.00
ADRENAGE	1.8835 ACRES	0.7474 ACRES
EASEMENTS	57' EASEMENT	VARIABLES
REF. DRG. NO.		

STATIONING	STA. 656+05 BEND 1" (H/L) 20' SAG BEND (V)
STATIONING	STA. 656+61 BEND 8" (H/L) 19' OVERBEND (V)
STATIONING	STA. 657+01 45' FTG. (H/LT)
STATIONING	STA. 657+50 45' FTG. (H/LT)
STATIONING	STA. 658+57 45' FTG. (H/LT)

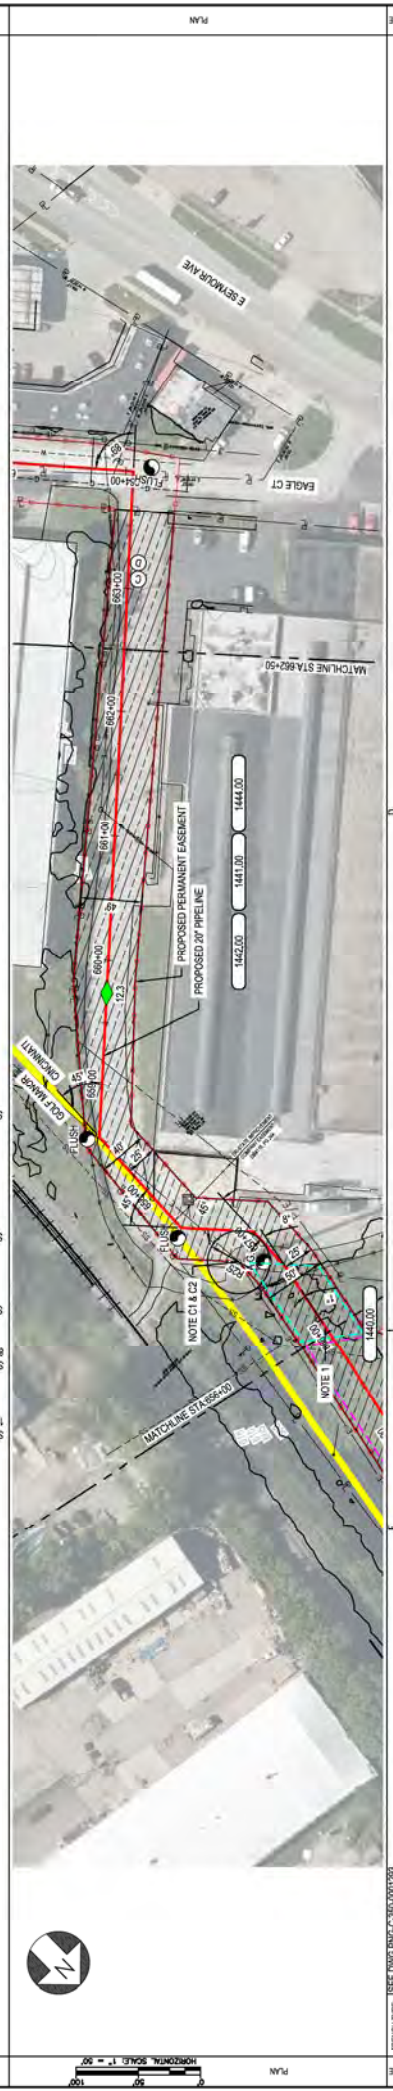

NOTES:

- TRENCH PIPES SHALL BE INSTALLED ON SLOPES AND TOE OF SLOPE TO MINIMIZE WATER SEEP ALONG PIPELINE FROM STA. 655+50 TO STA. 658+49.
- CONTRACTOR SHALL MAINTAIN 25-FOOT CLEARANCE FROM HIGH VOLTAGE OVERHEAD ELECTRIC WHERE POSSIBLE.
- CONTRACTOR SHALL GROUND PIPE PER CODE REQUIREMENTS AND SHALL PROVIDE OVERHEAD ELECTRIC LINES. SEE DRAWING PNG-C-350-000131A.
- ACTIVATION SITE. SEE DRAWING PNG-SB00000102E.

CONSTRUCTION NOTES:

- FROM HIGH VOLTAGE OVERHEAD ELECTRIC WHERE POSSIBLE.
- CONTRACTOR SHALL GROUND PIPE PER CODE REQUIREMENTS AND SHALL PROVIDE OVERHEAD ELECTRIC LINES. SEE DRAWING PNG-C-350-000131A.
- ACTIVATION SITE. SEE DRAWING PNG-SB00000102E.

CLASS #1 MAP# 50 PSHG
OPEN TRENCH

DATE	18/07/2020	ISSUED FOR 40% REVIEW
DATE	07/24/2020	ISSUED FOR BID

BY	CHK	DATE	DESCRIPTION
AKT	CNS	18/07/20	AREA CODE
AKT	JMP	07/24/20	PROJECT NUMBER: 180115
			DRAWING BY: AKT
			STATION ID: C350
			CHECKER INITIALS: JBP

APPROVALS

REVISION	DATE	BY	DESCRIPTION
NO. 1			
NO. 2			

DUKE ENERGY
Piedmont Natural Gas
COMPLIANT 2018

C350 PIPELINE
ALIGNMENT PLAN & PROFILE
HAMILTON COUNTY, OH
HAMILTON COUNTY, OH

REF. DWG(S) SEE REFERENCE BAND


SHEETS: 61 OF 64
DWS SCALE AS NOTED
DWG DATE 01/13/2020
SUPERSEDED
DRAWING NUMBER: PNG -C-350-0001239
REV: 00
B
HAMILTON COUNTY, OH

INSTALLATION:

1. ASBESTOS (1.5x8 INCH STONE OR RECYCLED CONCRETE EQUIVALENT) SHALL BE PLACED AT A MINIMUM 6-INCH THICKNESS FOR LIGHT DUTY USE OR AT LEAST 10-INCH THICKNESS FOR HEAVY DUTY USE.
2. THE ENTRANCE SHALL BE AS LONG AS REQUIRED TO STABILIZE HIGH TRAFFIC AREAS (NOT MINIMUM ON A SINGLE RESIDENTIAL LOT; 10 FT MINIMUM FOR HIGHWAYS).
3. A GEOTEXTILE SHALL BE PLACED OVER THE ENTIRE AREA UNDER THE ENTRANCE TO PREVENT SURFACE WATER FROM FLOWING UNDER THE ENTRANCE. THE GEOTEXTILE SHALL BE A STRONG NOT-PROOF POLYMERIC FIBERS AND MEET THE FOLLOWING SPECIFICATIONS:

MINIMUM TENSILE STRENGTH	200 LB
MINIMUM TENSILE ELONGATION	30%
MINIMUM TENSILE STRENGTH WITH SOIL	300 LB
MINIMUM BULGE STRENGTH	300 LB
MINIMUM TENSILE STRENGTH	300 LB
EQUIVALENT COEFFICIENT OF FRICTION	0.85
PERMEABILITY	XX-153 (EMER)



4. IF NEEDED, A PIPE OR CULVERT SHALL BE CONSTRUCTED UNDER THE ENTRANCE TO PREVENT SURFACE WATER FROM FLOWING UNDER THE ENTRANCE. THE PIPE OR CULVERT SHALL BE CONSTRUCTED TO PREVENT SURFACE WATER FROM FLOWING ALONG THE LENGTH OF THE ENTRANCE UT ONTO PAVED SURFACES.
5. IF NEEDED, WATER BARS SHALL BE CONSTRUCTED TO PREVENT SURFACE WATER FROM FLOWING ALONG THE LENGTH OF THE ENTRANCE UT ONTO PAVED SURFACES.

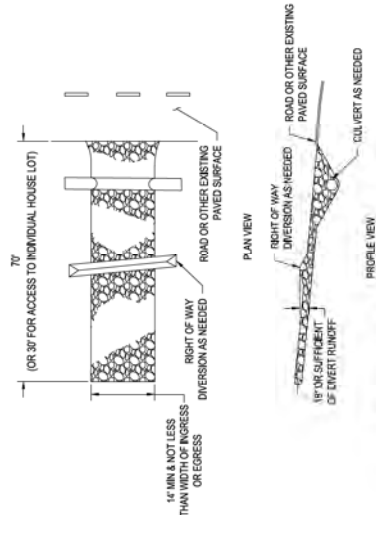

STABILIZING CONSTRUCTION ENTRANCE
SCALE: 1/2\"/>

NOTES:

1. CONCRETE WASHOUT WATER SHALL NOT BE ALLOWED TO FLOW TO STREAMS, DITCHES, STORM DRAINS, OR ANY OTHER WASHOUT CONFORMANCE.
2. THE CONCRETE WASHOUT SIGN SHALL BE INSTALLED IMMEDIATELY TO THE TEMPORARY CONCRETE WASHOUT FACILITY.
3. WASHOUT PIT MUST BE INSPECTED FREQUENTLY TO ENSURE LINERS INTACT.
4. ONCE 75% OF ORIGINAL PIT VOLUME IS FILLED OR LINERS BECOME DAMAGED, THE CONCRETE WASHOUT PIT MUST BE REPLACED IF TORN.

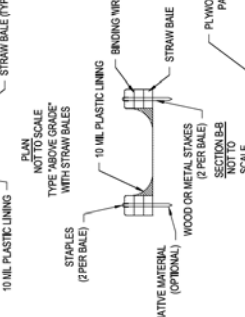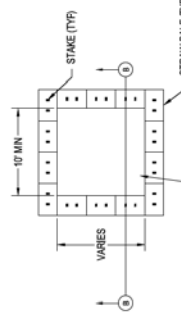


CONCRETE WASHOUT AREAS
SCALE: 1/2\"/>

MAINTENANCE:


1. TOP PRESS WITH ADDITIONAL STONE AS SITE CONDITIONS DEMAND.
2. REMOVE AND TRACKED ONTO PUBLIC STREETS IMMEDIATELY VIA SCRAPING OR SWEEPING.
3. ENSURE THE ENDS OF TEMPORARY CULVERT PIPE (IF USED) ARE PROPERLY CAPED AND THAT THE PIPE (IF FREE OF DEBRIS) THROUGHOUT.

REMOVAL:

1. THE ENTRANCE SHALL REMAIN IN PLACE UNTIL THE DESIGN AREA IS STABLE AND CAN BE REPLACED WITH A PERMANENT ROADWAY OR ENTRANCE.
2. PULL OUT ALL CONSTRUCTION ENTRANCE MATERIAL AND REGRADE AS NECESSARY AND AS SITE CONDITIONS ALLOW.
3. REGRADE THE AREA AS NECESSARY AND ESTABLISH VEGETATION ON ANY RESULTING DISTURBED AREAS.

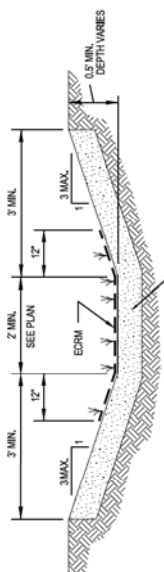


SWALE CROSS SECTION
SCALE: N/A

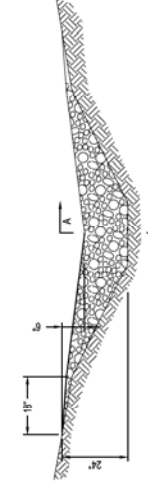

NOTE: KEY STONES INTO CHANNEL BANKS AND EXTEND IF BEYOND THE ABUTMENTS A MINIMUM OF 18\"/>

VIEW LOOKING UPSTREAM

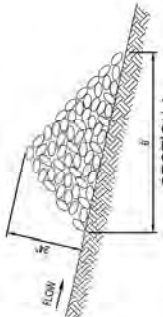


SIDE VIEW

ROCK DITCH CHECK
SCALE: 1/2\"/>

REV	DATE	DESCRIPTION	BY	CHK.	APP'D	DESCRIPTION	APPROVALS
A	10/01/2020	ISSUED FOR WAY REVIEW	JAKT	CNS/JAMP		AREA CODE	
B	07/29/2020	ISSUED FOR BID	JAKT	CNS/JAMP		ACCOUNT NUMBER	
						DRAWING NUMBER	
						STATIONING BY	
						STATIONING ID	
						CHECKER INITIALS	
						JAMP	

DUKE ENERGY
Piedmont Natural Gas
COPYRIGHT 2018

C350 PROJECT
ENVIRONMENTAL NOTES & DETAILS 1
HAMILTON COUNTY, OHIO
HAMILTON COUNTY, OHIO

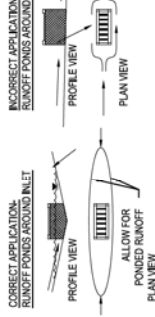

INLET PROTECTION FOR CURB DRAINS & YARD DRAINS SITUATED ON A SLOPE.


- INSTALLATION:**
- REMOVE THE GRATE FROM THE CATCH BASIN.
 - INSERT THE FILTRATION SACK INTO OPENING OF CATCH BASIN. SOME PRODUCTS REQUIRE THE FILTRATION SACK TO BE OPENED UNDER THE CATCH BASIN OR THE FILTRATION SACK TO BE OPENED UNDER THE CATCH BASIN OR THE FILTRATION SACK TO BE OPENED UNDER THE CATCH BASIN.
 - PROVIDE SUPPORT AND ENSURE THE FILTRATION SACK DOES NOT FALL INTO CATCHBASIN AS IT FILLS WITH SEDIMENT.

- MAINTENANCE:**
- THE FILTRATION SACK MUST BE EMPTIED WHEN IT IS 1/3 FULL OF SEDIMENT AND DEBRIS. SACKS ARE TYPICALLY MANUFACTURED WITH LIFTING STRAPS AND DUMPING STRAPS. TO EMPTY THE SACK, REMOVE THE GRADE, LIFT THE SACK OUT OF THE CATCH BASIN VIA THE LIFTING STRAPS AND HURL IT TO AN APPROPRIATE AREA, TURN IT INSIDE OUT WITH THE DUMPING STRAPS PROVIDED.
 - THE FILTRATION SACK MUST BE REPLACED IF IT IS TORN, OTHERWISE THE SAME SACK CAN BE REUSED.
 - THE CONTRACTOR IS REQUIRED TO HAVE STAGED REDUNDANT CONTROLS ON-SITE IN THE EVENT OF REPLACEMENTS ARE NEEDED.

- INSPECTION:**
- INLET PROTECTION MEASURES MUST BE INSPECTED AT LEAST 24 HOURS PRIOR TO RAIN EVENTS. INSPECTION SHOULD BE CONDUCTED BY THE PROJECT ENGINEER OR A QUALIFIED INSPECTOR. NON-FUNCTIONAL DEVICES MUST BE REPLACED.

- REMOVAL:**
- PULL OUT ALL INLET PROTECTION MATERIAL AND PROPERLY DISPOSE OF OFF-SITE.
 - RESTORE AREA TO ORIGINAL CONDITION AND RE-ESTABLISH VEGETATION AS NECESSARY AND APPROPRIATE.

THE FOLLOWING DIAGRAMS PROVIDE A GENERAL IDEA OF HOW TO INSTALL AND MAINTAIN A VARIETY OF MANUFACTURED STORM DRAIN INLET PROTECTION PRACTICES. BE SURE TO IMPLEMENT FILTRATION SACKS THAT ARE APPROPRIATE FOR EITHER CURB INLETS OR FOR YARD DRAIN INLETS. MANUFACTURER'S SPECIFICATIONS FOR THE PRODUCT OF CHOICE SHOULD BE FOLLOWED.

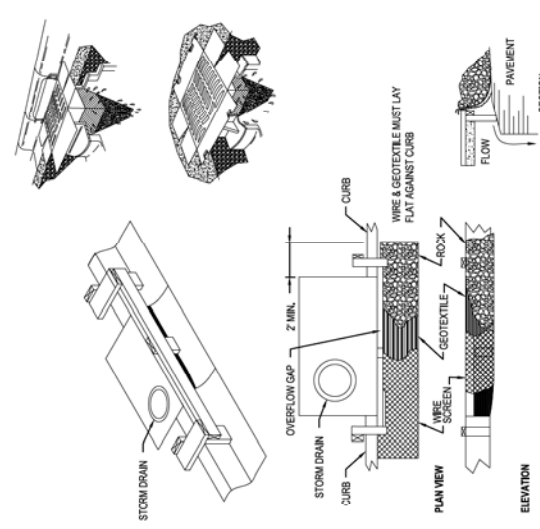

TYPICAL GEOTEXTILE FILTER BAG FOR DEWATERING

- INSTALLATION:**
- CONSTRUCT PRIOR TO UPSLOPE LAND DISTURBANCE.
 - CONSTRUCT WOODEN FRAME FROM 2"x4" LUMBER. DRIVE POSTS INTO THE GROUND AT EACH CORNER DIRECTLY UNDER THE CONCRETE BOX AND ASSEMBLE THE TOP FRAME WITH AN OVERLAP OF 12" AT EACH CORNER. THE FRAME SHOULD BE AT AN ELEVATION THAT DOES NOT CAUSE PONDING WATER TO BACKUP INTO UNWANTED AREAS.
 - THE WIRE MESH AND GEOTEXTILE SHALL BE TIGHTLY STRETCHED AND FASTENED TO THE FRAME. THE GEOTEXTILE SHALL OVERLAP AND CROSS ONE SIDE OF THE INLET SO THE ENDS OF THE CLOTH ARE NOT FASTENED TO THE SAME POST.
 - BACKFILL SHALL BE PLACED IN THE 18" TRENCH AROUND THE INLET IN COMPACTED 2" LAYERS UNTIL THE ELEVATION OF THE TOP OF THE GRATE IS REACHED.

MAINTENANCE:

- REMOVE ACCUMULATED SEDIMENT WHEN IT REACHES ONE HALF THE HEIGHT OF THE PRACTICE. THE REMOVED SEDIMENT MUST BE STABILIZED AND SHOULD NOT BE PLACED WHERE IT COULD EVENTUALLY BE COMPELLED BACK TO THE INLET VIA SURFACE RUNOFF.
- REPLACE AND PROPERLY DISPOSE OF DAMAGED SILT FENCE MATERIAL.
- AREA WHERE SURFACE FLOW HAS OUT UNDER THE SILT FENCE MATERIAL WITHIN THE TRENCH SHALL BE RE-COMPACTED WITH APPROPRIATE MATERIAL (I.E. HIGH CLAY CONTENT).

REMOVAL:

- PULL OUT ALL SILT FENCE MATERIAL AND STAKES AND PROPERLY DISPOSE OF OFF-SITE.
- RE-CRAZE AREA SEDIMENT HAS ACCUMULATED AS NECESSARY AND ESTABLISH VEGETATION ON ANY RESULTING DISTURBED AREAS.

ALTERNATIVE MANUFACTURED YARD DRAINLET PROTECTION PRODUCTS ARE AVAILABLE AND CAN BE USED. SUBJECT TO PRIOR APPROVAL BY THE COMMUNITY ENGINEER.

CURB INLET PROTECTION


SCALE 1/8" = 1'-0"



SCALE 1/8" = 1'-0"

DROP INLET PROTECTION


SCALE 1/8" = 1'-0"



SCALE 1/8" = 1'-0"

TYPICAL TEMPORARY SOIL CONTAINMENT BERM FOR WATERBODY TRENCH SPOILS

SCALE 1/8" = 1'-0"

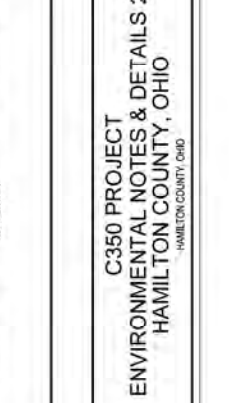

SCALE 1/8" = 1'-0"


C350 PROJECT
ENVIRONMENTAL NOTES & DETAILS 2
HAMILTON COUNTY, OHIO
 HAMILTON COUNTY, OHIO



DUKE ENERGY
 Pledmont Natural Gas
 COPYRIGHT 2018


REGIONAL SUPERVISOR	APPROVALS
REC & STD	DATE
PRINCIPAL ENGINEER	DATE

NO.	DATE	ISSUED FOR	DESCRIPTION	BY	CHK.	APP'D.
A	09/17/2020	ISSUED FOR REVIEW	ACT CENS/AMP AREA CODE			
B	07/26/2020	ISSUED FOR BID	ACT CENS/AMP ACCOUNT NUMBER			
			DRAWING NUMBER			
			STATION ID			
			CHECKER INITIALS			

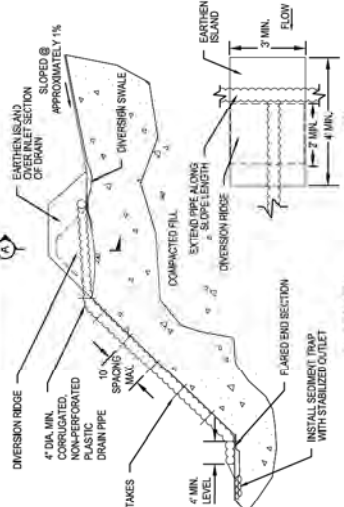

TEMPORARY SLOPE DRAIN
SCALE: N=1/8"

- NOTES:**
- THE SLOPE DRAIN SHALL BE CONSTRUCTED WITH THE CONSTRUCTION OF THE SLOPE AND THE SLOPE STABILIZATION SHALL VARY ACCORDING TO GRADE ELEVATIONS AT THE TIME OF CONSTRUCTION.
 - INSPECT SLOPE DRAIN AND SUPPORTING OVERSISONS AFTER EVERY RAINFALL EVENT AND MAKE NECESSARY REPAIRS FOR PROPER OPERATION OF THE SYSTEM.
 - UPON PROJECT COMPLETION, REMOVE THE SLOPE DRAIN AND PROPERLY STABILIZE ALL DISTURBED AREAS.

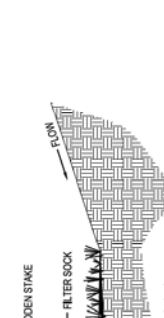

FILTER SOCK
SCALE: N=1/8"

- NOTES:**
- ALL FILTER SOCK MUST BE 12 INCH COMPOST FILTER SOCK OR THE ENGINEERED EQUIVALENT.
 - MATERIALS - COMPOST USED FOR FILTER SOCKS SHALL BE WEED, PATHOGEN AND INSECT FREE AND FREE OF ANY REFUSE, CONTAMINANTS OR OTHER MATERIALS TOXIC TO PLANT GROWTH. THEY SHALL BE DERIVED FROM A WELLDOCUMENTED SOURCE OF ORGANIC MATTER AND CONSIST OF A PARTICLES RANGING FROM 3/8" TO 2".
 - FILTER SOCKS SHALL BE 3 OR 6 M. CONTINUOUS, TUBULAR, HOPE 3/8" KNITTED MESH NETTING MATERIAL, FILLED WITH COMPOST PASSING THE ABOVE SPECIFICATIONS FOR COMPOST PRODUCTS.

INSTALLATION:

- FILTER SOCKS WILL BE PLACED ON A LEVEL LINE ACROSS SLOPES. GENERALLY PARALLEL TO THE BASE OF THE SLOPE OR OTHER AFFECTED AREA, ON SLOPES APPROACHING 2:1, ADDITIONAL SOCKS SHALL BE PROVIDED AT THE TOP AND AS NEEDED M.O.SLOPE.
- FILTER SOCKS INTENDED TO BE LEFT AS A PERMANENT FILTER OR PART OF THE NATURAL LANDSCAPE SHALL BE SEEDED AT THE TIME OF INSTALLATION FOR ESTABLISHMENT OF PERMANENT VEGETATION.
- FILTER SOCKS ARE NOT TO BE USED IN CONCENTRATED FLOW SITUATIONS OR IN RUNOFF CHANNELS.

MAINTENANCE:

- ROUTINELY INSPECT FILTER SOCKS AFTER EACH SIGNIFICANT RAIN, MAINTAINING FILTER SOCKS IN A FUNCTIONAL CONDITION AT ALL TIMES.
- REMOVE SEGMENTS COLLECTED AT THE BASE OF THE FILTER SOCKS WHEN THEY REACH 1/3 OF THE EXPOSED HEIGHT OF THE PRACTICE.
- WHERE THE FILTER SOCK DETERIORATES OR FAILS, IT WILL BE REPAIRED OR REPLACED WITH A MORE EFFECTIVE ALTERNATIVE.
- REMOVAL - FILTER SOCKS WILL BE DISPERSED ON SITE WHEN NO LONGER REQUIRED IN SLOP AS WAY AS TO FACILITATE AND NOT OBSTRUCT SEEDINGS.




RIPRAPPED CHANNEL
SCALE: N=1/8"

- NOTES:**
- SILT FENCE SHALL BE CONSTRUCTED WITH POSITIVE SLOPE 1:1 AND OUTLET TO A STABLE VEGETATED AREA OR SEDIMENT TRAP OR BASIN.



DIVERSION SWALE
SCALE: N=1/8"

- NOTES:**
- SILT FENCE SHALL BE CONSTRUCTED WITH POSITIVE SLOPE 1:1 AND OUTLET TO A STABLE VEGETATED AREA OR SEDIMENT TRAP OR BASIN.



SILT FENCE
SCALE: N=1/8"

- NOTES:**
- SILT FENCE SHALL BE CONSTRUCTED WITH POSITIVE SLOPE 1:1 AND OUTLET TO A STABLE VEGETATED AREA OR SEDIMENT TRAP OR BASIN.

INSTALLATION:


- CONSTRUCT PRIOR TO UPSLOPE LAND DISTURBANCE.
- PLACE CONTINUOUS LENGTHS OF SILT FENCE ALONG A CONSISTENT CONTOUR SO AS TO PREVENT THE CONCENTRATION OF RUNOFF AT LOW POINTS IN THE FENCE.
- TO PREVENT FLOW AROUND ENDS, EXTEND ENDS TO A CONTINUOUS LENGTH OF SILT FENCE USING 1/2" GALVANIZED STEEL OR WOODEN STAKES. STAKES SHOULD BE PLACED AT 10' HORIZONTAL DISTANCE, WHICHEVER IS ACHIEVED FIRST.
- AT A MINIMUM, THE BOTTOM BANCHES OF THE SILT FENCE MATERIAL MUST BE PLACED IN A TRENCH (MINIMUM 6-INCH DEPTH) THAT IS CUT WITH A TRENCHER, CABLE LAYING MACHINE, OR OTHER SUITABLE DEVICE. THE TRENCH SHALL NOT BE CONSTRUCTED WITH THE TILT BLADE OF A BACKFILLER. THE TRENCH MUST BE BACKFILLED WITH SOIL AND PROPERLY COMPACTED, WHEN AGRICULTURE IS TO BE PRACTICED. THE TRENCH SHOULD NOT PULL OUT OF THE GROUND.
- THE TRENCH MUST BE BACKFILLED WITH SOIL AND PROPERLY COMPACTED, WHEN AGRICULTURE IS TO BE PRACTICED. THE TRENCH SHOULD NOT PULL OUT OF THE GROUND.
- STAKES MIN. 3-INCH LENGTH, 2"x2" HARDWOOD OF GOOD QUALITY MUST BE PALCED ON THE DOWNSLOPE SIDE OF THE SILT FENCE MATERIAL.
- STAKES MUST BE PALCED RIGHT BETWEEN CONSECUTIVE STAKES TO ENSURE THE FENCE DOES NOT SAG.
- WHEN IT IS NECESSARY TO JOIN TWO SEPARATE LENGTHS OF SILT FENCE TO FORM A CONTINUOUS RUN, THE END OF TWO SEPARATE LENGTHS MUST BE JOINED TOGETHER BY FIRST OVERLAPPING THEM AND THEN TWISTING THEM TOGETHER AT LEAST 18" PRIOR TO DRIVING THE STAKES INTO THE GROUND.
- EXCESS OF 10% REQUIRE SILT FENCE TO BE "HOOKED" AS DESCRIBED IN THE SHPPP DOCUMENT.

MAINTENANCE:

- REMOVE ACCUMULATED SEDIMENT WHEN IT REACHES 1/3 OF THE HEIGHT OF THE SILT FENCE. THE SEDIMENT SHALL BE REMOVED BY HAND OR BY USING A SHOVEL. WHERE IT COULD BE REMOVED BY HAND, IT SHALL BE COMPOSED BACK TO THE SURFACE AS SURFACE SOIL.
- REPLACE AND PROPERLY DISPOSE OF DAMAGED SILT FENCE MATERIAL.
- AREAS WHERE SURFACE FLOW HAS CUT UNDER THE SILT FENCE MATERIAL WITHIN THE TRENCH SHALL BE RE-COMPACTED WITH APPROPRIATE MATERIAL, I.E. HIGH CLAY CONTENT.


REMOVAL:

- PULL OUT ALL SILT FENCE MATERIAL AND STAKES AND PROPERLY DISPOSE OF OFF-SITE.
- RE-GRADE AREA WHERE SEDIMENT HAS ACCUMULATED AS NECESSARY AND ESTABLISH VEGETATION IN ANY RESULTING DISTURBED AREAS.

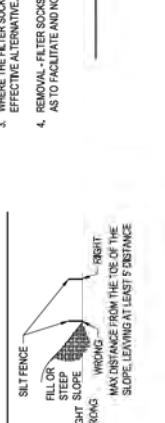

TEMPORARY SLOPE DRAIN
SCALE: N=1/8"

- NOTES:**
- SILT FENCE SHALL BE CONSTRUCTED WITH POSITIVE SLOPE 1:1 AND OUTLET TO A STABLE VEGETATED AREA OR SEDIMENT TRAP OR BASIN.

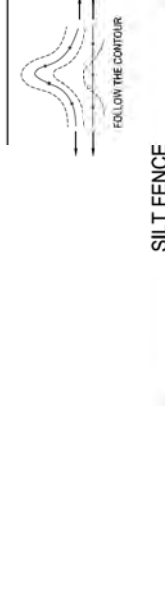


FILTER SOCK
SCALE: N=1/8"

- NOTES:**
- SILT FENCE SHALL BE CONSTRUCTED WITH POSITIVE SLOPE 1:1 AND OUTLET TO A STABLE VEGETATED AREA OR SEDIMENT TRAP OR BASIN.



RIPRAPPED CHANNEL
SCALE: N=1/8"

- NOTES:**
- SILT FENCE SHALL BE CONSTRUCTED WITH POSITIVE SLOPE 1:1 AND OUTLET TO A STABLE VEGETATED AREA OR SEDIMENT TRAP OR BASIN.



TEMPORARY SLOPE DRAIN
SCALE: N=1/8"

- NOTES:**
- SILT FENCE SHALL BE CONSTRUCTED WITH POSITIVE SLOPE 1:1 AND OUTLET TO A STABLE VEGETATED AREA OR SEDIMENT TRAP OR BASIN.



FILTER SOCK
SCALE: N=1/8"

- NOTES:**
- SILT FENCE SHALL BE CONSTRUCTED WITH POSITIVE SLOPE 1:1 AND OUTLET TO A STABLE VEGETATED AREA OR SEDIMENT TRAP OR BASIN.



RIPRAPPED CHANNEL
SCALE: N=1/8"


- NOTES:**
- SILT FENCE SHALL BE CONSTRUCTED WITH POSITIVE SLOPE 1:1 AND OUTLET TO A STABLE VEGETATED AREA OR SEDIMENT TRAP OR BASIN.

NO.	DATE	ISSUED FOR	REVISION
A	06/27/2020	ISSUED FOR W/18 REVIEW	
B	07/24/2020	ISSUED FOR BID	


BY	CHK.	APP'D	DESCRIPTION
JAKT	CNS/JMP	AREA CODE	03650
JAKT	JMP	CNS ACCOUNT NUMBER	03650
JAKT	JMP	CNS ACCOUNT NUMBER	1880115
JAKT	JMP	DRAWING BY	JAKT
JAKT	JMP	STATION ID	C350
JAKT	JMP	CHECKER/INITIALS	JMP

NO.	DATE	ISSUED FOR	REVISION
A	06/27/2020	ISSUED FOR W/18 REVIEW	
B	07/24/2020	ISSUED FOR BID	


- PRESERVATION OF NATURAL VEGETATION**
- AREAS WHERE NATURAL VEGETATION IS TO BE PRESERVED, INCLUDING TREES, SHALL BE FENCED PRIOR TO BEGINNING CLEARING OPERATIONS.
 - ACCEPTABLE FENCE MATERIALS INCLUDE PLASTIC FENCE OR SNOW FENCE ANCHORED TO METAL FENCE POSTS.
 - SIGNAGE SHALL CLEARLY IDENTIFY THE PROTECTION AREA AND STATE THAT NO CLEARING OR EQUIPMENT IS ALLOWED WITHIN IT.
 - FENCE SHALL REMAIN AROUND PROTECTION AREAS UNTIL AFTER FINAL GRADING HAS BEEN COMPLETED.
 - FENCE SHALL BE PLACED AS SHOWN ON PLANS AND BEYOND THE DRIP LINE OR CANOPY OF TREES TO BE PROTECTED.
 - IF ANY CLEARING IS DONE AROUND SPECIMEN TREES IT SHALL BE DONE BY CUTTING AT GROUND LEVEL WITH HAND TOOLS AND SHALL NOT BE GRUBBED OR PULLED OUT.

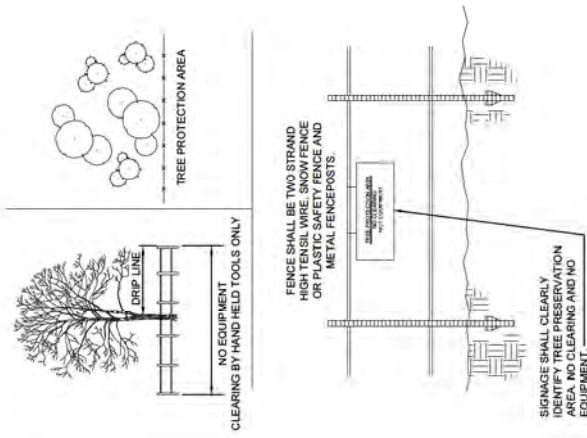

CROSS SECTION
TREE PRESERVATION AREA
SCALE: N.T.S.

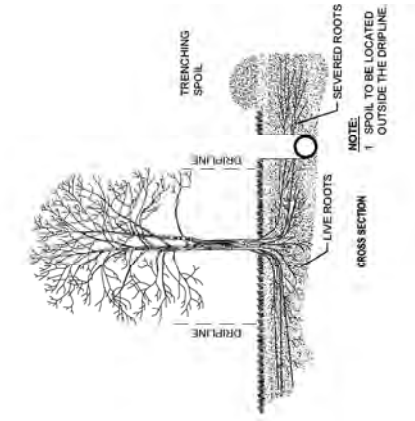

CROSS SECTION
TREE PRESERVATION AREA BEFORE TRENCHING
SCALE: N.T.S.

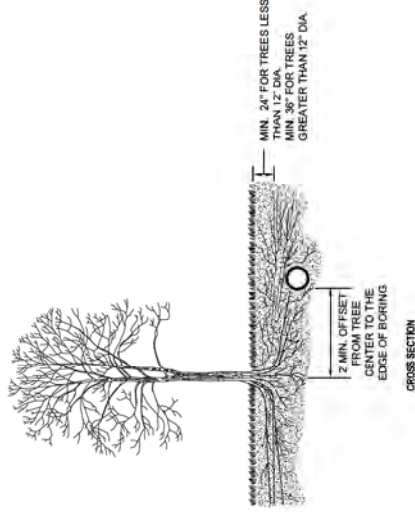

CROSS SECTION
TREE PRESERVATION AREA DURING BORING
SCALE: N.T.S.

BURNS & MCCONNELL
ENGINEERING COMPANY, INC.
STATE LICENSE # CDA-01567
PROFESSIONAL ENGINEER/STATE

REV	DATE	REVISION/DESCRIPTION	BY	CHK./APPD	DESCRIPTION	APPROVALS
A	10/01/2020	ISSUED FOR 04/1 REVIEW	JAKT	CNS/JMP	JAKT CNS ACCOUNT NUMBER: C3500	REGIONAL SUPERVISOR REC & STD
B	07/24/2020	ISSUED FOR BID	JAKT	CNS/JMP	JAKT CNS ACCOUNT NUMBER: 1380715	REGIONAL SUPERVISOR REC & STD
					DRAWING BY: JAKT	PRINCIPAL ENGINEER
					STATION ID: C350	PRINCIPAL ENGINEER
					CHECKER/INITIALS: JMP	PRINCIPAL ENGINEER

REF. DWG(S): PNG-C-350-0001286


SHEETS: 4 OF 4 DWGSCALE: NONE

DWG DATE: 04-25-2018 (SUPERSEDED)

DRAWING NUMBER: PNG -C-350-0001286 REGION: B


PROJECT: C350 PROJECT
ENVIRONMENTAL NOTES & DETAILS 4
HAMILTON COUNTY, OHIO
HAMILTON COUNTY, OHIO

DUKE ENERGY
Piedmont Natural Gas
COPYRIGHT 2018

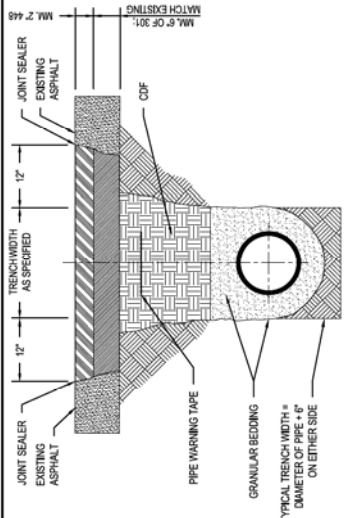


- NOTES:**
1. ALL RESTORATION IN BLUE ASH RIGHT OF WAY SHALL BE MILLED AND PAVED TO A WIDTH OF 12'.
 2. APPLY GRANULAR BEDDING AROUND PIPE AND BACKFILL TRENCH WITH A CONTROLLED DENSITY FILL (CD) TO BOTTOM OF EXISTING ASPHALT.
 3. MINIMUM 6" OF 301 ASPHALT IN 4" (MAXIMUM) LIFTS OR MATCH EXISTING ASPHALT CROSS SECTION. APPLY MINIMUM 2" OF ITEM 448 ASPHALT SURFACE COURSE.
 4. APPLY ASPHALT IN SUCH A WAY THAT WHEN IT IS FULLY COMPACTED, THE EDGES ARE FLUSH, AND THE CENTER IS 1" HIGH, FOR FUTURE COMPACTION.
 5. SEAL ALL EDGES OF THE TRENCH WITH ITEM 702.17 JOINT SEALER.
 6. PIPE WARNING TAPE SHALL BE INSTALLED APPROXIMATELY 24"-36" ABOVE PIPELINE, OR AS OTHERWISE RECOMMENDED BY MANUFACTURER. MATERIALS SHALL BE SIGNAL TAPE OR APPROVED EQUIVALENT AND SHALL BE NON-TRACEABLE VARIETY.

TYPICAL UTILITY TRENCH AND SURFACE RESTORATION A: CITY OF BLUE ASH
SCALE: N.T.S.

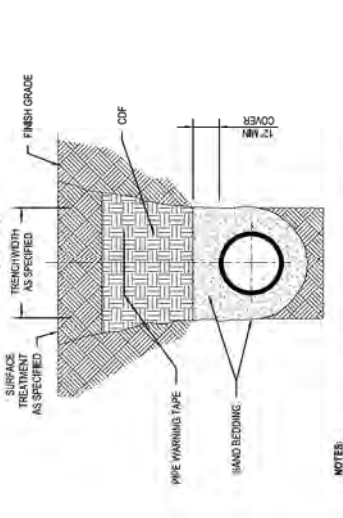


- NOTES:**
1. PIPE BEDDING SHALL BE CLEAN, GRADED SAND COMPACTED TO PROVIDE EVEN SUPPORT FOR PIPE. APPROVED MATERIALS INCLUDE MUDSTONE DUST OR SIMILAR BEDDING MATERIAL SHALL BE INSTALLED IN SUCH A MANNER THAT HORIZONAL JOINTS AND DOES NOT OBSTRUCT BEDDING OR PIPE.
 2. PIPE WARNING TAPE SHALL BE INSTALLED APPROXIMATELY 24"-36" ABOVE PIPELINE, OR AS OTHERWISE RECOMMENDED BY MANUFACTURER. MATERIALS SHALL BE SIGNAL TAPE OR APPROVED EQUIVALENT AND SHALL BE NON-TRACEABLE VARIETY.

TYPICAL UTILITY TRENCH D
SCALE: N.T.S.

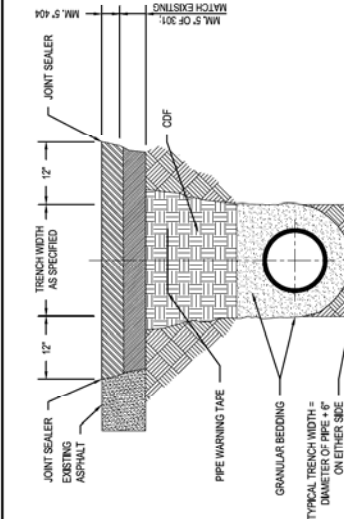


- NOTES:**
1. APPLY GRANULAR BEDDING AROUND PIPE AND BACKFILL TRENCH WITH FLASH-FILL TO BOTTOM OF EXISTING ASPHALT.
 2. MINIMUM 5" OF 301 ASPHALT OR MATCH EXISTING ASPHALT CROSS SECTION. APPLY MINIMUM 5" OF ITEM 404 ASPHALT SURFACE COURSE.
 3. APPLY ASPHALT IN SUCH A WAY THAT WHEN IT IS FULLY COMPACTED, THE EDGES ARE FLUSH, AND THE CENTER IS 1" HIGH, FOR FUTURE COMPACTION.
 4. SEAL ALL EDGES OF THE TRENCH WITH ITEM 702.17 JOINT SEALER.
 5. PIPE WARNING TAPE SHALL BE INSTALLED APPROXIMATELY 24"-36" ABOVE PIPELINE, OR AS OTHERWISE RECOMMENDED BY MANUFACTURER. MATERIALS SHALL BE SIGNAL TAPE OR APPROVED EQUIVALENT AND SHALL BE NON-TRACEABLE VARIETY.

TYPICAL UTILITY TRENCH AND SURFACE RESTORATION B: SHARONVILLE
SCALE: N.T.S.

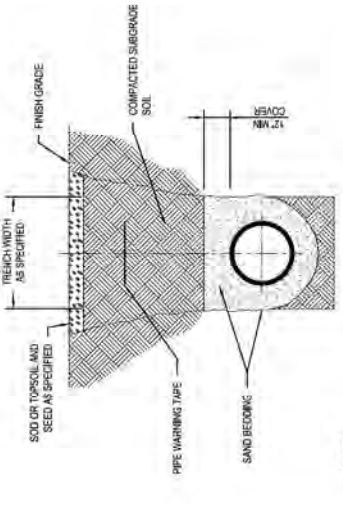


- NOTES:**
1. PIPE BEDDING SHALL BE CLEAN, GRADED SAND COMPACTED TO PROVIDE EVEN SUPPORT FOR PIPE. APPROVED MATERIALS INCLUDE MUDSTONE DUST OR SIMILAR BEDDING MATERIAL SHALL BE INSTALLED IN SUCH A MANNER THAT HORIZONAL JOINTS AND DOES NOT OBSTRUCT BEDDING OR PIPE.
 2. PIPE WARNING TAPE SHALL BE INSTALLED APPROXIMATELY 24"-36" ABOVE PIPELINE, OR AS OTHERWISE RECOMMENDED BY MANUFACTURER. MATERIALS SHALL BE SIGNAL TAPE OR APPROVED EQUIVALENT AND SHALL BE NON-TRACEABLE VARIETY.

TYPICAL UTILITY TRENCH E
SCALE: N.T.S.

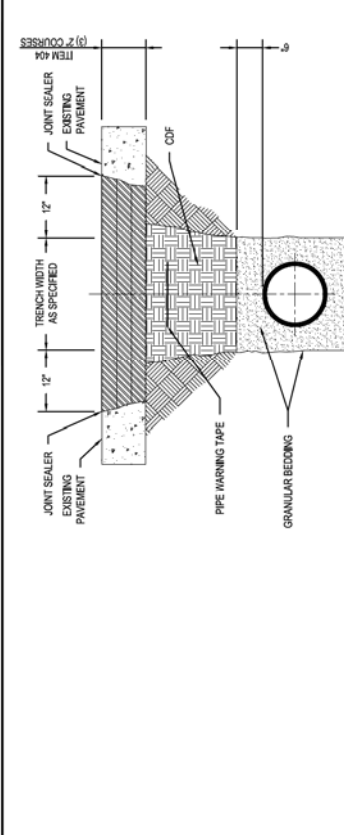

- NOTES:**
1. ALL RESTORATION IN CITY OF READING RIGHT OF WAY SHALL BE MILLED AND PAVED FROM CURB TO CURB. SEE PNG-C-350-0001294 FOR MILL AND PAVE DETAIL.
 2. ALL CONCRETE TO BE CLASS C-4000 P.S.I.
 3. SAW CUT EXISTING PAVEMENT FULL DEPTH ALL EDGES.
 4. REPLACE PAVEMENT WITH (3) 2" LAYER OF 404.
 5. BACKFILL SHALL BE CONTROL DENSITY FLOWABLE MATERIAL.
 6. SEAL ALL PAVEMENT EXISES.
 7. INSPECTOR MUST BE PRESENT DURING CONSTRUCTION.
 8. COVER TRENCH WITH STEEL PLATE AS NEEDED.
 9. STREET TO BE SWEEP CLEAN AT CONCLUSION OF CONSTRUCTION.
 10. PIPE WARNING TAPE SHALL BE INSTALLED APPROXIMATELY 24"-36" ABOVE PIPELINE, OR AS OTHERWISE RECOMMENDED BY MANUFACTURER. MATERIALS SHALL BE SIGNAL TAPE OR APPROVED EQUIVALENT AND SHALL BE NON-TRACEABLE VARIETY.

TYPICAL UTILITY TRENCH AND SURFACE RESTORATION C: CITY OF READING
SCALE: N.T.S.

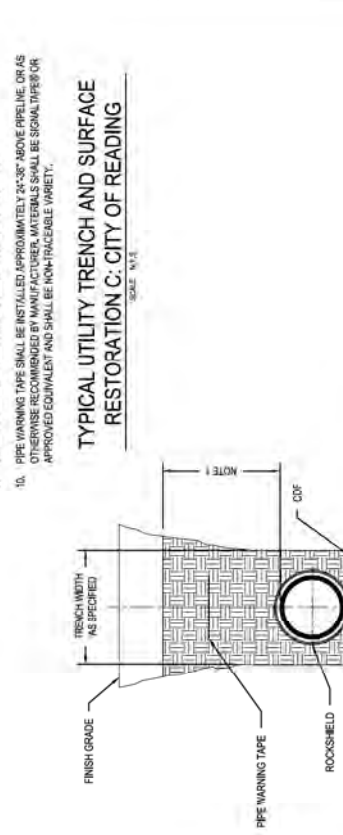

- NOTES:**
1. CDF BACKFILL SHALL EXTEND TO BOTTOM OF PIPE IF CROSSING EXISTING PIPE OR A MINIMUM OF 12 INCHES.
 2. CDF SHALL BE PER HAMILTON COUNTY SPECIFICATION. C.S.M. SHALL BE EXCAVATABLE AND HAVE A COMPRESSIVE STRENGTH NO LESS THAN 100 P.S.I.

TYPICAL UTILITY TRENCH F
SCALE: N.T.S.

BERNIS J. MCCONNELL
ENGINEERING COMPANY, INC.
STATE LICENSE # CCA, DIST.

PROFESSIONAL ENGINEER STATE #

NO.	DATE	REVISION/DESCRIPTION	BY	CHK.	APP'D.
A.	06/17/2020	ISSUED FOR 50% REVIEW	AKT	CNS	JMP
B.	07/24/2020	ISSUED FOR BD	AKT	CNS	JMP

PROJECT NUMBER	PROJECT LOCATION	STATIONING	CHECKER INITIALS	JMP
03860	180915	CNS		

APPROVALS

NAME	DATE	APPROVAL

REG. DWG(S): PNG-C-350-0001009

SHEET(S) 1 OF 3 DWG SCALE NONE

DATE: 06/16/2020 SUPERSEDE

DRAWING NUMBER

PNG -C-350-0001293

FILE NUMBER


HAMILTON COUNTY, OHIO

C350 PROJECT
RESTORATION DETAILS 1
HAMILTON COUNTY, OHIO

Piedmont
Natural Gas

DUKE
ENERGY


COPYRIGHT 2019

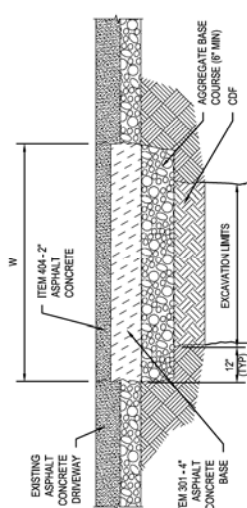

- NOTES:
- SEE MILL AND PAVE DETAIL ON THIS DRAWING. WIDTH SHALL BE 12\"/>
 - WHERE ASPHALT CONCRETE PAVEMENT IS REQUIRED, THE EDGES ARE TO BE CUT WITH A SAW IN A NEAT STRAIGHT LINE. ALL EDGES ARE TO BE SWEEP AND TACKED, AND ALL JOINTS, AFTER THE SURFACE HAS BEEN PLACED, ARE TO BE SEALED WITH AC-20 IN A MANNER TO AVOID TRACKING.

**SURFACE TYPE 1 RESTORATION STANDARD:
HAMILTON COUNTY ASPHALT CONC. DRIVEWAY**


SCALE: N.T.S.

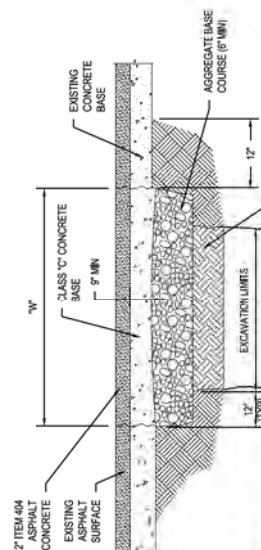

- NOTES:
- SEE MILL AND PAVE DETAIL ON THIS DRAWING. WIDTH SHALL BE THAT OF THE AFFECTED LANE(S).
 - THICKNESS OF ALL REPLACEMENT COURSES SHALL BE EQUAL TO EXISTING BUT SHALL NOT BE LESS THAN INDICATED.
 - CONCRETE PAVEMENT SHALL BE SAWCUT AND REMOVED TO NEAREST JOINT TO PREVENT PARTIAL PANEL REMOVAL. WIDTH OF PAVEMENT REMOVAL SHALL BE MINIMUM 2' EITHER SIDE OF UTILITY CENTERLINE AND UP TO NEXT PANEL LIMIT.
 - SAWCUTS THAT EXTEND OUTSIDE THE AREA OF REMOVAL AND REPLACEMENT SHALL BE FILLED WITH AN EPOXY-BASED GROUT APPROVED BY THE ENGINEER.
 - FULL DEPTH SAWCUTS SHALL BE MADE AROUND THE PERIMETER OF THE AREA TO BE PATCHED. THE CUT SHALL BE MADE AT A RIGHT ANGLE TO THE PAVEMENT EDGE AND TO THE CENTERLINE OF THE PAVEMENT.
 - LONGITUDINAL FULL DEPTH SAWCUTS SHALL BE AT EXISTING LONGITUDINAL JOINTS.
 - ADDITIONAL SAWCUTS MAY BE REQUIRED WITH THE AREA OF THE PATCH TO FACILITATE REMOVAL OF THE CONCRETE OR TO ALLEVIATE BONDING OF THE FULL DEPTH SAW CUT AT THE PATCH EDGE.
 - SEAL ALL EDGES OF RESTORATION WITH ITEM 102.01 - JOINT SEALER.

**SURFACE TYPE 4 RESTORATION STANDARD:
CINCINNATI, GOLF MANOR, AMBERLEY VILLAGE**


SCALE: N.T.S.

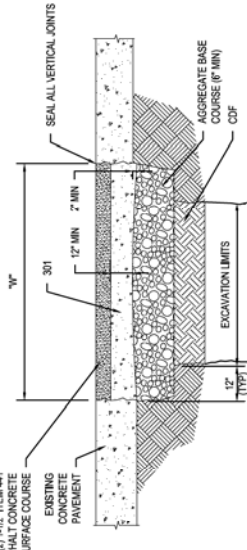

- NOTES:
- ALL RESTORATION IN VILLAGE OF EVENDALE RIGHT OF WAY SHALL BE MILLED AND PAVED TO THE ENTIRE WIDTH OF THE AFFECTED LANES). SEE MILL AND PAVE DETAIL ON THIS DRAWING.
 - EXCAVATION MUST BE REPLACED IN THE LIKE KIND OR BETTER.
 - IF PAVEMENT IS ASPHALT, REPLACE WITH NOT LESS THAN 12\"/>
 - IF PAVEMENT IS CONCRETE, REPLACE WITH NOT LESS THAN 10\"/>
 - THE SERVICE DEPARTMENT SUPERINTENDENT MUST BE NOTIFIED A DAY IN ADVANCE OF RESTORATION WORK.(563-4438).
 - PERMANENT RESTORATION MADE WITHIN 3 DAYS AFTER STREETS IS OPENED.

**SURFACE TYPE 2 RESTORATION STANDARD:
VILLAGE OF EVENDALE**


SCALE: N.T.S.

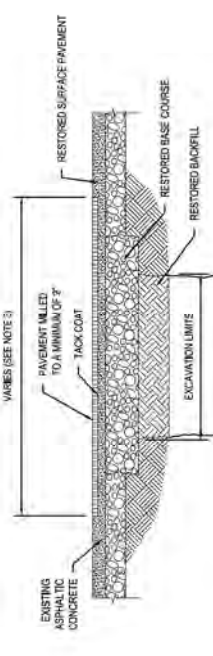

- NOTES:
- THICKNESS OF ALL REPLACEMENT COURSES SHALL NOT BE LESS THAN THAT OF EXISTING COURSE.
 - OVERLAY MATERIAL USED TO REPLACE MILLED SURFACE SHALL MATCH MATERIAL USED DURING RESTORATION.
 - MILING WIDTHS VARY BASED ON LOCATION/MUNICIPALITY. SEE THE SELECTED RESTORATION TYPE FOR SPECIFIED WIDTHS.

MILL AND PAVE

SCALE: N.T.S.

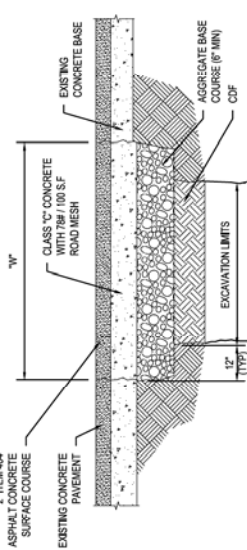

- NOTES:
- WHERE ASPHALT CONCRETE PAVEMENT IS REQUIRED, THE EDGES ARE TO BE CUT WITH A SAW IN A NEAT STRAIGHT LINE. ALL EDGES ARE TO BE SWEEP AND TACKED, AND ALL JOINTS, AFTER THE SURFACE HAS BEEN PLACED, ARE TO BE SEALED WITH AC-20 IN A MANNER TO AVOID TRACKING.
 - WHERE CONCRETE BASE IS REQUIRED, THE SURFACE SHALL BE FLOATED SMOOTH BY THE USE OF HAND FLOATS OR BULL FLOATS AND THE FINAL FINISH OR TEXTURING SHALL BE COMPLETED WITH A BROOM.

SURFACE TYPE 3 RESTORATION STANDARD: HAMILTON COUNTY ASPHALT CONC. SURFACE & CONC. BASE

SCALE: N.T.S.

REF. DWG(S): PNC-G-350-0001039 SHEET(S) 2 OF 3 DWG SCALE NONE DATE: 02/04/2020 SUPERSEDED DRAWING NUMBER PNC -C-350-0001294 COUNTY: HAMILTON COUNTY, OHIO		C350 PROJECT RESTORATION DETAILS 2 HAMILTON COUNTY, OHIO HAMILTON COUNTY, OHIO	
PROJECT: C350 PROJECT SHEET: RESTORATION DETAILS 2 COUNTY: HAMILTON COUNTY, OHIO		 COPYRIGHT 2019	
NO. DATE A. 08/17/2020 B. 07/24/2020	REVISION/DESCRIPTION ISSUED FOR 50% REVIEW ISSUED FOR BD	BY: CJK / JPD ACT: CINS / JAMP ACT: CINS / JAMP	DESCRIPTION AREA C/CDE ACCOUNT NUMBER Q3860 PROJECT NUMBER 1809115 STATIONING CHS CHECKER INITIALS J_MP
BURNS & MCDONNELL ENGINEERING COMPANY, INC. STATE LICENSE # C.O.A. 01587		PROFESSIONAL ENGINEER'S SEAL	

PERMANENT STABILIZATION

AREAS REQUIRING PERMANENT STABILIZATION	TIME FRAME TO APPLY EROSION CONTROLS:
ANY AREAS THAT WILL BE DORMANT FOR ONE (1) YEAR OR MORE	WITHIN SEVEN (7) DAYS OF THE MOST RECENT DISTURBANCE
ANY DISTURBED AREAS WITHIN FIFTY (50) FEET OF A STREAM AND AT FINAL GRADE.	WITHIN TWO (2) DAYS OF REACHING FINAL GRADE.
ANY OTHER AREAS AT FINAL GRADE	WITHIN SEVEN (7) DAYS OF REACHING FINAL GRADE WITHIN THAT AREA

NOTE: WHERE VEGETATIVE STABILIZATION TECHNIQUES MAY CAUSE STRUCTURAL INSTABILITY OR ARE OTHERWISE UNOBTAINABLE, ALTERNATIVE STABILIZATION TECHNIQUES MUST BE EMPLOYED. THESE TECHNIQUES MAY INCLUDE MULCHING OR EROSION MATTING.

TEMPORARY STABILIZATION

AREAS REQUIRING TEMPORARY STABILIZATION	TIME FRAME TO APPLY EROSION CONTROLS:
ANY DISTURBED AREA WITHIN FIFTY (50) FEET OF A STREAM AND NOT AT FINAL GRADE.	WITHIN TWO (2) DAYS OF THE MOST RECENT DISTURBANCE IF THAT AREA WILL REMAIN IDLE FOR MORE THAN FOURTEEN (14) DAYS.
FOR ALL CONSTRUCTION ACTIVITIES, ANY DISTURBED AREAS INCLUDING SOIL STOCKPILES THAT WILL BE DORMANT FOR MORE THAN FOURTEEN (14) DAYS BUT LESS THAN ONE YEAR, AND NOT WITHIN FIFTY (50) FEET OF A STREAM.	WITHIN SEVEN (7) DAYS OF REACHING FINAL GRADE WITHIN THAT AREA

NOTE: NEGATIVE STABILIZATION TECHNIQUES MAY CAUSE STRUCTURAL INSTABILITY OR ARE OTHERWISE UNOBTAINABLE. ALTERNATIVE STABILIZATION TECHNIQUES MUST BE EMPLOYED. THESE TECHNIQUES MAY INCLUDE MULCHING OR EROSION MATTING.

SEEDING SCHEDULE

TYPE I MUD-CUT AND EMBANKMENT FILL AREAS (NONMETEORIC CHANNELS)	COMMON NAME	RATE OF PURE LIVE SEED (AS SUPPLIED)
FESTUCA ARUNDINACEA	TALL FESCUE	40-50 LBS

- NOTES:**
- ALL ACTIVITIES, MATERIALS, EQUIPMENT AND PERFORMANCE IN CONNECTION WITH ESTABLISHING TURF SHALL BE IN ACCORDANCE WITH THE SPECIFICATIONS.
 - PERMANENT SEEDING SPECIES AND RATES SHALL BE IN ACCORDANCE WITH THE SEEDING SPECIFICATION.
 - TEMPORARY TOPSOIL STOCKPILE SHALL BE SEED AT A RATE OF 150 POUNDS OF PURE LIVE SEED (PUL) PER ACRE IF LEFT UNDELETED FOR OVER 7 DAYS. SEEDING RATE SHALL BE IN ACCORDANCE WITH THE SEEDING SPECIFICATION.
 - ACTIVITIES ASSOCIATED WITH APPLICATION OF LIME, SEED, MULCH, COMPACTING, WATERING, MAINTENANCE AND PROTECTION SHALL BE IN ACCORDANCE WITH THE SPECIFICATIONS.
 - STABILIZATION SHALL BE IN ACCORDANCE WITH THE FOLLOWING TABLES.

PERMANENT/TEMPORARY SEEDING, FERTILIZING, & MULCHING

SCALE: N.E.A.

NOTES

1. THIS SCHEDULE APPLIES TO ALL AREAS THAT WILL BE DORMANT FOR ONE (1) YEAR OR MORE. THE TIME FRAME TO APPLY EROSION CONTROLS IS THE MOST RECENT DISTURBANCE.

2. ANY DISTURBED AREAS WITHIN FIFTY (50) FEET OF A STREAM AND AT FINAL GRADE.



3. ANY OTHER AREAS AT FINAL GRADE.

4. WITHIN SEVEN (7) DAYS OF REACHING FINAL GRADE WITHIN THAT AREA.

5. WHERE VEGETATIVE STABILIZATION TECHNIQUES MAY CAUSE STRUCTURAL INSTABILITY OR ARE OTHERWISE UNOBTAINABLE, ALTERNATIVE STABILIZATION TECHNIQUES MUST BE EMPLOYED. THESE TECHNIQUES MAY INCLUDE MULCHING OR EROSION MATTING.

LEGEND


- PREPARED JOINT SHALL BE APPROVED BY THE ENGINEER FOR THE PROJECT. THE JOINT SHALL BE APPROVED BY THE ENGINEER FOR THE PROJECT. THE JOINT SHALL BE APPROVED BY THE ENGINEER FOR THE PROJECT.
- JOINT SHALL BE APPROVED BY THE ENGINEER FOR THE PROJECT. THE JOINT SHALL BE APPROVED BY THE ENGINEER FOR THE PROJECT. THE JOINT SHALL BE APPROVED BY THE ENGINEER FOR THE PROJECT.

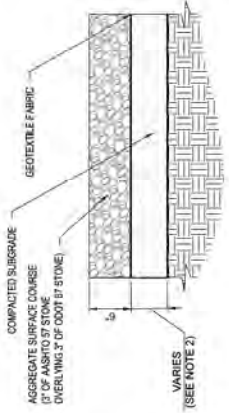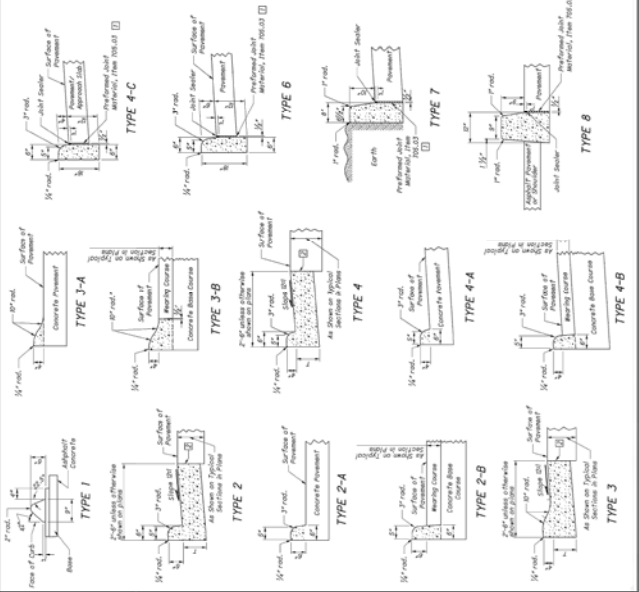

- SURFACE COURSE MATERIAL NOTES**
- NONWOVEN GEOTEXTILE SHALL BE MINIMUM OR ENGINEER-APPROVED EQUAL.
 - CONTRACTOR SHALL REMOVE TOPSOIL AND ROOT MASSES FROM ALL AREA, THEN REPLACE WITH ACCEPTABLE FILL MATERIAL PER THE GEOTECHNICAL REPORT. COMPACT SUBGRADE AND FILL MATERIAL TO AT LEAST 95% MAXIMUM DRY DENSITY PER ASTM D1556.

REG. DWG(S): PNG-C3-0001009 SHEET(S) 3 OF 3 DWG(S) NONE DATE: 02/04/2020 SUPERSEDED DRAWING NUMBER PNG -C-350-0001295 PROJECT NUMBER CHAMBERLAIN COUNTY, OHIO	
C350 PROJECT RESTORATION DETAILS 3 HAMILTON COUNTY, OHIO HAMILTON COUNTY, OHIO	
COPYRIGHT 2019	
NO. DATE A 06/17/2020 B 07/24/2020	REVISIONS/DESCRIPTION ISSUED FOR 50% REVIEW ISSUED FOR BD
BY: CJK / JPD AKT / CNS / JMP AKT / CNS / JMP	APPROVALS DATE: _____ CHECKER: _____ PROJECT NUMBER: 03890 PROJECT NUMBER: 1809115 STATION: _____ CHECKER INITIALS: J_MP
REGIONAL ENGINEER MGR. TECH. ENGINEER PRINCIPAL ENGINEER	REGIONAL ENGINEER MGR. TECH. ENGINEER PRINCIPAL ENGINEER
PROFESSIONAL ENGINEER STATE LICENSE # CCA, D/SST	

PIPE LOCATION	MIN. DEPTH OF COVER (A)
NORMAL	4'-0"
STREAM/WETLAND CROSSING	5'-0"
ROAD CROSSING	5'-0"
RAILROAD CROSSING	10'-0"
WITHIN 50' OF RAILROAD	6'-0"




PIPELINE DEPTH OF COVER

SCALE: N.T.S.



WARNING TAPE

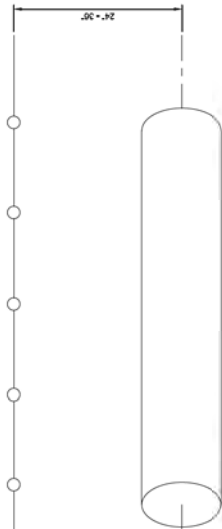


PIPELINE

NOTES:

- WARNING TAPE DEPTH MAY VARY BASED ON MANUFACTURER RECOMMENDATIONS OR AS OTHERWISE DIRECTED BY COMPANY.
- WARNING TAPE INSTALLATION NOT APPLICABLE FOR TRENCHLESS INSTALLATIONS.
- PIPE WARNING TAPE SHALL BE INSTALLED APPROXIMATELY 24"-36" ABOVE THE TOP OF THE PIPE. OTHER MANUFACTURER MATERIALS SHALL BE EQUAL TAPER OR APPROVED EQUIVALENT AND SHALL BE NON-TRACEABLE VARIETY.

UNDERGROUND WARNING TAPE INSTALLATION DETAIL

SCALE: N.T.S.

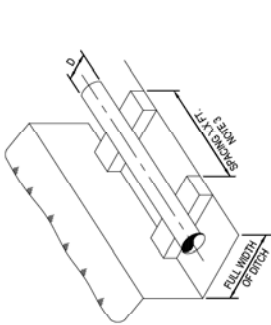


NOTES:

- ALL MATERIALS SHALL BE SUPPLIED BY CONTRACTOR.
- WIDTH SHALL BE INCREASED PROPORTIONAL TO SPACING INCREASE IF REQUIRED.
- SPACING TO BE 20' FOR 20" PIPE.

TYPICAL PIPELINE SUPPORT PILLOWS

SCALE: N.T.S.



NOTES:

- GEOTEXTILE PIPELINE WEIGHT TO BE 5000 POUNDS.
- GEOTEXTILE PIPELINE WEIGHT TO BE SPACED EVERY 34'.
- GEOTEXTILE PIPELINE WEIGHT TO BE FILLED WITH SAND OR GRAVEL.
- GEOTEXTILE PIPELINE WEIGHT VENDORS TO BE PIPEAK OR ECOBAG OR APPROVED BY OWNER.
- ROCK SHIELD SHALL BE APPLIED IN ALL LOCATIONS WITH BUOYANCY CONTROL.
- SPACING REQUIREMENTS SHALL ROUND CONSERVATIVELY OR EXTEND BEYOND PLANS DELINEATED WIDTH.

GEOTEXTILE PIPELINE WEIGHT

SCALE: N.T.S.

BURNS & MCDONNELL
ENGINEERING COMPANY, INC.
STATE LICENSE # 00A-01957

PROFESSIONAL REGISTERED ENGINEER

NO.	DATE	REVISION/DESCRIPTION	BY	CHK./APPD.	DESCRIPTION	DATE	INITIALS	APPROVALS
A	08/17/2020	ISSUED FOR BIDDING REVIEW	JAKT	CNS/JMP	AREA CODE	05690		REGIONAL SUPERVISOR
B	07/24/2020	ISSUED FOR BID	JAKT	CNS/JMP	ACCOUNT NUMBER	1880115		DESIGNER
			JAKT		DRAWING BY	JAKT		REC & STD
					STATION ID	C350		PRINCIPAL ENGINEER
					CHECKER/INITIALS	JMP	07/20/2020	CNS





C350 PROJECT
CONSTRUCTION DETAILS 1
HAMILTON COUNTY, OHIO
HAMILTON COUNTY, OHIO

REF. DWG(S): PNG-C-350-0001009

SHEET(S)	1 OF 10	DWG SCALE	NONE
DWG DATE	04-26-2018	SUPERSEDED	
DRAWING NUMBER	PNG - C-350-0001303		
REGION	B		

NOTES:

- CONTRACTOR TO NOTIFY EXISTING PIPELINE/UTILITY COMPANY PRIOR TO INSTALLATION OF CROSSING RAMP.
- LENGTH OF RAMP TO VARY IN ACCORDANCE WITH CROSSING ANGLE MINIMUM CROSSING ANGLE TO BE 45 DEGREES.
- VEHICLES OR EQUIPMENT USING CROSSINGS SHALL PROCEED SLOWLY AND WITH CAUTION TO MINIMIZE IMPACT LOADING AND REDUCTION ON DEPTH OF COVER OVER PIPE/UTILITY.
- ON COMPLETION OF CONSTRUCTION, CONTRACTOR TO REMOVE COMPLETE RAMP AND RESTORE AREA TO THE SATISFACTION OF THE EXISTING PIPELINE/UTILITY COMPANY AND THE COMPANY'S INSPECTOR.
- GEOTEXTILE FABRIC (AND GEOTEXTILE GRID WHERE REQUIRED) SHALL BE INSTALLED TO PROTECT NATIVE TOP SOIL AS DIRECTED BY COMPANY'S INSPECTOR WHEN IMPORTED GRANULAR FILL OR NATIVE SUBSOIL FILL MATERIAL IS UTILIZED. IMPORTED GRANULAR FILL MATERIAL OR NATIVE SUBSOIL FILL MATERIAL TO BE REMOVED AND DISPOSED OF AS DIRECTED BY COMPANY'S REPRESENTATIVE.
- IN ROCK TERRAIN THE CONTRACTOR SHALL UNDER THE EXISTING PIPELINE COMPANY'S SUPERVISION, EXPOSE THE TOP HALF OF THE PIPE AND BACKFILL WITH COMPACTED SAND OR APPROVED SOIL.

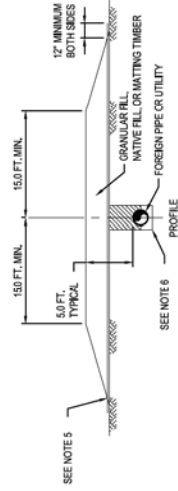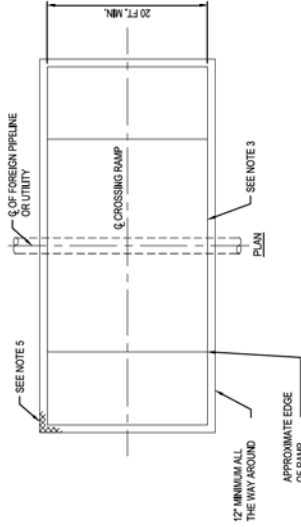

TEMPORARY RAMP CROSSING

SCALE: N.T.S.


NOTES:

- BURIED CABLE LOCATIONS & PIPE DEPTHS TO BE DETERMINED BY ELECTRONIC MEANS IN ORDER TO AVOID DAMAGE TO EXISTING UTILITIES. FIELD LOGS TO BE MAINTAINED THROUGHOUT THE PROJECT.
- OWNER OF BURIED CABLE(S) SHALL BE NOTIFIED 48 HOURS IN ADVANCE OF EXCAVATION OF CROSSING.
- DEPTH OF PRELIME INCLUDING 2'-0\"/>



CROSS SECTION OF BURIED CABLE R.O.W.

SCALE: N.T.S.

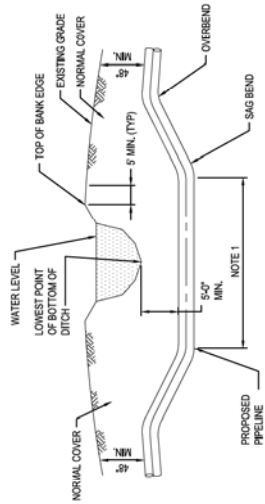


NOTE:
1. PIPELINE WEIGHTS OR ANCHORS TO BE INSTALLED PER PLANS OR AS DIRECTED BY COMPANY.

TYPICAL OPEN CUT STREAM CROSSING

SCALE: N.T.S.

NOTES:

- FOREIGN PIPELINE LOCATIONS & DEPTHS TO BE DETERMINED BY ELECTRONIC MEANS IN ORDER TO AVOID DAMAGE TO EXISTING UTILITIES. FIELD LOGS TO BE MAINTAINED THROUGHOUT THE PROJECT.
- OWNER OF FOREIGN PIPELINE(S) SHALL BE NOTIFIED 48 HOURS IN ADVANCE OF EXCAVATION OF CROSSING.
- TEST LEAD STATION TO BE INSTALLED WHERE PRACTICAL AT THE NEAREST FENCE HEDGE ROW OR FIELD EDGE AND WHERE READILY ACCESSIBLE. INSTALL PERMANENT REFERENCE CELL AND EXTEND CELL LEAD TO TEST LEAD STATION.
- DEPTH OF PRELIME INCLUDING 2'-0\"/>

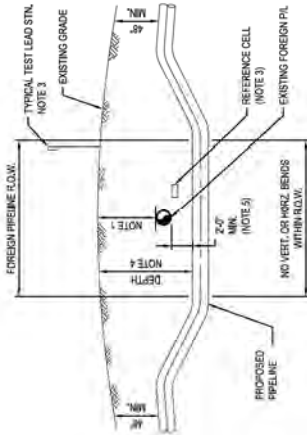

CROSSING FOREIGN PIPELINE

SCALE: N.T.S.

BURNS & MCGONNELL
ENGINEERING COMPANY, INC.
STATE LICENSE # CCA-01587
PROFESSIONAL REGISTERED ENGINEER

REV	DATE	ISSUED FOR	DESCRIPTION	BY	CHK.	APP'D.	DESCRIPTION	APPROVALS
A	08/17/2020	ISSUED FOR BIDDING REVIEW	JACT CNA/AREA CODE 03690					
B	07/29/2020	ISSUED FOR BID	JACT CNA/ACCOUNT NUMBER 03690					
			JACT CNA/ACCOUNT NUMBER 1380715					
			DRAWING BY JACT					
			STATION ID C350					
			CHECKER INITIALS JAMP					



DUKE ENERGY

Piedmont Natural Gas

Copyright 2018

C350 PROJECT
CONSTRUCTION DETAILS 2
HAMILTON COUNTY, OHIO
HAMILTON COUNTY, OHIO

REF: DWG(S): PNG-C-350-0001008
SHEETS: 2 OF 19
DWG SCALE: NONE
DWG DATE: 04-25-2018 (SUPERSEDED)
DRAWING NUMBER: PNG -C-350-0001304
REVISION: B
EXAMINER COUNTY: OHIO

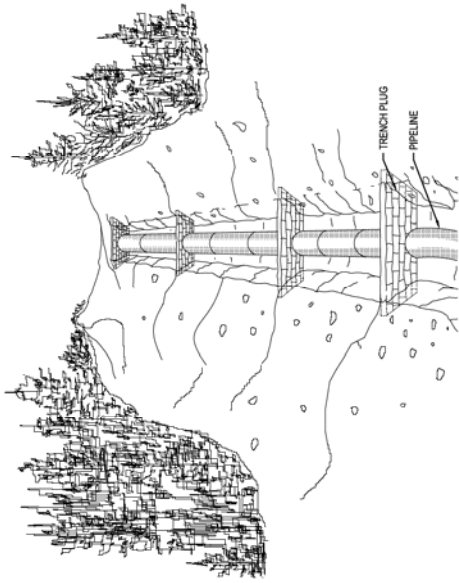



CROSS SECTION

KEY SLOT 17" DEEP X 12" WIDE INTO UNDISTURBED TRENCH WALL AND BOTTOM

- NOTES:
- TRENCH PLUGS SHALL BE INSTALLED:
 - ON SLOPES ALONG THE TRENCH LINE WHERE THE NATURAL DRAINAGE PATTERN, PROFILE, AND TYPE OF BACKFILL MATERIAL MAY RESULT IN LOSS OF BACKFILL MATERIAL OR ALTERATION OF THE NATURAL PATTERN;
 - WHERE NECESSARY TO AVOID DRAINAGE OF WETLANDS;
 - ON UPLAND SLOPES AT THE SAME SPACING AS SLOPE BREAKERS AND UP SLOPE OF SLOPE BREAKERS;
 - IN CULTIVATED LAND AND RESIDENTIAL AREAS WHERE PERMANENT SLOPE BREAKERS ARE NOT TYPICALLY INSTALLED, AT THE SAME SPACING AS IF PERMANENT SLOPE BREAKERS WERE REQUIRED.
 - PLUGS SHALL BE INSTALLED IN ACCORDANCE WITH THE CONSTRUCTION STANDARDS AND AS DIRECTED BY COMPANY'S INSPECTOR. SACK BREAKS SHALL UTILIZE OPEN WEAVE HEMP OR LITE SACKS FILLED WITH MINIMUM OF 98% OF SUBSOL SAND OR A MIXTURE OF 7 PART CEMENT TO 6 PARTS SAND OR SUBSOL AS DETERMINED BY COMPANY'S INSPECTOR. POLYURETHANE FOAM BREAKERS MAY BE USED IN-STEAD OF SACK BREAKERS, WHEN APPROVED BY COMPANY'S REPRESENTATIVE.
 - PLUG SPACING AND CONFIGURATION MAY BE CHANGED AS DIRECTED BY COMPANY. DEPTH OF DITCH-WAY VARY WITH SITE CONDITIONS.
 - ALL MATERIALS SHALL BE SUPPLIED BY CONTRACTOR.

TYPICAL TRENCH PLUG

SCALE: N.T.S.

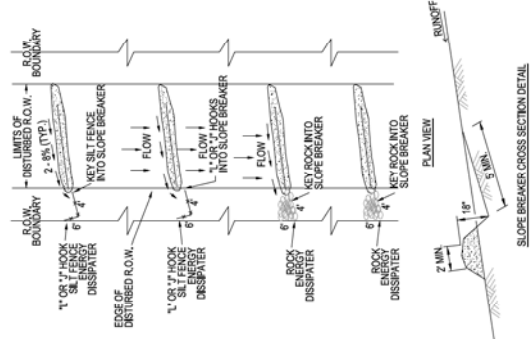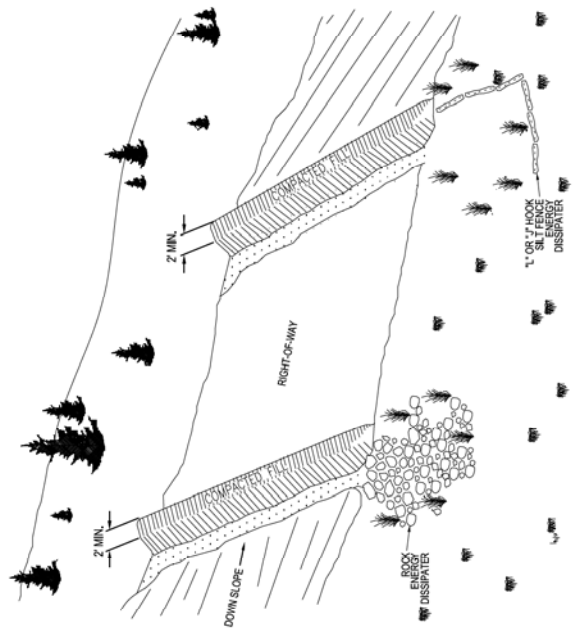

SLOPE BREAKER CROSS SECTION DETAIL

- NOTES:
- SLOPE BREAKERS SHALL BE CONSTRUCTED OF COMPACTED NATIVE SOIL AND INSTALLED AT LOCATIONS AS REQUIRED BY DUKE CONSTRUCTION STANDARDS OR AS DIRECTED BY THE COMPANY'S REPRESENTATIVE.
 - SLOPE BREAKERS SHALL BE ORIENTED AS SHOWN OR OTHER PATTERN AS DIRECTED BY THE COMPANY'S REPRESENTATIVE TO DIRECT THE WATER OFF THE RIGHT-OF-WAY.
 - SLOPE BREAKERS SHALL BE CONSTRUCTED AT 2% GRAZENT ACROSS THE SLOPE.
 - THE SLOPE BREAKERS SHALL BE 18" DEEP (AS MEASURED FROM THE TROUGH TO THE TOP OF THE SLOPE BREAKER), THE THROUGH WILL BE A MINIMUM OF 6" WIDE ACROSS THE WIDTH OF THE RIGHT-OF-WAY.
 - THE OUTLET OF THE SLOPE BREAKER MUST FREELY DISCHARGE ALL RUNOFF OFF THE DISTURBED RIGHT-OF-WAY INTO AN ENERGY DISSIPATER.
 - WHERE SLOPE BREAKERS EXTEND BEYOND THE EDGE OF THE CONSTRUCTION RIGHT-OF-WAY TO DIRECT RUNOFF INTO STABLE, WELL VEGETATED AREAS, THESE LOCATIONS MUST BE APPROVED BY THE COMPANY'S REPRESENTATIVE.
- FLOW ENERGY DISSIPATER NOTES:
- THE OUTLET SHALL CONTAIN AN ENERGY DISSIPATER IF THE COMPANY'S INSPECTOR DETERMINES EXISTING VEGETATION IS NOT SUFFICIENTLY STABLE TO PREVENT EROSION. THE ENERGY DISSIPATER SHALL BE CONSTRUCTED AS FOLLOWS:
 - OUTFALL END OF DISSIPATER SHOULD BE LOWER THAN SLOPE BREAKER END.
 - SILT FENCE OR ROCK DISSIPATER SHOULD BE VETED INTO THE END OF THE SLOPE BREAKER.
 - PROVIDE ENOUGH AREA INSIDE L' TO CAPTURE AND LOAD SEDIMENT.

TYPICAL SLOPE BREAKER

SCALE: N.T.S.

REF. DWG(S):	PNG-C-350-0001305
SHEET(S):	3 OF 10
DWG DATE:	04-25-2018
DWG DATE:	04-25-2018
DRAWING NUMBER:	PNG - C-350-0001305
REVISION:	B
EXAMINER:	TONY LYONS

C350 PROJECT
CONSTRUCTION DETAILS 3
HAMILTON COUNTY, OHIO

Duke Energy
 Piedmont Natural Gas

Copyright 2018


NO.	DATE	DESCRIPTION	BY	CHK.	APP.	DESCRIPTION
A.	08/17/2020	ISSUED FOR BIDDING REVIEW	JAKT	CHS	AMP	AREA CODE
B.	07/24/2020	ISSUED FOR BID	JAKT	CHS	AMP	CONTRACT NUMBER
						03650
						NUMBER
						1880115
						STATION
						JAKT
						STATION ID
						C350
						CHECKER INITIALS
						AMP

REGIONAL SUPERVISOR REC & STD
 PRINCIPAL ENGINEER

REGISTRATION NUMBER: PNC-C-350-0001305


BURNS & MCDONNELL ENGINEERING COMPANY, INC. STATE LICENSE # 0041-01567

PROFESSIONAL ENGINEER 67167

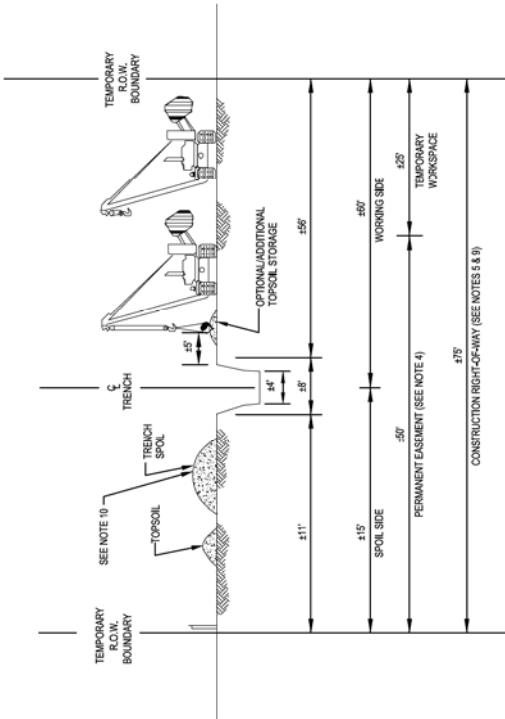

- NOTES:**
1. UNLESS THE TRENCH ONLY TOPSOIL SEPARATION METHOD AT LOCATIONS SUCH AS RIP-RAP AREAS OR UNMANAGED WOODLAND. WHERE IDENTIFIED ON THE CONSTRUCTION DRAWINGS OR AS DIRECTED BY THE COMPANY'S REPRESENTATIVE.
 2. THE TRENCH ONLY METHOD IS NOT TO BE USED ON AGRICULTURAL LAND EXCEPT AS DIRECTED BY THE COMPANY INSPECTOR (PFI/ LANDOWNER REQUEST).
 3. FOR TRENCH ONLY STRIPPING THE STRIPPED AREA SHALL BE WIDE ENOUGH TO ACCOMMODATE TRAPPING EQUIPMENT.
 4. CONSTRUCTION RIGHT-OF-WAY WILL TYPICALLY BE 80 FEET WIDE CONSISTING OF 50 FEET PERMANENT EASEMENT AND 25 FEET OF TEMPORARY WORKSPACE. EXTRA TEMPORARY WORKSPACE SHALL BE NECESSARY AT MAJOR ROAD, RAIL AND RIVER CROSSINGS AND OTHER SPECIAL CIRCUMSTANCES, AS REQUIRED. CERTAIN SITUATIONS MAY REQUIRE A WIDER WIDTH.
 5. STOCKPILE TOPSOIL AS SHOWN OR IN ANY CONFIGURATION APPROVED BY THE COMPANY'S INSPECTOR. KEEP TOPSOIL CLEAN OF ALL CONSTRUCTION DEBRIS.
 6. LEAVE GAPS IN TOPSOIL AND SPOIL PILES AT OBVIOUS DRAINAGES. DO NOT PUSH TOPSOIL INTO CREEKS OR WETLANDS. DO NOT USE TOPSOIL FOR PADDING.
 7. AVOID SCALPING VEGETATED GROUND SURFACE WHEN BACKFILLING SPOIL AND TOPSOIL PILES.
 8. SAME LAYOUT APPLIES WHERE CONSTRUCTION R.O.W. DOES NOT ABUT EXISTING R.O.W.
 9. TEMPORARILY SUSPEND TOPSOIL HANDLING OPERATIONS DURING INSTANTANEOUSLY WINDY CONDITIONS UNTIL MITIGATIVE MEASURES TO MINIMIZE WIND EROSION CAN BE IMPLEMENTED.
 10. TOPSOIL AND TRENCH SPOIL RELATIVE POSITIONS CAN, AS DIRECTED BY THE COMPANY'S INSPECTOR, BE REVERSED.

TYPICAL 75' WORKSPACE TOPSOIL SEPARATION
SCALE: N:1.5

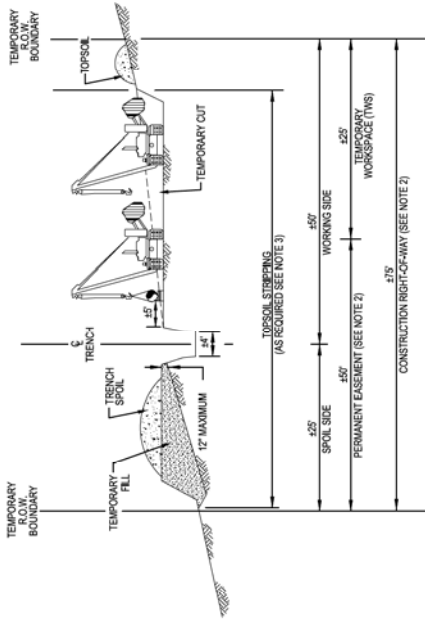

- NOTES:**
1. SIDE HILL CONSTRUCTION CUT AND FILL SHALL BE ALLOWED WHENEVER, IN THE OPINION OF THE COMPANY, THE SIDE HILL CONSTRUCTION IS WARRANTED FOR PERSONNEL.
 2. CONSTRUCTION RIGHT-OF-WAY WILL TYPICALLY BE 75 FEET WIDE CONSISTING OF 50 FEET OF PERMANENT EASEMENT AND 25 FEET OF TEMPORARY WORKSPACE. EXTRA TEMPORARY WORKSPACE WILL BE NECESSARY AT MAJOR ROAD, RAIL AND RIVER CROSSINGS AND OTHER SPECIAL CIRCUMSTANCES, AS REQUIRED. CERTAIN SITUATIONS MAY REQUIRE A WIDER WIDTH.
 3. THIS DRAWING REFLECTS TRENCH SPOIL AND WORKING SIDE TOPSOIL STRIPPING PROCEDURE AS NEEDED FOR HILL SIDE LEVELING. SKAVACE TOPSOIL OVER TRENCH UNDER THE SPOIL PILE AND FROM TEMPORARY CUT AND FILL AREAS AT LOCATIONS IDENTIFIED ON THE CONSTRUCTION ALIGNMENT SHEETS OR AS DIRECTED BY THE COMPANY'S REPRESENTATIVE.
 4. THIS DRAWING IS SHOWN OR IN ANY CONFIGURATION APPROVED BY THE COMPANY'S REPRESENTATIVE. KEEP TOPSOIL CLEAN OF ALL CONSTRUCTION DEBRIS.
 5. LEAVE GAPS IN TOPSOIL AND SPOIL PILES AT OBVIOUS DRAINAGES. DO NOT PUSH TOPSOIL INTO CREEKS OR WETLANDS. DO NOT USE TOPSOIL FOR PADDING. AVOID SCALPING VEGETATED GROUND SURFACE WHEN BACKFILLING TOPSOIL PILE.

TYPICAL SIDE HILL CONSTRUCTION
SCALE: N:1.5


NO.	DATE	REVISION/DESCRIPTION	BY	CHK./APP'D	DESCRIPTION
A.	08/17/2020	ISSUED FOR BIDD REVIEW	JAKT	CNS/JMP	AREA CODE
B.	07/29/2020	ISSUED FOR BID	JAKT	JMP	CONS/ACCOUNT NUMBER
					03690
					PROJECT NUMBER
					1880715
					DRAWING BY
					JAKT
					STATION ID
					C350
					CHECKER/INITIALS
					JMP

DUKE ENERGY
Piedmont Natural Gas
COPYRIGHT 2018

**C350 PROJECT
CONSTRUCTION DETAILS 4
HAMILTON COUNTY, OHIO**
HAMILTON COUNTY, OHIO


SHEETS: 4 OF 10 | DWG SCALE: NONE
DWG DATE: 04-20-2018 | SUPERSEDED: _____
DRAWING NUMBER: PNG-C-350-0001306
REVISION: B

REF: DWG057: PNG-C-350-0001306

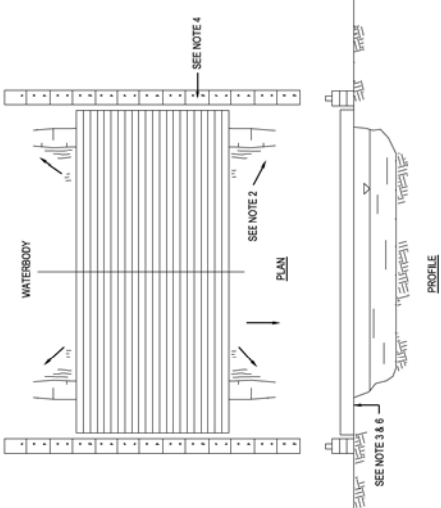


- THIS TYPE OF BRIDGE IS GENERALLY USED ON NARROW CROSSINGS, LESS THAN 20 FEET WIDE, WITH APPROPRIATE BANK CONFIGURATION. MULTIPLE MATS MAY BE LAYERED FOR HEAVIER EQUIPMENT CROSSINGS.
- BRIDGE IS ANCHORED AND/OR TIED OFF TO ANCHOR BLOCKS FOR STABILITY. BRIDGE SHOULD BE TEMPORARILY REMOVED IF HIGH WATER REMAINS IT UNSAFE TO USE.
- IF REQUIRED, UTILIZE APPROACH FILLS OF CLEAN GRANULAR MATERIAL, SWAMP MATS, SKIDS OR OTHER SUITABLE MATERIALS TO AVOID CUTTING THE BANKS WHEREVER FEASIBLE. ENSURE ADEQUATE FREEBOARD, AS REQUIRED, INSURE THAT FILL MATERIAL IF USED DOES NOT INTERFERE WITH REMOVAL OF DIRT FROM UNDERLAPPING OPERATION.
- CONSTRUCT SEDIMENT BARRIERS ACROSS THE ENTIRE CONSTRUCTION R.O.W. TO PREVENT SILT, LOESS AND SOIL FROM FLOWING BACK INTO WATERBODY. BARRIERS MAY BE CONSTRUCTED FROM SAND BAGS OR SAND BARRIERS. SAND BAGS OR SAND BARRIERS MAY BE USED AT THE END OF EACH WORK DAY. SILT FENCE, HAY BALES OR SAND BAGS MAY BE USED INTERCHANGEABLY.
- REMOVE BRIDGES AS SOON AS POSSIBLE AFTER PERMANENT SEEDING UNLESS OTHERWISE DIRECTED BY COMPANY REPRESENTATIVE. THE STRUCTURE IS TO BE REMOVED IF THERE IS ACCESS TO THE CONSTRUCTION R.O.W. IS AVAILABLE.
- DISPOSE OF ANY ROCK AS DIRECTED BY COMPANY REPRESENTATIVE.
- RESTORE AND STABILIZE BED AND BANKS TO APPROXIMATE PRE-CONSTRUCTION CONDITIONS.

TYPICAL TIMBER MAT WATERBODY BRIDGE
SCALE: N/A

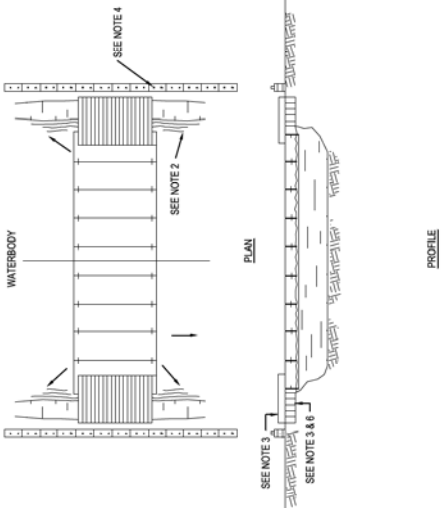

- THIS TYPE OF BRIDGE IS GENERALLY USED ON WIDE, DEEP CROSSINGS.
- BRIDGE IS ANCHORED AND/OR TIED OFF TO ANCHOR BLOCKS FOR STABILITY.
- UTILIZE APPROACH FILLS OF CLEAN GRANULAR MATERIAL, SWAMP MATS, SKIDS OR OTHER SUITABLE MATERIALS TO AVOID CUTTING THE BANKS WHEREVER FEASIBLE. ENSURE ADEQUATE FREEBOARD, AS REQUIRED, INSURE THAT FILL MATERIAL IF USED, DOES NOT SPILL INTO WATERCOURSE.
- CONSTRUCT SEDIMENT BARRIERS ACROSS THE ENTIRE CONSTRUCTION R.O.W. TO PREVENT SILT, LOESS WATER AND SOIL FROM FLOWING BACK INTO WATERBODY. BARRIERS MAY BE TEMPORARILY REMOVED TO ALLOW CONSTRUCTION ACTIVITIES BUT MUST BE REPLACED BY THE END OF EACH WORK DAY. SILT FENCE, HAY BALES OR SAND BAGS MAY BE USED INTERCHANGEABLY.
- REMOVE FLOATING BRIDGES AS SOON AS POSSIBLE AFTER PERMANENT SEEDING UNLESS OTHERWISE DIRECTED BY COMPANY REPRESENTATIVE. THE STRUCTURE IS TO BE REMOVED IF THERE IS MORE THAN ONE MONTH BETWEEN FINAL GRADING AND SEEDING AND AN ALTERNATIVE ACCESS TO THE CONSTRUCTION R.O.W. IS AVAILABLE.
- DISPOSE OF ANY ROCK AS DIRECTED BY COMPANY REPRESENTATIVE.
- RESTORE AND STABILIZE BED AND BANKS TO APPROXIMATE PRE-CONSTRUCTION CONDITIONS.

TYPICAL FLEX-FLOAT WATERBODY BRIDGE
SCALE: N/A

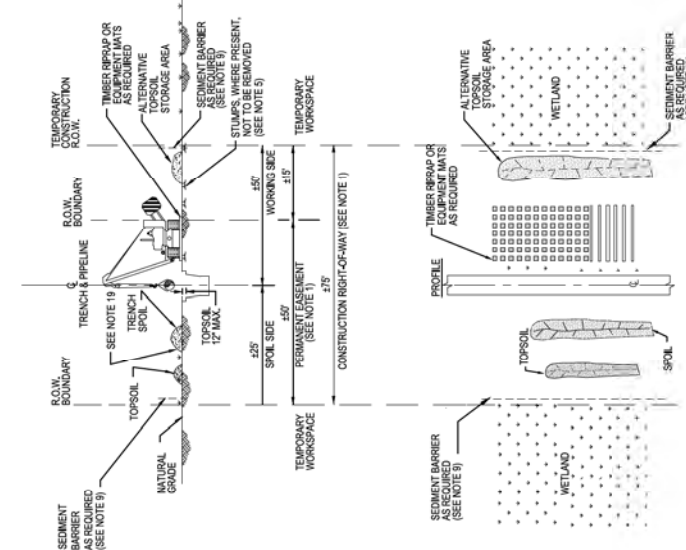

- CONSTRUCTION RIGHT-OF-WAY WILL TYPICALLY BE 75 FEET WIDE CONSISTING OF 50 FEET OF PERMANENT EASEMENT AND UP TO 25 FEET OF TEMPORARY WORKSPACE.
- THE SAME LAYOUT APPLIES WHETHER CONSTRUCTION R.O.W. JOBS OR DOES NOT ABUT A FOREBAY R.O.W.
- LOCATE ANY EXTRA TEMPORARY WORK SPACE AREAS AT LEAST 25 FEET FROM EDGE OF WETLAND AND WITHIN THE APPLICABLE FULL WIDTH CONSTRUCTION R.O.W.
- CLEARING OF VEGETATION AND TREES IS PROHIBITED BETWEEN TEMPORARY EXTRA WORK SPACE AND THE EDGE OF THE WETLAND.
- CUT VEGETATION AND TREES OFF AT GROUND LEVEL, LEAVING EXISTING ROOTS INTACT WHERE PRACTICABLE, AND REMOVE CUTTINGS FROM THE WETLAND FOR DISPOSAL.
- LIMIT CONSTRUCTION EQUIPMENT TO ONE PASS THROUGH WETLANDS TO THE EXTENT PRACTICABLE.
- NO REUSE OF EQUIPMENT WITHIN 100 FEET OF WETLAND EXCEPT IN ACCORDANCE WITH THE SPEC PLAN.
- IF SATURATED AT TIME OF CONSTRUCTION, REDUCE SOIL COMPACTION BY UTILIZING WIDE TRACK OR BALLOON TIRE CONSTRUCTION EQUIPMENT OR NORMAL EQUIPMENT OPERATED ON TIMBER RIPRAP OR EQUIPMENT MATS.
- AVOID ADJACENT WETLANDS. INSTALL SEDIMENT BARRIERS IMMEDIATELY AFTER INITIAL GROUND DISTURBANCE AND AT THE EDGE OF THE CONSTRUCTION R.O.W. ALONG THE WETLAND AS DIRECTED BY THE COMPANY'S INSPECTOR.
- THIS DRAWING REFLECTS TRENCH ONLY. TOPSOIL STRIPPING PROCEDURE FOR AREAS WHERE STANDING WATER OR SATURATED SOIL ARE NOT PRESENT.
- SAVE USE UP TO 1 FT OF TOPSOIL OVER TRENCH AT LOCATIONS DESCRIBED ON THIS DRAWING. CONSTRUCTION CHANGES OR AS DIRECTED BY THE COMPANY'S INSPECTOR. MAINTAIN SEPARATION BETWEEN TOPSOIL AND TRENCH SPILL.
- LEAVE GAPS IN TOPSOIL AND SPILL PILES AT OBVIOUS DRAINAGES. DO NOT USE TOPSOIL FOR PADDING. AVOID SCALPING VEGETATED GROUND SURFACE WHEN EXCAVATING SPILL PILE.
- IN UNSATURATED CONDITIONS, SPILL MAY BE USED TO STABILIZE THE WORKING SIDE.
- IF SATURATED AT TIME OF CONSTRUCTION, LEAVE HARD PILES AT THE EDGE OF WETLAND UNTIL JUST PRIOR TO TRENCHING.
- TRENCH THROUGH WETLANDS.
- LOWER PIPE INSTALL TRENCH BRIDGES AT WETLAND EDGES AS DIRECTED BY COMPANY INSPECTOR TO PREVENT DRAINAGE BACKFILL UPON COMPLETION OF CONSTRUCTION.
- REMOVE ALL TIMBER, RIPRAP OR EQUIPMENT MATS FROM WETLANDS UPON COMPLETION OF CONSTRUCTION.
- RESTORE GRADE TO NEAR PRE-CONSTRUCTION TOPOGRAPHY AND REPLACE TOPSOIL, WHERE SALVAGED, WITHOUT A COVER OVER THE TRENCH.
- IF STANDING WATER IS NOT PRESENT, SEED AS SPECIFIED.
- TOPSOIL AND TRENCH SOIL, RESOLVE POSITIONS CAN, AS DIRECTED BY THE COMPANY'S INSPECTOR, BE REVERSED.


TYPICAL WETLAND CROSSING
SCALE: N/A

- CONSTRUCTION RIGHT-OF-WAY WILL TYPICALLY BE 75 FEET WIDE CONSISTING OF 50 FEET OF PERMANENT EASEMENT AND UP TO 25 FEET OF TEMPORARY WORKSPACE.
- THE SAME LAYOUT APPLIES WHETHER CONSTRUCTION R.O.W. JOBS OR DOES NOT ABUT A FOREBAY R.O.W.
- LOCATE ANY EXTRA TEMPORARY WORK SPACE AREAS AT LEAST 25 FEET FROM EDGE OF WETLAND AND WITHIN THE APPLICABLE FULL WIDTH CONSTRUCTION R.O.W.
- CLEARING OF VEGETATION AND TREES IS PROHIBITED BETWEEN TEMPORARY EXTRA WORK SPACE AND THE EDGE OF THE WETLAND.
- CUT VEGETATION AND TREES OFF AT GROUND LEVEL, LEAVING EXISTING ROOTS INTACT WHERE PRACTICABLE, AND REMOVE CUTTINGS FROM THE WETLAND FOR DISPOSAL.
- LIMIT CONSTRUCTION EQUIPMENT TO ONE PASS THROUGH WETLANDS TO THE EXTENT PRACTICABLE.
- NO REUSE OF EQUIPMENT WITHIN 100 FEET OF WETLAND EXCEPT IN ACCORDANCE WITH THE SPEC PLAN.
- IF SATURATED AT TIME OF CONSTRUCTION, REDUCE SOIL COMPACTION BY UTILIZING WIDE TRACK OR BALLOON TIRE CONSTRUCTION EQUIPMENT OR NORMAL EQUIPMENT OPERATED ON TIMBER RIPRAP OR EQUIPMENT MATS.
- AVOID ADJACENT WETLANDS. INSTALL SEDIMENT BARRIERS IMMEDIATELY AFTER INITIAL GROUND DISTURBANCE AND AT THE EDGE OF THE CONSTRUCTION R.O.W. ALONG THE WETLAND AS DIRECTED BY THE COMPANY'S INSPECTOR.
- THIS DRAWING REFLECTS TRENCH ONLY. TOPSOIL STRIPPING PROCEDURE FOR AREAS WHERE STANDING WATER OR SATURATED SOIL ARE NOT PRESENT.
- SAVE USE UP TO 1 FT OF TOPSOIL OVER TRENCH AT LOCATIONS DESCRIBED ON THIS DRAWING. CONSTRUCTION CHANGES OR AS DIRECTED BY THE COMPANY'S INSPECTOR. MAINTAIN SEPARATION BETWEEN TOPSOIL AND TRENCH SPILL.
- LEAVE GAPS IN TOPSOIL AND SPILL PILES AT OBVIOUS DRAINAGES. DO NOT USE TOPSOIL FOR PADDING. AVOID SCALPING VEGETATED GROUND SURFACE WHEN EXCAVATING SPILL PILE.
- IN UNSATURATED CONDITIONS, SPILL MAY BE USED TO STABILIZE THE WORKING SIDE.
- IF SATURATED AT TIME OF CONSTRUCTION, LEAVE HARD PILES AT THE EDGE OF WETLAND UNTIL JUST PRIOR TO TRENCHING.
- TRENCH THROUGH WETLANDS.
- LOWER PIPE INSTALL TRENCH BRIDGES AT WETLAND EDGES AS DIRECTED BY COMPANY INSPECTOR TO PREVENT DRAINAGE BACKFILL UPON COMPLETION OF CONSTRUCTION.
- REMOVE ALL TIMBER, RIPRAP OR EQUIPMENT MATS FROM WETLANDS UPON COMPLETION OF CONSTRUCTION.
- RESTORE GRADE TO NEAR PRE-CONSTRUCTION TOPOGRAPHY AND REPLACE TOPSOIL, WHERE SALVAGED, WITHOUT A COVER OVER THE TRENCH.
- IF STANDING WATER IS NOT PRESENT, SEED AS SPECIFIED.
- TOPSOIL AND TRENCH SOIL, RESOLVE POSITIONS CAN, AS DIRECTED BY THE COMPANY'S INSPECTOR, BE REVERSED.

C350 PROJECT
CONSTRUCTION DETAILS 6
HAMILTON COUNTY, OHIO
HAMILTON COUNTY, OHIO




NO.	DATE	REVISION/DESCRIPTION	BY	CHK.	APP'D.	DESCRIPTION
A	08/17/2020	ISSUED FOR WAY REVIEW	JAKT	CNS	JMP	AREA CODE
B	07/29/2020	ISSUED FOR BID	JAKT	CNS	JMP	ACCOUNT NUMBER: 03660
			JAKT	CNS	JMP	WORK ORDER NUMBER: 180715
			JAKT	CNS	JMP	DRAWING BY: JAKT
			JAKT	CNS	JMP	STATION ID: C350
			JAKT	CNS	JMP	CHECKER INITIALS: JAKT

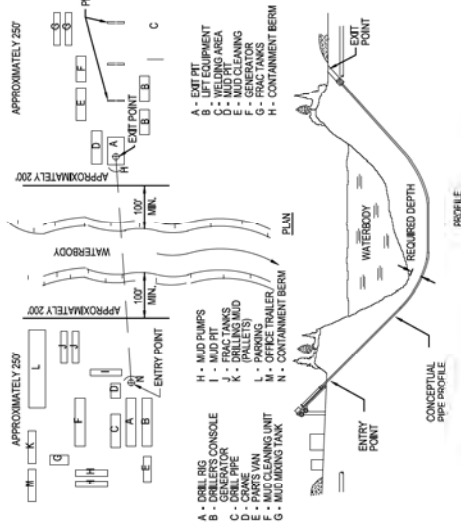

NOTES:

- SET UP DRILLING EQUIPMENT A MINIMUM OF 100 FEET FROM THE EDGE OF THE WATERBODY. DO NOT CLEAN OR GRADE WITHIN THE 100 FOOT ZONE.
- ENSURE THAT ONLY BENTONITE BASED DRILLING MUDS USED. DO NOT ALLOW THE USE OF ANY ADDITIVES TO THE DRILLING MUD WITHOUT THE APPROVAL OF COMPANY'S INSPECTOR.
- INSTALL SUITABLE DRILLING MUD TANKS OR SWUMPS TO PREVENT CONTAMINATION OF WATERBODY.
- INSTALL BERMS DOWN-SLOPE FROM THE DRILL ENTRY AND ANTICIPATED EXIT POINTS TO CONTAIN ANY RELEASE OF DRILLING MUD.
- OBSEDE OF DRILLING MUD IN ACCORDANCE WITH THE APPROPRIATE REGULATORY AUTHORITY REQUIREMENTS.

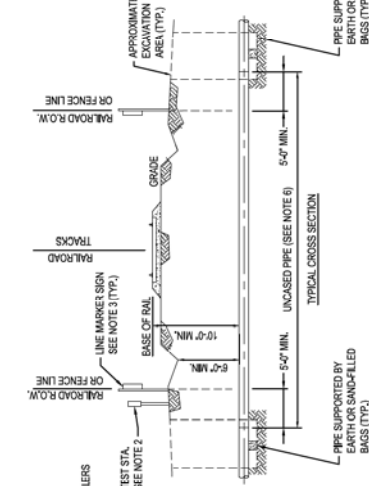


NOTES:

- WHERE CONTRACTOR MAY EXIST, PERMIT SPECIFICATIONS SHALL ALWAYS GOVERN THE DRAWING.
- CATHODIC TEST STATION TO BE INSTALLED IF REQUIRED. SEE TYPICAL DRAWING PNG-C-350-000101L.
- PIPELINE MARKER TO BE INSTALLED PER TYPICAL DRAWING PNG-C-350-0001311 (IF REQUIRED).
- ANY EXCAVATION WITHIN THE LIMITS OF THE R.O.W. SHALL BE REPAIRED WITH BACKFILL SPECIFIED BY THE ENGINEER AND COMPACTED IN 8-INCH LAYERS.
- SAND BAG SUPPORT SHALL BE PLACED ON UNDISTURBED SOIL UNDER THE CARRIER PIPE TO AVOID SAGGING WHEN BACKFILLED.
- PIPE TO BE IN ACCORDANCE WITH SPECIFIC STATE REQUIREMENTS.
- THE ANGLE OF INTERSECTION BETWEEN A PIPELINE CROSSING AND THE RAILROAD TO BE CROSSED SHOULD BE AS NEAR TO 90 DEGREES AS PRACTICABLE. IN NO CASE SHOULD IT BE LESS THAN 30 DEGREES.
- UNCAUSED GAS PIPES SHALL NOT BE LESS THAN 10 FEET FROM THE BASE OF RAIL TO THE TOP OF THE PIPE AT ITS CLOSEST POINT AT ALL OTHER LOCATIONS WHERE CROSSING THE RIGHT-OF-WAY. THE MINIMUM GROUND COVER MUST BE 6 FEET.

CONCEPTUAL CROSSING METHOD FOR HORIZONTAL DIRECTIONAL DRILL

SCALE: N.T.S.

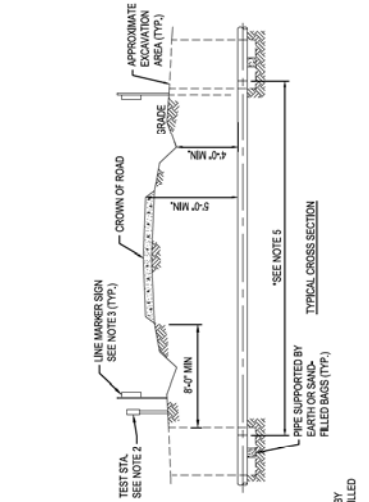


NOTES:

- CARRIER PIPE IS TO BE COATED WITH APPROVED EXTERNAL PROTECTIVE COATING.
- CATHODIC TEST STATION TO BE INSTALLED IF REQUIRED. SEE TYPICAL DRAWING PNG-C-350-000101L.
- PIPELINE MARKER TO BE INSTALLED PER TYPICAL DRAWING PNG-C-350-0001311 (IF REQUIRED).
- INSTALL PIPELINE MARKER & TEST STATIONS ON ROW LINE NEXT TO FENCE IF POSSIBLE.
- CROSSING SHALL BE INSTALLED BY OPEN CUTTING.
- PIPE WALL THICKNESS AND GRADE SHALL BE AS SPECIFIED ON ALIGNMENT DRAWINGS.
- CROSSING TO BE AS NEAR TO 90° TO THE CENTERLINE OF ROADWAY AS PRACTICAL.
- CONTRACTOR TO FURNISH AND THOROUGHLY COMPACT SAND BAGG TELL AT ALL IN VET CONDITIONS. USE SAND BAG SUPPORTS AT 10' INTERVALS IN LIEU OF CONTINUOUS SAND BAGG TELL AT THE DISCRETION OF THE COMPANY REPRESENTATIVE.

CONCEPTUAL UNCAUSED BORED ROAD CROSSING

SCALE: N.T.S.

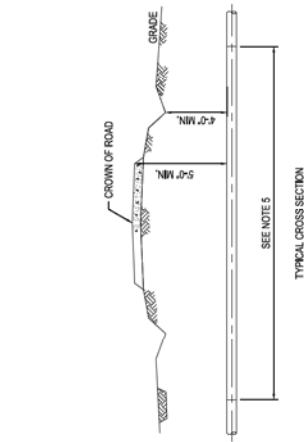

NOTES:

- CARRIER PIPE IS TO BE COATED WITH APPROVED EXTERNAL PROTECTIVE COATING.
- CATHODIC TEST STATION TO BE INSTALLED IF REQUIRED. SEE TYPICAL DRAWING PNG-C-350-000101L.
- PIPELINE MARKER TO BE INSTALLED PER TYPICAL DRAWING PNG-C-350-0001311 (IF REQUIRED).
- INSTALL PIPELINE MARKER & TEST STATIONS ON ROW LINE NEXT TO FENCE IF POSSIBLE.
- CROSSING SHALL BE INSTALLED BY OPEN CUTTING.
- PIPE WALL THICKNESS AND GRADE SHALL BE AS SPECIFIED ON ALIGNMENT DRAWINGS.
- CROSSING TO BE AS NEAR TO 90° TO THE CENTERLINE OF ROADWAY AS PRACTICAL.
- EXCAVATION WITHIN THE LIMITS OF THE ROAD EASEMENT SHALL BE REPLACED WITH BACKFILL SPECIFIED BY THE ENGINEER AND COMPACTED IN 8-INCH LAYERS.

CONCEPTUAL OPEN CUT ROAD CROSSING

SCALE: N.T.S.

BURNS & MCDONNELL ENGINEERING COMPANY, INC. STATE LICENSE # 0041 01587

NO.	DATE	ISSUED FOR	DESCRIPTION
A	10/01/2020	ISSUED FOR BIDDING REVIEW	
B	10/29/2020	ISSUED FOR BID	

BY	CHK.	APP'D	DESCRIPTION	DATE	APPROVALS
JACK CAMP			DESIGN NUMBER: 03690		
JACK CAMP			DESIGN NUMBER: 180715		
			STATIONING: C350		
			CHECKER INITIALS: JMC		






DUKE ENERGY
Piedmont Natural Gas
COPYRIGHT 2018

C350 PROJECT CONSTRUCTION DETAILS 7 HAMILTON COUNTY, OHIO
HAMILTON COUNTY, OHIO

REF. DWG(S): PNG-C-350-000100B	
SHEETS: 7 OF 10	DWG SCALE: NONE
DWG DATE: 10-29-2018	ISSUED FOR: BIDDING
PROJECT NUMBER: PNG-C-350-0001309	
REVISION: HAMILTON COUNTY, OHIO	

SIZE	"K" NO. OF ROWS	SIZE OF FINISHED LOOPS	"N" NO. OF ROWS	CIRCUMFERENCE OF FINISHED LOOPS
4"	12	18"	3	60"
6"	10	24"	4	66"
8"	8	30"	4	72"
10"	6	37"	4	80"
12"	5	45"	4	88"
	5	54"	4	96"

* PIPE GREATER THAN 20" WILL BE 4 ROWS.

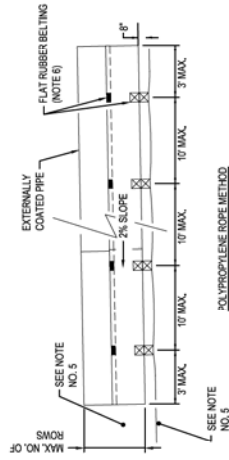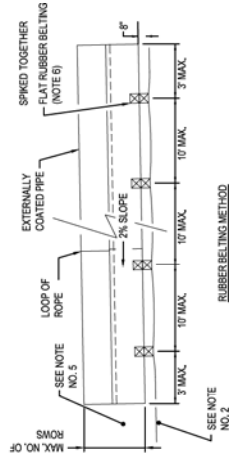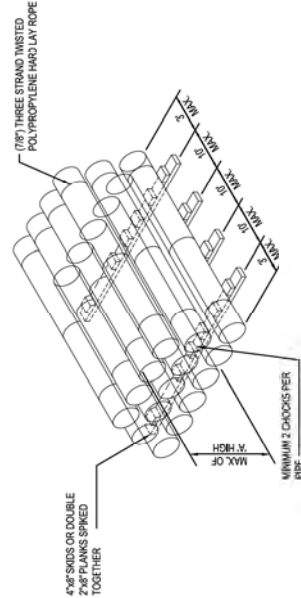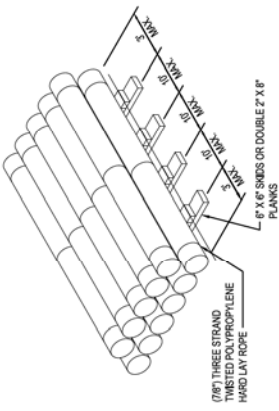

CIRCUMFERENCE OF LOOPS WITH THE FOLLOWING TABLE	
PIPE O.D.	20" 24" 30" 36" 42" 48" 54" 60" 66" 72" 78" 84" 90" 96" 102" 108" 114" 120"
CIRCUMFERENCE OF FINISHED LOOPS	36" 48" 60" 72" 84" 96" 108" 120" 132" 144" 156" 168" 180" 192" 204" 216" 228" 240"

- NOTES:
- ALL PIPE THAT IS BARRIS AFTER A CONSTRUCTION PROJECT MUST BE PERMANENTLY STOCKPILED.
 - THE USE OF ALTERNATE METHODS FOR STOCKPILING PIPE AND/OR THE USE OF ALTERNATE MATERIALS FOR PREVENTING PIPE TO PIPE CONTACT SHALL REQUIRE THE APPROVAL OF THE COMPANY REPRESENTATIVE.
 - NUMBER OF ROWS TO BE SPECIFIED BY COMPANY.
 - ALL MATERIALS SHALL BE FURNISHED BY CONTRACTOR.
 - EARTHEN BERMS WILL BE ACCEPTABLE ALTERNATIVES AS APPROVED BY COMPANY REPRESENTATIVE.

ROPE INSTALLATION

ROPE SPACING SHOULD BE A MAXIMUM OF 6.0 FEET FROM THE PIPE ENDS AND A MAXIMUM OF 6.0 FEET FROM GIRTH WELDS. THE INTERVALS BETWEEN RINGS SHOULD BE BETWEEN 10.0 FEET AND 20.0 FEET WITH A MINIMUM OF FOUR LOOPS SPACED OVER A STANDARD DOUBLE RANDOM LENGTH (40 FEET). THE INTERVALS MUST BE ADJUSTED TO INSURE THERE IS NO PIPE TO PIPE CONTACT. ROPE ENDS SHALL BE FLUSH WITH A BLOW TORCH PRIOR TO SUPPING THE LOOP OVER THE PIPE.

TYPICAL TEMPORARY PIPE STOCKPILE

TYPICAL PERMANENT PIPE STOCKPILE

- NOTES:
- THE USE OF THE RUBBER BELTING METHOD OR THE POLYPROPYLENE ROPE METHOD TO PREVENT PIPE TO PIPE CONTACT IN THE STOCKPILE SHALL BE AS DIRECTED BY THE COMPANY.
 - SITE TO BE GRADED TO 2% SLOPE AND PADDED WITH 6" OF RIM GRAVEL.
 - SKIDS TO BE CAREFULLY LEVELED TO MAINTAIN 2% SLOPE. PIPES TO MAINTAIN CLOSE CONTACT THROUGHOUT ENTIRE LENGTH TO PREVENT SPLITTING AND ROLLING OF THE STOCKPILE.
 - MINIMUM OF TWO CHOCKS TO BE PLACED TO ALIGN WITH SPACES BETWEEN NESTED PIPES.
 - PIPE AT TOP TO BE STOCKPILED A MINIMUM OF 2 ROWS HIGH. PIPE 10" TO 18" TO BE STOCKPILED A MINIMUM OF 3 ROWS HIGH. PIPE LARGER THAN 18" TO BE STOCKPILED A MINIMUM OF 4 ROWS HIGH.
 - THE BOTTOM ROW OF PIPE SHALL REST ON SKIDS PROTECTED BY A CONTINUOUS STRIP OF FLAT RUBBER BELTING.
 - ALL MATERIAL TO BE SUPPLIED BY CONTRACTOR.

ROPE INSTALLATION

ROPE SPACING SHOULD BE A MAXIMUM OF 6" FROM THE PIPE ENDS AND A MAXIMUM OF 6" FROM GIRTH WELDS. THE INTERVAL BETWEEN RINGS SHOULD BE BETWEEN 10' AND 20' WITH A MINIMUM OF FOUR LOOPS SPACED OVER A STANDARD DOUBLE RANDOM LENGTH (40 FEET). THE INTERVALS MUST BE ADJUSTED TO INSURE THERE IS NO PIPE TO PIPE CONTACT. ROPE ENDS SHALL BE FLUSH WITH A BLOW TORCH PRIOR TO SUPPING THE LOOP OVER THE PIPE.

NO.	DATE	ISSUED FOR	REVISION/DESCRIPTION	BY	CHK.	APP'D	DESCRIPTION
A.	08/17/2020	ISSUED FOR BIDDING REVIEW		JAKT	CNS/JMP		AREA CODE
B.	07/29/2020	ISSUED FOR BID		JAKT	CNS/JMP		ACCOUNT NUMBER
				JAKT	CNS/JMP		PROJECT NUMBER
				JAKT	CNS/JMP		STATION ID
				JAKT	CNS/JMP		CHECKER INITIALS
				JAKT	CNS/JMP		PROJECT
				JAKT	CNS/JMP		PRINCIPAL ENGINEER

Item: CHRY Pipeline Marker Example

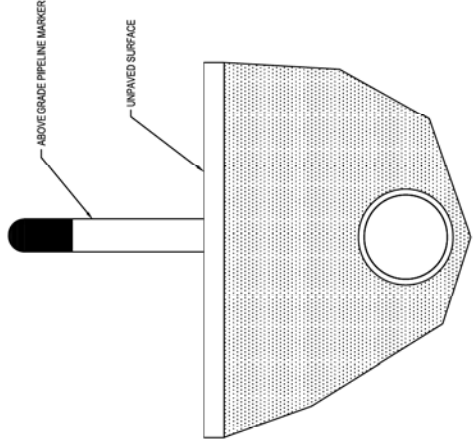


Figure 3: CHRY Pipeline Marker

PRINTED COPIES ARE NOT DOCUMENT CONTROLLED.
 Please refer to the Duke Energy Color Photo Log for the latest authorized content.

NOTE:

1. ABOVE GRADE PIPELINE MARKERS TO BE INSTALLED IN GRASS OR UNPAVED AREAS WHEN PIPELINE MARKER IS REQUIRED.
2. PIPELINE MARKERS SHALL BE INSTALLED PER FORM-1140.



ABOVE GRADE PIPELINE MARKER

SCALE: N.T.S.

NOTES:

1. PIPELINE MARKERS SHALL BE PLACED AT:
 - IN LINE-OF-SIGHT INTERVALS AND TURNING POINTS
 - AT ALL ROAD CROSSINGS
 - AT ALL RAILROAD CROSSINGS
 - RIVER, STREAM, CREEK, DITCH AND CANAL CROSSINGS
 - UTILITY CROSSINGS (PER DUKE DISCRETION)
 - SWAMPS OR WETLANDS (ENTRY AND EXIT)
 - ROAD WEDGINS
 - ROAD CROSSINGS (UNDERPASS, OVERPASS, BRIDGE)
 - FACILITIES SUCH AS VALVE SETTINGS, BORDER STATIONS, REGULATOR STATIONS, AND PIPELINE INTERCONNECTS
 - UNDERGROUND VALVES
 - HOV ENTRY AND EXIT POINTS
2. PIPELINE MARKERS SHALL BE PLACED DIRECTLY ON TOP OR WITHIN 24 INCHES OF THE PIPELINE.
3. SET MARKERS AS SOON AS PRACTICAL AFTER THE INSTALLATION OF THE PIPELINE. MAKE EVERY EFFORT TO PROVIDE MARKERS BEFORE VEGETATION IS RE-ESTABLISHED AFTER CONSTRUCTION.

PIPELINE MARKER LOCATIONS

NO.	DATE	BY	CHK.	APP'D	DESCRIPTION
A.	08/17/2020	JAKT	CNS	JMP	AREA CODE
B.	07/24/2021	JAKT	CNS	JMP	CONTRACT NUMBER: 03660
					MARKER NUMBER: 188715
					DRAWING BY: JAKT
					STATION ID: C350
					CHECKER INITIALS: JMP

APPROVALS:


REGIONAL SUPERVISOR	DATE
REC & STD	
PRINCIPAL ENGINEER	



C350 PROJECT
CONSTRUCTION DETAILS 9
HAMILTON COUNTY, OHIO
 HAMILTON COUNTY, OHIO

REF. DWG(S): PNG-C-350-0001009

SHEET(S)	9 OF 10	DWG SCALE	NONE
DWG DATE	04-05-2018	SUPERSEDED	
PROJECT NUMBER	PNG -C-350-0001311		
REGION	B		

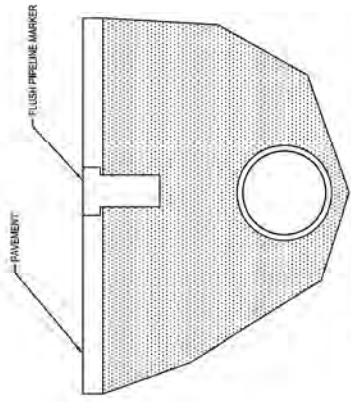

NOTE:



1. FLUSH PIPELINE MARKERS TO BE INSTALLED IN PAVEMENT WHEN PIPELINE MARKER IS REQUIRED.

FLUSH PIPELINE MARKER

SCALE: N.T.S.

CONSTRUCTION BARRIER


- NOTES:**
1. CONSTRUCTION FENCE SHALL BE INSTALLED ALONG THE CONSTRUCTION BOUNDARY TO PREVENT ACCESS TO THE CONSTRUCTION AREA.
 - A. NO FENCE REQUIRED ACCESS DRIVES.
 - B. CONSTRUCTION BOUNDARY IN ROAD SHALL BE BARRICADED IN ACCORDANCE WITH TRAFFIC PLANS AND MUTCD REQUIREMENTS.
 - C. OTHER BOUNDARY SPECIFIED ON PLANS.
 2. FENCE SHALL BE REMOVABLE FOR RESIDENTIAL AND COMMERCIAL DRIVE ACCESS.

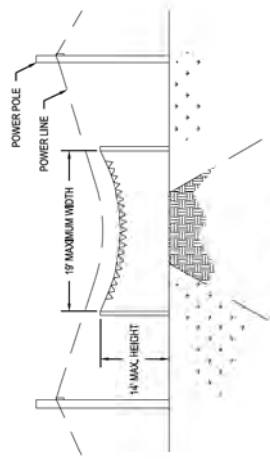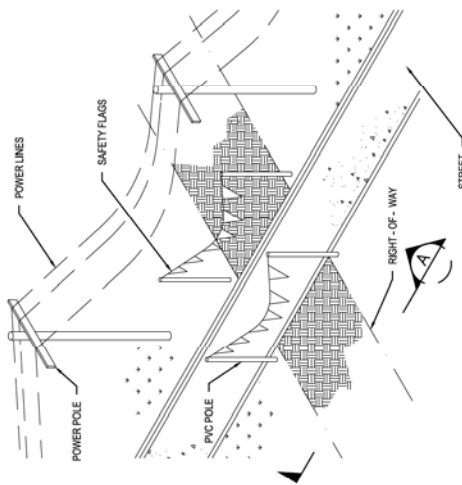


SECTION A-A
SCALE: N.T.S.

NOTE:
FLAG HEIGHT AND WIDTH MAY BE ADJUSTED
BASED ON SITE CONDITIONS OR AS DIRECTED BY
COMPANY REPRESENTATIVE.

**OVERHEAD ELECTRICAL
WARNING FLAGS**
SCALE: N.T.S.

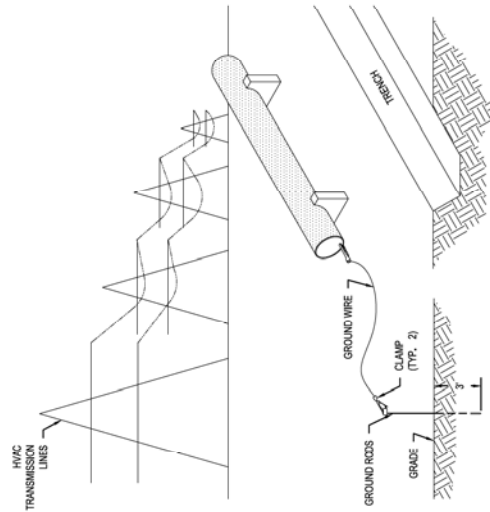

SAFETY GROUNDING
SCALE: N.T.S.

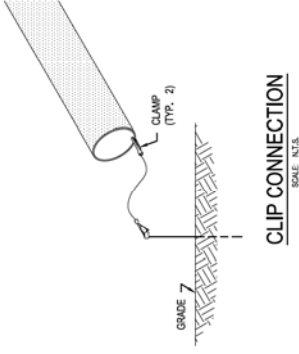

CLIP CONNECTION
SCALE: N.T.S.

REF. DWGS: PNC-C-350-0001009 SHEETS: 10 OF 10 DWGSCALE: NONE DWGDATE: 04-26-2018 SUPERSEDED: _____ DRAWING NUMBER: PNC-C-350-0001312 REGION: B COUNTY: HAMILTON COUNTY, OHIO		C.350 PROJECT CONSTRUCTION DETAILS 10 HAMILTON COUNTY, OHIO HAMILTON COUNTY, OHIO		 COPYRIGHT 2018	
NO. DATE A. 08/17/2020 B. 07/24/2020	REVISION/DESCRIPTION ISSUED FOR BID ISSUED FOR BID	BY: CHK, APPD JAKT CNS/AMP JAKT CNS/AMP	DESCRIPTION AREA CODE: C350 ACCOUNT NUMBER: 1880715 DRAWING BY: JAKT STATION ID: C350 CHECKER/INITIALS: AMP	APPROVALS REGIONAL SUPERVISOR: _____ REGIONAL REC & STD: _____ PRINCIPAL ENGINEER: _____	PROFESSIONAL ENGINEER/STATE NO.

BURNS & MCDONNELL
ENGINEERING COMPANY, INC.
STATE LICENSE # 004, 01567

**APPENDIX D – INSPECTION, CORRECTIVE ACTION, AND RECORD OF
REVISIONS FORMS**

C350 Central Corridor Pipeline Extension Project

Storm Water Pollution Prevention Plan

INSPECTION AND MAINTENANCE REPORT FORM

Name of Permittee: Duke Energy, Ohio

Construction Site Name: C350 Central Corridor Pipeline Extension Project

Inspector: _____ Date: _____ Time: _____

Present Phase of Construction: _____

Site Conditions: _____

Inspection Event:

- ROUTINE WEEKLY STORM EVENT SINCE LAST INSPECTION (record all events > 0.5 inches): inches
 RAIN EVENT TIME EVENT STARTED: _____ DURATION OF EVENT: _____
 OTHER EXPLANATION OF DISCHARGES: _____

Measures & Controls	Location	In Conformance with Typical Standard	Effective Pollutant Control Practice
Construction Ingress/Egress		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
Perimeter Sediment Controls		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
Stream Crossing BMPs		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
Inlet Protection		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
HDD Sites		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
Rock Check Dams		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
Erosion Control Blankets		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
Concrete Washout		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
Vegetated Swale		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
Temporary Stabilization		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
Permanent Stabilization		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
Slope Controls		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
Run-on Controls		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO

NON-CONFORMANCE/INEFFECTIVE POLLUTANT CONTROL PRACTICES NOTED DURING INSPECTION: (Explain each "NO" circled above)

RECOMMENDED REMEDIAL ACTIONS AND SCHEDULE OF THOSE EVENTS:

LIST OF AREAS WHERE CONSTRUCTION OPERATIONS HAVE PERMANENTLY OR TEMPORARILY CEASED:

OBSERVATIONS AT STORM WATER DISCHARGE LOCATIONS:

ADDITIONAL COMMENTS:

Signature: _____
Environmental Inspector

Printed Name: _____

APPENDIX E – HDD FLUID LOSS AND CONTINGENCY PLAN

HORIZONTAL DIRECTION DRILLING (HDD) CONTINGENCY PLAN PIEDMONT NATURAL GAS

HDD is a common method used to install pipeline through heavily developed areas, roadways, waterways and environmentally sensitive areas to minimize the surface disturbance that traditional open-cut trenching methods typically require. The use of HDD construction limits disturbances to the drilling site and temporary accesses if required.

Directional bore operations have the potential to release drilling fluids into the surface environment through fractured bedrock. The drilling mud typically will flow into the surrounding rock and sand and travel toward the ground surface. The drilling fluid, a bentonite slurry, is used as a lubricant during the drilling of the bore hole, enabling the rock and soil cuttings from the drilling process to be carried back up to a containment bay at the ground surface at the drilling site. It also works as a seal to enhance the integrity of the bore hole. Bentonite is a non-toxic, naturally occurring clay commonly used for agricultural purposes such as decreasing water loss in ponds and soils. Note that there will be no hydraulic fracturing associated with this method of drilling on the site.

While drilling, fluid seepage is most likely to occur near the bore entry and exit points where the drill head is shallow, seepage can occur in any location along a directional bore. This Horizontal Direction Drilling Contingency Plan establishes operational procedures and responsibilities for the prevention, containment, and cleanup of fluid loss incidents associated with this project. The project specifications also reference the HDD portion of the project.

All personnel and Sub-Contractors responsible for the work must adhere to this plan during the directional drilling process.

The specific objectives of this plan are to:

1. Minimize the potential for a drilling fluid release associated with directional drilling activities;
2. Provide for the timely detection of fluid releases;
3. Protect the environmentally sensitive areas and associated riparian vegetation;
4. Ensure an organized, timely, and efficient response in the event of a release of drilling bentonite; and
5. Ensure that all appropriate notifications are made immediately to the client and regulatory personnel.

Pre-Construction Measures

Before any HDD occurs, a safety meeting will take place. This contingency plan will be discussed and any questions will be answered. The Site Supervisor shall ensure that a copy of this plan is available (onsite) and accessible to all construction personnel. The Site Supervisor shall ensure that all workers are properly trained and familiar with the necessary procedures for response to a drilling fluid release, prior to commencement of drilling operations. Other best-management measures are listed below.

1. Prior to construction, the work areas will be flagged and the limits defined. Erosion and sediment controls will be placed near the drilling rig location and around the drilling fluid containment bays as a preventative measure against drilling fluid leaving the site.
2. A spill kit shall be kept onsite and used if a drilling fluid loss occurs. Other containment materials, such as straw bales, shall also be kept on-site prior to and during all HDD drilling operations.

Fluid Loss Response and Measures

The response of the field crew to a drilling fluid loss shall be immediate and in accordance with procedures identified in this Plan. All appropriate emergency actions that do not pose additional threats to sensitive resources will be taken, as follows:

1. The pressure and volume of drilling fluid will be closely observed by the drilling contractor during HDD activities to watch for indications of fluid loss.
2. Drilling operations will be halted by the drill rig operators immediately upon detection of a drop in drilling pressure or any other indicator of fluid loss. The loss of drilling fluid to the surface is greatest at shallow locations, typically near the entry and exit points of the HDD.
3. Containment bays will be in place at both the drill entry and exit points to prevent drilling fluid from leaving the site at the entry and exit points, in addition to silt fence placed along the perimeter of the drilling area.
4. The HDD bores have been designed to provide sufficient depth below water crossings to reduce the risk of drilling fluid reaching the ground surface.
5. The clean-up of all spills and fluid loss shall begin immediately.
6. The Site Supervisor will notify Piedmont Natural Gas and the project inspector immediately at any time during drilling operations that the drilling contractor observed a loss of drilling fluid.
7. In the event of a loss of drilling fluid, the Site Supervisor shall be notified immediately and will conduct an evaluation of the situation and direct recommended mitigation actions, based on the following guidelines of the severity of the fluid loss.
 - a. If the loss of drilling fluid is minor, easily contained, has not reached the surface and is not threatening sensitive resources, drilling operations may resume after use of a leak stopping compound or redirection of the bore.
 - b. If drilling fluid reaches the surface, the area will be isolated with silt fence or similar measures to contain drilling fluid.
 - i. A containment or relief bay may be installed, if possible, to keep drilling fluid from reaching environmentally sensitive areas and removal will begin by vac-truck or hand tools.
 - ii. In areas that cannot be reached by a vac-truck for drilling fluid removal, a tiered system of contained areas will relay drilling fluid to a location accessible by a vac-truck and removed.

- iii. If it is not possible to relay drilling fluid to a suitable location for removal by a vac-truck, drilling contractor workers will use hand tools and vacuums to remove the drilling fluid from contained areas.
 - iv. Any material contaminated with Bentonite shall be removed by hand to a depth of 2-feet, contained and properly disposed of, as required by law. The drilling contractor shall be responsible for ensuring that the bentonite is either properly disposed of at an approved disposal facility or properly recycled in an approved manner. Contractor must provide Piedmont with documented proof of disposal.
- c. If drilling fluid reaches the surface in flowing waters, the following actions should be initiated.
 - i. A coffer dam will be installed downstream.
 - ii. Drilling fluid removal will begin by hand tools immediately. If the fluid loss is widespread, the Site Supervisor may discuss the use of the vac-truck with the regulatory agencies.
 - iii. Any material contaminated with Bentonite shall be removed by hand to a depth of 2-feet, contained and properly disposed of, as required by law. The drilling contractor shall be responsible for ensuring that the bentonite is either properly disposed of at an approved disposal facility or properly recycled in an approved manner. Contractor must provide Piedmont with documented proof of disposal.
 - iv. Piedmont's Environmental Department and environmental regulatory agencies will be notified.

During drilling activities, the pressure of the drilling fluid in the bore hole is greatest at the end of the drill. If there is a drilling fluid loss, the danger of it occurring again at the same location will be significantly reduced as the drilling continues and the bore hole is advanced beyond the location of the original fluid loss. The pressure at the original loss location will be reduced and drilling fluids will be more likely to resume their path through the bore hole and out to the containment bay at the drill site.

Response Close-out Procedures

When the release has been contained and cleaned up, response closeout activities will be conducted at the direction of the Site Supervisor and shall include the following:

1. The recovered drilling fluid will either be recycled or hauled to an approved facility for disposal. Contractor must provide Piedmont with documented proof of disposal. No recovered drilling fluids will be discharged into streams, storm drains or any other water source;
2. All spilled drilling fluid excavation and clean-up sites will be returned to pre-project contours using clean fill, as necessary; and
3. All containment measures (fiber rolls, straw bale, etc.) will be removed, unless otherwise specified by the Site Supervisor/Foremen.

The Site Supervisor shall record the drilling fluid loss in their daily log. The log will include the following: Details on the release event, including an estimate of the amount of bentonite released, the location and time of release, the size of the area impacted, and the success of the clean-up action. The log report shall also include the: name and telephone number of person reporting; date; how the release occurred; type of activity that was occurring around the area of the drilling fluid loss; description of any sensitive areas and their location in relation to the drilling fluid loss; description of the methods used to clean up or secure the site; and a listing of the current permits obtained for the project.

In the event the drilling fluid loss results in drilling fluid entering the creek, the Site Supervisor will notify Piedmont's Environmental Department and environmental regulatory agencies will be notified. All notifications will occur within 24 hours of the discovery of the release and proper documentation will be prepared within a timely manner.

Construction Re-start

For small releases, drilling may continue, if 100 percent containment is achieved through the use of a leak stopping compound or redirection of the bore and the clean-up crew remains at the drilling fluid loss location throughout the remainder of the drilling of that bore.

For all other releases, construction activities will not restart without prior approval from Piedmont Natural Gas and the project engineer's inspector.

Bore Abandonment

Abandonment of the bore will only be required when all efforts to control the drilling fluid loss within the existing directional bore have failed. The borehole will be completely abandoned and a new location determined. Any borehole abandonment locations will be documented and shown on any as-built documents.

The following steps will be implemented during abandonment of the borehole:

1. Determine the new location for the HDD crossing.
2. Insert casing, as necessary to remove the pilot string.
3. Pump a thick grout plug into the borehole to securely seal the abandoned borehole.



CREATE AMAZING.

Burns & McDonnell World Headquarters
9400 Ward Parkway
Kansas City, MO 64114
O 816-333-9400
F 816-333-3690
www.burnsmcd.com

Quick Search
Address

You are here: » [ezTrak Home](#) » [Search](#) » [Records list](#) » Record#: PWS200047

■ ezTrak Record Details

Detailed Information for Project/Case#:PWS200047 at 7658 School rd, Sycm

Please select the relevant tab below to view more information.

- General Information**
- Approvals
- Inspections

● General Information:

Type	HCPW
Sub Type	Other
Title	C350 - PIPELINE HIGHPOINT STAT
Description	Gravel covered Pipeline station
Location	Northern-most portion of 7650 School Road
Parcel Number	060001400396

● Key Dates:

Applied Date	Wednesday, November 18, 2020
Current Status	APPROVED
Status as of	



Hamilton County Earthwork Program

Administered By: Hamilton County Soil & Water Conservation District

Mission Statement: A public organization committed to assisting the citizens of Hamilton County through education, technical assistance and leadership to be stewards of our soil and water resources.

November 20, 2020

James Olberding
Duke Energy Ohio
139 E. 4th St
Cincinnati, Ohio 45202

Subject: Approval Letter
Reference: C350 Central Corridor Natural Gas Pipeline Project
7658 School Rd, Sycamore Township
Earthwork Permit: HSWE200306

Mr. Olberding

This letter serves as the District's Earthwork Permit Approval for the C350 Central Corridor Natural Gas Pipeline Project located in Sycamore Township. The issuance of the Earthwork Permit allows Duke Energy Ohio and its contractor to perform earthwork activities in accordance with the approved Improvement Plan.

In order for the site to remain in compliance with the current **Hamilton County Earthwork Regulations**, the requirements of the following sections shall be observed:

Section 307 Coordination with Local, State, and Federal Regulations and Permits
Section 310 Erosion and Sediment Pollution Control Performance Standards
Section 311 Geotechnical Performance Standards
Section 312 Non-Sediment Pollution Control Performance Standards
Section 314 Inspection and Maintenance of Erosion and Sediment Pollution Controls
Section 316 Inspection and Maintenance of Non-Sediment Pollution Controls

Failure to comply with any section of the Hamilton County Earthwork Regulations, shall subject the owner to the penalties described under Section 319 Enforcement and Section 321 Penalty.

The Hamilton County Earthwork Regulations can be downloaded from

Hamilton County Earthwork Program
1325 East Kemper Rd, Suite 115
Cincinnati, Ohio 45246
Phone: 513-772-7645
Fax: 513-772-7656
Electronic Submittal: EarthworkPermits@hamilton-co.org

<https://www.hcswcd.org/earthwork-earth-movement.html>.

- 1) Duke Energy Ohio is responsible for the installation, inspection and maintenance of the Erosion and Sediment Pollution Controls up to final stabilization of the project. ***Sediment basins and traps and perimeter sediment barriers shall be implemented prior to grading and within 7 days of grubbing.*** All erosion and sediment pollution controls must comply with the standards under the current Ohio EPA Rainwater and Land Development Manual. The Manual can be downloaded from: http://epa.ohio.gov/dsw/storm/technical_guidance
- 2) Erosion and Sediment Pollution Controls on the site shall be inspected by the ***Qualified Inspection Personnel*** at least once every seven (7) calendar days and by end of the next calendar day after any storm event greater than one-half (1/2) inch of rain per 24-hour period. A record shall be made of each inspection. At a minimum, the inspection report shall include the all the information requested in Section 314.D on pages 30 and 31 of the Earthwork Regulations. Records of these inspections must be kept on site and made available to the District upon request.
- 3) Erosion and Sediment Pollution Controls must be maintained per the timelines prescribed in Section 314 on pages 30 and 31 of the Earthwork Regulations.
- 4) Non-Sediment Pollution Controls must be implemented to prevent the discharge of hazardous substances, solid waste or liquid waste, including building materials from the site. Non-Sediment Pollution sources include: construction chemical compounds; concrete washout wastewater; equipment and vehicle fueling and maintenance; demolition debris and contaminated soils; solid, liquid, sanitary or septic waste disposal; landscaping materials
- 5) Non-Sediment Pollution Controls must be inspected and maintained per the timelines prescribed in Section 316 on pages 33 and 34 of the Earthwork Regulations.
- 6) Discharges of sediment laden water from dewatering activities must be prevented. Dewatering of flooded footer, foundation or utility trenches containing sediment must be directed to the sediment basin or to a sediment control prior to discharge from the site.
- 7) Off-site vehicle tracking of sediment and dust shall be minimized. All roads, storm drainage systems and sidewalks shall be kept free of sediment. All access points shall have a stabilized construction entrance.
- 8) Application of temporary and permanent soil stabilization must conform to the timelines on tables 310-B and 310-C in Section 310.K on page 25 of the Earthwork Regulations.

- 9) All areas disturbed for construction must be stabilized prior to the District's final approval.
- 10) The District will be inspecting this site as part of Hamilton County's Municipal Separate Storm Sewer System (MS4) Permit from the Ohio EPA. Copies of the District's inspection reports will be sent to [Site Supervisor].

Please contact the District at (513) 772-7645 with questions or comments regarding this letter.

Sincerely,

A handwritten signature in cursive script, appearing to read "Jim Gleason", followed by a long horizontal flourish.

Jim Gleason
Urban Technician II

Cc: Chey Alberto (HCSWCD), Olivia Maltry (HCSWCD), file



Hamilton County Earthwork Program

Administered By: Hamilton County Soil & Water Conservation District

Mission Statement: A public organization committed to assisting the citizens of Hamilton County through education, technical assistance and leadership to be stewards of our soil and water resources.

November 20, 2020

James Olberding
Duke Energy Ohio
139 E. 4th St
Cincinnati, Ohio 45202

Subject: Approval Letter
Reference: C350 Central Corridor Natural Gas Pipeline Project
1861 Section Rd, Golf Manor
Earthwork Permit: HSWE200312

Mr. Olberding

This letter serves as the District's Earthwork Permit Approval for the C350 Central Corridor Natural Gas Pipeline Project located in Golf Manor. The issuance of the Earthwork Permit allows Duke Energy Ohio and its contractor to perform earthwork activities in accordance with the approved Improvement Plan.

In order for the site to remain in compliance with the current **Hamilton County Earthwork Regulations**, the requirements of the following sections shall be observed:

Section 307 Coordination with Local, State, and Federal Regulations and Permits
Section 310 Erosion and Sediment Pollution Control Performance Standards
Section 312 Non-Sediment Pollution Control Performance Standards
Section 314 Inspection and Maintenance of Erosion and Sediment Pollution Controls
Section 316 Inspection and Maintenance of Non-Sediment Pollution Controls

Failure to comply with any section of the Hamilton County Earthwork Regulations, shall subject the owner to the penalties described under Section 319 Enforcement and Section 321 Penalty.

The Hamilton County Earthwork Regulations can be downloaded from
<https://www.hcswcd.org/earthwork-earth-movement.html>.

Hamilton County Earthwork Program
1325 East Kemper Rd, Suite 115
Cincinnati, Ohio 45246
Phone: 513-772-7645
Fax: 513-772-7656
Electronic Submittal: EarthworkPermits@hamilton-co.org

- 1) Duke Energy Ohio is responsible for the installation, inspection and maintenance of the Erosion and Sediment Pollution Controls up to final stabilization of the project.
Sediment basins and traps and perimeter sediment barriers shall be implemented prior to grading and within 7 days of grubbing. All erosion and sediment pollution controls must comply with the standards under the current Ohio EPA Rainwater and Land Development Manual. The Manual can be downloaded from:
http://epa.ohio.gov/dsw/storm/technical_guidance
- 2) Erosion and Sediment Pollution Controls on the site shall be inspected by the **Qualified Inspection Personnel** at least once every seven (7) calendar days and by end of the next calendar day after any storm event greater than one-half (1/2) inch of rain per 24-hour period. A record shall be made of each inspection. At a minimum, the inspection report shall include the all the information requested in Section 314.D on pages 30 and 31 of the Earthwork Regulations. Records of these inspections must be kept on site and made available to the District upon request.
- 3) Erosion and Sediment Pollution Controls must be maintained per the timelines prescribed in Section 314 on pages 30 and 31 of the Earthwork Regulations.
- 4) Non-Sediment Pollution Controls must be implemented to prevent the discharge of hazardous substances, solid waste or liquid waste, including building materials from the site. Non-Sediment Pollution sources include: construction chemical compounds; concrete washout wastewater; equipment and vehicle fueling and maintenance; demolition debris and contaminated soils; solid, liquid, sanitary or septic waste disposal; landscaping materials
- 5) Non-Sediment Pollution Controls must be inspected and maintained per the timelines prescribed in Section 316 on pages 33 and 34 of the Earthwork Regulations.
- 6) Discharges of sediment laden water from dewatering activities must be prevented. Dewatering of flooded footer, foundation or utility trenches containing sediment must be directed to the sediment basin or to a sediment control prior to discharge from the site.
- 7) Off-site vehicle tracking of sediment and dust shall be minimized. All roads, storm drainage systems and sidewalks shall be kept free of sediment. All access points shall have a stabilized construction entrance.
- 8) Application of temporary and permanent soil stabilization must conform to the timelines on tables 310-B and 310-C in Section 310.K on page 25 of the Earthwork Regulations.
- 9) All areas disturbed for construction must be stabilized prior to the District's final approval.

10) The District will be inspecting this site as part of Hamilton County's Municipal Separate Storm Sewer System (MS4) Permit from the Ohio EPA. Copies of the District's inspection reports will be sent to [Site Supervisor].

Please contact the District at (513) 772-7645 with questions or comments regarding this letter.

Sincerely,

A handwritten signature in blue ink, appearing to read "James Gleason", with a long horizontal flourish extending to the right.

James Gleason
Urban Technician II

Cc: Chey Alberto (HCSWCD), Olivia Maltry (HCSWCD), file