Bricker & Eckler
ATTORNEYS AT LAW

COLUMBUS • CLEVELAND

BRICKER & ECKLER LLP
100 South Third Street
Columbus, Ohio 43215-4291
MAIN: 614.227.2300
FAX: 614.227.2390

www.bricker.com
info@bricker.com

Sally W. Bloomfield
614.227.2368
sbloomfield@bricker.com

FILE

RECEIVED-DOCKETING DIV
2007 JUL -6 PM 3:54
PUCO

July 6, 2007

VIA HAND DELIVERY

Ms. Renee Jenkins
Public Utilities Commission of Ohio
Administration/Docketing
180 East Broad Street, 13th Floor
Columbus, OH 43215-3793

Re: Case No. 07-252-WS-UNC
Ohio American Water Company
Stipulation Page No. 17, ¶15

Dear Ms. Jenkins:

Pursuant to the Commission's March 7, 2007 Opinion and Order in Case No. 06-433-WS-AIR, Ohio American Water Company herewith submits for filing the June 2007 Hardness Report for the Marion district.

If you have any questions, please call me at the number listed above.

Sincerely,

Sally W Bloomfield

Sally W. Bloomfield

Enclosure

cc: Parties of Record (w/Enclosure)

This is to certify that the images appearing are an accurate and complete reproduction of a case file document delivered in the regular course of business.
Technician _____ Date Processed 7/6/07

OHIO AMERICAN WATER COMPANY
MARION - DISTRICT

2007

EFFLUENT HARDNESS / MG/L

June	RAW HARDNESS MG/L	EFFLUENT HARDNESS MG/L
1	430	142
2	450	146
3	450	141
4	412	137
5	389	143
6	445	148
7	456	146
8	430	131
9	444	149
10	444	143
11	406	143
12	410	142
13	418	144
14	435	146
15	442	141
16	453	141
17	465	140
18	460	144
19	438	140
20	437	139
21	438	137
22	432	129
23	442	142
24	450	142
25	448	139
26	456	142
27	480	141
28	485	140
29	475	140
30	400	136
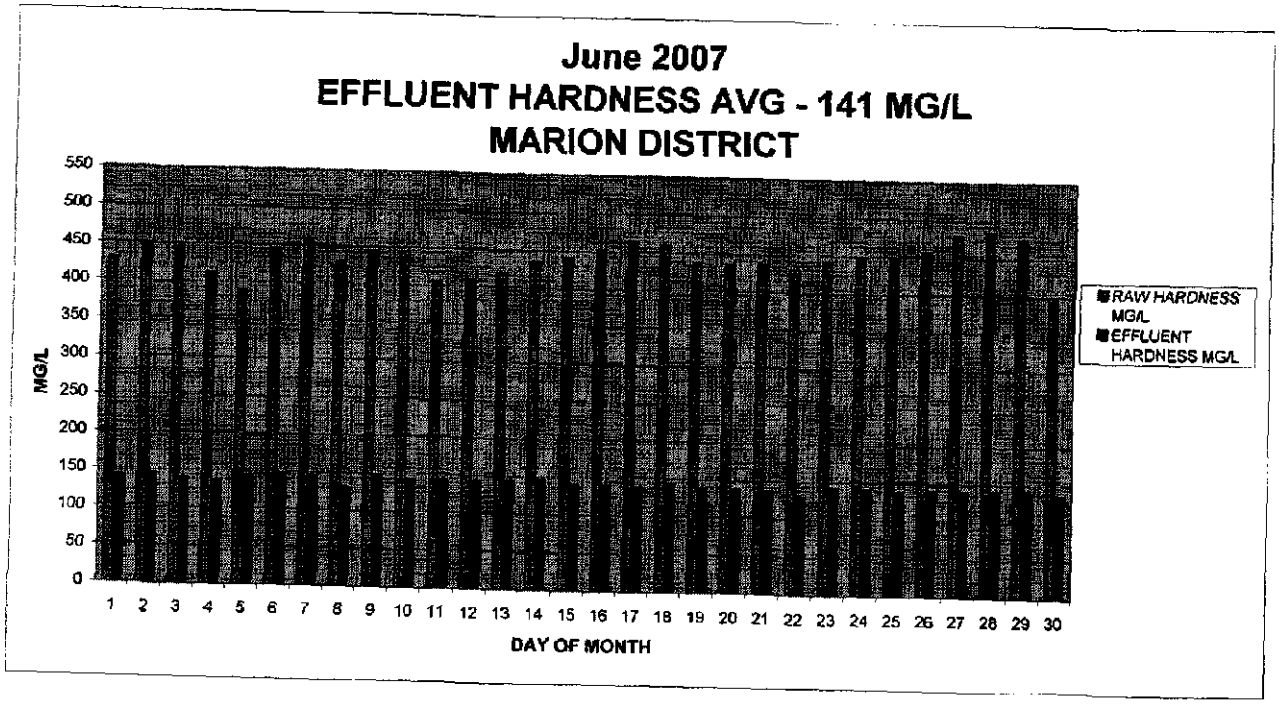
AVERAGE	441	141
MAX	485	149
MIN	389	129