

March 26, 2008

Ms. Renee J. Jenkins
Director, Administration Department
Secretary to the Commission
Docketing Division
The Public Utilities Commission of Ohio
180 East Broad Street
Columbus, OH 43215-3793

Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-341 -EL-BNR

RECEIVED-DOCKETING DIV
2008 MAR 27 AM 10:45
PUCO

Dear Ms. Jenkins:

In accordance with Rule 4906-11-01 American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, transmits one (1) original and eleven (11) copies of the enclosed Construction Notice. In this project, ATSI is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

Please be advised of the following:

a) Name and address of the applicant:

American Transmission Systems, Incorporated
76 South Main Street
Akron, Ohio 44308

b) Name of proposed facilities:

Eber-Swanton 138 kV Transmission Line Relocation for the Hallett Road
Railroad Re-Alignment Project.

Docketing

March 26, 2008

c) Location of proposed facilities:

The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

d) Description of proposed facilities:

In this project, ATSI is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles.


e) Applicant's representative:

John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company
76 South Main Street
Akron, OH 44308-1890

After docketing this filing, please return one time-stamped copy of the Construction Notice for our records to us in the enclosed envelope. We have provided a copy of this Construction Notice by certified mail, with return receipt requested, to officials of the political subdivisions immediately affected by the proposed project as listed in the attached Exhibit 1. Copies of the transmittal letters addressed to the local government representatives of the Village of Swanton, Fulton County, Township of Swanton, and Lucas County are enclosed for your file.

Should the Ohio Power Siting Board desire further information or discussion of this submittal, please contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachments

EXHIBIT 1
Officials Served Copy of Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation for the Hallett Road Railroad Re-Alignment Project
Case No. 08-341-EL-BNR

Village of Swanton (Fulton County)

The Honorable James Bushong
Mayor, Village of Swanton
219 Chestnut Street
Swanton, Ohio 43558-1303

Mr. Scott Haselman
President of Council, Village of
Swanton
219 Chestnut Street
Swanton, Ohio 43558-1303

Mr. Jon Gochenour
Village Administrator
219 Chestnut Street
Swanton, Ohio 43558-1303

Fulton County

The Honorable Joe Short
Fulton County Commissioner
152 South Fulton Street
Wauseon, Ohio 43567

Mr. Frank T. Onweller, P.E., P.S.
Fulton County Engineer
9120 County Road 14
Wauseon, Ohio 43567-9669

The Honorable Paul Barnaby
Fulton County Commissioner
152 South Fulton Street
Wauseon, Ohio 43567

Mr. Steve Brown
Director, Regional Planning
Commission
152 South Fulton Street, Suite 230
Wauseon, Ohio 43567

The Honorable Dean Genter
Fulton County Commissioner
152 South Fulton Street
Wauseon, Ohio 43567

Township of Swanton (Lucas County)

Mr. John Warkentin, II
Trustee, Township of Swanton
13410 Airport Highway
Swanton, Ohio 43558

Mr. Jim Irmien
Trustee, Township of Swanton
13410 Airport Highway
Swanton, Ohio 43558

Mr. Dennis Tippie
Trustee, Township of Swanton
13410 Airport Highway
Swanton, Ohio 43558

Mr. William B. Cook
Fiscal Officer, Township of
Swanton
13410 Airport Highway
Swanton, Ohio 43558

Lucas County

The Honorable Tina Skeldon Wozniak
President, Lucas County
Commissioner
One Government Center, Suite 800
Toledo, Ohio 43604

Mr. Calvin J. Lawshe
Acting Director, Toledo-Lucas County
Planning Commission
One Government Center, Suite 1620
Toledo, Ohio 43604

The Honorable Ben Konop
Lucas County Commissioner
One Government Center, Suite 800
Toledo, Ohio 43604

Mr. Warren Schlatter, P.E., P.S.
Lucas County Engineer
500 Second Street
Toledo, Ohio 43604

The Honorable Pete Gerken
Lucas County Commissioner
One Government Center, Suite 800
Toledo, Ohio 43604

Ms. Jody Balogh
Clerk of Commissioners
One Government Center, Suite 800
Toledo, Ohio 43604

Mr. Keith G. Earley, P.E., P.S.
Lucas County Engineer
One Government Center, Suite 870
Toledo, Ohio 43604

Mr. James B. Spengler, Director
Metropolitan Park District of
Toledo Area
5100 West Central Avenue
Toledo, Ohio 43615-2100

March 26, 2008

The Honorable James Bushong
Mayor, Village of Swanton
219 Chestnut Street
Swanton, Ohio 43558-1303

**Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-341 -EL-BNR**

Dear Mayor Bushong,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

Mr. Jon Gochenour
Village Administrator
219 Chestnut Street
Swanton, Ohio 43558-1303

**Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-341 -EL-BNR**

Dear Mr. Gochenour,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

Mr. Scott Haselman
President of Council, Village of Swanton
219 Chestnut Street
Swanton, Ohio 43558-1303

**Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-34 -EL-BNR**

Dear Mr. Haselman,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

The Honorable Joe Short
Fulton County Commissioner
152 South Fulton Street
Wauseon, Ohio 43567

**Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-34 -EL-BNR**

Dear Commissioner Short,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

The Honorable Paul Barnaby
Fulton County Commissioner
152 South Fulton Street
Wauseon, Ohio 43567

**Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-34 -EL-BNR**


Dear Commissioner Barnaby,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

The Honorable Dean Genter
Fulton County Commissioner
152 South Fulton Street
Wauseon, Ohio 43567

**Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-341 -EL-BNR**

Dear Commissioner Genter,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

Mr. Frank T. Onweller, P.E., P.S.
Fulton County Engineer
9120 County Road 14
Wauseon, Ohio 43567-9669

Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-3rd -EL-BNR


Dear Mr. Onweller,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

Mr. Steve Brown
Director, Regional Planning Commission
152 South Fulton Street, Suite 230
Wauseon, Ohio 43567

**Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-3rd -EL-BNR**


Dear Mr. Brown,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

Mr. John Warkentin, II
Trustee, Township of Swanton
13410 Airport Highway
Swanton, Ohio 43558

**Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-341 -EL-BNR**


Dear Mr. Warkentin,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

Mr. Dennis Tippie
Trustee, Township of Swanton
13410 Airport Highway
Swanton, Ohio 43558

Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-341-EL-BNR


Dear Mr. Tippie,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

Mr. Jim Irmen
Trustee, Township of Swanton
13410 Airport Highway
Swanton, Ohio 43558

**Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-34 -EL-BNR**


Dear Mr. Irmen,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

Mr. William B. Cook
Fiscal Officer, Township of Swanton
13410 Airport Highway
Swanton, Ohio 43558

**Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-341 -EL-BNR**


Dear Mr. Cook,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

The Honorable Tina Skeldon Wozniak
President, Lucas County Commissioner
One Government Center, Suite 800
Toledo, Ohio 43604

**Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-344 -EL-BNR**


Dear Commissioner Wozniak,

In the above captioned project, American Transmission Systems, Inc. ("ATSP"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

The Honorable Ben Konop
Lucas County Commissioner
One Government Center, Suite 800
Toledo, Ohio 43604

**Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-341 -EL-BNR**


Dear Commissioner Konop,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

The Honorable Pete Gerken
Lucas County Commissioner
One Government Center, Suite 800
Toledo, Ohio 43604

**Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-34 -EL-BNR**


Dear Commissioner Gerken,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

Mr. Keith G. Earley, P.E., P.S.
Lucas County Engineer
One Government Center, Suite 870
Toledo, Ohio 43604

Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-34 -EL-BNR


Dear Mr. Earley,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,

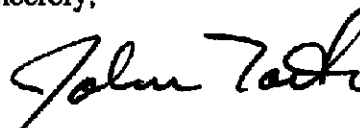

John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

Mr. Calvin J. Lawshe
Acting Director, Toledo-Lucas County Planning Commission
One Government Center, Suite 1620
Toledo, Ohio 43604

Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-34\ -EL-BNR


Dear Mr. Lawshe,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

Mr. Warren Schlatter, P.E., P.S.
Lucas County Engineer
500 Second Street
Toledo, Ohio 43604

Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-344 -EL-BNR


Dear Mr. Schlatter,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

Ms. Jody Balogh
Clerk of Commissioners
One Government Center, Suite 800
Toledo, Ohio 43604

**Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-344-EL-BNR**


Dear Ms. Balogh,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

March 26, 2008

Mr. James B. Spengler, Director
Metropolitan Park District of Toledo Area
5100 West Central Avenue
Toledo, Ohio 43615-2100

Construction Notice
Eber-Swanton 138 kV Transmission Line
Relocation For The Hallett Road
Railroad Re-Alignment Project
Case No. 08-3A -EL-BNR


Dear Mr. Spengler,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corporation, is proposing to remove four (4) existing transmission poles and replace them with two (2) new laminated wood poles and two (2) wood poles as part of the Hallett Road Railroad Re-Alignment project. The project is located in the Village of Swanton, Fulton County and the Township of Swanton, Lucas County, Ohio.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-4564.

Sincerely,



John Toth, Associate Transmission Engineer
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

AMERICAN TRANSMISSION SYSTEMS, INCORPORATED

CONSTRUCTION NOTICE

**EBER-SWANTON 138 kV TRANSMISSION LINE
RELOCATION FOR THE HALLETT ROAD
RAILROAD RE-ALIGNMENT PROJECT**

OPSB CASE NO. 08-341-EL-BNR

March 26, 2008

**American Transmission Systems, Incorporated
76 South Main Street
Akron, Ohio 44308**

approximately five (5) feet from their current locations, as shown in the general layout Exhibit 2.

The proposed Project meets the requirements for a Construction Notice because the project is within the types of project defined by Item (9) of the Application Requirement Matrix for Electric Power Transmission Lines in Appendix A of 4906-1-01 of the Ohio Administrative Code, which requires the filing of a Construction Notice. This items states:

- (9) Replacement or relocation of an electric power transmission line and associated facilities where the project is required by publicly funded entities and is located on or adjacent to right-of-way or land owned by the public entity requiring the project.*

The existing poles are located within and the new poles will be located within the existing right of way of the transmission line which is adjacent to the right of way of Hallett Road. The existing Eber-Swanton 138 kV Transmission Line and the relocated poles will be owned by ATSI.

4906-11-02 (A) (3): Construction Schedule

Construction on the proposed Project is proposed to begin on August 1, 2008, and is expected to be completed by November 3, 2008.

4906-11-02 (A) (4): Estimated Costs

The estimated capital costs for the Project is \$150,000.

4906-11-02 (A) (5): Operating Characteristics

The existing Eber-Swanton 138 kV Transmission Line operates at 138 kV. The proposed relocation of four (4) poles will not change the operating characteristics of this transmission line. No new property rights are required for the proposed Project.

4906-11-02 (A) (6): Area Map

Exhibit No. 1 depicts the general location of the project site. This exhibit provides a partial copy of the United States Geologic Survey, Fulton County, Ohio Quad, Map ID

41083-E8. To locate and view the project site from Columbus, Ohio, travel onto US-23 towards I-70 / I-71. Exit Interstate 70 at exit 93 onto I-270 towards Cleveland. At exit 17B travel onto US-33 for 17 miles towards OH-31 for approximately 30.3 miles. Turn onto SR-309, then immediately turn north onto US-68 for approximately 29.0 miles to I-75. At exit 192 turn onto I-475 towards US-23 Maumee for approximately 6.4 miles. At exit 6 turn right and travel towards Salisbury Road. Travel on Salisbury Road for approximately 0.7 miles. Turn left onto Strayer Road for approximately 0.7 miles, then turn right (west) onto Alt US-20 for approximately 4.8 miles. Turn right (north) onto CR-1 for approximately 0.6 miles. The project is located immediately to the north of the railroad tracks on Hallett Road.

4906-11-02 (B): Documentation of Construction Notice Transmittal

This Construction Notice is being provided concurrently to the following officials of the Village of Swanton, and Fulton County as well as the Township of Swanton, and Lucas County, Ohio. Copies of the transmittal letters to these officials have been included with the transmittal letter submitting this Construction Notice to the Ohio Power Siting Board.

Village of Swanton (Fulton County)

The Honorable James Bushong
Mayor, Village of Swanton
219 Chestnut Street
Swanton, Ohio 43558-1303

Mr. Jon Gochenour
Village Administrator
219 Chestnut Street
Swanton, Ohio 43558-1303

Mr. Scott Haselman
President of Council, Village of
Swanton
219 Chestnut Street
Swanton, Ohio 43558-1303

Fulton County

The Honorable Joe Short
Fulton County Commissioner
152 South Fulton Street
Wauseon, Ohio 43567

The Honorable Paul Barnaby
Fulton County Commissioner
152 South Fulton Street
Wauseon, Ohio 43567

The Honorable Dean Genter
Fulton County Commissioner
152 South Fulton Street
Wauseon, Ohio 43567

Mr. Frank T. Onweller, P.E., P.S.
Fulton County Engineer
9120 County Road 14
Wauseon, Ohio 43567-9669

Mr. Steve Brown
Director, Regional Planning
Commission
152 South Fulton Street, Suite 230
Wauseon, Ohio 43567

Township of Swanton (Lucas County)

Mr. John Warkentin, II
Trustee, Township of Swanton
13410 Airport Highway
Swanton, Ohio 43558

Mr. Dennis Tippie
Trustee, Township of Swanton
13410 Airport Highway
Swanton, Ohio 43558

Mr. Jim Irmen
Trustee, Township of Swanton
13410 Airport Highway
Swanton, Ohio 43558

Mr. William B. Cook
Fiscal Officer, Township of
Swanton
13410 Airport Highway
Swanton, Ohio 43558

Lucas County

The Honorable Tina Skeldon
Wozniak
President, Lucas County
Commissioner
One Government Center, Suite 800
Toledo, Ohio 43604


Mr. Keith G. Earley, P.E., P.S.
Lucas County Engineer
One Government Center, Suite 870
Toledo, Ohio 43604

The Honorable Ben Konop
Lucas County Commissioner
One Government Center, Suite 800
Toledo, Ohio 43604

Mr. Calvin J. Lawshe
Acting Director, Toledo-Lucas
County Planning Commission
One Government Center, Suite
1620
Toledo, Ohio 43604

The Honorable Pete Gerken
Lucas County Commissioner
One Government Center, Suite 800
Toledo, Ohio 43604

Exhibit 1

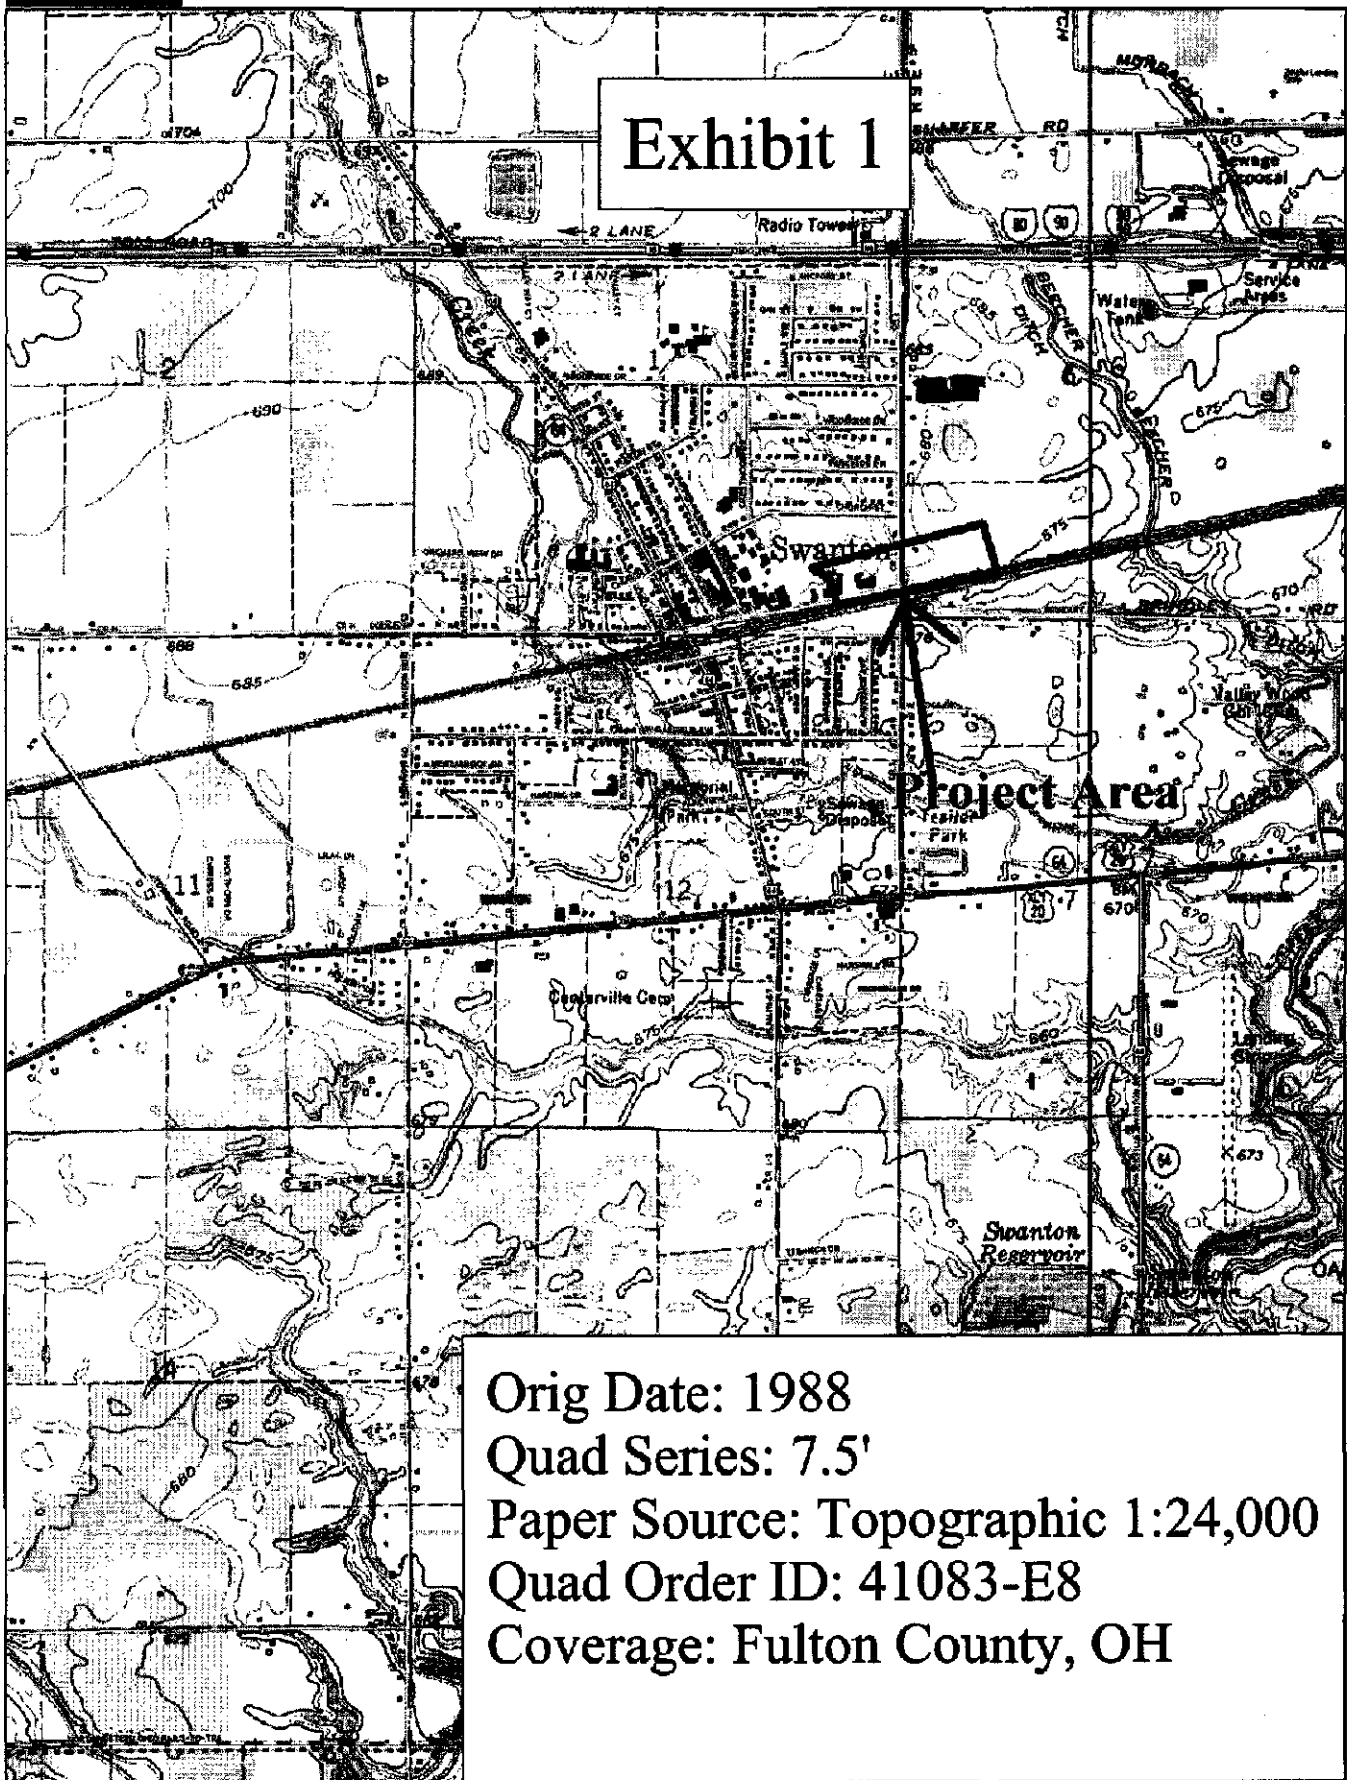


Orig Date: 1988
 Quad Series: 7.5'
 Paper Source: Topographic 1:24,000
 Quad Order ID: 41083-E8
 Coverage: Fulton County, OH

Data use subject to license.


© 2006 DeLorme. Topo USA® 6.0.


www.delorme.com



GENERAL LAYOUT EXHIBIT #2

- Pole #2 - Exhibit 3
- Pole #3 - Exhibit 4
- Pole #4 - Exhibit 4
- Pole #5 - Exhibit 3

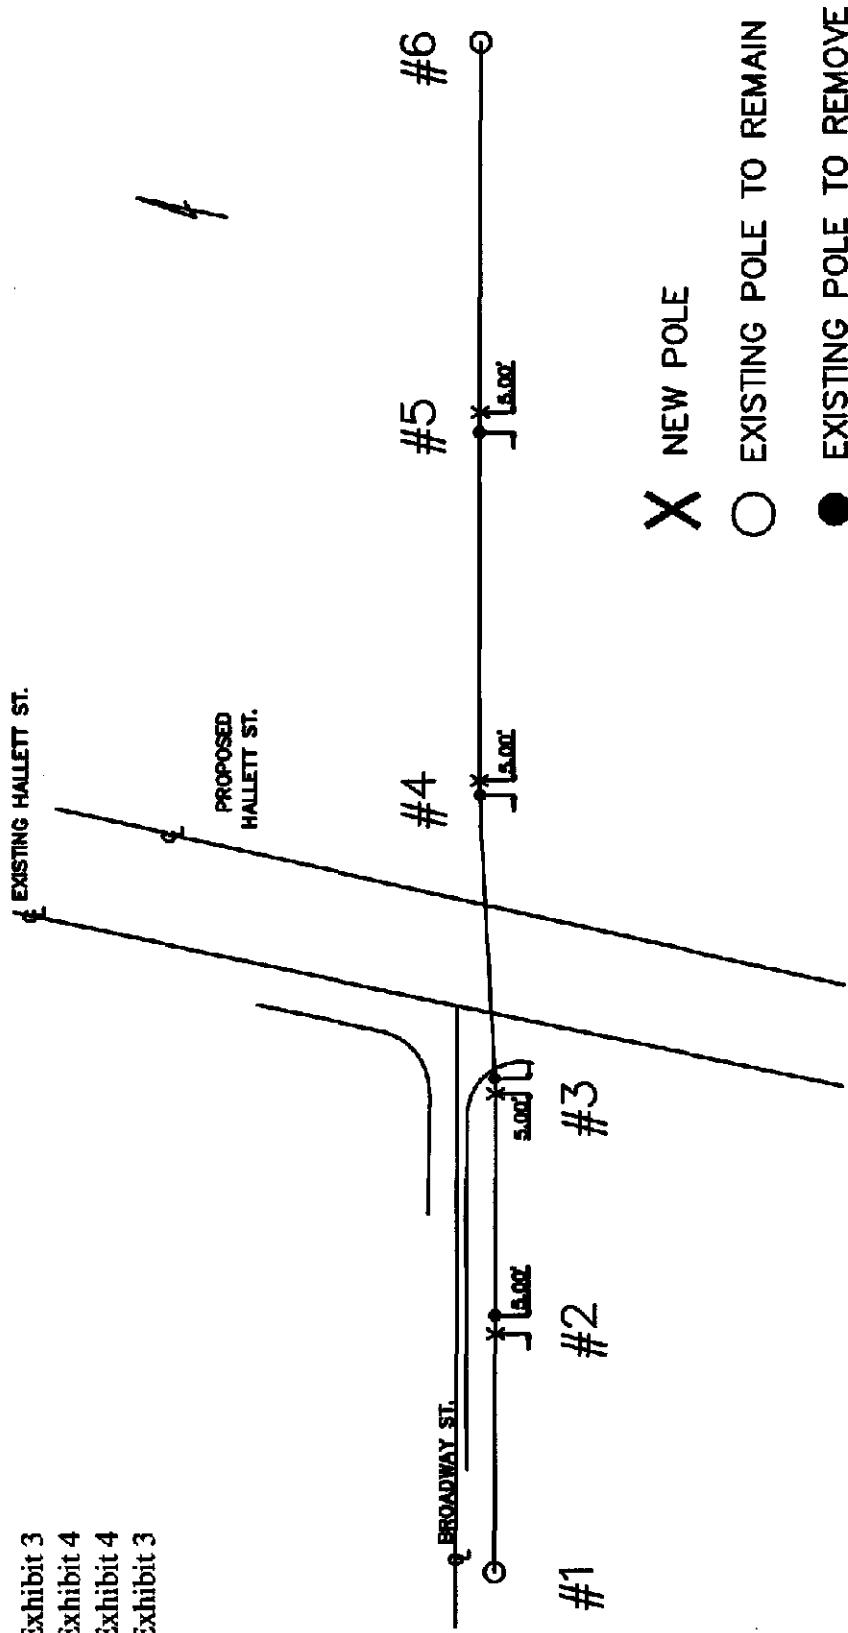

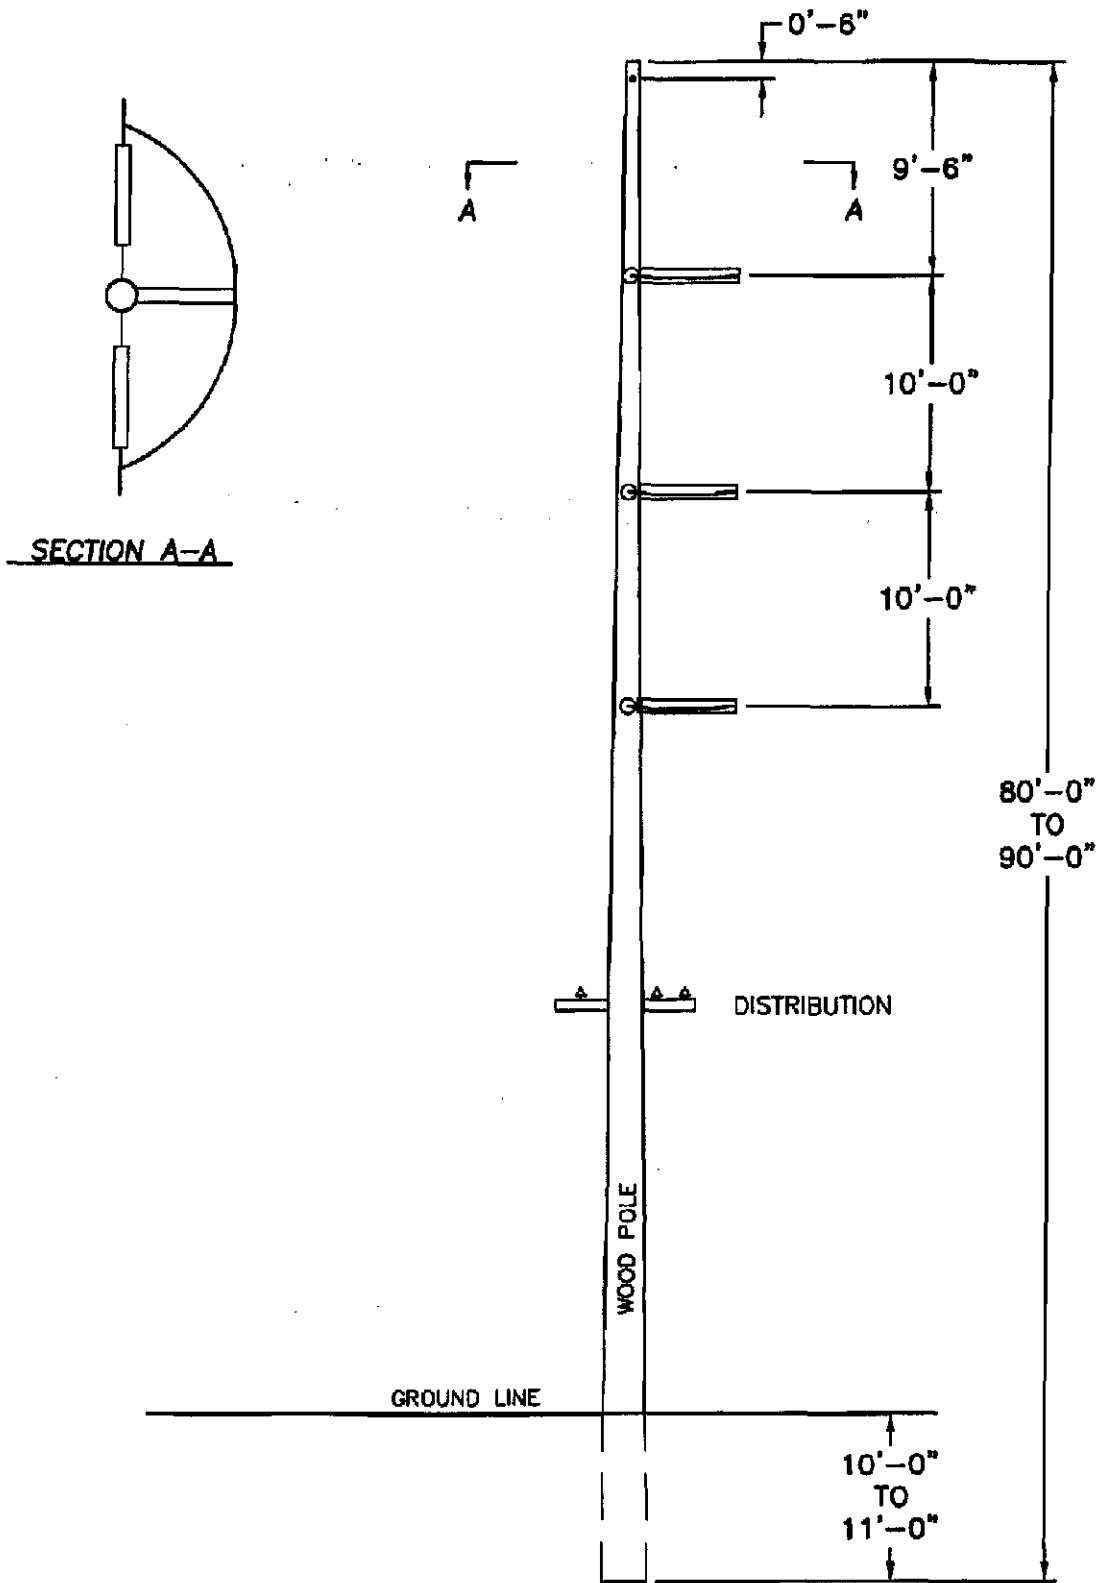

STRS. #135 & #138

ISSUE DATE:
☐ CONSTRUCTION
☐ AS BUILT
☐ RECORD

DR. <i>JWB</i>	3/08	C.E. 06-50-X
CHK.		ORDER NO. 118780188
INS.		WBS TW-008502-AI-C R/W WBS
APP.		SCALE N.T.S.

EBER-SWANTON 138kV
 HALLETT RD. RAILROAD REALIGNMENT
 TANGENT DEAD END STRUCTURE

FirstEnergy
 Transmission Design


OPERATING CO.
 TOLEDO EDISON

DWG NO.

EXHIBIT 3

SHEET REV.

SKETCHES\EBER-SWANTON_EX3

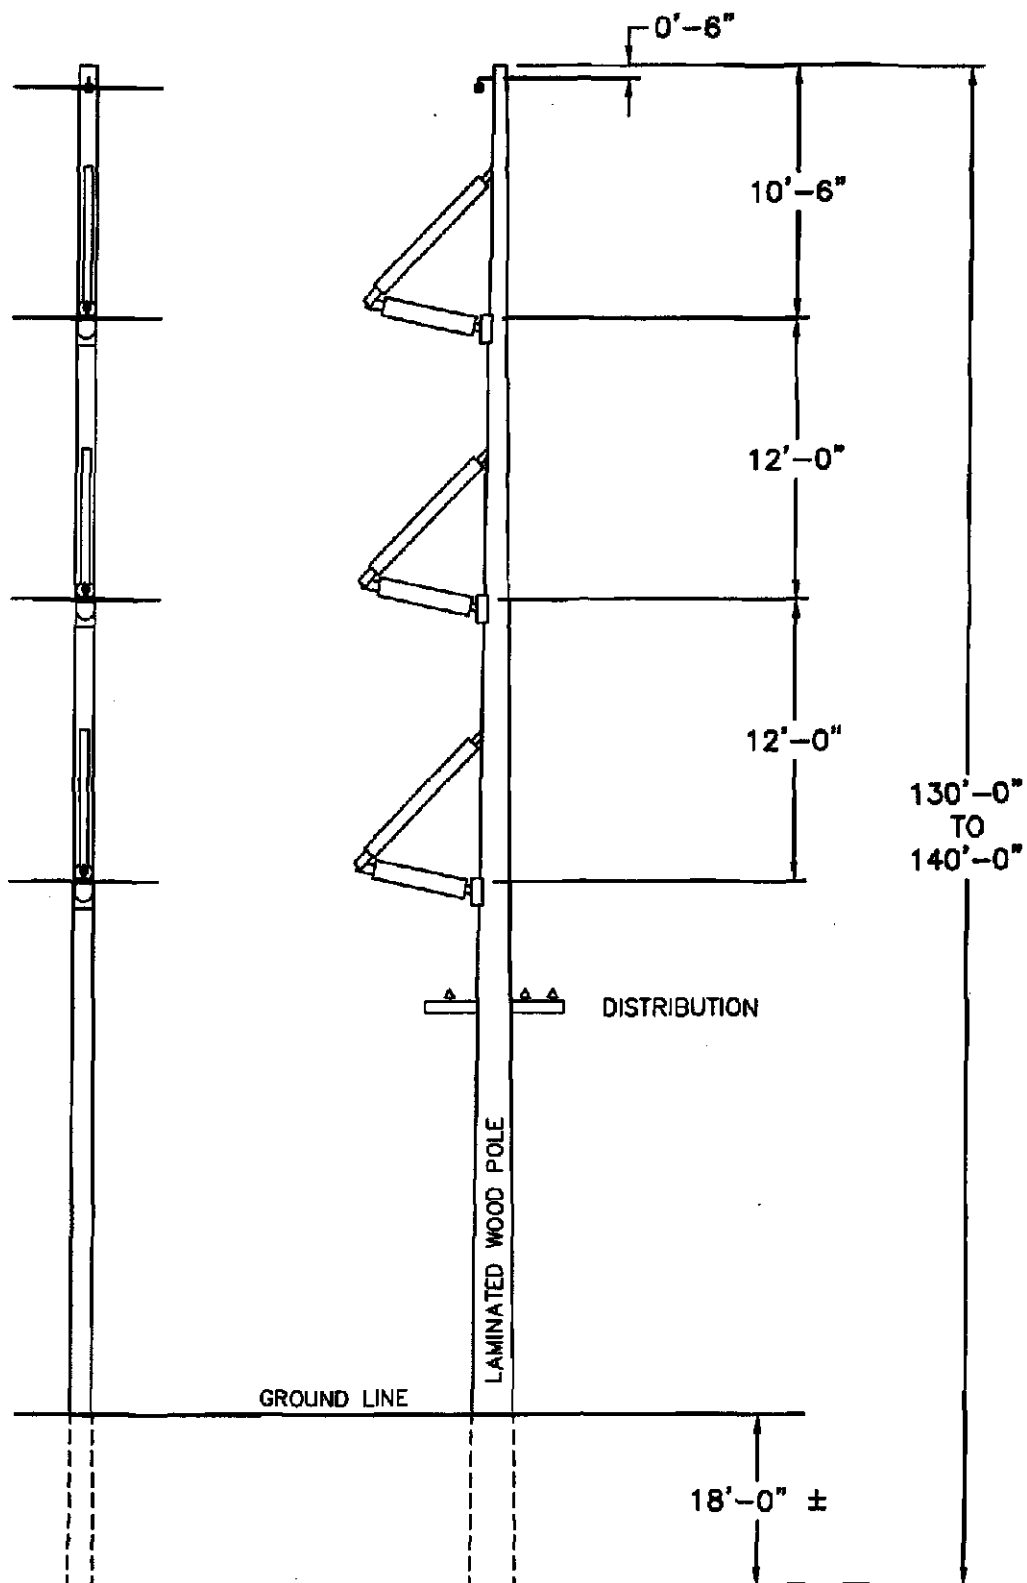

STRS. #136 & #137

ISSUE DATE:
☐ CONSTRUCTION
☐ AS BUILT
☐ RECORD

DR. <i>JWD</i>	3/08	CE 06-50-X
CHK.		ORDER NO. 118780188
INS.		WES TW-000502-AI-C R/H
APP.		SCALE N.T.S.

EBER-SWANTON 138KV
 HALLETT RD. RAILROAD REALIGNMENT
 BRACE POST ANGLE STRUCTURE

FirstEnergy
 Transmission Design

OPERATING CO.
 TOLEDO EDISON

DWG NO.

EXHIBIT 4

SHEET REV.

SKETCHES/EBER-SWANTON EXA