

FILE

CHESTER WILLCOX & SAXBE LLP

Attorneys and Counselors at Law

MARK S. YURICK

DIRECT DIAL 614-334-7197
myurick@cwsllaw.com

September 29, 2008

Ms. Renee Jenkins
Chief of Docketing
The Public Utilities Commission of Ohio
180 East Broad St.
Columbus, Ohio 43266-0573

RECEIVED-DOCKETING DIV
2008 SEP 29 PM 3:04
PUCO

Re: In the Matter of the Application of Aqua Ohio, Inc. to Add a Provision Clarifying that Aqua Ohio is not Required to Connect the Aqua Ohio System to Master Meters for Multi-Unit/Premise Development, Case No. 08-768-WW-AAC

Aqua Ohio, Inc., Tariff Case No. 89-7028-WW-TRF


Dear Ms. Jenkins:

In accordance with the Commission's Opinion and Order in Case No. 08-768-WW-AAC, issued on September 10, 2008, please find enclosed four (4) final copies of the approved Revised Tariff Sheets as listed below. One copy is for the tariff docket, one copy for the case docket, with the remaining two copies for distribution to the Rates and Tariffs, Energy and Water Division of the PUCO. The required documents are attached in the following order:

1. Struthers Division Master Tariff P.U.C.O. No. 2, section 2, Eighteenth Revised Sheet No. 2 Canceling Seventeenth Revised Sheet No. 2
2. Struthers Division Master Tariff P.U.C.O. No. 2, section 5, Fourth Revised Sheet No. 5 Canceling Third Revised Sheet No. 5.

If you have any questions, please feel free to contact me.

Very truly yours,


Mark S. Yurick
Counsel for Aqua Ohio, Inc.

Enclosures

cc: Rich Hideg/Aqua Ohio Inc.

ND: 4824-2347-6739, v. 1

This is to certify that the images appearing are an accurate and complete reproduction of a case file document delivered in the regular course of business.
Technician TM Date Processed 9/29/2008

MASTER TARIFF P.U.C.O. NO. 2


SUBJECT INDEX (Continued)

<u>Description</u>	<u>Section</u>	<u>Sheet No.</u>	<u>Effective Date</u>
E			
Explanation of Terms	3-1	1,2 & 3	12/23/96
Employee Identification	3-2	5	"
F			
Final Bill	3-3	2	"
Fire Protection – Private	3-8	1	"
Fire Protection – Public	3-9	1	"
Flow Detecting Devices	3-8	1	"
Forms – Service Application	6-1	1-2	"
H			
Hose Connections	4	See "Sch. Of Rates"	
Hydrants, Public Fire-Installation of	3-9	1	"
Hydrants, Public Fire-Specifications of	3-9	1	"
Hydrants, Public Fire-Use of Water from	3-9	1	"
Hydrants, Rates	4	"See Sch. Of Rates"	
I			
Installation – Meter	3-6	1	"
Installation – Service Dates	3-5	1	"
M			
Main Extensions – Customer Finan. Plans	3-7	3,4,5,6	4/1/04
Main Extensions – General	3-7	1,2	4/1/04
Map – Lake Erie East Division	5	1	01/13/99
Map – Stark Regional Division	5	4	05/04/01,03/11/03
Map – Struthers Division	5	5	03/11/03, 10/2/08
Meter – Inability of Company to Read	3-2	5	12/23/96
Meter – Inaccurate or Not Registering	3-6	3	12/23/96
Meter – Installation	3-6	1	12/23/96
Meter – Installation Location	3-6	2	12/23/96
Meter – Maintenance of and Repairs to	3-6	3	12/23/96
Meter – Minimum	4	"See Sch. Of Rates"	
Meter – Outside Vault Location	3-5	1	12/23/96

Issued: October 2, 2008

Effective: October 2, 2008

MASTER TARIFF P.U.C.O. No. 2
Struthers Division Service Area
(Former Tariffs P.U.C.O. No's 5,7,8, &23)

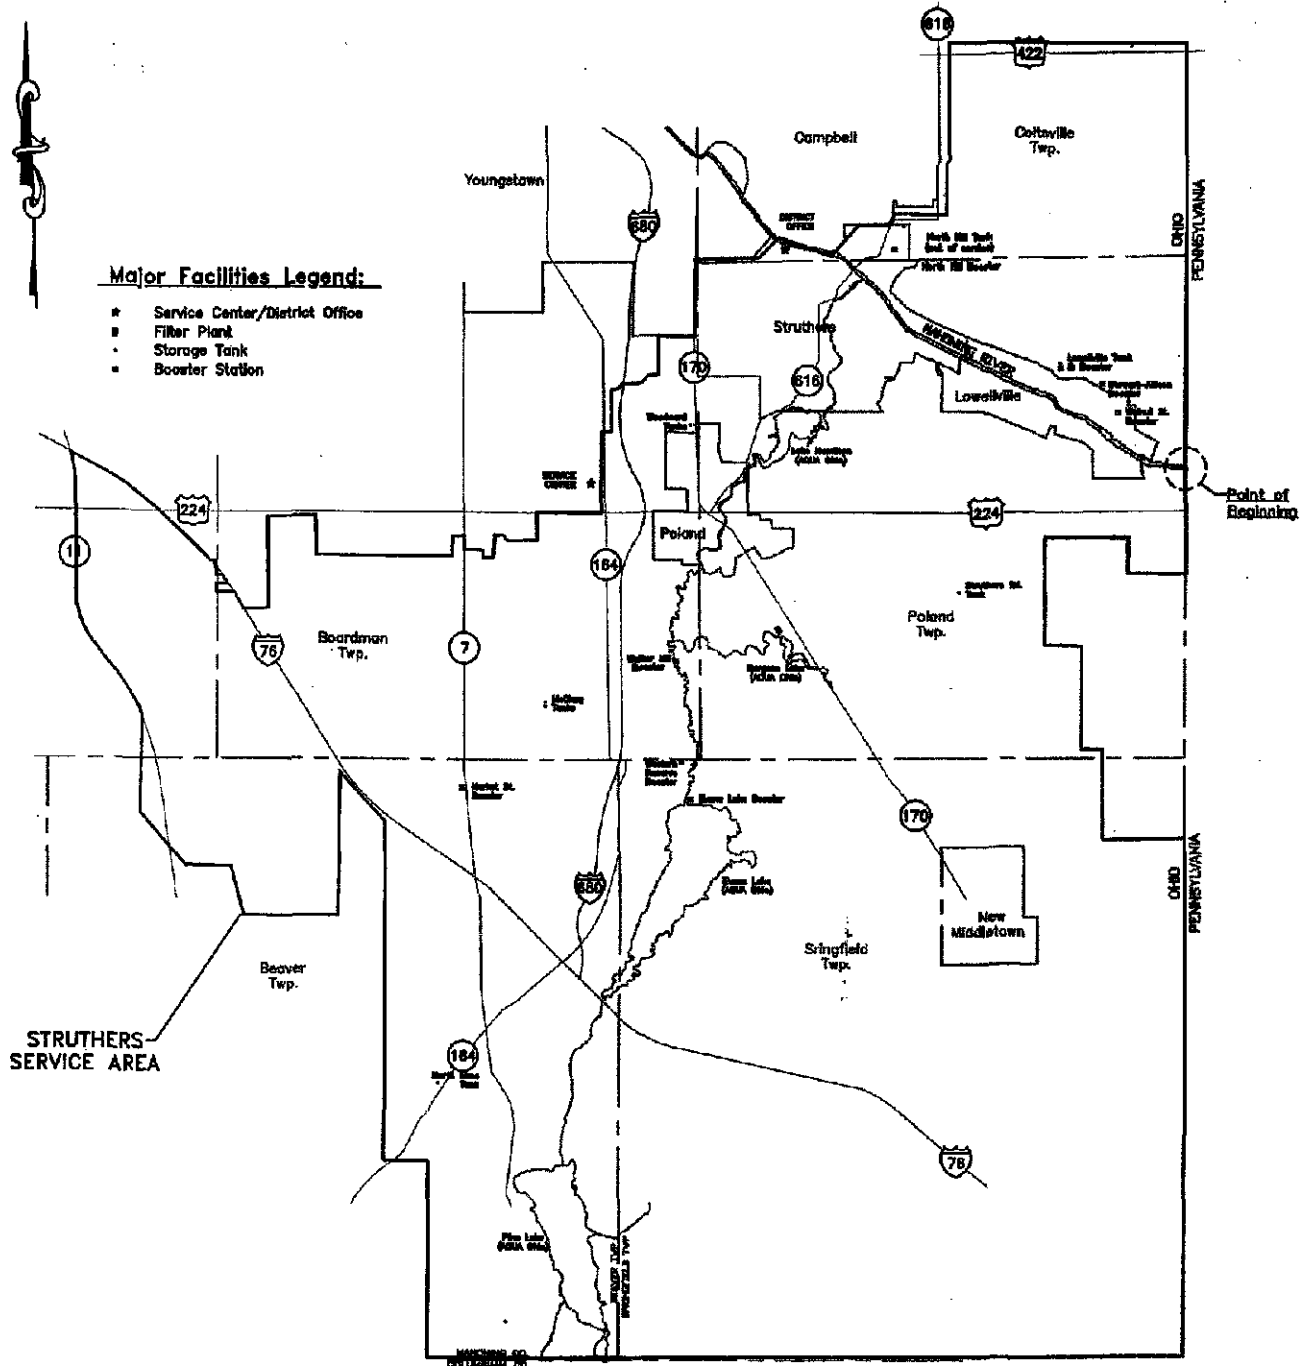

Issued: October 2,2008

Effective: October 2,2008

Issued by Walter J. Pishkur, President, Aqua Ohio, Inc.
In Accordance with the Public Utilities Commission of Ohio
Order Dated September 10,2008 for Case No. 08-768-WW-AAC