
Meter Specifications

All facilities are required to measure output with a utility grade meter. Please provide this information for each meter used in your system.

Manufacturer: GE

Serial Number: 704760

Type: Phase 3


Date of Last Certification: 10/28/06

Attach a photograph of the meter with date image taken. The meter reading must be clearly visible in the photograph.

Total kWh shown on meter at time of photograph: 57

Photo taken 9/8/2009

The Public Utilities Commission of Ohio reserves the right to verify the accuracy of the data reported to the tracking system and to the PUCO.

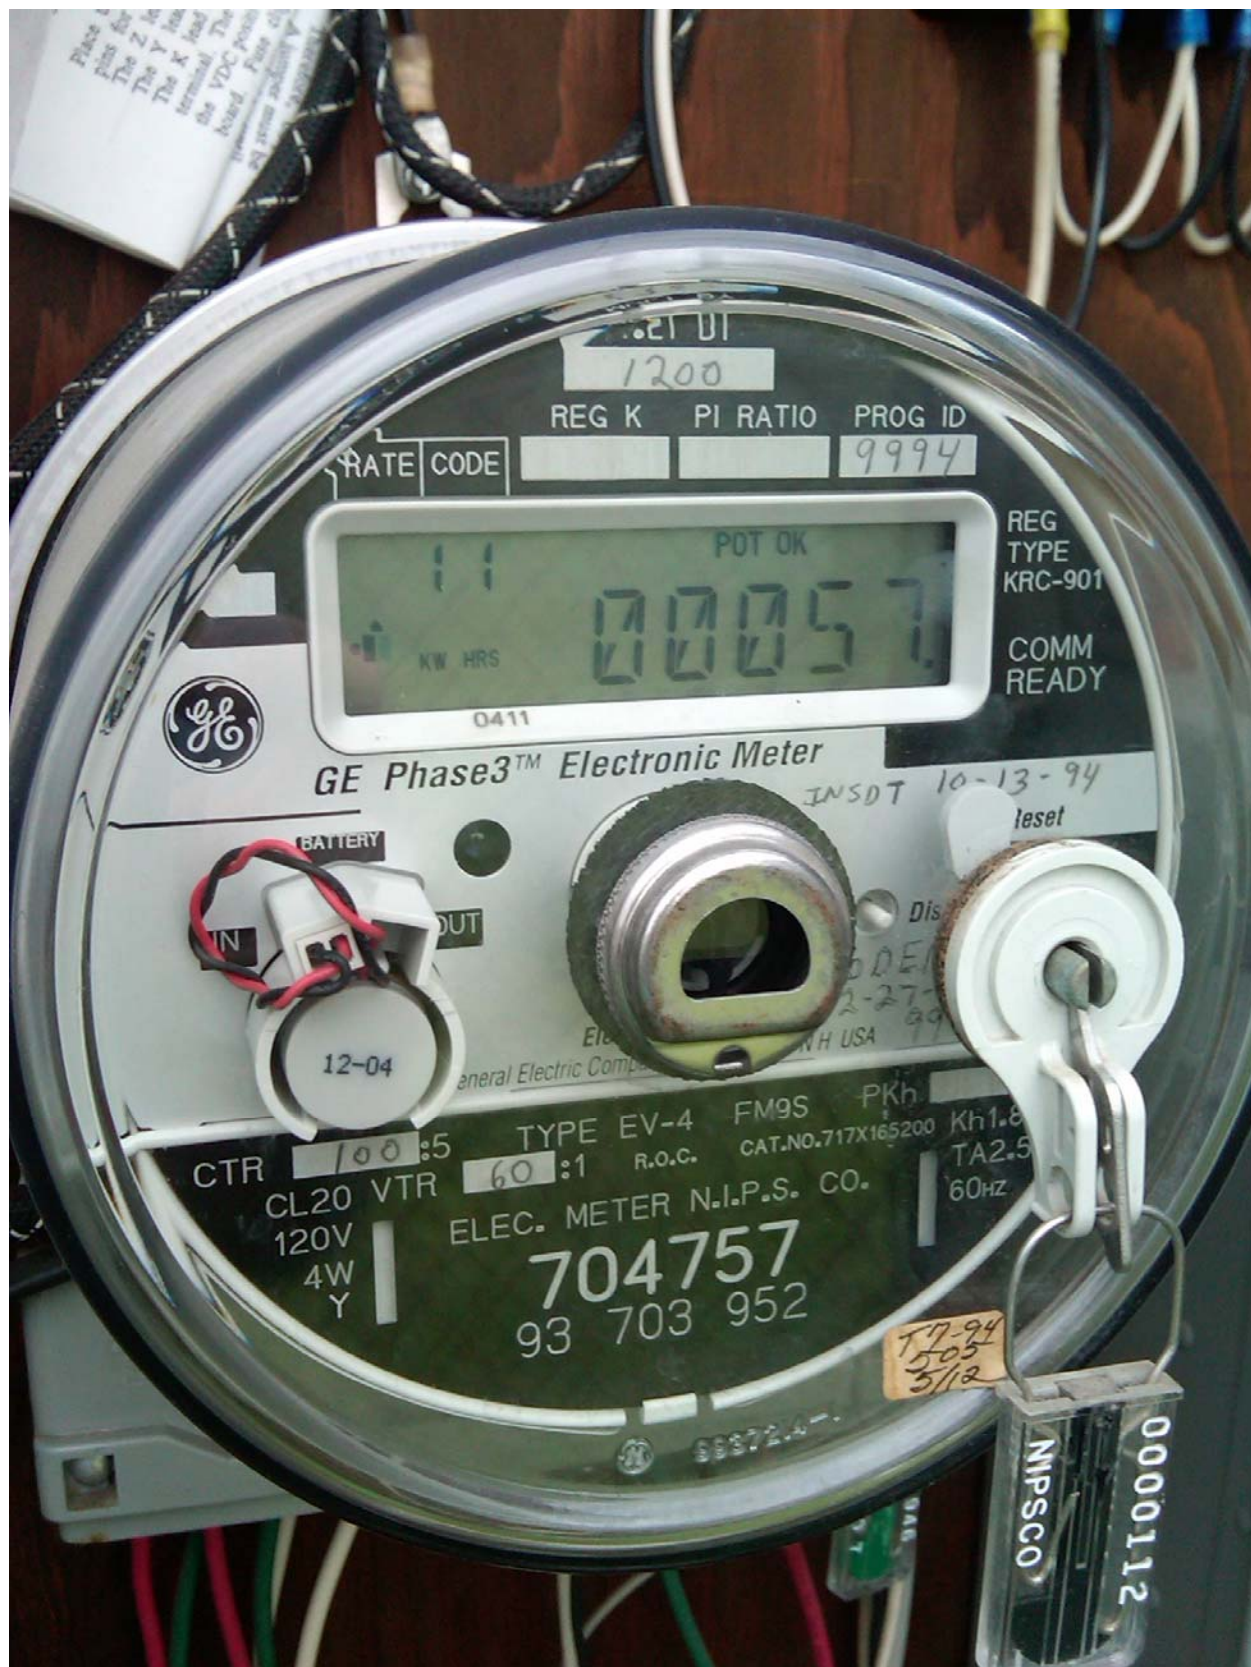



This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

9/8/2009 4:40:34 PM

in

Case No(s). 09-0690-EL-REN

Summary: Amended Application containing the last page of application including updated meter photographs electronically filed by Mr. Ken R Nelson on behalf of Wabash Valley Power Association, Inc