

FILE

December 3, 2009

Ms. Renee J. Jenkins
Director, Administration Department
Secretary to the Commission
Docketing Division
The Public Utilities Commission of Ohio
180 East Broad Street
Columbus, OH 43215-3793

Construction Notice
Babb-East Akron 138 kV Transmission Line Relocation
For The Martha Avenue Roundabout
Case No. 09-1914-EL-BNR

1914

Dear Ms. Jenkins:

In accordance with Rule 4906-01-11 American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corp., transmits one (1) original and eleven (11) copies of the enclosed Construction Notice. In this project, ATSI is proposing to relocate one (1) 138 kV transmission pole and the associated right-of-way, remove one (1) pole with guying and install guying on one existing pole at the intersection of Seiberling Street and Martha Avenue. The relocated pole will be installed approximately 66 feet west of the existing 138 kV transmission pole to be removed. The proposed Project is located at the intersection of Seiberling Street and Martha Avenue in the City of Akron, Summit County, Ohio.

Please be advised of the following:

a) Name and address of the applicant:

American Transmission Systems, Incorporated
76 South Main Street
Akron, Ohio 44308

b) Name of proposed facilities:

Babb-East Akron 138 kV Transmission Line Relocation for the Martha Avenue Roundabout.

RECEIVED-DOCKETING DIV
2009 DEC -4 PM 1:39
PUCO

This is to certify that the images appearing are an accurate and complete reproduction of a case file document delivered in the regular course of business.
Technician Sam Date Processed DEC 04 2009

c) Location of proposed facilities:

The Project is located at the intersection of Seiberling Street and Martha Avenue in the City of Akron, Summit County, Ohio.

d) Description of proposed facilities:

In this project, ATSI is proposing to relocate one (1) 138 kV transmission pole and the associated right-of-way and remove one (1) pole with guying and install guying on one existing pole at the intersection of Seiberling Street and Martha Avenue.

e) Applicant's representative:

Scott Humphrys, Associate Distribution Specialist
Energy Delivery Technical Services
FirstEnergy Service Company
76 South Main Street
Akron, OH 44308-1890

After docketing this filing, please return one time-stamped copy of the Construction Notice for our records to us in the enclosed envelope. We have provided a copy of this Construction Notice by certified mail, with return receipt requested, to officials of the political subdivisions immediately affected by the proposed project as listed in the attached Exhibit 1. Copies of the transmittal letters addressed to the local government representatives of the City of Akron, Summit County are enclosed for your file.

Should the Ohio Power Siting Board desire further information or discussion of this submittal, please contact me at (330) 384-2526.

Sincerely,



Scott Humphrys
Associate Distribution Specialist
Energy Delivery Technical Services
FirstEnergy Service Company

Attachments

EXHIBIT 1
Officials Served Copy of Construction Notice
Babb-East Akron 138 kV Transmission Line
Relocation for the Martha Avenue Roundabout
Case No. 09- -EL-BNR

City of Akron

The Honorable Donald L. Plusquellic
Mayor, City of Akron
Suite 200 Municipal Building
166 South High Street
Akron, OH 44308

Mr. Marco S. Sommerville
President of Council, City of Akron
166 South High Street 3rd Floor
Akron, OH 44308

Mr. Richard Merolla
Director of Public Service, City of Akron
166 South High Street 2nd Floor
Akron, OH 44308

Mr. John O. Moore
Director of Planning, City of Akron
166 South High Street 4th Floor
Akron, OH 44308

Summit County

The Honorable Russell M. Pry
Summit County Executive
175 South Main St. 8th Floor
Akron, OH 44308

Mr. Nick Kostandaras
President of Council, Summit County
175 South Main Street, Room 700
Akron, OH 44308

Mr. Alan Brubaker, P.E., P.S.
Summit County Engineer
538 E. South Street
Akron, OH 44311

Mr. John A. Donofrio
Fiscal Officer, Summit County
175 S. Main Street 4th Floor
Akron, OH 44308

December 3, 2009

The Honorable Donald L. Plusquellic
Mayor, City of Akron
Suite 200 Municipal Building
166 South High Street
Akron, OH 44308

Construction Notice
Babb-East Akron 138 kV Transmission Line Relocation
For The Martha Avenue Roundabout
Case No. 09-1914 -EL-BNR

Dear Mayor Plusquellic,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one (1) 138 kV transmission pole and the associated right-of-way, remove one (1) pole with guying and install guying on one existing pole at the intersection of Seiberling Street and Martha Avenue. The relocated pole will be installed approximately 66 feet west of the existing 138 kV transmission pole to be removed. The proposed Project is located at the intersection of Seiberling Street and Martha Avenue in the City of Akron, Summit County, Ohio.

The proposed Project improvements are needed to facilitate the Martha Avenue Roundabout Project in the City of Akron, Summit County. This requires the relocation of one (1) 138 kV transmission pole and the associated right-of-way remove one (1) pole with guying and install guying on one existing pole at the intersection of Seiberling Street and Martha Avenue.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the Project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott Humphrys
Associate Distribution Specialist
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

December 3, 2009

Mr. Marco S. Sommerville
President of Council, City of Akron
166 South High Street 3rd Floor
Akron, OH 44308

Construction Notice
Babb-East Akron 138 kV Transmission Line Relocation
For The Martha Avenue Roundabout
Case No. 09-111 -EL-BNR

Dear Mr. Sommerville,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one (1) 138 kV transmission pole and the associated right-of-way, remove one (1) pole with guying and install guying on one existing pole at the intersection of Seiberling Street and Martha Avenue. The relocated pole will be installed approximately 66 feet west of the existing 138 kV transmission pole to be removed. The proposed Project is located at the intersection of Seiberling Street and Martha Avenue in the City of Akron, Summit County, Ohio.

The proposed Project improvements are needed to facilitate the Martha Avenue Roundabout Project in the City of Akron, Summit County. This requires the relocation of one (1) 138 kV transmission pole and the associated right-of-way remove one (1) pole with guying and install guying on one existing pole at the intersection of Seiberling Street and Martha Avenue.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the Project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott Humphrys
Associate Distribution Specialist
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

December 3, 2009

Mr. Richard Merolla
Director of Public Service, City of Akron
166 South High Street 2nd Floor
Akron, OH 44308

Construction Notice
Babb-East Akron 138 kV Transmission Line Relocation
For The Martha Avenue Roundabout
Case No. 09-114 -EL-BNR

Dear Mr. Merolla,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one (1) 138 kV transmission pole and the associated right-of-way, remove one (1) pole with guying and install guying on one existing pole at the intersection of Seiberling Street and Martha Avenue. The relocated pole will be installed approximately 66 feet west of the existing 138 kV transmission pole to be removed. The proposed Project is located at the intersection of Seiberling Street and Martha Avenue in the City of Akron, Summit County, Ohio.

The proposed Project improvements are needed to facilitate the Martha Avenue Roundabout Project in the City of Akron, Summit County. This requires the relocation of one (1) 138 kV transmission pole and the associated right-of-way remove one (1) pole with guying and install guying on one existing pole at the intersection of Seiberling Street and Martha Avenue.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the Project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott Humphrys
Associate Distribution Specialist
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

December 3, 2009

Mr. John O. Moore
Director of Planning, City of Akron
166 South High Street 4th Floor
Akron, OH 44308

Construction Notice
Babb-East Akron 138 kV Transmission Line Relocation
For The Martha Avenue Roundabout
Case No. 09-114 -EL-BNR

Dear Mr. Moore,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one (1) 138 kV transmission pole and the associated right-of-way, remove one (1) pole with guying and install guying on one existing pole at the intersection of Seiberling Street and Martha Avenue. The relocated pole will be installed approximately 66 feet west of the existing 138 kV transmission pole to be removed. The proposed Project is located at the intersection of Seiberling Street and Martha Avenue in the City of Akron, Summit County, Ohio.

The proposed Project improvements are needed to facilitate the Martha Avenue Roundabout Project in the City of Akron, Summit County. This requires the relocation of one (1) 138 kV transmission pole and the associated right-of-way remove one (1) pole with guying and install guying on one existing pole at the intersection of Seiberling Street and Martha Avenue.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the Project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott Humphrys
Associate Distribution Specialist
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

December 3, 2009

The Honorable Russell M. Pry
Summit County Executive
175 South Main St. 8th Floor
Akron, OH 44308

Construction Notice
Babb-East Akron 138 kV Transmission Line Relocation
For The Martha Avenue Roundabout
Case No. 09-1914 -EL-BNR

Dear Mr. Pry,

In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one (1) 138 kV transmission pole and the associated right-of-way, remove one (1) pole with guying and install guying on one existing pole at the intersection of Seiberling Street and Martha Avenue. The relocated pole will be installed approximately 66 feet west of the existing 138 kV transmission pole to be removed. The proposed Project is located at the intersection of Seiberling Street and Martha Avenue in the City of Akron, Summit County, Ohio.

The proposed Project improvements are needed to facilitate the Martha Avenue Roundabout Project in the City of Akron, Summit County. This requires the relocation of one (1) 138 kV transmission pole and the associated right-of-way remove one (1) pole with guying and install guying on one existing pole at the intersection of Seiberling Street and Martha Avenue.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the Project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott Humphrys
Associate Distribution Specialist
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

December 3, 2009

Mr. Nick Kostandaras
President of Council, Summit County
175 South Main Street, Room 700
Akron, OH 44308

Construction Notice
Babb-East Akron 138 kV Transmission Line Relocation
For The Martha Avenue Roundabout
Case No. 09-114 -EL-BNR

Dear Mr. Kostandaras,


In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one (1) 138 kV transmission pole and the associated right-of-way, remove one (1) pole with guying and install guying on one existing pole at the intersection of Seiberling Street and Martha Avenue. The relocated pole will be installed approximately 66 feet west of the existing 138 kV transmission pole to be removed. The proposed Project is located at the intersection of Seiberling Street and Martha Avenue in the City of Akron, Summit County, Ohio.

The proposed Project improvements are needed to facilitate the Martha Avenue Roundabout Project in the City of Akron, Summit County. This requires the relocation of one (1) 138 kV transmission pole and the associated right-of-way remove one (1) pole with guying and install guying on one existing pole at the intersection of Seiberling Street and Martha Avenue.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the Project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott Humphrys
Associate Distribution Specialist
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

December 3, 2009

Mr. Alan Brubaker, P.E., P.S.
Summit County Engineer
538 E. South Street
Akron, OH 44311

Construction Notice
Babb-East Akron 138 kV Transmission Line Relocation
For The Martha Avenue Roundabout
Case No. 09-1914-EL-BNR

Dear Mr. Brubaker,


In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one (1) 138 kV transmission pole and the associated right-of-way, remove one (1) pole with guying and install guying on one existing pole at the intersection of Seiberling Street and Martha Avenue. The relocated pole will be installed approximately 66 feet west of the existing 138 kV transmission pole to be removed. The proposed Project is located at the intersection of Seiberling Street and Martha Avenue in the City of Akron, Summit County, Ohio.

The proposed Project improvements are needed to facilitate the Martha Avenue Roundabout Project in the City of Akron, Summit County. This requires the relocation of one (1) 138 kV transmission pole and the associated right-of-way remove one (1) pole with guying and install guying on one existing pole at the intersection of Seiberling Street and Martha Avenue.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the Project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott Humphrys
Associate Distribution Specialist
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

December 3, 2009

Mr. John A. Donofrio
Fiscal Officer, Summit County
175 S. Main Street 4th Floor
Akron, OH 44308

Construction Notice
Babb-East Akron 138 kV Transmission Line Relocation
For The Martha Avenue Roundabout
Case No. 09-1914-EL-BNR

Dear Mr. Donofrio,


In the above captioned project, American Transmission Systems, Inc. ("ATSI"), a subsidiary of FirstEnergy Corp., is proposing to relocate one (1) 138 kV transmission pole and the associated right-of-way, remove one (1) pole with guying and install guying on one existing pole at the intersection of Seiberling Street and Martha Avenue. The relocated pole will be installed approximately 66 feet west of the existing 138 kV transmission pole to be removed. The proposed Project is located at the intersection of Seiberling Street and Martha Avenue in the City of Akron, Summit County, Ohio.

The proposed Project improvements are needed to facilitate the Martha Avenue Roundabout Project in the City of Akron, Summit County. This requires the relocation of one (1) 138 kV transmission pole and the associated right-of-way remove one (1) pole with guying and install guying on one existing pole at the intersection of Seiberling Street and Martha Avenue.

In accordance with the provisions of Ohio Administrative Code ("OAC") Rule 4906-1-01, this project falls within the Ohio Power Siting Board's requirements for a Construction Notice ("CN"). Therefore, in compliance with OAC 4906-11-02 of the OPSB's Rules and Regulations, we have prepared and filed the attached CN with the OPSB for their review and approval. The CN contains a description of the Project and is provided for your information.

I'll be glad to answer any question concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott Humphrys
Associate Distribution Specialist
Energy Delivery Technical Services
FirstEnergy Service Company

Attachment

NE

AMERICAN TRANSMISSION SYSTEMS, INCORPORATED

CONSTRUCTION NOTICE

**BABB-EAST AKRON 138 kV
TRANSMISSION LINE RELOCATION FOR
THE MARTHA AVENUE ROUNDABOUT**

OPSB CASE NO. 09- 1914 -EL-BNR

December 3, 2009

RECEIVED-DOCKETING DIV

2009 DEC -4 PM 1:40

PUCO

**American Transmission Systems, Incorporated
76 South Main Street
Akron, Ohio 44308**

**CONSTRUCTION NOTICE
BABB-EAST AKRON 138 kV TRANSMISSION LINE RELOCATION
FOR THE MARTHA AVENUE ROUNDABOUT**

The following information is being provided in accordance with the procedures delineated in Ohio Administrative Code Section 4906-11-02: Construction Notice Requirements of the Rules and Regulations of the Ohio Power Siting Board.

4906-11-02 (B): Information Requirements

4906-11-02 (B) (1): Name of the Project

Name of Project: Babb-East Akron 138 kV Transmission Line Relocation for
the Martha Avenue Roundabout Project

4906-11-02 (B) (2) (a): Brief Description of Project

American Transmission Systems, Incorporated (“ATSI”), a FirstEnergy Corp. subsidiary, is preparing a Babb-East Akron 138 kV Transmission Line Relocation for the Martha Avenue Roundabout Project (“Project”). The proposed Project consists of relocating one (1) 138 kV transmission pole and the associated right-of-way, removing one pole with guying and installing guying on one existing pole at the intersection of Seiberling Street and Martha Avenue. The relocated pole will be installed approximately 66 feet west of the existing pole being removed. The proposed Project is located at the intersection of Seiberling Street and Martha Avenue in the City of Akron, Summit County, Ohio.

The general location of the proposed Project is shown in Exhibit 1, which is a partial copy of the United States Geologic Survey, Summit County Ohio Quad, Map ID 41081-A4. The general layout of the proposed Project is shown in Exhibit 2. The typical details of the new pole are shown in Exhibit 3.

4906-11-02 (B) (2) (b): Construction Notice Requirements

The proposed Project meets the requirements for a Construction Notice because the project is within the types of project defined by Item (9) of the Application Requirement Matrix for Electric Power Transmission Lines in Appendix A of 4906-1-01 of the Ohio Administrative Code, which requires the filing of a Construction Notice. This items states:

- (9) Replacement or relocation of an electric power transmission line and associated facilities where the project is required by publicly funded entities and is located on or adjacent to right-of-way or land owned by the public entity requiring the project.*

The City of Akron is installing a roundabout at the intersection of Seiberling Street and Martha Avenue in their Martha Avenue Street Improvements Project. The relocated pole will be installed in the public road right-of-way for the proposed Martha Avenue roundabout. The existing Babb-East Akron 138 kV transmission line and the proposed modifications will be owned by ATSI.

4906-11-02 (B) (3): Need for the Project

The proposed Project is needed to facilitate the installation of the Martha Avenue Roundabout in the City of Akron, Summit County, Ohio. This requires the relocation of one pole of the Babb-East Akron 138kV transmission line, and the associated right-of-way at the intersection of Seiberling Street and Martha Avenue.

4906-11-02 (B) (4): Construction Schedule

Construction on the proposed Project is proposed to begin on February 1, 2010. Construction on the proposed Project is expected to be completed by February 26, 2010.

4906-11-02 (B) (5): Estimated Costs

The following is the estimated capital cost for the Project:

| | |
|----------------|-----------|
| Estimated Cost | \$ 50,000 |
|----------------|-----------|

4906-11-02 (B) (6): Operating Characteristics

The existing Babb-East Akron 138 kV transmission line operates at 138 kV. The proposed modifications will not change the operating characteristics of this transmission line. New property rights are required for the relocation of the transmission pole for the proposed Project.

4906-11-02 (B) (7): Area Map

Exhibit No. 1 depicts the general location of the project site. This exhibit provides a partial copy of the United States Geologic Survey, Summit County Ohio Quad Map ID 41081-A4. To locate and view the project site from Columbus, Ohio, travel north on OH-71 towards Cleveland for approximately 100 miles. Take exit number 209 to merge onto I-76/US-224 E toward Akron for approximately 18.5 miles. Take the exit onto I-76 E toward Akron and proceed approximately 1.7 miles. Take the exit onto I-76 E/I-77 S toward Akron for approximately 5 miles. Take exit 25 B toward General St./Brittain Rd. Merge onto Englewood Ave. and turn right at Seiberling St. The proposed Project location will be at the intersection of Seiberling Street and Martha Avenue.

4906-11-02 (B) (8): Properties List

The relocated pole will be located within the road right-of-way for the Martha Avenue Roundabout. The adjacent right-of-way will be located within the road right-of-way and right-of-way to be obtained by ATSI and listed below.

IRG RC Lessor LLC.

IRG RC 4B LLC.

Parcel # 6763110

Parcel # 6763180

4906-11-02 (C): Documentation of Construction Notice Transmittal

This Construction Notice is being provided concurrently to the following officials of the City of Akron and Summit County, Ohio. Copies of the transmittal letters to these officials have been included with the transmittal letter submitting this Construction Notice to the Ohio Power Siting Board.

City of Akron

The Honorable Donald L. Plusquellic
Mayor, City of Akron
Suite 200 Municipal Building
166 South High Street
Akron, OH 44308

Mr. Marco S. Sommerville
President of Council, City of Akron
166 South High Street 3rd Floor
Akron, OH 44308

Mr. Richard Merolla
Director of Public Service, City of Akron
166 South High Street 2nd Floor
Akron, OH 44308

Mr. John O. Moore
Director of Planning, City of Akron
166 South High Street 4th Floor
Akron, OH 44308

Summit County


The Honorable Russell M. Pry
Summit County Executive
175 South Main St. 8th Floor
Akron, OH 44308

Mr. Nick Kostandaras
President of Council, Summit County
175 South Main Street, Room 700
Akron, OH 44308

Mr. Alan Brubaker, P.E., P.S.
Summit County Engineer
538 E. South Street
Akron, OH 44311

Mr. John A. Donofrio
Fiscal Officer, Summit County
175 S. Main Street 4th Floor
Akron, OH 44308

Exhibit 1

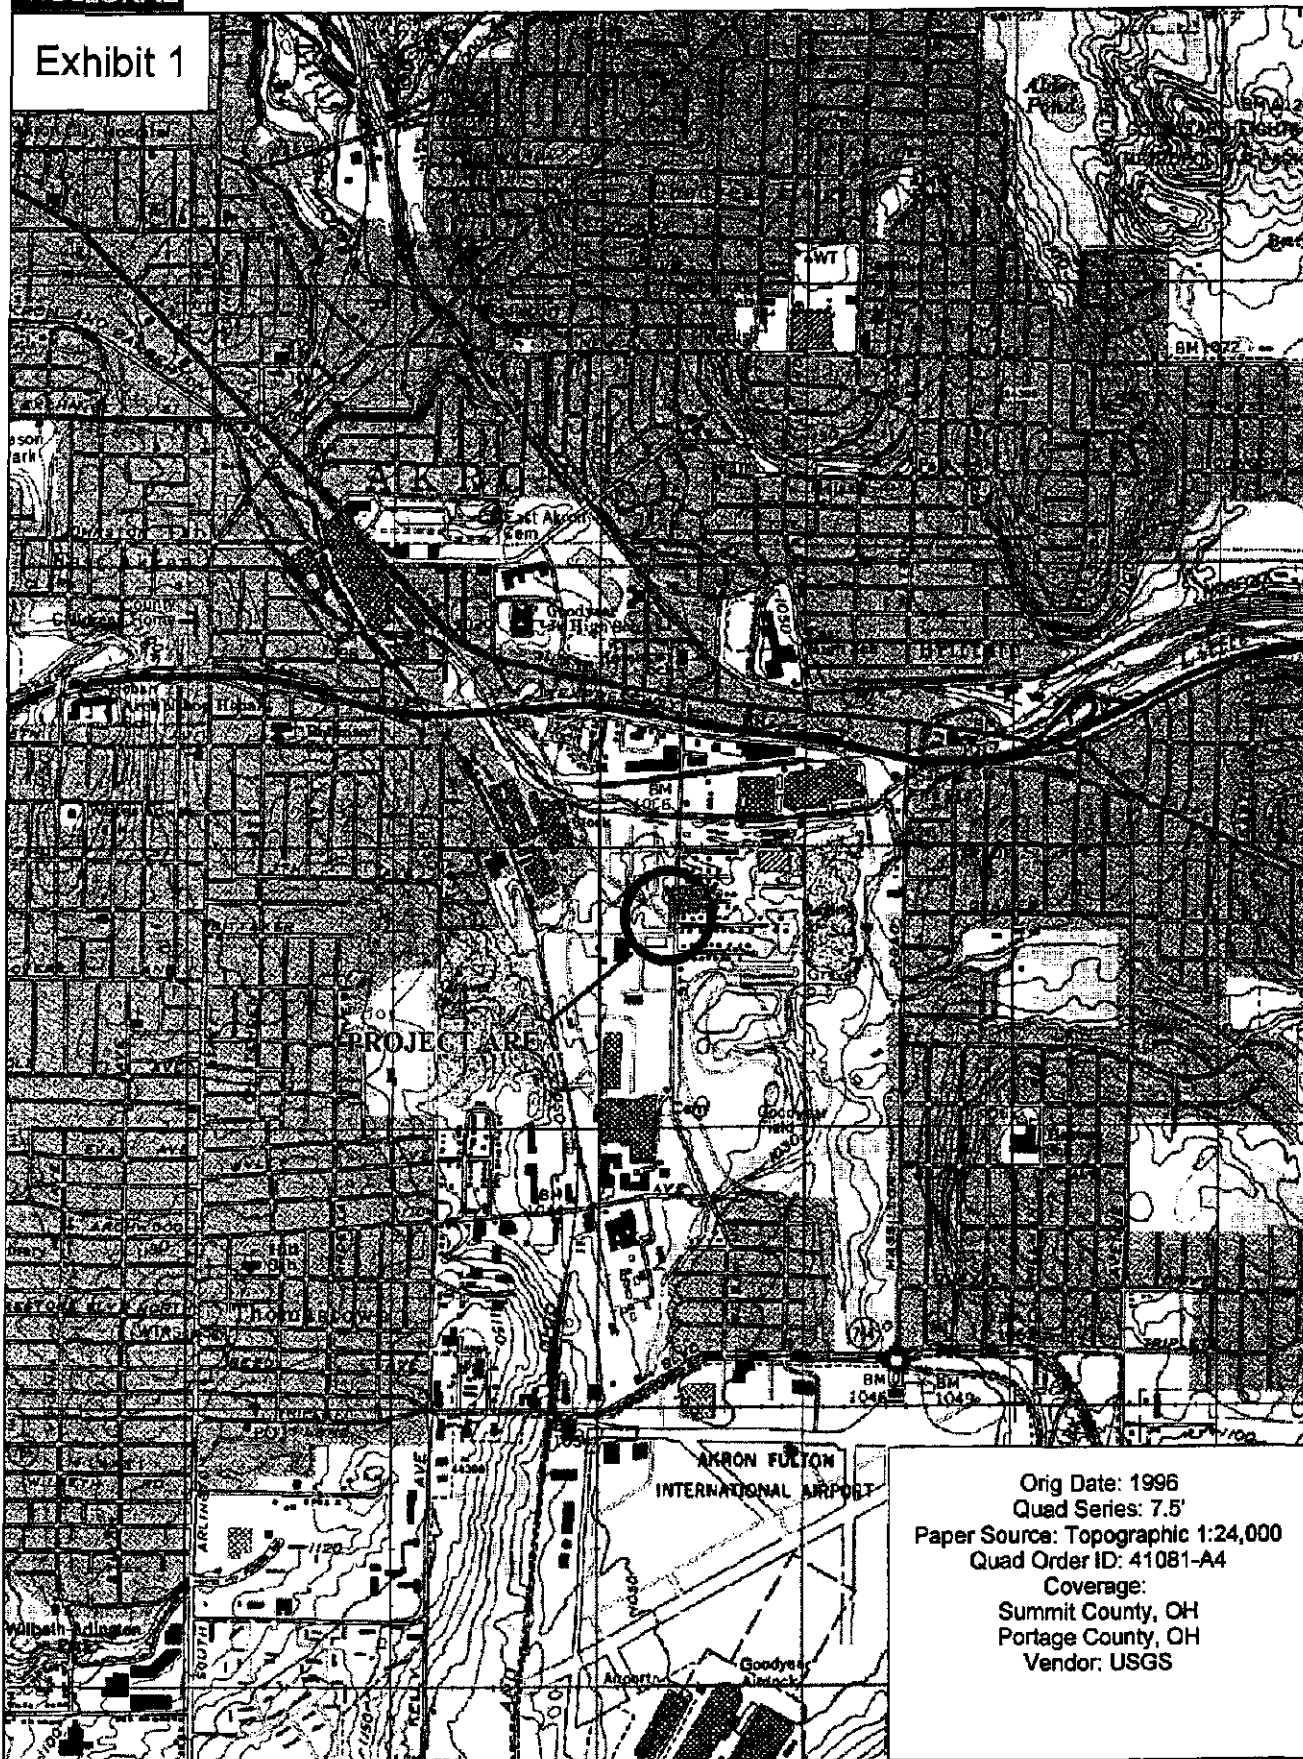

Orig Date: 1996
 Quad Series: 7.5'
 Paper Source: Topographic 1:24,000
 Quad Order ID: 41081-A4
 Coverage:
 Summit County, OH
 Portage County, OH
 Vendor: USGS


Data use subject to license.

© 2006 DeLorme. Topo USA® 6.0.


www.delorme.com



Scale 1 : 24,000



1" = 2,000.0 ft Data Zoom 13-4

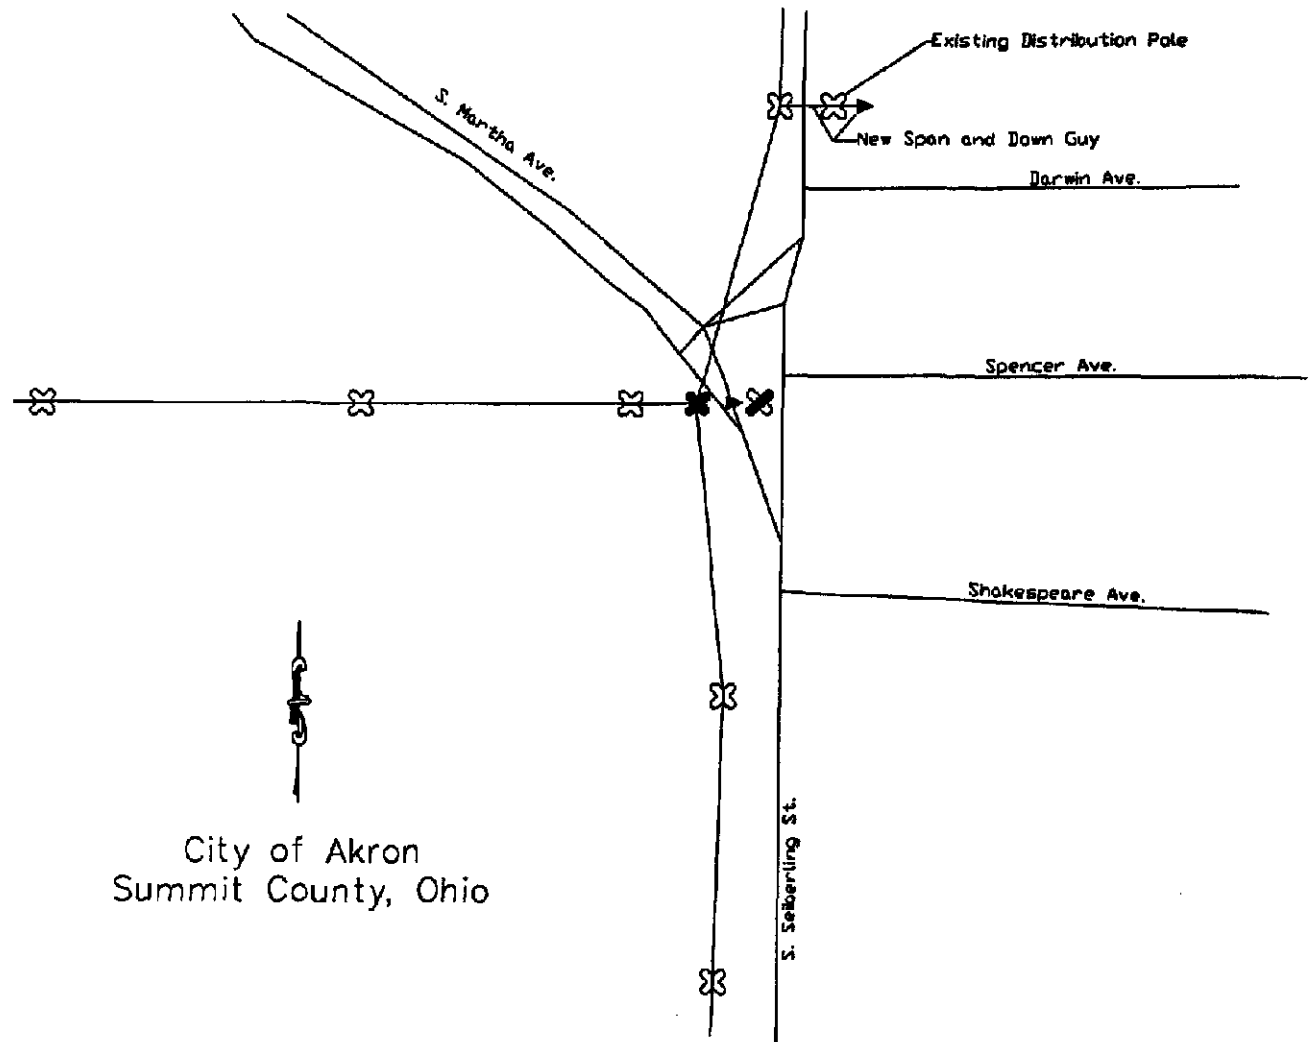

- ✕ Existing Pole
- ✕ New Pole
- ✕ Pole to be Removed
- ◄ New Anchor

** Not to Scale


ATSI

American Transmission Systems, Inc.
a subsidiary of FluorEnergy Corp

BABB-EAST AKRON 138 kV
TRANSMISSION LINE RELOCATION
FOR THE MARTHA AVENUE ROUNDABOUT

GENERAL LAYOUT

EXHIBIT 2

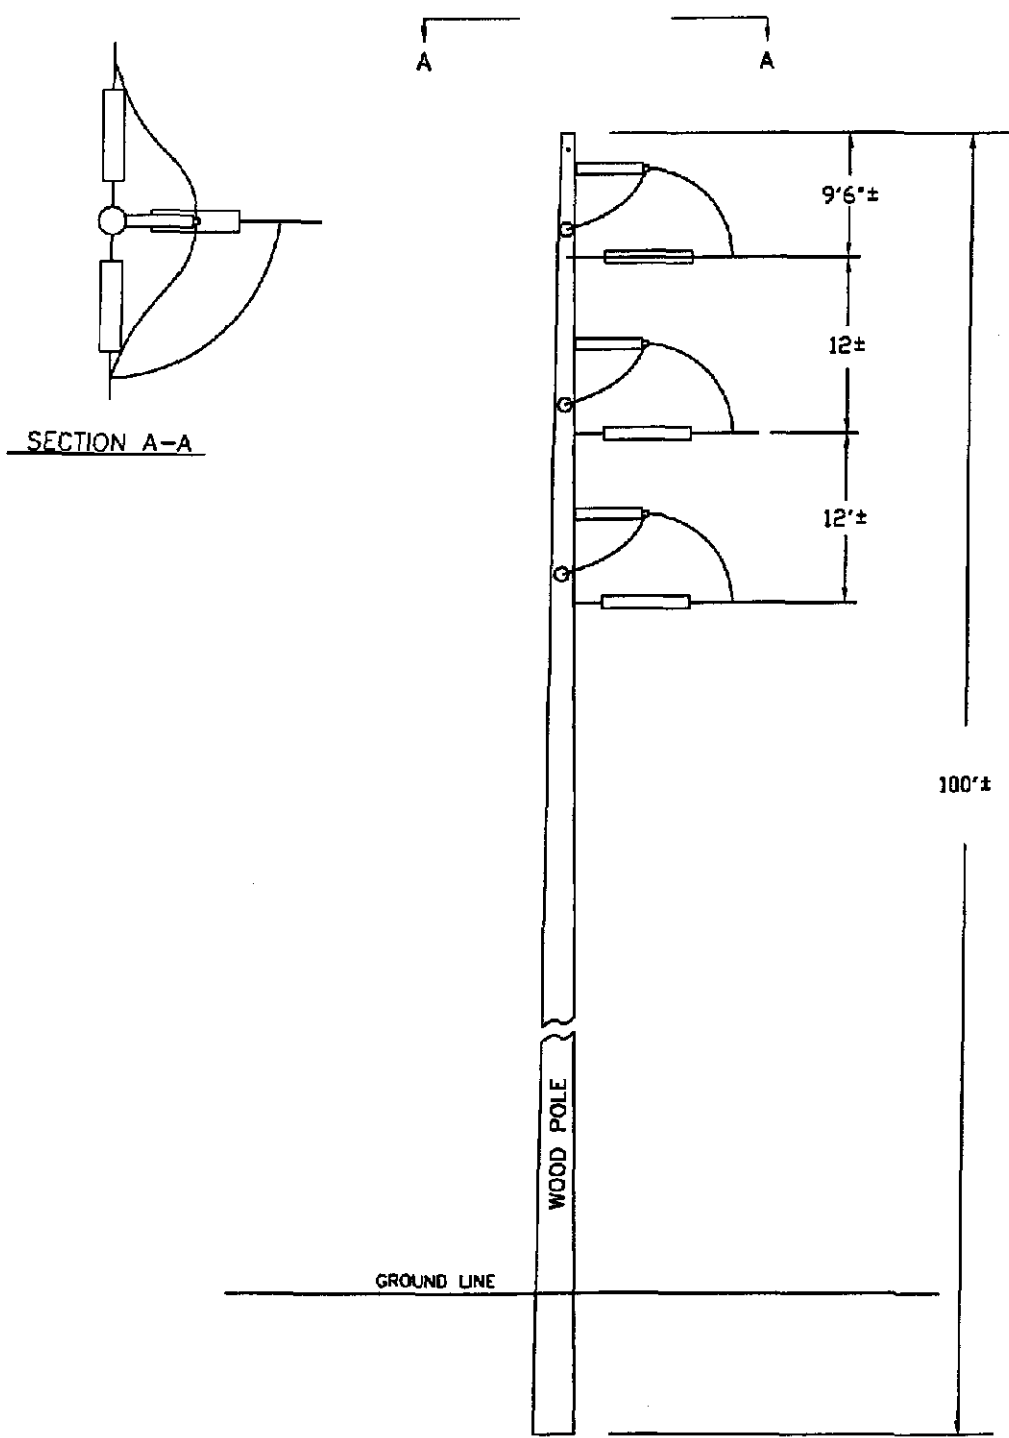

ATSI.

American Transmission Systems, Inc.
a subsidiary of Amelsbury Corp.

BABB-EAST AKRON 138 kV
TRANSMISSION LINE RELOCATION
FOR THE MARTHA AVENUE ROUNDABOUT

3-WAY DEAD END W/DISC. TAPS STRUCTURE

EXHIBIT 3