



Bricker & Eckler
ATTORNEYS AT LAW

COLUMBUS | CLEVELAND
CINCINNATI-DAYTON

BRICKER & ECKLER LLP
100 South Third Street
Columbus, Ohio 43215-4291
MAIN: 614.227.2300
FAX: 614.227.2390

www.bricker.com
info@bricker.com

Sally W. Bloomfield
614.227.2368
sbloomfield@bricker.com

January 6, 2010

VIA HAND DELIVERY

Ms. Renee Jenkins
Public Utilities Commission of Ohio
Administration/Docketing
180 East Broad Street, 13th Floor
Columbus, OH 43215-3793

**Re: Ohio American Water Company
Case No. 08-1233-WS-UNC**

Dear Ms. Jenkins:

Ohio American Water Company submits for filing the December 2009
Hardness Report for the Marion district.

If you have any questions, please call me at the number listed above.

Sincerely,

Sally W. Bloomfield

Enclosure

cc: Parties of Record (w/Enclosure)

RECEIVED-DOCKETING DIV
2010 JAN -6 PM 4:28
PUCO


This is to certify that the images appearing are an
accurate and complete reproduction of a case file
document delivered in the regular course of business.
Technician ADJ Date Processed 1/7/10

EFFLUENT HARDNESS / MG/L

December	RAW HARDNESS MG/L	EFFLUENT HARDNESS MG/L
1	440	135
2	423	131
3	409	136
4	400	140
5	395	143
6	398	144
7	400	141
8	430	149
9	430	149
10	420	136
11	445	138
12	450	140
13	450	137
14	428	141
15	395	137
16	383	137
17	426	148
18	414	146
19	417	146
20	411	143
21	452	149
22	428	143
23	435	135
24	436	137
25	406	131
26	425	143
27	412	144
28	408	143
29	400	140
30	419	147
31	430	144

AVERAGE	420	141
MAX	452	149
MIN	383	131

December 2009
EFFLUENT HARDNESS AVG - 141 MG/L
MARION DISTRICT

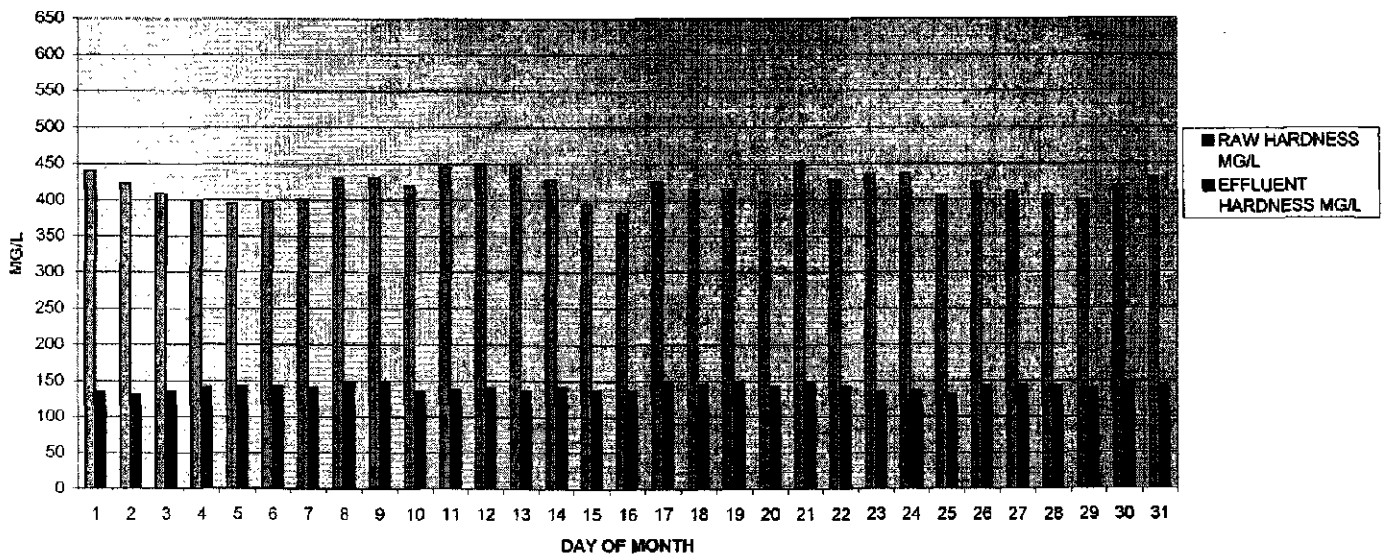



Bricker & Eckler
ATTORNEYS AT LAW

COLUMBUS | CLEVELAND
CINCINNATI-DAYTON

BRICKER & ECKLER LLP
100 South Third Street
Columbus, Ohio 43215-4291
MAIN: 614.227.2300
FAX: 614.227.2390

www.bricker.com
info@bricker.com

Sally W. Bloomfield
614.227.2368
sbloomfield@bricker.com

January 6, 2010

VIA HAND DELIVERY

Ms. Renee Jenkins
Public Utilities Commission of Ohio
Administration/Docketing
180 East Broad Street, 13th Floor
Columbus, OH 43215-3793

**Re: Ohio American Water Company
Case No. 08-1233-WS-UNC**

Dear Ms. Jenkins:

Ohio American Water Company submits for filing the December 2009
Hardness Report for the Marion district.

If you have any questions, please call me at the number listed above.

Sincerely,

Sally W. Bloomfield

Enclosure


cc: Parties of Record (w/Enclosure)

EFFLUENT HARDNESS / MG/L

December	RAW HARDNESS MG/L	EFFLUENT HARDNESS MG/L
1	440	135
2	423	131
3	409	136
4	400	140
5	395	143
6	398	144
7	400	141
8	430	149
9	430	149
10	420	136
11	445	138
12	450	140
13	450	137
14	428	141
15	395	137
16	383	137
17	426	148
18	414	146
19	417	146
20	411	143
21	452	149
22	428	143
23	435	135
24	436	137
25	406	131
26	425	143
27	412	144
28	408	143
29	400	140
30	419	147
31	430	144

AVERAGE	420	141
MAX	452	149
MIN	383	131

December 2009
EFFLUENT HARDNESS AVG - 141 MG/L
MARION DISTRICT

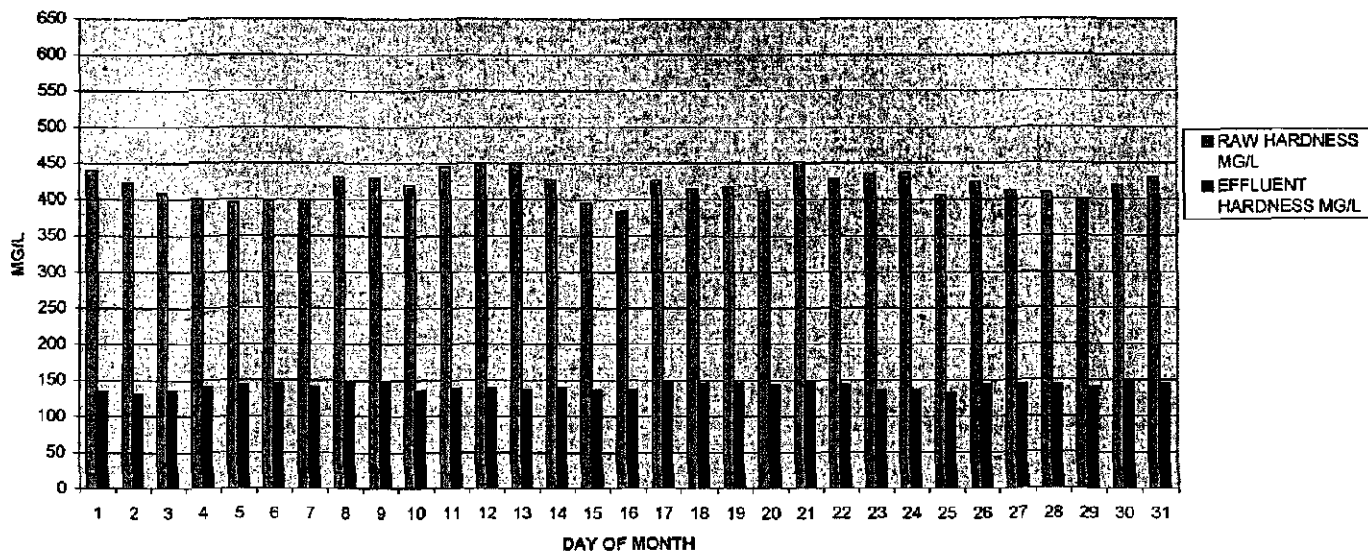



Bricker & Eckler
ATTORNEYS AT LAW

COLUMBUS | CLEVELAND
CINCINNATI-DAYTON

BRICKER & ECKLER LLP
100 South Third Street
Columbus, Ohio 43215-4291
MAIN: 614.227.2300
FAX: 614.227.2390

www.bricker.com
info@bricker.com

Sally W. Bloomfield
614.227.2368
sbloomfield@bricker.com

January 6, 2010

VIA HAND DELIVERY

Ms. Renee Jenkins
Public Utilities Commission of Ohio
Administration/Docketing
180 East Broad Street, 13th Floor
Columbus, OH 43215-3793

**Re: Ohio American Water Company
Case No. 08-1233-WS-UNC**

Dear Ms. Jenkins:

Ohio American Water Company submits for filing the December 2009
Hardness Report for the Marion district.

If you have any questions, please call me at the number listed above.

Sincerely,

Sally W. Bloomfield

Enclosure


cc: Parties of Record (w/Enclosure)

EFFLUENT HARDNESS / MG/L

December	RAW HARDNESS MG/L	EFFLUENT HARDNESS MG/L
1	440	135
2	423	131
3	409	136
4	400	140
5	395	143
6	398	144
7	400	141
8	430	149
9	430	149
10	420	136
11	445	138
12	450	140
13	450	137
14	428	141
15	395	137
16	383	137
17	426	148
18	414	146
19	417	146
20	411	143
21	452	149
22	428	143
23	435	135
24	436	137
25	406	131
26	425	143
27	412	144
28	408	143
29	400	140
30	419	147
31	430	144

AVERAGE	420	141
MAX	452	149
MIN	383	131

December 2009
EFFLUENT HARDNESS AVG - 141 MG/L
MARION DISTRICT

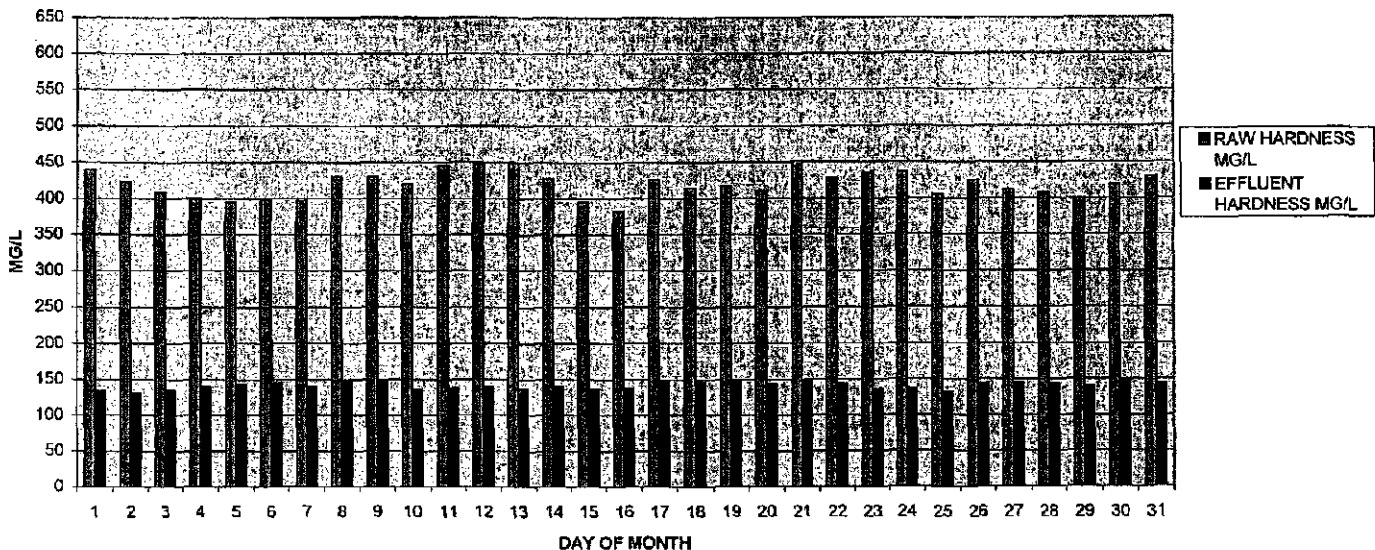



Bricker & Eckler
ATTORNEYS AT LAW

COLUMBUS | CLEVELAND
CINCINNATI-DAYTON

BRICKER & ECKLER LLP

100 South Third Street
Columbus, Ohio 43215-4291
MAIN: 614.227.2300
FAX: 614.227.2390

www.bricker.com
info@bricker.com

Sally W. Bloomfield
614.227.2368
sbloomfield@bricker.com

January 6, 2010

VIA HAND DELIVERY

Ms. Renee Jenkins
Public Utilities Commission of Ohio
Administration/Docketing
180 East Broad Street, 13th Floor
Columbus, OH 43215-3793

Re: **Ohio American Water Company**
Case No. 08-1233-WS-UNC

Dear Ms. Jenkins:

Ohio American Water Company submits for filing the December 2009
Hardness Report for the Marion district.

If you have any questions, please call me at the number listed above.

Sincerely,

Sally W. Bloomfield

Enclosure


cc: Parties of Record (w/Enclosure)

EFFLUENT HARDNESS / MG/L

December	RAW HARDNESS MG/L	EFFLUENT HARDNESS MG/L
1	440	135
2	423	131
3	409	136
4	400	140
5	395	143
6	398	144
7	400	141
8	430	149
9	430	149
10	420	136
11	445	138
12	450	140
13	450	137
14	428	141
15	395	137
16	383	137
17	426	148
18	414	146
19	417	146
20	411	143
21	452	149
22	428	143
23	435	135
24	436	137
25	406	131
26	425	143
27	412	144
28	408	143
29	400	140
30	419	147
31	430	144

AVERAGE	420	141
MAX	452	149
MIN	383	131

December 2009
EFFLUENT HARDNESS AVG - 141 MG/L
MARION DISTRICT

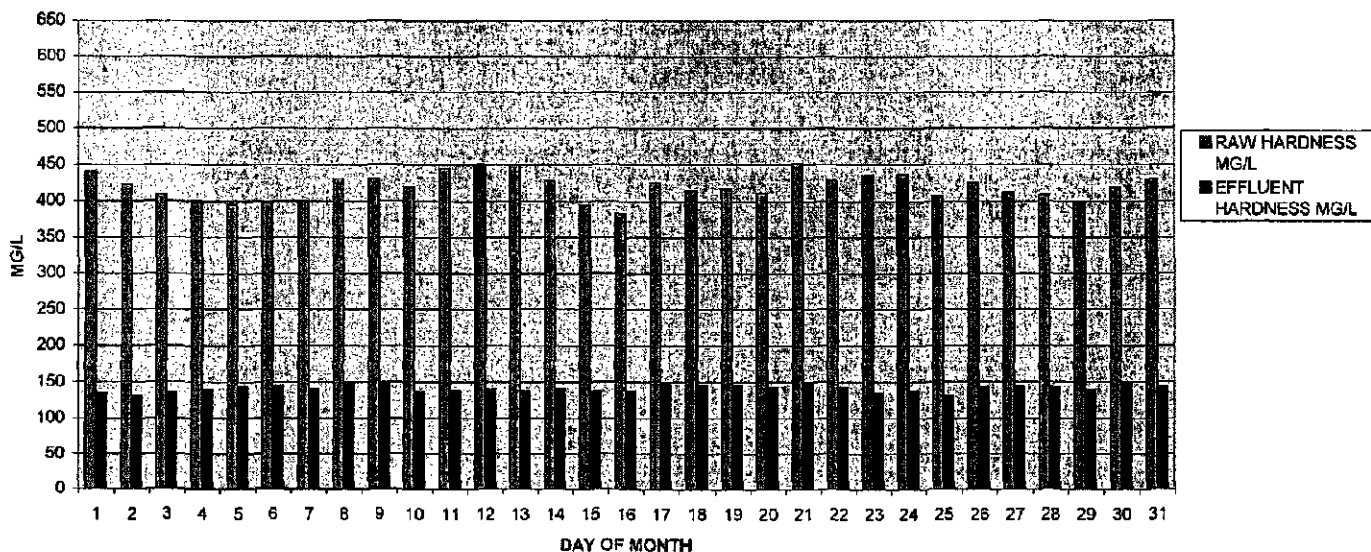



Bricker & Eckler
ATTORNEYS AT LAW

COLUMBUS | CLEVELAND
CINCINNATI-DAYTON

BRICKER & ECKLER LLP
100 South Third Street
Columbus, Ohio 43215-4291
MAIN: 614.227.2300
FAX: 614.227.2390

www.bricker.com
info@bricker.com

Sally W. Bloomfield
614.227.2368
sbloomfield@bricker.com

January 6, 2010

VIA HAND DELIVERY

Ms. Renee Jenkins
Public Utilities Commission of Ohio
Administration/Docketing
180 East Broad Street, 13th Floor
Columbus, OH 43215-3793

**Re: Ohio American Water Company
Case No. 08-1233-WS-UNC**

Dear Ms. Jenkins:

Ohio American Water Company submits for filing the December 2009
Hardness Report for the Marion district.

If you have any questions, please call me at the number listed above.

Sincerely,

Sally W. Bloomfield


Enclosure

cc: Parties of Record (w/Enclosure)

EFFLUENT HARDNESS / MG/L

December	RAW HARDNESS MG/L	EFFLUENT HARDNESS MG/L
1	440	135
2	423	131
3	409	136
4	400	140
5	395	143
6	398	144
7	400	141
8	430	149
9	430	149
10	420	136
11	445	138
12	450	140
13	450	137
14	428	141
15	395	137
16	383	137
17	426	148
18	414	146
19	417	146
20	411	143
21	452	149
22	428	143
23	435	135
24	436	137
25	406	131
26	425	143
27	412	144
28	408	143
29	400	140
30	419	147
31	430	144
AVERAGE	420	141
MAX	452	149
MIN	383	131

December 2009
EFFLUENT HARDNESS AVG - 141 MG/L
MARION DISTRICT

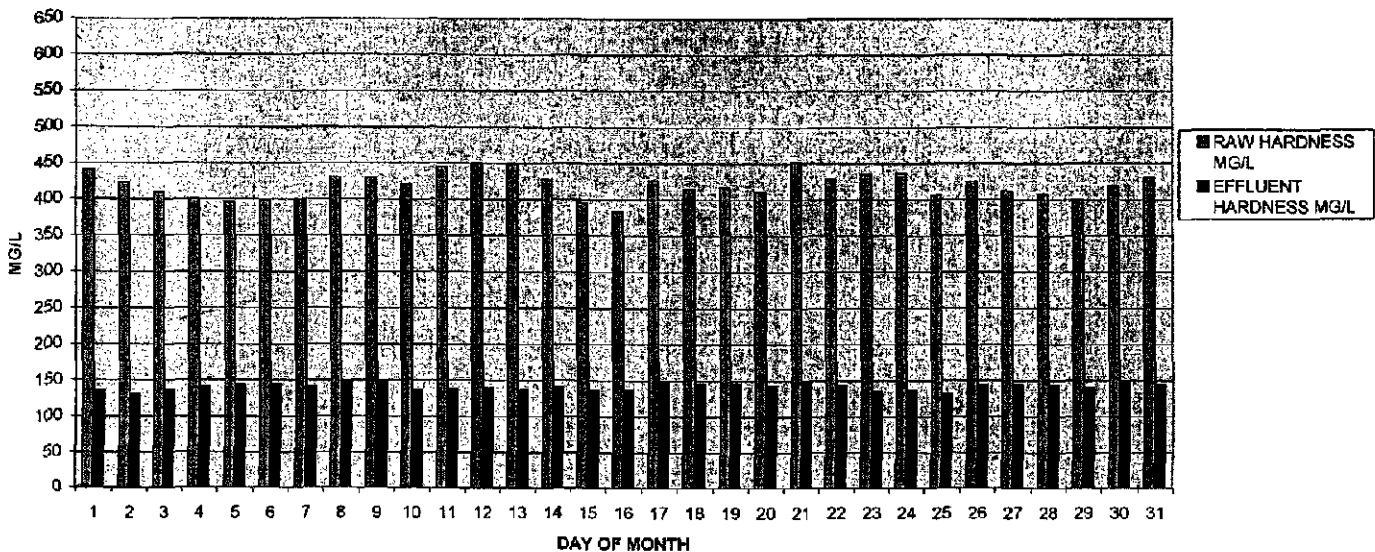



Bricker & Eckler
ATTORNEYS AT LAW

COLUMBUS | CLEVELAND
CINCINNATI-DAYTON

BRICKER & ECKLER LLP
100 South Third Street
Columbus, Ohio 43215-4291
MAIN: 614.227.2300
FAX: 614.227.2390

www.bricker.com
info@bricker.com

Sally W. Bloomfield
614.227.2368
sbloomfield@bricker.com

January 6, 2010

VIA HAND DELIVERY

Ms. Renee Jenkins
Public Utilities Commission of Ohio
Administration/Docketing
180 East Broad Street, 13th Floor
Columbus, OH 43215-3793

**Re: Ohio American Water Company
Case No. 08-1233-WS-UNC**

Dear Ms. Jenkins:

Ohio American Water Company submits for filing the December 2009
Hardness Report for the Marion district.

If you have any questions, please call me at the number listed above.

Sincerely,

Sally W. Bloomfield

Enclosure


cc: Parties of Record (w/Enclosure)

EFFLUENT HARDNESS / MG/L

December	RAW HARDNESS MG/L	EFFLUENT HARDNESS MG/L
1	440	135
2	423	131
3	409	136
4	400	140
5	395	143
6	398	144
7	400	141
8	430	149
9	430	149
10	420	136
11	445	138
12	450	140
13	450	137
14	428	141
15	395	137
16	383	137
17	426	148
18	414	146
19	417	146
20	411	143
21	452	149
22	428	143
23	435	135
24	436	137
25	406	131
26	425	143
27	412	144
28	408	143
29	400	140
30	419	147
31	430	144

AVERAGE	420	141
MAX	452	149
MIN	383	131

December 2009
EFFLUENT HARDNESS AVG - 141 MG/L
MARION DISTRICT

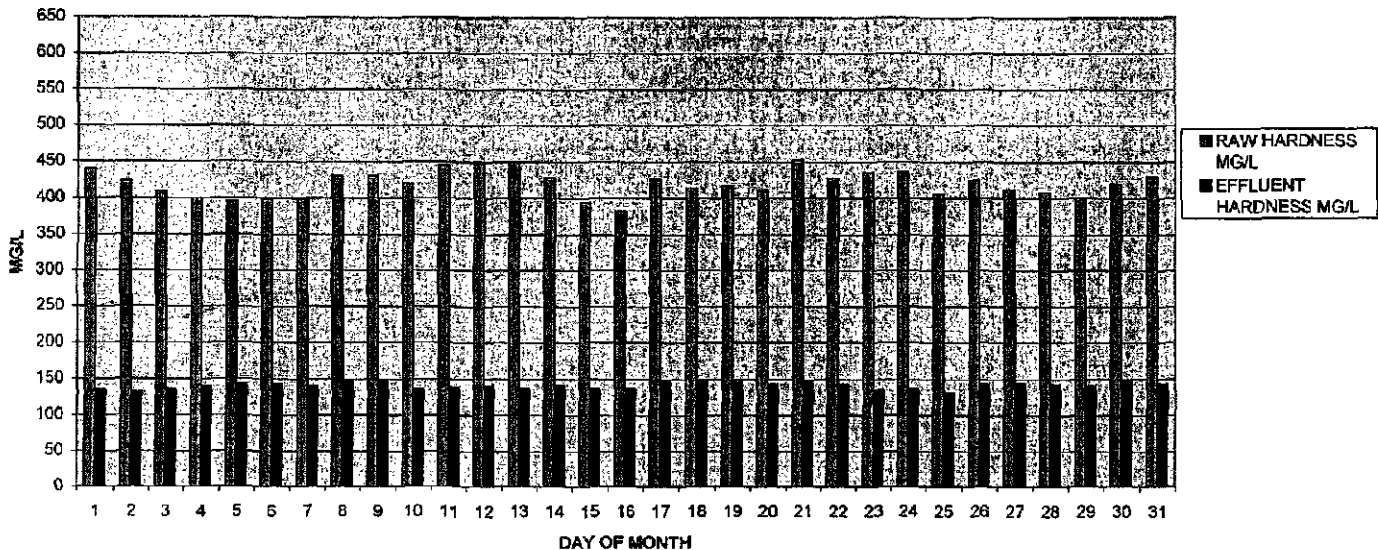



Bricker & Eckler
ATTORNEYS AT LAW

COLUMBUS | CLEVELAND
CINCINNATI-DAYTON

BRICKER & ECKLER LLP
100 South Third Street
Columbus, Ohio 43215-4291
MAIN: 614.227.2300
FAX: 614.227.2390

www.bricker.com
info@bricker.com

Sally W. Bloomfield
614.227.2368
sbloomfield@bricker.com

January 6, 2010

VIA HAND DELIVERY

Ms. Renee Jenkins
Public Utilities Commission of Ohio
Administration/Docketing
180 East Broad Street, 13th Floor
Columbus, OH 43215-3793

**Re: Ohio American Water Company
Case No. 08-1233-WS-UNC**

Dear Ms. Jenkins:

Ohio American Water Company submits for filing the December 2009
Hardness Report for the Marion district.

If you have any questions, please call me at the number listed above.

Sincerely,

Sally W. Bloomfield

Enclosure


cc: Parties of Record (w/Enclosure)

EFFLUENT HARDNESS / MG/L

December	RAW HARDNESS MG/L	EFFLUENT HARDNESS MG/L
1	440	135
2	423	131
3	409	136
4	400	140
5	395	143
6	398	144
7	400	141
8	430	149
9	430	149
10	420	136
11	445	138
12	450	140
13	450	137
14	428	141
15	395	137
16	383	137
17	426	148
18	414	146
19	417	146
20	411	143
21	452	149
22	428	143
23	435	135
24	436	137
25	406	131
26	425	143
27	412	144
28	408	143
29	400	140
30	419	147
31	430	144

AVERAGE	420	141
MAX	452	149
MIN	383	131

December 2009
EFFLUENT HARDNESS AVG - 141 MG/L
MARION DISTRICT

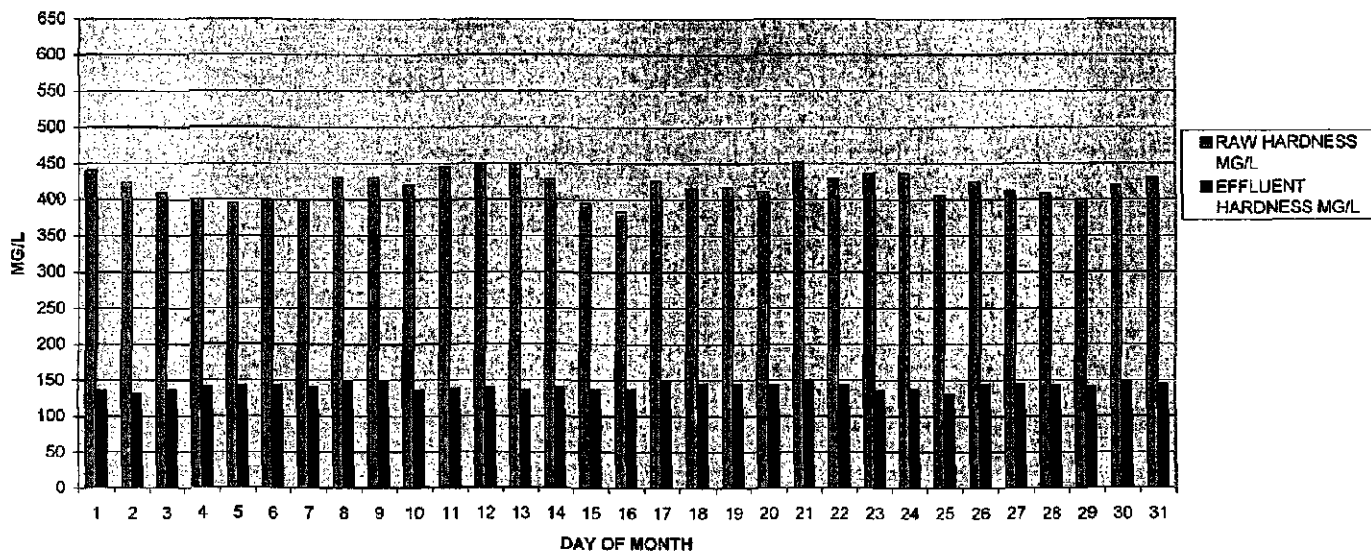



Bricker & Eckler
ATTORNEYS AT LAW

COLUMBUS | CLEVELAND
CINCINNATI-DAYTON

BRICKER & ECKLER LLP
100 South Third Street
Columbus, Ohio 43215-4291
MAIN: 614.227.2300
FAX: 614.227.2390

www.bricker.com
info@bricker.com

Sally W. Bloomfield
614.227.2368
sbloomfield@bricker.com

January 6, 2010

VIA HAND DELIVERY

Ms. Renee Jenkins
Public Utilities Commission of Ohio
Administration/Docketing
180 East Broad Street, 13th Floor
Columbus, OH 43215-3793

**Re: Ohio American Water Company
Case No. 08-1233-WS-UNC**

Dear Ms. Jenkins:

Ohio American Water Company submits for filing the December 2009
Hardness Report for the Marion district.

If you have any questions, please call me at the number listed above.

Sincerely,

Sally W. Bloomfield

Enclosure

cc: Parties of Record (w/Enclosure)

EFFLUENT HARDNESS / MG/L

December	RAW HARDNESS MG/L	EFFLUENT HARDNESS MG/L
1	440	135
2	423	131
3	409	136
4	400	140
5	395	143
6	398	144
7	400	141
8	430	149
9	430	149
10	420	136
11	445	138
12	450	140
13	450	137
14	428	141
15	395	137
16	383	137
17	426	148
18	414	146
19	417	146
20	411	143
21	452	149
22	428	143
23	435	135
24	436	137
25	406	131
26	425	143
27	412	144
28	408	143
29	400	140
30	419	147
31	430	144

AVERAGE	420	141
MAX	452	149
MIN	383	131

December 2009
EFFLUENT HARDNESS AVG - 141 MG/L
MARION DISTRICT

