

Case No. 10-0099-EL-REN

Conneaut Schools Wind LLC

Staff Interrogatories – Initial Set

Question 1: Provide the “name of the facility owner”, as requested in response to application question B. The facility owner name will be the name that appears on the certificate.

Answer 1: Conneaut Schools Wind LLC

Question 2: Provide an organization chart and/or narrative description of the relationship between Conneaut Schools Wind LLC and NexGen Energy Partners.

Answer 2: NexGen Energy is the majority owner and controller of Conneaut Schools Wind LLC.

Question 3: The application (G.2) indicates that the output of the facility will be measured by an Elkor, WattsOn Universal Power Transducer. Confirm how this transducer satisfies the “utility grade” metering requirements of 4901:1-40-04(D)(1), Ohio Administrative Code.

Answer 3:

The meter must comply with 2001 ANSI C12.1 standards. As seen here <http://www.elkor.net/WattsOn.htm> the transducer meets ANSI C12.20 Class 0,2 Accuracy compliance.

Question 4: The application contains two different projected in-service dates (1/30/10 & 2/12/10). Indicate the current projected in-service date, or if currently on-line, when the facility was placed in-service.

Answer 4: The project will be commissioned on 3/10/10.

Question 5: Clarify the responses to question (K.) on the application. Is the facility currently registered in GATS? Also, the GATS generation ID number in the application differs from typical convention. Confirm that this is in fact a generation ID number assigned by GATS (as opposed to the case number assigned for PUCO purposes).

Answer 5: The facility is not currently registered by GATS. However, once the state identification number is issued the GATS application will be complete and we will have a GATS certification number shortly.

Question 6: In response to question (M.), the application indicates the existence of a net metering agreement with FirstEnergy. What entity has entered into the net metering program with FirstEnergy – is it Conneaut Schools Wind LLC?

Answer 6: Conneaut Area City Schools has entered into a net metering agreement with First Energy.

Question 7: In response to question (N.), the application indicates that the meter serial number will be provided closer to project completion. Provide this number now, if available. In addition, provide the date of last certification for the meter if currently available.


Answer 7: Meter serial number: 55838

This is clearly visible on the right side the photograph below.

Question 8: The application indicates that “updated photographs will be uploaded within 30 days on the commission date of 2/12/10”. Provide updated photographs, if currently available.

Answer 8:

The Elkor utility grade meter SN number can be seen on the right hand side of the photograph below

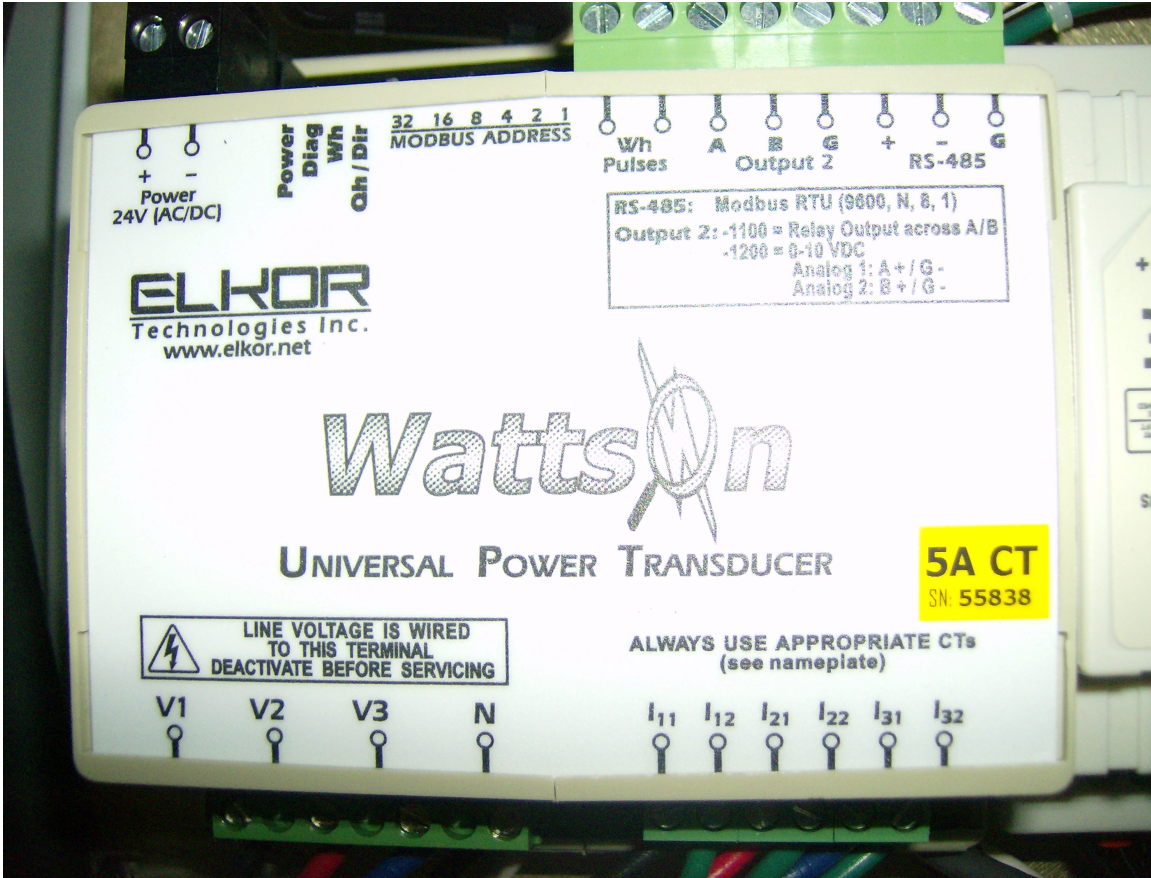

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

3/5/2010 2:19:24 PM

in

Case No(s). 10-0099-EL-REN

Summary: Amended Application This document is filed in response to the interrogatory sent to us by Mr. Stuart Sigfried. We appreciate your attention to this matter. electronically filed by Mr. Ted G Rose on behalf of 10-99