

FILE

FirstEnergy

2

RECEIVED-DOCKETING DIV

76 South Main St.
Akron, Ohio 44308

2010 JUN 14 PM 2: 23

1-800-646-0400

PUCO

June 11, 2010

Ms. Renee J. Jenkins
Director, Administration Department
Secretary to the Commission
Docketing Division
The Public Utilities Commission of Ohio
180 East Broad Street
Columbus, OH 43215-3793

**Letter of Notification
Evergreen-Ivanhoe 138 kV Transmission Line
To Marvin Group Supplemental Engineering Information
Case No. 10-0597-EL-BLN**

Dear Ms. Jenkins:

Please be advised of the supplemental engineering information that is being submitted to the above captioned Letter of Notification submitted on April 30, 2010. Enclosed are one (1) original and ten (10) copies of Exhibit 4A. Exhibit 4A replaces Exhibit 4 of the Letter of Notification.

The supplemental engineering information conveyed in Exhibit 4A indicates that the proposed transmission line tap structure will be a guyed steel pole rather than a wood pole. The location and height of the pole have not changed. All other structures and features of the project remain the same.

Should the Ohio Power Siting Board desire further information or discussion of this submittal, please contact me at (330) 384-2526.


Sincerely,



Scott M. Humphrys
Associate Distribution Specialist
Energy Delivery Transmission and Substation
Design
FirstEnergy Service Company

Attachment

This is to certify that the images appearing are an accurate and complete reproduction of a case file document delivered in the regular course of business.
Technician OK Date Processed 6-14-2010

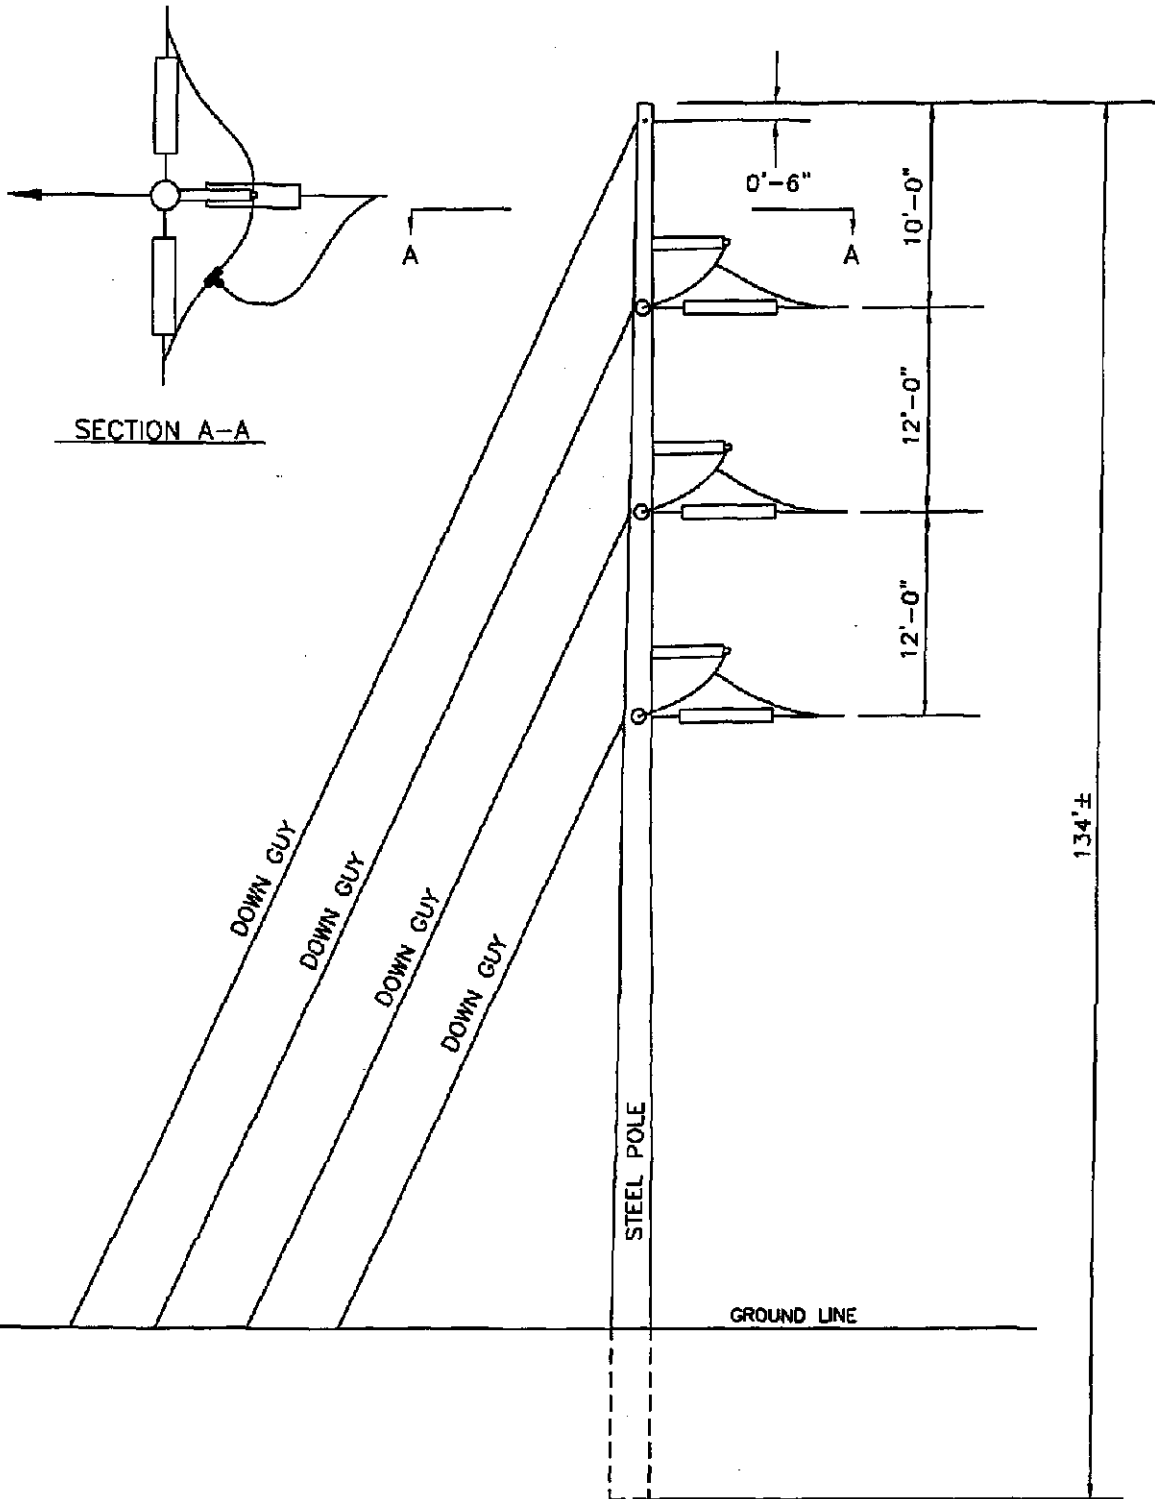

ATSI.

American Transmission Systems, Inc.
a subsidiary of Progress Corp.

Ohio Edison

A FirstEnergy Company

EVERGREEN-IVANHOE 138 KV TRANSMISSION LINE TAP TO
MARVIN GROUP

TAP STRUCTURE WITH DISCONNECTABLE TAPS

EXHIBIT 4A