

RECEIVED-DOCKETING DIV

2010 SEP 23 PM 3:46

1-800-646-0400

September 14, 2010

Mr. Klaus Lambeck, Chief
Facilities, Siting & Environmental Analysis Division
Ohio Power Siting Board
Public Utilities Commission of Ohio
180 East Broad Street
Columbus, OH 43215-3793

PUCO

**Letter of Notification
Evergreen-Ivanhoe 138 kV Transmission Line
To Marvin Group Supplemental Engineering Information
Case No. 10-0597-EL-BLN**


Dear Mr. Lambeck:

Please be advised of the supplemental engineering information that is being submitted to the above captioned Letter of Notification submitted on April 30, 2010 and approved June 28, 2010. Enclosed are Exhibits 2A, 5A, 11 and 12 that depict the engineering information. Exhibits 2A and 5A supplement Exhibits 2 and 5, respectively, and Exhibits 11 and 12 replace Exhibit 7 of the Letter of Notification. Exhibit 2A shows the engineering adjustments of general layout of the project, which includes identification of the locations of the structures depicted in Exhibits 5A, 11 and 12. In general, the supplemental information involves engineering changes for three of the structures and is consistent with easements that have been granted for the right-of-way of the transmission line. For the two structures depicted by Exhibit 5A, the poles have been revised to laminated wood poles and the location of the poles has been shifted slightly to the southwest. Exhibits 11 and 12 replace the guyed double pole light angle structure depicted in Exhibit 7 with two single poles with one pole supporting the rebuilt 23 kV line and the other support the 138 kV transmission line.

With the exception of the modifications in Exhibits 2A, 5A, 11 and 12, all other structures and features of the project remain the same.

Should the Ohio Power Siting Board desire further information or discussion of this submittal, please contact me at (330) 384-2526.


Sincerely,



Scott M. Humphrys
Associate Distribution Specialist
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

Attachments
cc: J. O'Dell (OPSB)

This is to certify that the images appearing are an accurate and complete reproduction of the file document delivered in the regular course of business.
Technician _____ Date Processed 9-23-2010

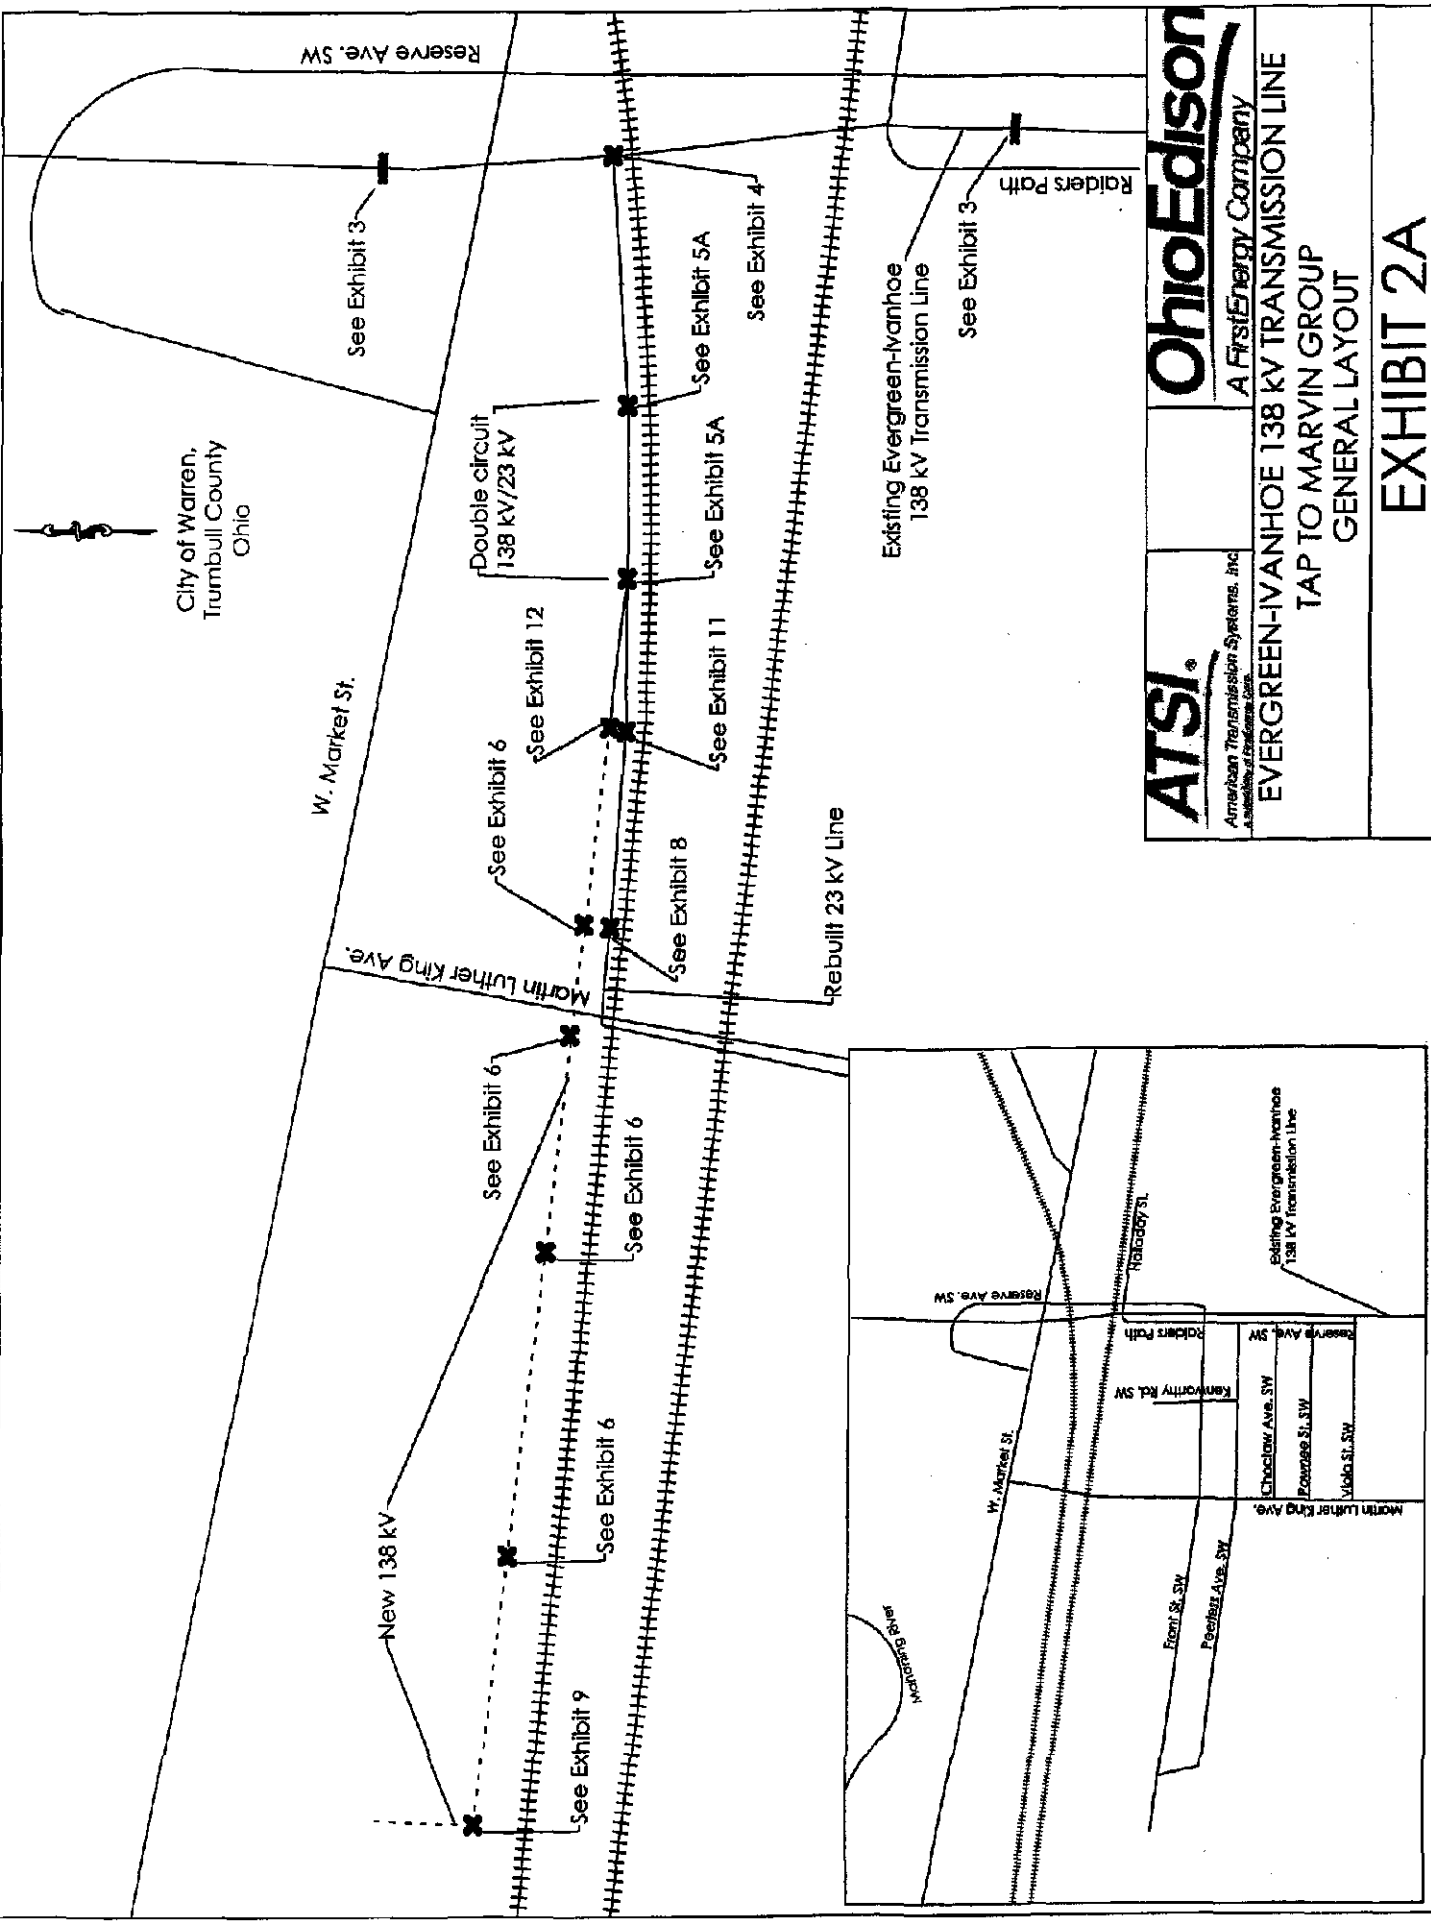

City of Warren,
Trumbull County
Ohio

W. Market St.

Martin Luther King Ave.

Reserve Ave. SW

New 138 kV

Double circuit
138 kV/23 kV

Rebuilt 23 kV Line

Existing Evergreen-Ivanhoe
138 kV Transmission Line

See Exhibit 3

See Exhibit 6

See Exhibit 12

See Exhibit 5A

See Exhibit 11

See Exhibit 4

See Exhibit 3

See Exhibit 6

See Exhibit 6

See Exhibit 6

See Exhibit 9

Reserve Ave. SW

W. Market St.

Kamworthy Rd. SW

Choclow Ave. SW

Pezorse St. SW

Viola St. SW


Raiders Path

Front St. SW


Peeters Ave. SW

Existing Evergreen-Ivanhoe
138 kV Transmission Line

<p>ATSI American Transmission Systems, Inc. A Division of Exponent, Inc.</p>	<p>Ohio Edison A FirstEnergy Company</p>
<p>EVERGREEN-IVANHOE 138 kV TRANSMISSION LINE TAP TO MARVIN GROUP GENERAL LAYOUT</p>	
<p>EXHIBIT 2A</p>	

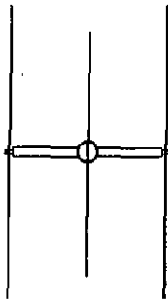

SECTION A-A

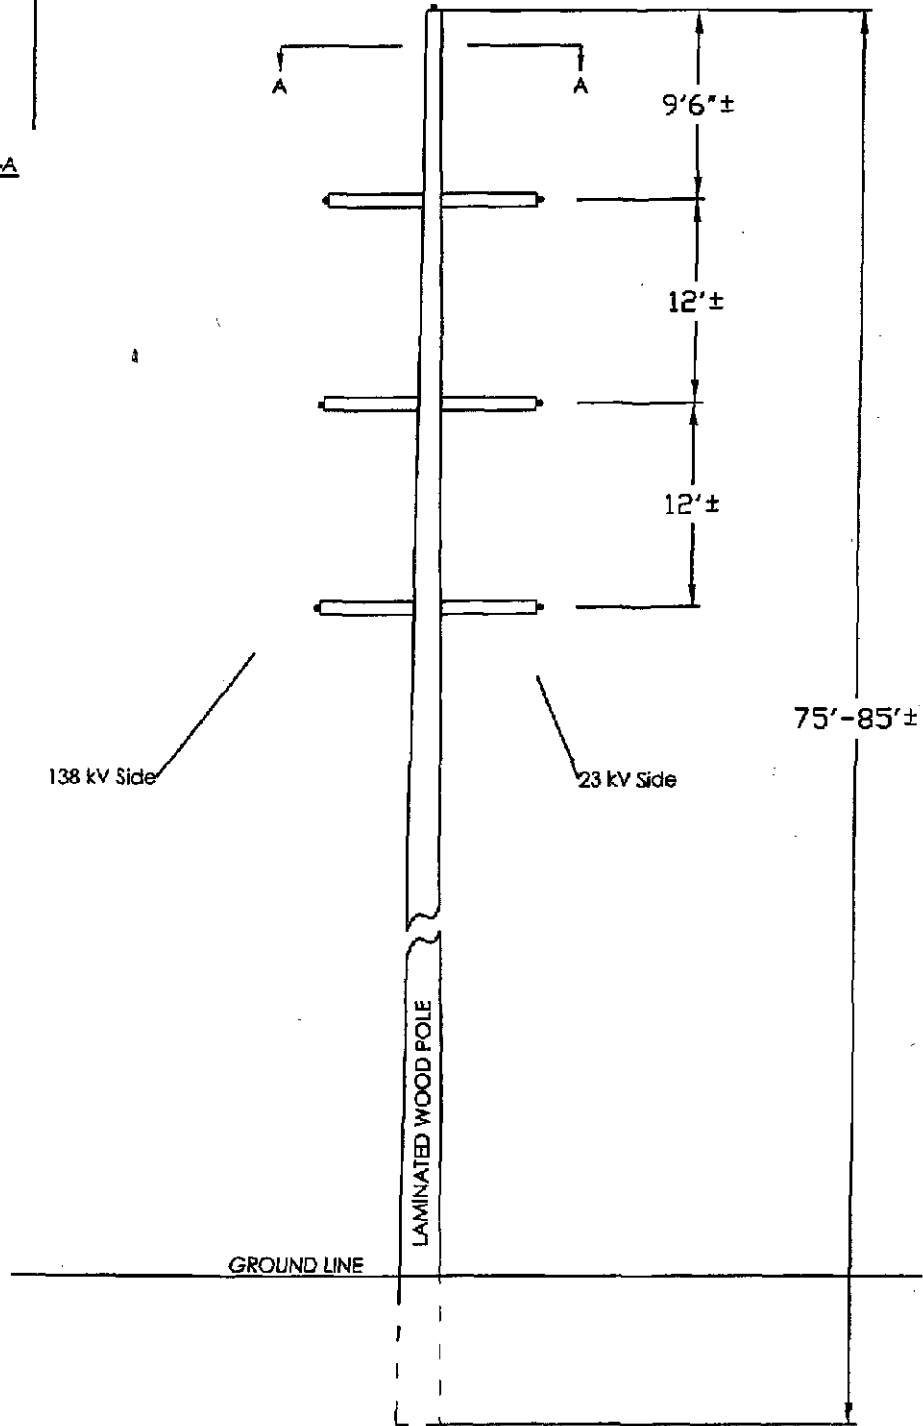

ATSI.


American Transmission Systems, Inc.
a subsidiary of FirstEnergy Corp.

Ohio Edison



A FirstEnergy Company

EVERGREEN-IVANHOE 138 kV TRANSMISSION LINE TAP TO
MARVIN GROUP
DOUBLE CIRCUIT TANGENT POLE

EXHIBIT 5A



SECTION A-A

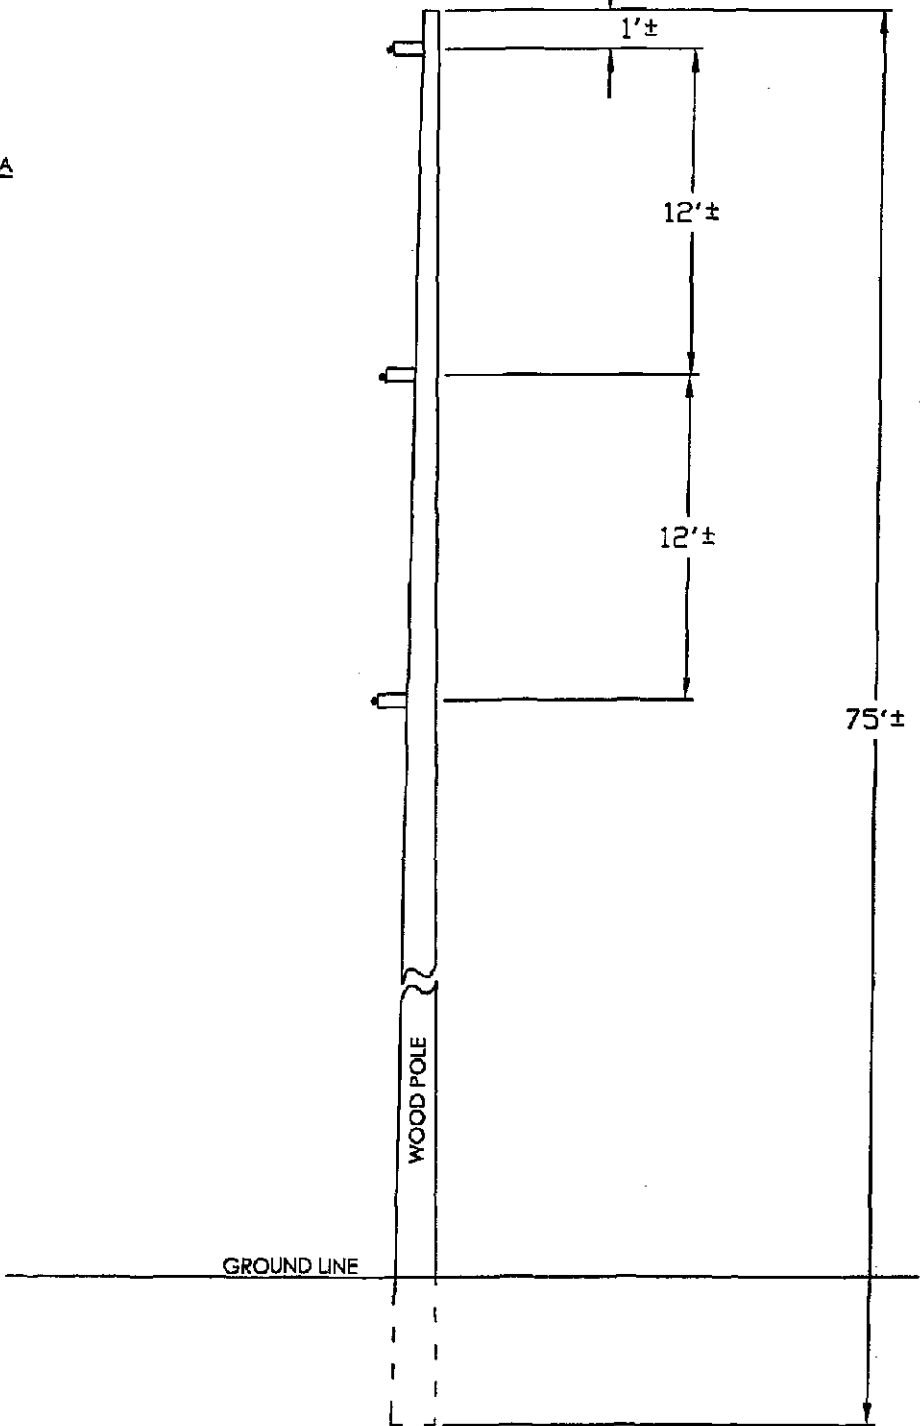


ATSI.
American Transmission Systems, Inc.
a subsidiary of FirstEnergy Corp.


Ohio Edison
A FirstEnergy Company

EVERGREEN-IVANHOE 138 KV TRANSMISSION LINE TAP TO
MARVIN GROUP
23 KV TANGENT POLE

EXHIBIT 11

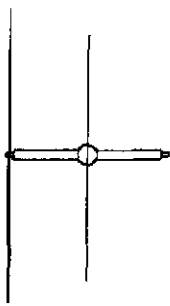

SECTION A-A

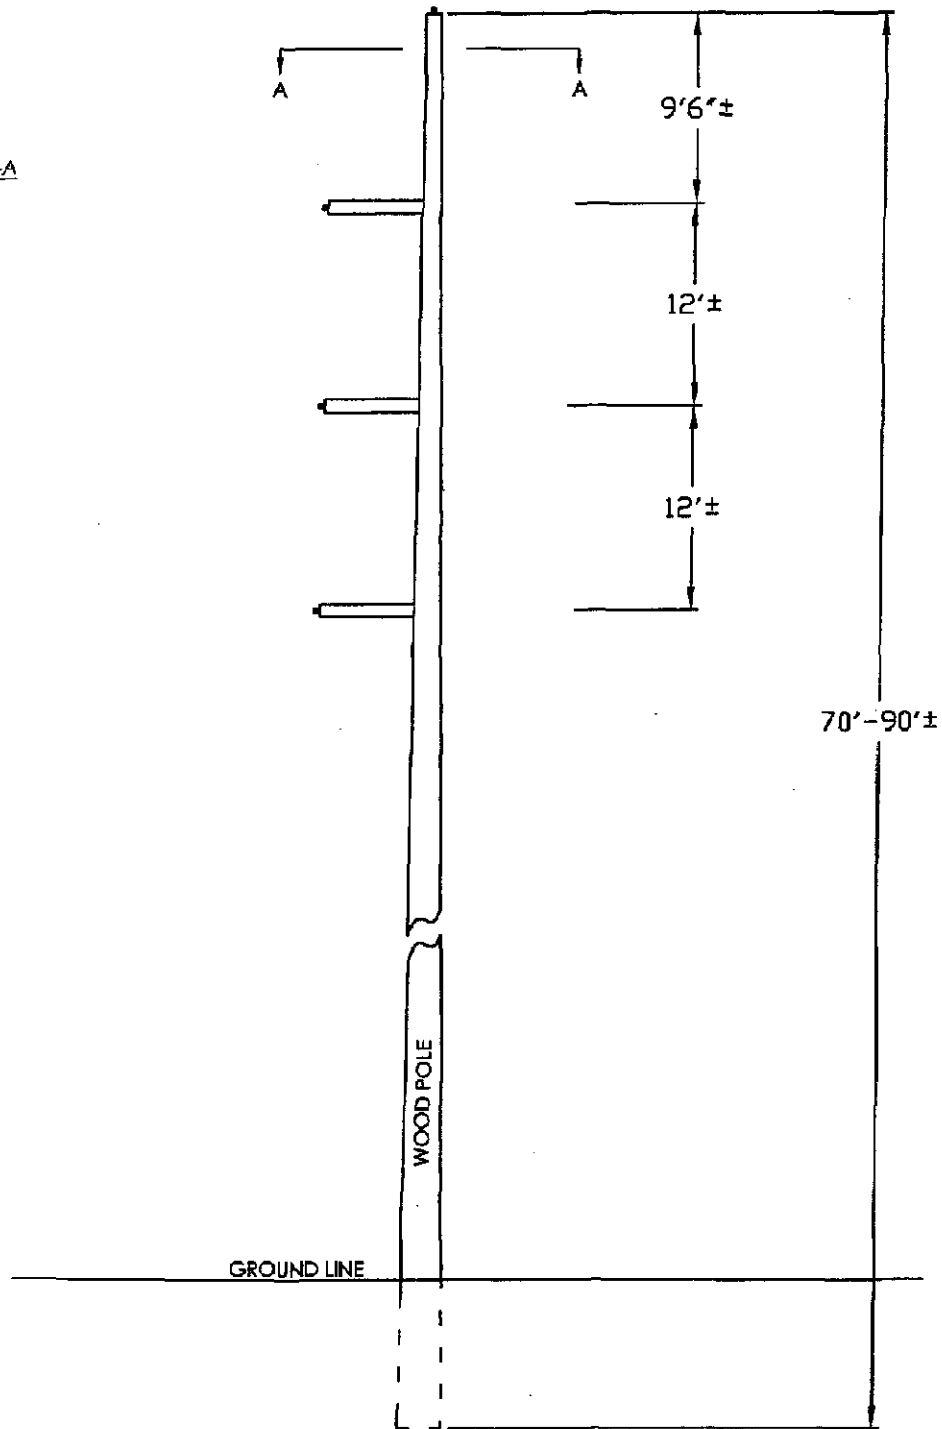

ATSI.
 American Transmission Systems, Inc.
 a subsidiary of FirstEnergy Corp.

Ohio Edison
 A FirstEnergy Company

EVERGREEN-IVANHOE 138 KV TRANSMISSION LINE TAP TO
 MARVIN GROUP
 SINGLE CIRCUIT TANGENT POLE

EXHIBIT 12