

RECEIVED-DOCKETING-DIV

76 South Main St.
Akron, Ohio 44308

2010 DEC 29 PM 3:33

1-800-646-0400

October 1, 2010

Mr. Klaus Lambeck, Chief
Facilities, Siting & Environmental Analysis Division
Ohio Power Siting Board
Public Utilities Commission of Ohio
180 East Broad Street
Columbus, OH 43215-3793

PUCO

Letter of Notification
Evergreen-Ivanhoe 138 kV Transmission Line
To Marvin Group Supplemental Engineering Information
Case No. 10-0597-EL-BLN

Dear Mr. Lambeck:

Please be advised of the supplemental engineering information that is being submitted to the above captioned Letter of Notification submitted on April 30, 2010 and approved June 28, 2010. Enclosed are Exhibits 2B, 5B, 8A and 11A that depict the engineering information. Exhibits 2B and 8A supplement Exhibits 2A and 8, respectively and Exhibit 11A replaces Exhibits 11 and 12 of the Supplemental Engineering Information submitted on September 14, 2010. Exhibit 2B shows the engineering adjustments of general layout of the project, which includes identification of the locations of the structures depicted in Exhibits 8A and 11A. Exhibit 5B identifies the addition of a structure, as shown in Exhibit 2B. In general, the supplemental information involves engineering changes for two structures and is consistent with easements with utilization of an existing easement on parcels 39-256550 and 39-256560 rather than obtaining a new easement on these parcels as identified in the LON. For the structure depicted by Exhibit 8A, the pole has been revised to include down guys. Exhibit 11A replaces the two single pole tangent structures supporting the rebuilt 23 kV line and the other support the 138 kV transmission line depicted in Exhibits 11 and 12.

With the exception of the modifications in Exhibits 2B, 8A and 11, all other structures and features of the project remain the same.

Should the Ohio Power Siting Board desire further information or discussion of this submittal, please contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Associate Distribution Specialist
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

Attachments
cc: J. O'Dell (OPSB)

This is to certify that the images appearing are an accurate and complete reproduction of a case file document delivered in the regular course of business.
Technician Sam Date Processed DEC 29 2010

Reserve Ave. SW

City of Warren,
Trumbull County
Ohio

W. Market St.

Martin Luther King Ave.

New 138 kV

Double circuit
138 kV/23 kV

See Exhibit 6

See Exhibit 11A

See Exhibit BA

See Exhibit 5B

See Exhibit 4

Rebuilt 23 kV Line

Existing Evergreen-Ivanhoe
138 kV Transmission Line

See Exhibit 3


Raiders Path


ATSI.
American Transmission Systems, Inc.
A Subsidiary of American Corp.

Ohio Edison
A FirstEnergy Company


EVERGREEN-IVANHOE 138 kV TRANSMISSION LINE
TAP TO MARVIN GROUP
GENERAL LAYOUT

EXHIBIT 2B

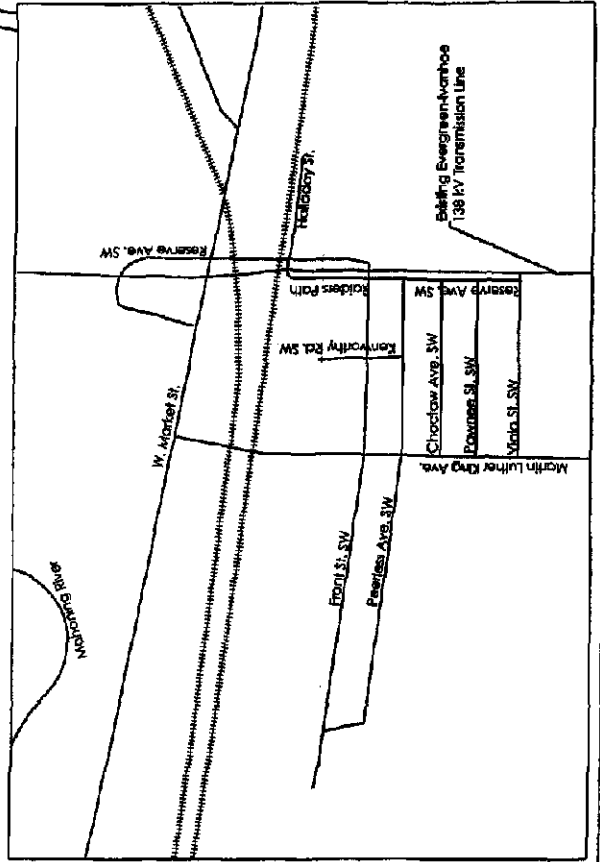

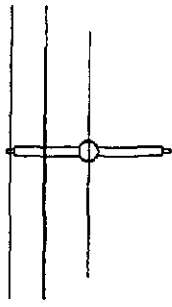

SECTION A-A

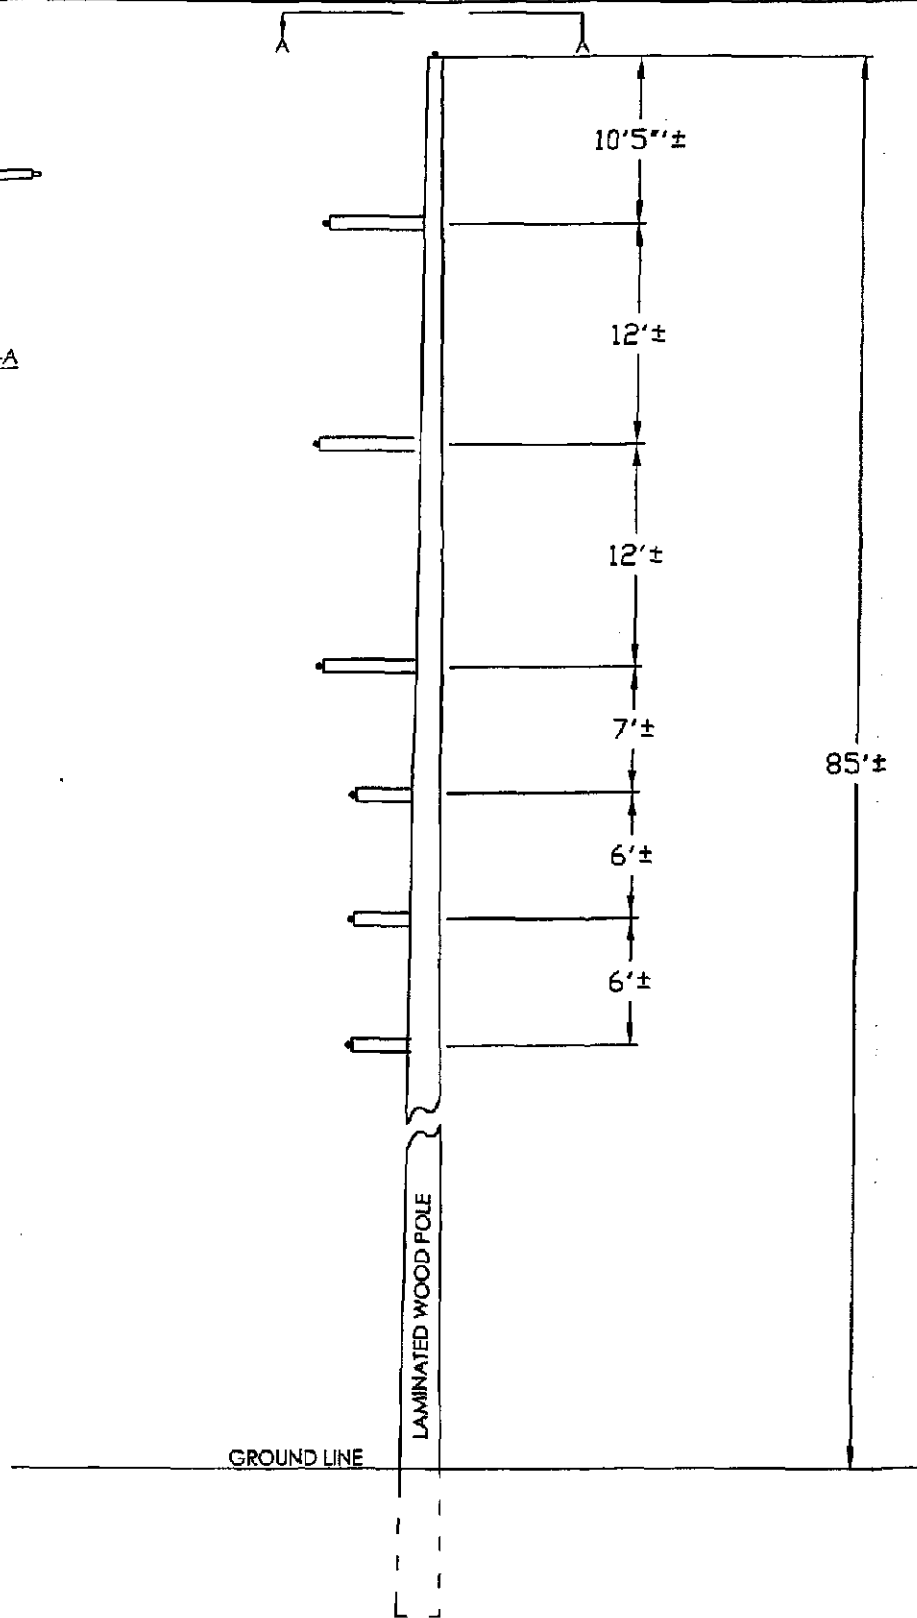

ATSI.


American Transmission Systems, Inc.
A FirstEnergy Company

Ohio Edison

A FirstEnergy Company

EVERGREEN-IVANHOE 138 KV TRANSMISSION LINE TAP TO
MARVIN GROUP
DOUBLE CIRCUIT TANGENT POLE

EXHIBIT 5B

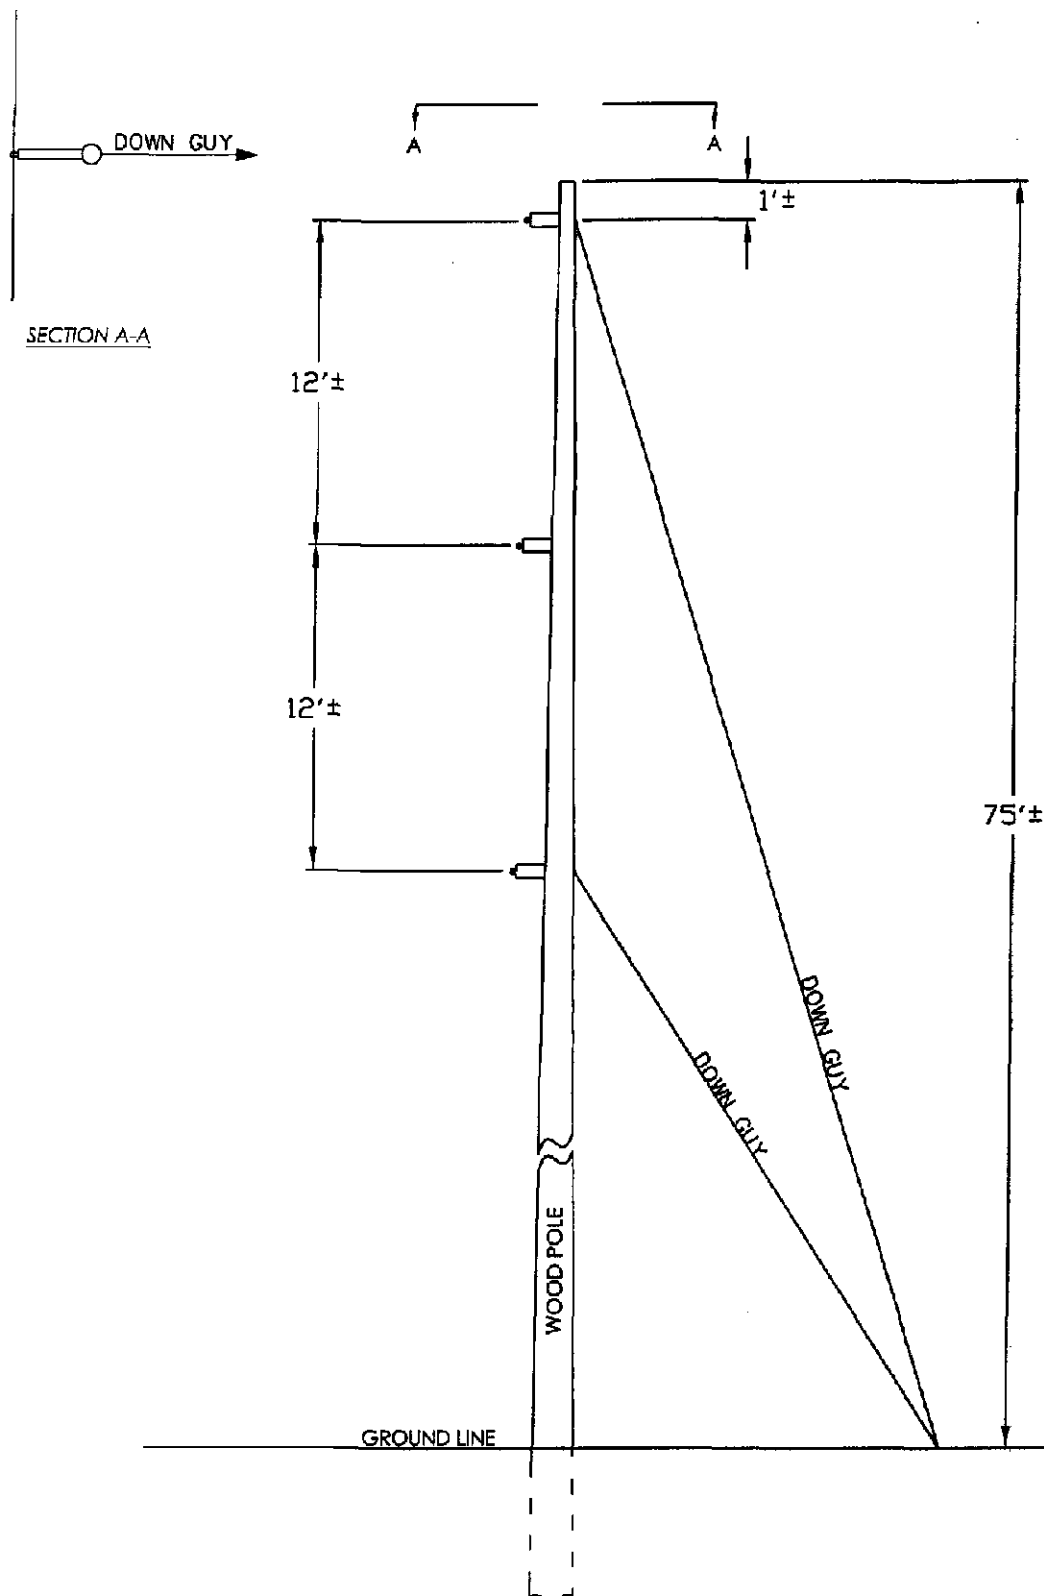

ATSI.


American Transmission Systems, Inc.
a subsidiary of FirstEnergy Corp.

Ohio Edison


A FirstEnergy Company

EVERGREEN-IVANHOE 138 kV TRANSMISSION LINE TAP TO
MARVIN GROUP
23 kV TANGENT POLE

EXHIBIT 8A

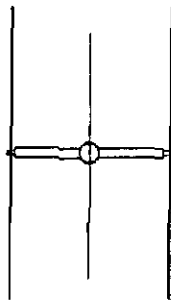

SECTION A-A

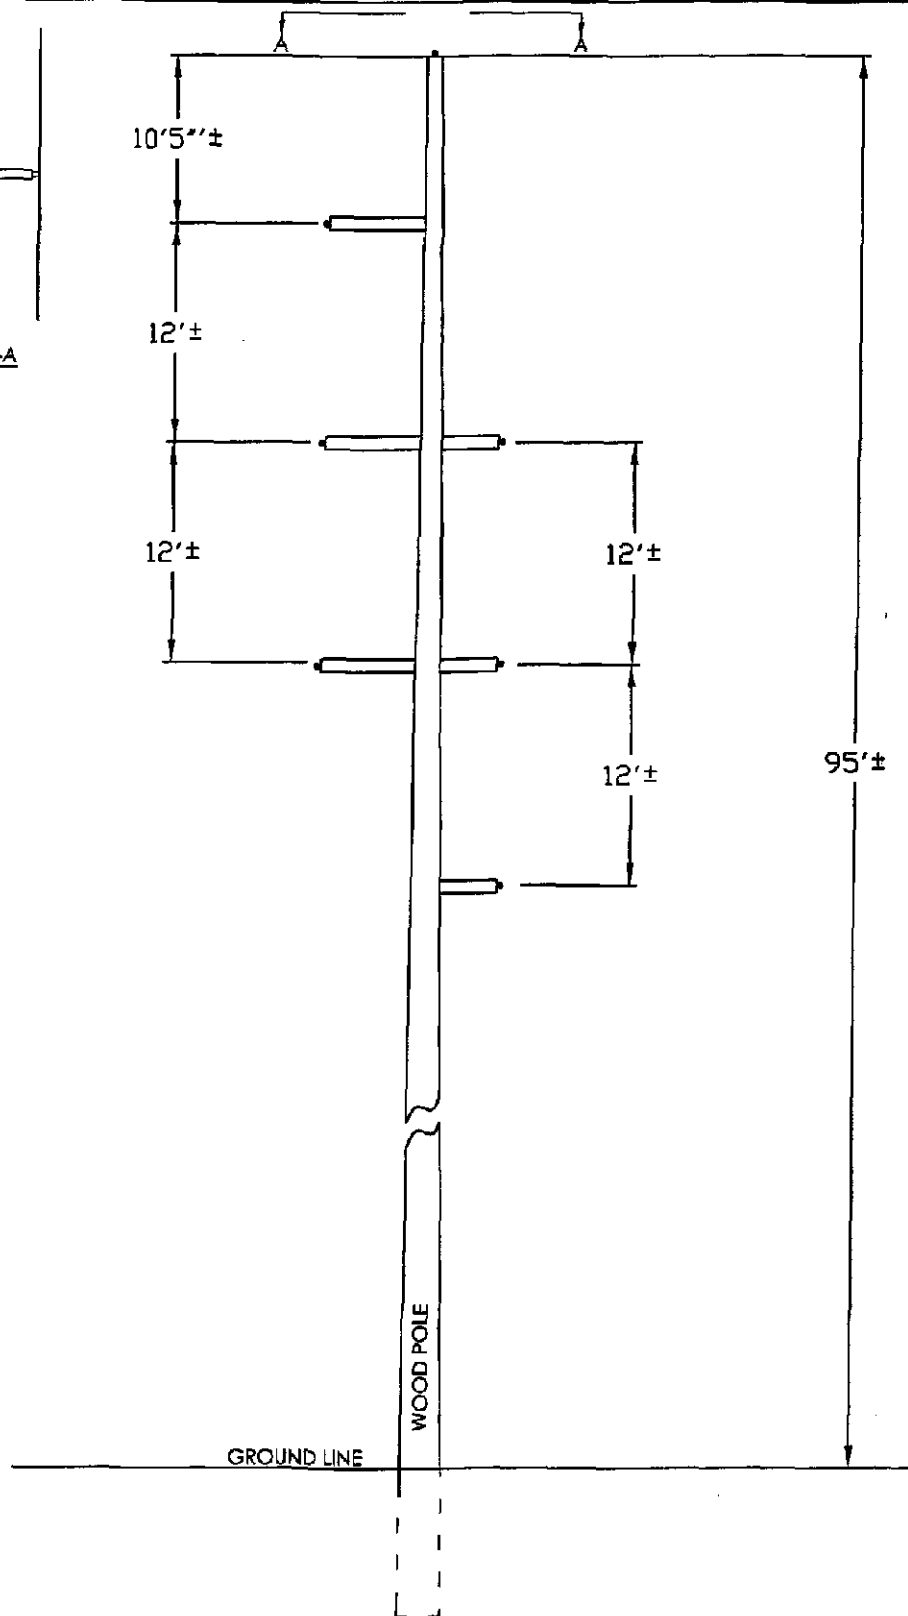

ATSI.

American Transmission Systems, Inc.
a subsidiary of FirstEnergy Corp.

Ohio Edison

A FirstEnergy Company

EVERGREEN-IVANHOE 138 KV TRANSMISSION LINE TAP TO
MARVIN GROUP
DOUBLE CIRCUIT TANGENT POLE

EXHIBIT 11A