


MARION EFFLUENT HARDNESS / MG/L

May	RAW HARDNESS MG/L	EFFLUENT HARDNESS MG/L
1	354	139
2	422	142
3	472	145
4	406	138
5	465	142
6	491	148
7	447	141
8	518	140
9	531	140
10	476	134
11	418	138
12	403	142
13	388	141
14	372	136
15	360	138
16	340	144
17	334	140
18	330	148
19	334	142
20	336	136
21	375	146
22	400	141
23	380	141
24	390	140
25	360	143
26	350	145
27	380	145
28	373	147
29	389	147
30	408	142
31	394	142

<b>AVERAGE</b>	<b>400</b>	<b>142</b>
<b>MAX</b>	<b>531</b>	<b>148</b>
<b>MIN</b>	<b>330</b>	<b>134</b>

May 2012  
EFFLUENT HARDNESS AVG - 142 MG/L  
MARION DISTRICT

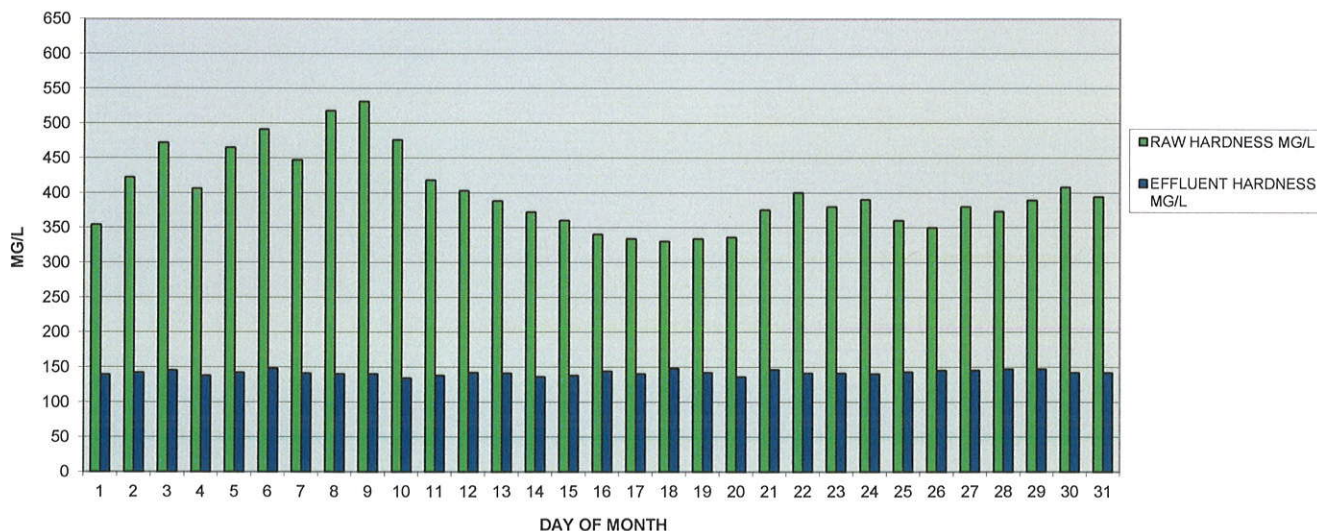

**This foregoing document was electronically filed with the Public Utilities**

**Commission of Ohio Docketing Information System on**

**6/6/2012 3:30:42 PM**

**in**

**Case No(s). 12-1771-WS-UNC**

Summary: Report Aqua Ohio Water Co., Inc. - Marion Water Hardness Report - May 2012.  
electronically filed by Mrs. Angela G Hosp on behalf of Aqua Ohio Water Co., Inc. and  
Ballenger, Scott Mr.