


April 16, 2014

**Case No. 14-0348-EL-REN
Sunny#1 - Sunny#1
Staff Interrogatories – Initial Set**

Question 1: In section N you claim that the meter used for this facility is a Hialeah meter and has the serial number 51276877, but these attributes cannot be confirmed from the meter photo you provided. Please provide a new photograph that shows the meter serial number as well as the meter type.

Answer 1:

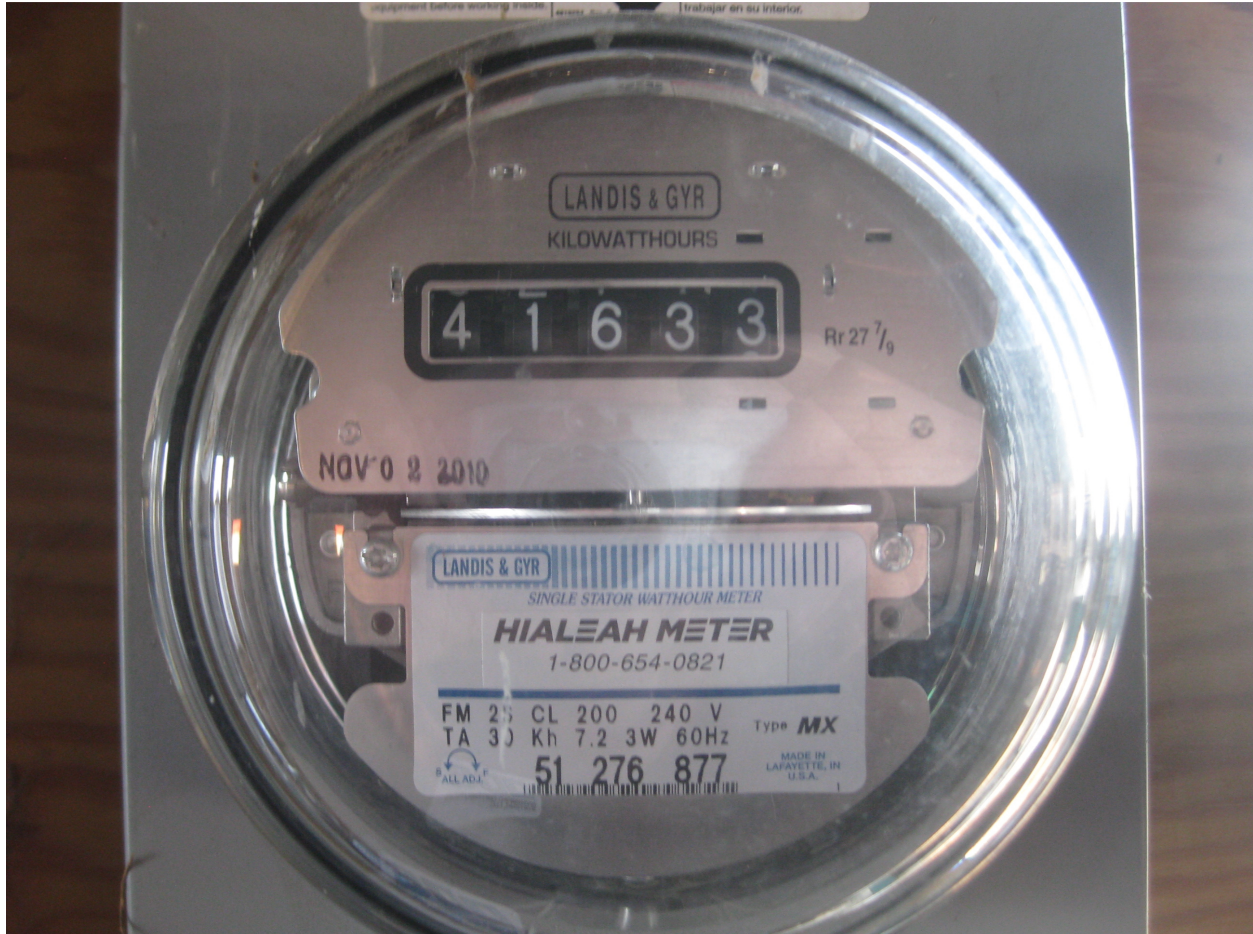

Please let me know if you have any further questions and thank you for your cooperation.

Best,
Anna Nocas
Senior Associate
Sol Systems, LLC

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

4/16/2014 6:31:12 PM

in

Case No(s). 14-0348-EL-REN

Summary: Reply reply to staff interrogatory electronically filed by Ms. Anna Noucas on behalf of Kennedy, Jeanne