

October 6, 2014

Mr. Jim O'Dell  
Facilities, Siting & Environmental Analysis Division  
Ohio Power Siting Board  
Public Utilities Commission of Ohio  
180 East Broad Street  
Columbus, OH 43215-3793

**Allen Junction-East Fayette 138 kV Transmission Line Rebuild Project**  
**Project Supplemental Information**  
**Case No. 14-1244-EL-BLN**


Dear Mr. O'Dell:

This letter provides supplemental information to the Board concerning the construction of the Allen Junction-East Fayette 138 kV Transmission Line Rebuild Project, Case No. 14-1244-EL-BLN. To provide easier construction in the field and reduce total transmission line outage duration, a change to the configuration of the conductors on the poles is needed. One conductor will be on the road side of the pole, and two conductors will be on the side away from the road.

A structure exhibit is attached to this letter to reflect the clarification described above. Other features of the Project are not affected by this clarification. This configuration does not create any additional impacts.

Should the Ohio Power Siting Board desire further information or discussion of this submittal, please contact me at (330) 384-5955.

Sincerely,





Jessica Thacker  
Supervisor, Transmission Siting  
Energy Delivery Transmission and Substation Design  
FirstEnergy Service Company

RECEIVED-DOCKETING DIV

2014 OCT -9 PM 1:30

PUCO

This is to certify that the images appearing are an  
accurate and complete reproduction of a case file  
document delivered in the regular course of business  
Technician AN Date Processed OCT 09 2014

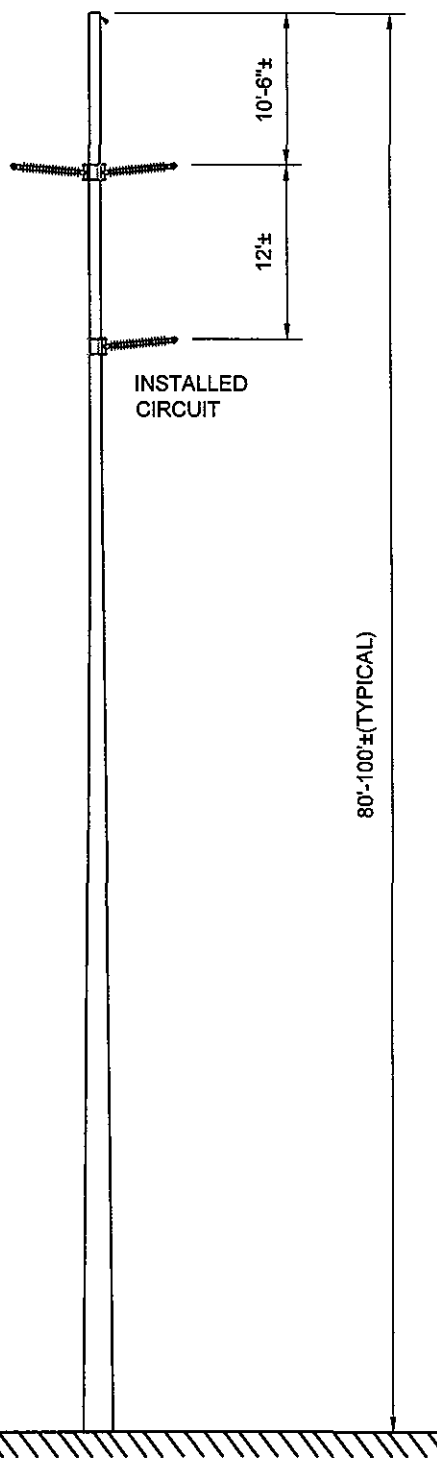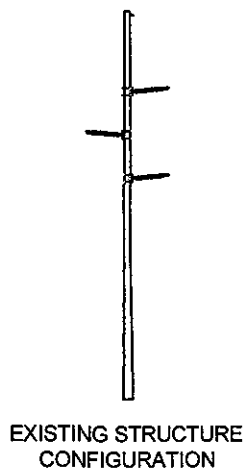

CONDUCTOR: 795ACSR DRAKE  
SHIELD WIRE: OPGW AFL DNO6525



date 10/03/14  
designed J. BOYER

# **SINGLE CIRCUIT WOOD POLE TANGENT WITH HORIZONTAL POSTS**

project  
ALLEN JCT-EAST FAYETTE 138kV

contract