



BRICKER & ECKLER LLP
100 South Third Street
Columbus, OH 43215-4291
MAIN: 614.227.2300
FAX: 614.227.2390

www.bricker.com
info@bricker.com

Sally W. Bloomfield
614.227.2368
sbloomfield@bricker.com

June 4, 2015

Via Electronic Filing

Ms. Barcy McNeal
Administration/Docketing
Public Utilities Commission of Ohio
180 East Broad Street, 11th Floor
Columbus, OH 43215-3793

**Re: Clean Energy Future-Lordstown, LLC,
OPSB Case No. 14-2322-EL-BGN**

Dear Ms. McNeal:

I am attaching for filing in the above-referenced matter, the proof of publication attesting to the publication of the Notice of Proposed Major Utility Facility. The notice was published in the *Tribune Chronicle* on May 31, 2015.

Please do not hesitate to contact me if you have any questions.

Sincerely,

Sally W. Bloomfield

Attachment

PROOF OF PUBLICATION

STATE OF OHIO

TRUMBULL COUNTY

SS: CHARLES JARVIS

BEING DULY SWORN, UPON OATH STATES THAT HE IS
THE PUBLISHER OF THE TRIBUNE CHRONICLE, (A DIVISION OF
EASTERN OHIO NEWSPAPERS INC) A DAILY NEWSPAPER PRINTED
IN THE CITY OF WARREN, COUNTY OF TRUMBULL, STATE OF OHIO
AND OF GENERAL CIRCULATION IN THE CITY OF WARREN,
TRUMBULL COUNTY, OHIO AND IS INDEPENDENT IN POLITICS.

THAT THE ATTACHED ADVERTISEMENT WAS
PUBLISHED IN THE TRIBUNE CHRONICLE EVERY
SUNDAY FOR (1) ONE
CONSECUTIVE WEEKS AND THAT THE FIRST INSERTION WAS
ON SUNDAY THE 31st DAY
OF MAY 2015.

PAMELA EAZOR

SWORN TO BEFORE ME AND SUBSCRIBED IN MY PRESENCE ON
THIS 1st DAY OF JUNE 2015 AT WARREN

Constance A. Pacek
NOTARY PUBLIC

CONSTANCE A. PACEK, Notary Public
State of Ohio
My Commission Expires March 7, 2016

SEAL

ADVERTISING COST: \$ 2364.80


Notice of Proposed Major Utility Facility

FACILITY DESCRIPTION

Clean Energy Future-Lordstown, LLC proposes to construct, own and operate an 800 megawatt (MW) gas fired, combined cycle power station, Lordstown Energy Center, to be located on an industrially zoned site within the Lordstown Industrial Park, located off Route 45, with close proximity to I-80/I-76. The project will consist of two gas fired, high efficiency combustion turbines with two heat recovery steam generators and a single steam turbine. It will have a cooling tower and state of the art environmental controls. The plant will be served by natural gas from one or multiple pipelines.

LOCATION AND GENERAL LAYOUT

The general location and planned project layout of Lordstown Energy Center is shown on the map below:

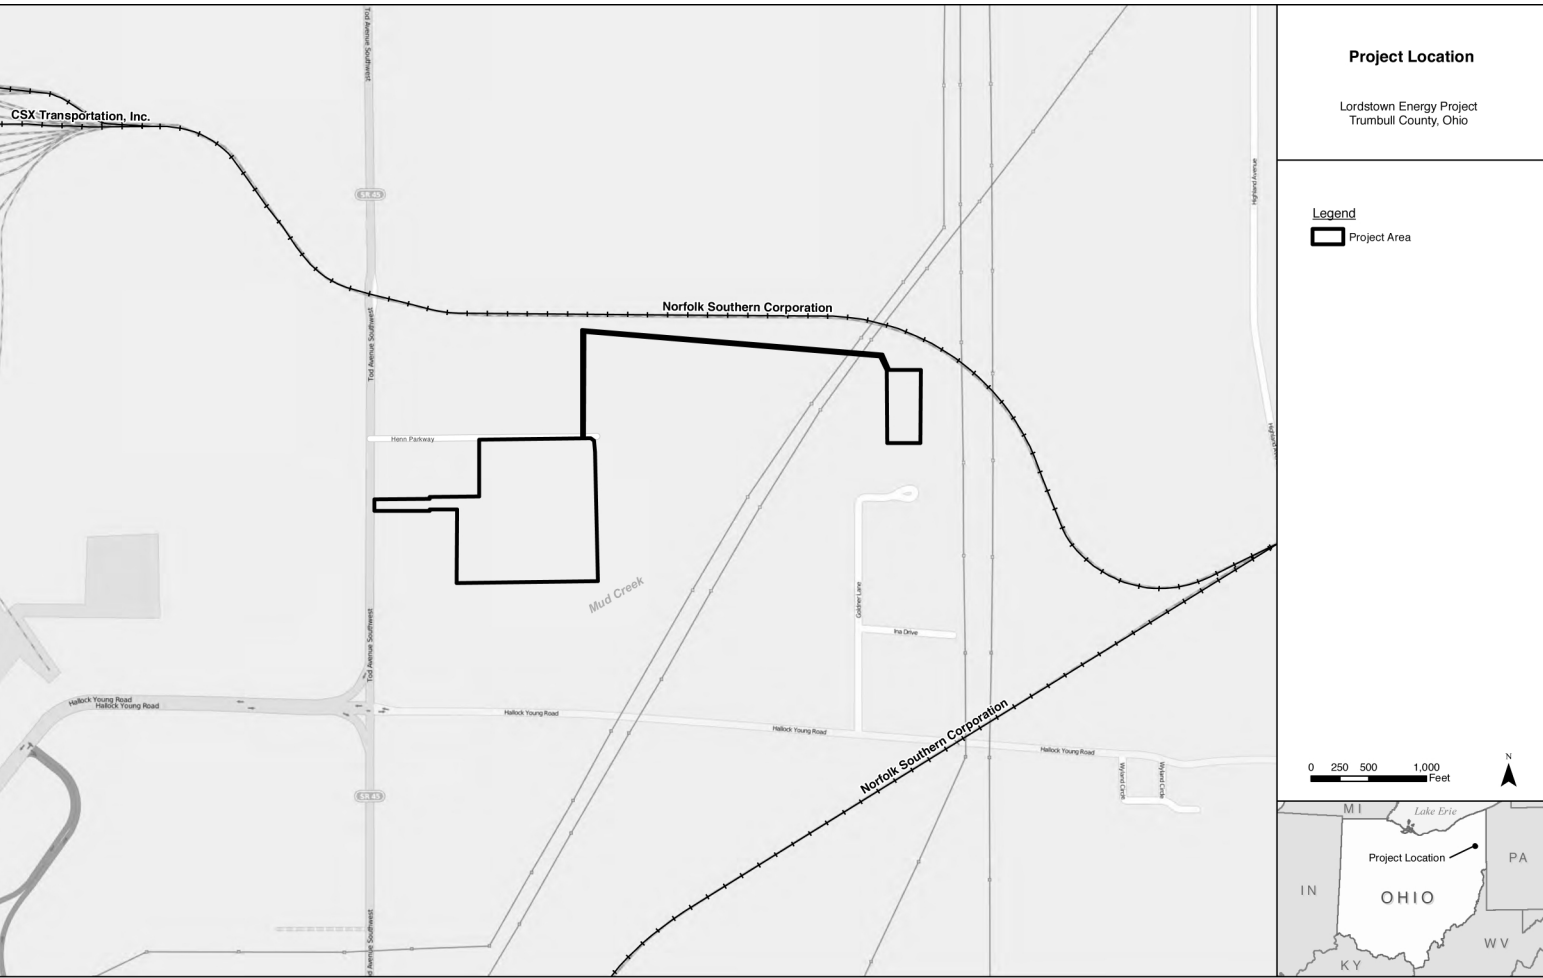

APPLICATION NOW PENDING

Clean Energy Future-Lordstown LLC has an Application pending before the Ohio Power Siting Board. The assigned docket number for the Application is Case No. 14-2322-EL-BGN, and copies of all filings in the case can be located at the Ohio Power Siting Board website at (<http://www.opsb.ohio.gov>) by scrolling down to “Pending Cases” and selecting the case by name or docket number. To view the filings, click the case number for the case record.

PUBLIC OFFICIALS SERVED WITH COPIES OF THE APPLICATION

The following public officials were served with a copy of the Application: Village of Lordstown Mayor Arno Hill; Village of Lordstown Planning & Zoning Administrator/Economic Development Director Kellie Bordner; Trumbull County Commissioners Frank S. Fuda, Mauro Cantalamessa, and Daniel E. Polivka; Trumbull County Engineer Randy L. Smith; Trumbull County Planning Commission Chairman Lewis Kostoff; and Trumbull Soil & Water Conservation District Chair Peter Kepner. A copy of the Application is also available for public inspection at the Warren-Trumbull County Public Library, Lordstown Branch Library, 1471 Salt Springs Road, Warren, Ohio 44481.

OHIO POWER SITING BOARD APPLICATION REVIEW CRITERIA

Pursuant to Ohio Revised Code Section 4906.10(A) the Ohio Power Siting Board shall not grant a certificate for the construction, operation, and maintenance of a major utility facility, either as proposed or as modified by the Board, unless it finds and determines all of the following: (1) The basis of the need for the facility; (2) The nature of the probable environmental impact; (3) That the facility represents the minimum adverse environmental impact, considering the state of available technology and the nature and economics of the various alternatives, and other pertinent considerations; (4) In the case of an electric transmission line, that the facility is consistent with regional plans for expansion of the electric power grid of the electric systems serving this state and interconnected utility systems and that the facility will serve the interests of electric system economy and reliability; (5) That the facility will comply with Chapters 3704., 3734., and 6111. of the Revised Code and all rules and standards adopted under those chapters and under Sections 1501.33, 1501.34, and 4561.32 of the Revised Code. In determining whether the facility will comply with all rules and standards adopted under Section 4561.32 of the Revised Code, the Board shall consult with the office of aviation of the division of multi-modal planning and programs of the department of transportation under Section 4561.341 of the Revised Code; (6) That the facility will serve the public interest, convenience, and necessity; (7) In addition to the provisions contained in divisions (A)(I) to (6) of this section and rules adopted under those divisions, what its impact will be on the viability as agricultural land of any land in an existing agricultural district established under Chapter 929 of the Revised Code that is located within the site and alternative site of the proposed major utility facility; rules adopted to evaluate impact under Division (A)(7) of this section shall not require the compilation, creation, submission, or production of any information, document, or other data pertaining to land not located within the site and alternative site; and (8) That the facility incorporates maximum feasible water conservation practices as determined by the Board, considering available technology and the nature and economics of the various alternatives.

STATEMENT PURSUANT TO OHIO REVISED CODE SECTION 4906.07

Upon the receipt of an application complying with Section 4906.06 of the Revised Code, the Ohio Power Siting Board shall promptly fix a date for a public hearing thereon, not less than sixty nor more than ninety days after such receipt, and shall conclude the proceeding as expeditiously as practicable. The public hearing for this case shall consist of two parts:

- (1) A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person. The local public hearing date is, July 28, 2015 at 6:00 PM., at the Village of Lordstown Administration Center, Community Room, 1455 Salt Springs Road, Lordstown, Ohio 44481; and,
- (2) The date for the adjudicatory hearing has been scheduled for, August 11, 2015 at 10:00 AM, at the offices of the Public Utilities Commission of Ohio, 11th Floor Hearing Room 11-C, 180 East Broad Street, Columbus, Ohio 43215-3793.

The chairman of the Ohio Power Siting Board shall cause each application filed with the Ohio Power Siting Board to be investigated and shall, not less than fifteen days prior to the date any application is set for hearing, submit a written report to the Ohio Power Siting Board and to the applicant. A copy of such report shall be made available to any person upon request. Such report shall set forth the nature of the investigation, and the report shall contain recommended findings with regard to division (A) of Section 4906.10 of the Revised Code and shall become part of the record and served upon all parties to the proceeding.

STATEMENT OF OHIO REVISED CODE SECTION 4906.08(C)

The Ohio Power Siting Board shall accept written or oral testimony from any person at the public hearing, but the right to call and examine witnesses shall be reserved for parties. However, the Board may adopt rules to exclude repetitive, immaterial, or irrelevant testimony.

Petitions to intervene in the adjudicatory hearing will be accepted by the Board up to 30 days following the publication of this notice required by Rule 4906-5-08(C)(1), O.A.C., or later if good cause is shown. However, the Board strongly encourages interested persons who wish to intervene in the adjudicatory hearing to file their petitions as soon as possible but by no later than July 13, 2015. Petitions should be addressed to the Ohio Power Siting Board, 180 East Broad Street, Columbus, Ohio 43215-3793 and cite the above-listed Case No. 14-2322-EL-BGN. #151-1T-May 31, 2015 WOH0001971

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

6/4/2015 11:11:17 AM

in

Case No(s). 14-2322-EL-BGN

Summary: Proof of Pub of Clean Energy Future-Lordstown LLC electronically filed by Teresa Orahod on behalf of Sally Bloomfield