



Legal Department

American Electric Power
1 Riverside Plaza
Columbus, OH 43215-2373
AEP.com

Hector Garcia
Senior Counsel –
Regulatory Services
(614) 716-3410 (P)
(614) 716-2014 (F)
hgarcia1@aep.com

Chairman Andre T. Porter
Ohio Power Siting Board
180 East Broad Street
Columbus, Ohio 43215

September 28, 2015

Re: PUCO Case No. 15-1682-EL-BTA
Biers Run-Hopetown-Delano 138kV Transmission Line Amendment Project

Dear Chairman Porter:

Attached is an Amendment to the Biers Run-Hopetown-Delano 138kV Transmission Line Project filed by AEP Ohio Transmission Company.

Respectfully Submitted,

/s/ Hector Garcia

Hector Garcia
Counsel for AEP Ohio Transmission Company


**AMENDMENT TO THE BIERS RUN-HOPETOWN-DELANO
138 kV TRANSMISSION LINE PROJECT**

Case Number 15-1682-EL-BTA

On March 9, 2015, the Ohio Power Siting Board (OPSB) issued an Opinion, Order and Certificate, in Case Number 13-0429-EL-BTX, granting the Application of AEP Ohio Transmission Company, Inc. (AEP) to construct a 138 kV electric transmission line along the proposed Preferred Route of the Biers Run-Hopetown-Delano project.

AEP is currently proposing a route adjustment to accommodate a property owner request.

The adjustment is located between Old OH-207 and State Route 104 on Ross County Parcel Nos. 370914008000, 370914009000, 370913270000, and 370914052000. The shift was done to accommodate the land owner west of State Route 104 and moves the route to a property owned by AEP.

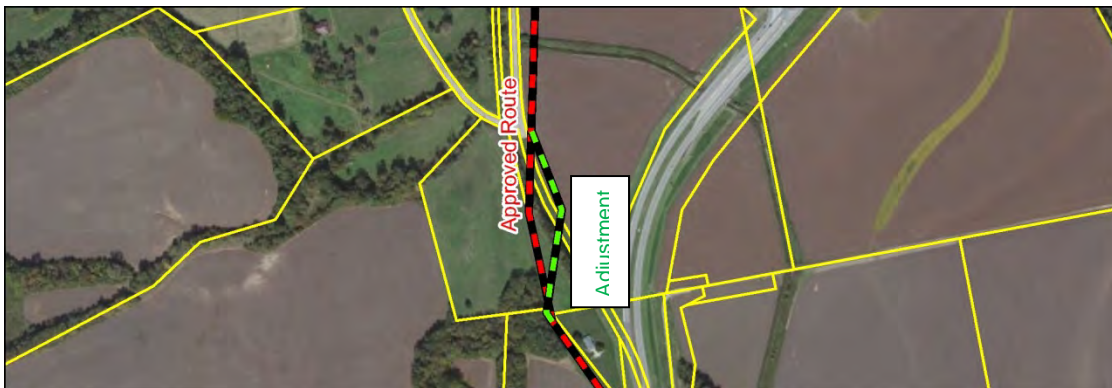

AEP has reviewed this adjustment to the OPSB Approved Route. It can be made with no or minimal increases to the project impacts. Accordingly, AEP respectfully submits their request that the OPSB Approved Route be amended as described herein. For the OPSB's convenience, the amendment information is presented in "Letter of Notification" ("LON") format.

4906-11-01(B) GENERAL INFORMATION

- 1. The name of the project and applicant's reference number, if any, names and reference numbers(s) of resulting circuits and a brief description of the project, and why the project meets the requirements of a letter of notification.**

The reference number for the Biers Run-Hopetown-Delano 138 kV Transmission Line Project was addressed and considered in the previous application filing and the subsequent

OPSB Opinion, Order and Certificate (13-0429-EL-BTX) and can be found on pages 02-4 of the Application. This Amendment proposes one adjustment to the route approved by the Board in Case No. 13-0429-EL-BTX. The adjustment is located between Old OH-207 and State Route 104 on Ross County Parcel Nos. 370914008000, 370914009000, 370913270000, and 370914052000.

The adjusted section of the OPSB Approved Route is located in Union Township in Ross County, Ohio. The alignment of the OPSB Approved Route and the proposed adjustment in this area of the Project are shown on Amendment Figure 04-1, Constraints Map.

The adjustment of the OPSB Approved Route is approximately 1,040 feet (0.20 mile) long and is located predominantly along State Route 104. The adjustment is located on four parcels with Parcel Numbers 370914008000, 370914009000, 370913270000, and 370914052000. The owner of parcels 370914008000 and 370914009000 is AEP, and the owner of parcels 370913270000 and 370914052000 is listed as Detillion Properties, LTD. The adjustment was done to accommodate a request by Detillion Properties, LTD to move the route more onto AEP land.

The Project meets the requirements for a LON because it is within the types of projects defined by Item (1)(d) of Attachment A of the interim process defined in the OPSB's September 4, 2012 Finding and Order in Docket 12-1981-GE-BRO. These items state:

(1) Rerouting or extension or new construction of single or multiple circuit electric power transmission line(s) as follows:

(d) Line(s) one hundred twenty-five kV and above, but less than three hundred kV, and greater than 0.2 miles in length but not greater than two miles in length.

The location of the OPSB Approved Route proposed to be adjusted has a length of 0.20 mile.

2. If the proposed letter of notification project is an electric power transmission line or gas or natural gas transmission line, a statement explaining the need for the proposed facility.

The need for the Biers Run-Hopetown-Delano 138 kV Transmission Line Project was addressed and considered in the previous Application filing and the subsequent OPSB Opinion, Order and Certificate of the original Application (13-0429-EL-BTX) and can be

found in Section 2 of the Application. The need for the adjustment to the OPSB Approved Route proposed in this Amendment is to accommodate the request of a property owner.

3. The location of the project in relation to existing or proposed lines and stations shown on maps and overlays provided to the Public Utilities Commission of Ohio in the applicant's most recent long term forecast report.

The location of the Project relative to existing or proposed transmission lines is shown in the Biers Run-Hopetown-Delano Project Overview map, included as Figures 01-1 and 02-1 of the original Application and supplemental filings.

4. The alternatives considered and reasons why the proposed location or route is best suited for the proposed facility. The discussion shall include, but not be limited to impacts associated with socioeconomic, natural environment, construction, or engineering aspects of the project.

Consideration of the proposed relocation was initiated at the request of a property owner. At the proposed relocation area, the potential area was carefully reviewed to identify potential ecological and social impacts associated with various potential alignments as well as the property owner's wishes. The proposed adjusted route represents the best solution to implementing the property owner's wishes while carefully balancing other impacts.

5. The anticipated construction schedule and proposed in-service date of project.

The overall anticipated construction schedule was provided in the Application as Figure 02-2. Construction of the area proposed in this Amendment will begin in fall of 2015. The in-service date for the Project is expected to be March 2016.

6. An area map of not less than 1:24,000-scale clearly depicting the facility's centerline with clearly marked streets, roads, and highways, and clearly written instructions for locating and viewing the facility.

A map of the overall project location was addressed and considered in the previous Application filing and the subsequent supplemental filings and OPSB Opinion, Order and Certificate of the original Application (13-0429-EL-BTX) and can be found in Figures 04-1A through 04-1E. Amendment Figure 04-1 provides the location of the adjustment.

- 7. A list of properties for which the applicant has obtained easements, options, and/or land use agreements necessary to construct and operate the facility and a list of the additional properties for which such agreements have not been obtained.**

The adjustment is located on Parcel Numbers 370914008000 and 370914009000, owned by AEP, and Parcel Numbers 370913270000 and 370914052000, owned by Detillion Properties, LTD. Easements and/or other land use agreements are pending on all of these properties.

4906-11-01 (C) TECHNICAL FEATURES OF THE PROJECT

- 1. Operating characteristics, estimated number and types of structures required, and right-of-way and/or land requirements.**

The change of the OPSB Approved Route will not change the operating characteristics that were addressed and considered in the previous application filing and the subsequent OPSB Opinion, Order and Certificate of the original Application (13-0429-EL-BTX) and can be found on pages 04-4 through 04-7.

- 2. For electric power transmission lines, the production of electric and magnetic fields during the operation of the proposed electric power transmission line.**

The change to the OPSB Approved Route will not significantly change the electro-magnetic field (EMF) calculations that were addressed and considered in the previous application filing and the subsequent OPSB Opinion, Order and Certificate of the original Application (13-0429-EL-BTX) and can be found on pages 06-14 through 06-19.

- 3. The estimated cost of the project by Federal Energy Regulatory Commission account, unless the applicant is not an electric light company, a gas company or a natural gas company as defined in Chapter 4905., of the Revised Code (in which case, the applicant shall file the capital costs classified in the accounting format ordinarily used by the applicant in its normal course of business).**

The change to the OPSB Approved Route will not significantly affect the estimated capital costs by FERC Accounts for the Project that were addressed and considered in the previous application filing and the subsequent OPSB Opinion, Order and Certificate of the original Application (13-0429-EL-BTX) and can be found on page 05-1 and Table 05-1.

(D) SOCIOECONOMIC DATA

- 1. A brief description of land use within the vicinity of the proposed project, including: (a) a list of municipalities, townships and counties affected; and (b) estimates of population density adjacent to rights of way within the study corridor (the U.S. census information may be used to meet this requirement.)**

The change to the OPSB Approved Route crosses land use that was addressed and considered in the previous application filing and the subsequent OPSB Opinion, Order and Certificate of the original Application (13-0429-EL-BTX).

- 2. The location and general description of all agricultural land (including agricultural district land) existing at least sixty days prior to submission of the letter of notification within the proposed electric power transmission line right-of-way, or within the proposed electric power transmission substation fenced-in area, or within the construction site boundary of a proposed compressor station.**

The change to the OPSB Approved Route crosses similar percentage of land use that was addressed and considered in the previous application filing and the subsequent OPSB Opinion, Order and Certificate of the original Application (13-0429-EL-BTX).

- 3. A description of the applicant's investigation (concerning the presence or absence of significant archaeological or cultural resources that may be located within the area likely to be disturbed by the project), a statement of the findings of the investigation, and a copy of any document produced as a result of the investigation.**

In accordance with the OPSB Opinion, Order and Certificate, an investigation and report of cultural resources has been prepared for the balance of the OPSB Approved Route. This investigation was extended to include the pole locations along the adjustment by Weller and Associates, Inc. in June 2015. No cultural resources were identified and no impacts to cultural resources are anticipated as a result of the adjustment.

- 4. Documentation that the chief executive officer of each municipal corporation and county, and the head of each public agency charged with planning land use in the area in which any portion of the facility is to be located have been notified of the project and have been provided with a copy of the letter of notification. The applicant shall describe the company's public information program used in the siting of the proposed facility. The information submitted shall include either a copy of the**

material distributed to the public or a copy of the agenda and summary of the meeting(s) held by the applicant.

The Amendment is being provided concurrently to the current public officials, libraries and parties of record as listed in Appendix 06-2 of the Application. Copies of the cover letters to these officials and the local library are attached in Appendix A. AEP Ohio Transco will advise local officials of features and the status of the proposed Project.

5. A brief description of any current or pending litigation involving the project known to the applicant at the time of the letter of notification.

There is no known current or pending litigation involving this Amendment.

6. A listing of local, state, and federal governmental agencies known to have requirements which must be met in connection with the construction of the project, and list of documents that have been or are being filed with those agencies in connection with siting and constructing the project.

There are no known local, state, or federal requirements that must be met prior to commencement of construction of the adjustment to the OPSB Approved Route beyond those planned for the other portions of the Project.

(E) ENVIRONMENTAL DATA

1. A description of the applicant's investigation concerning the presence or absence of federal or state endangered species (including endangered species, threatened species, rare species, species proposed for listing, species under review for listing, and species of special interest) that may be located within the area likely to be disturbed by the project, a statement of the findings of the investigation, and a copy of any document produced as a result of the investigation.

An investigation of endangered or threatened species was addressed and considered in the previous Application filing and the subsequent OPSB Opinion, Order and Certificate of the original Application and supplemental filings (13-0429-EL-BTX). On behalf of AEP, URS conducted a field reconnaissance of the route adjustment. No new concerns associated with special status species were identified.


- 2. A description of the applicant's investigation concerning the presence or absence of areas of ecological concern (including national and state forests and parks, floodplains, wetlands, designated or proposed wilderness areas, national and state wild and scenic rivers, wildlife areas, wildlife refuges, wildlife management areas, and wildlife sanctuaries) that may be located within the areas likely to be disturbed by the project, a statement of the findings of the investigation, and a copy of any document produced as a result of the investigation.**

An investigation of areas of ecological concern was conducted and considered in the previous Application filing and the subsequent OPSB Opinion, Order and Certificate of the original Application and supplemental filings (13-0429-EL-BTX).

On behalf of AEP, URS conducted a field reconnaissance of the route adjustment. Table 07-1 Revision 3, was provided in the 3rd Supplement to the OPSB Application, dated July 31, 2014. No new stream crossings were identified. The length of Stream 17 within the proposed right-of-way is reduced from 258 feet to 36 feet by the adjustment. Amendment Figure 07-1 shows streams and wetlands along the adjustment and corresponding portions of the OPSB Approved Route.

- 3. Any known additional information that will describe any unusual conditions resulting in significant environmental, social, health or safety impacts.**

To the best of AEP's knowledge, no unusual conditions exist that would result in environmental, social, health, or safety impacts along the proposed adjustment or remainder of the overall Project. Construction and operation of the proposed Project will meet all applicable safety standards established by the Occupational Safety and Health Administration, and will be in accordance with the requirements specified in the latest revision of the National Electrical Safety Code as adopted by the Public Utilities Commission of Ohio. The Stormwater Pollution Prevention Plan (SWPPP), which will include the Access Plan, will be provided to the OPSB under separate cover, after submission of this LON.

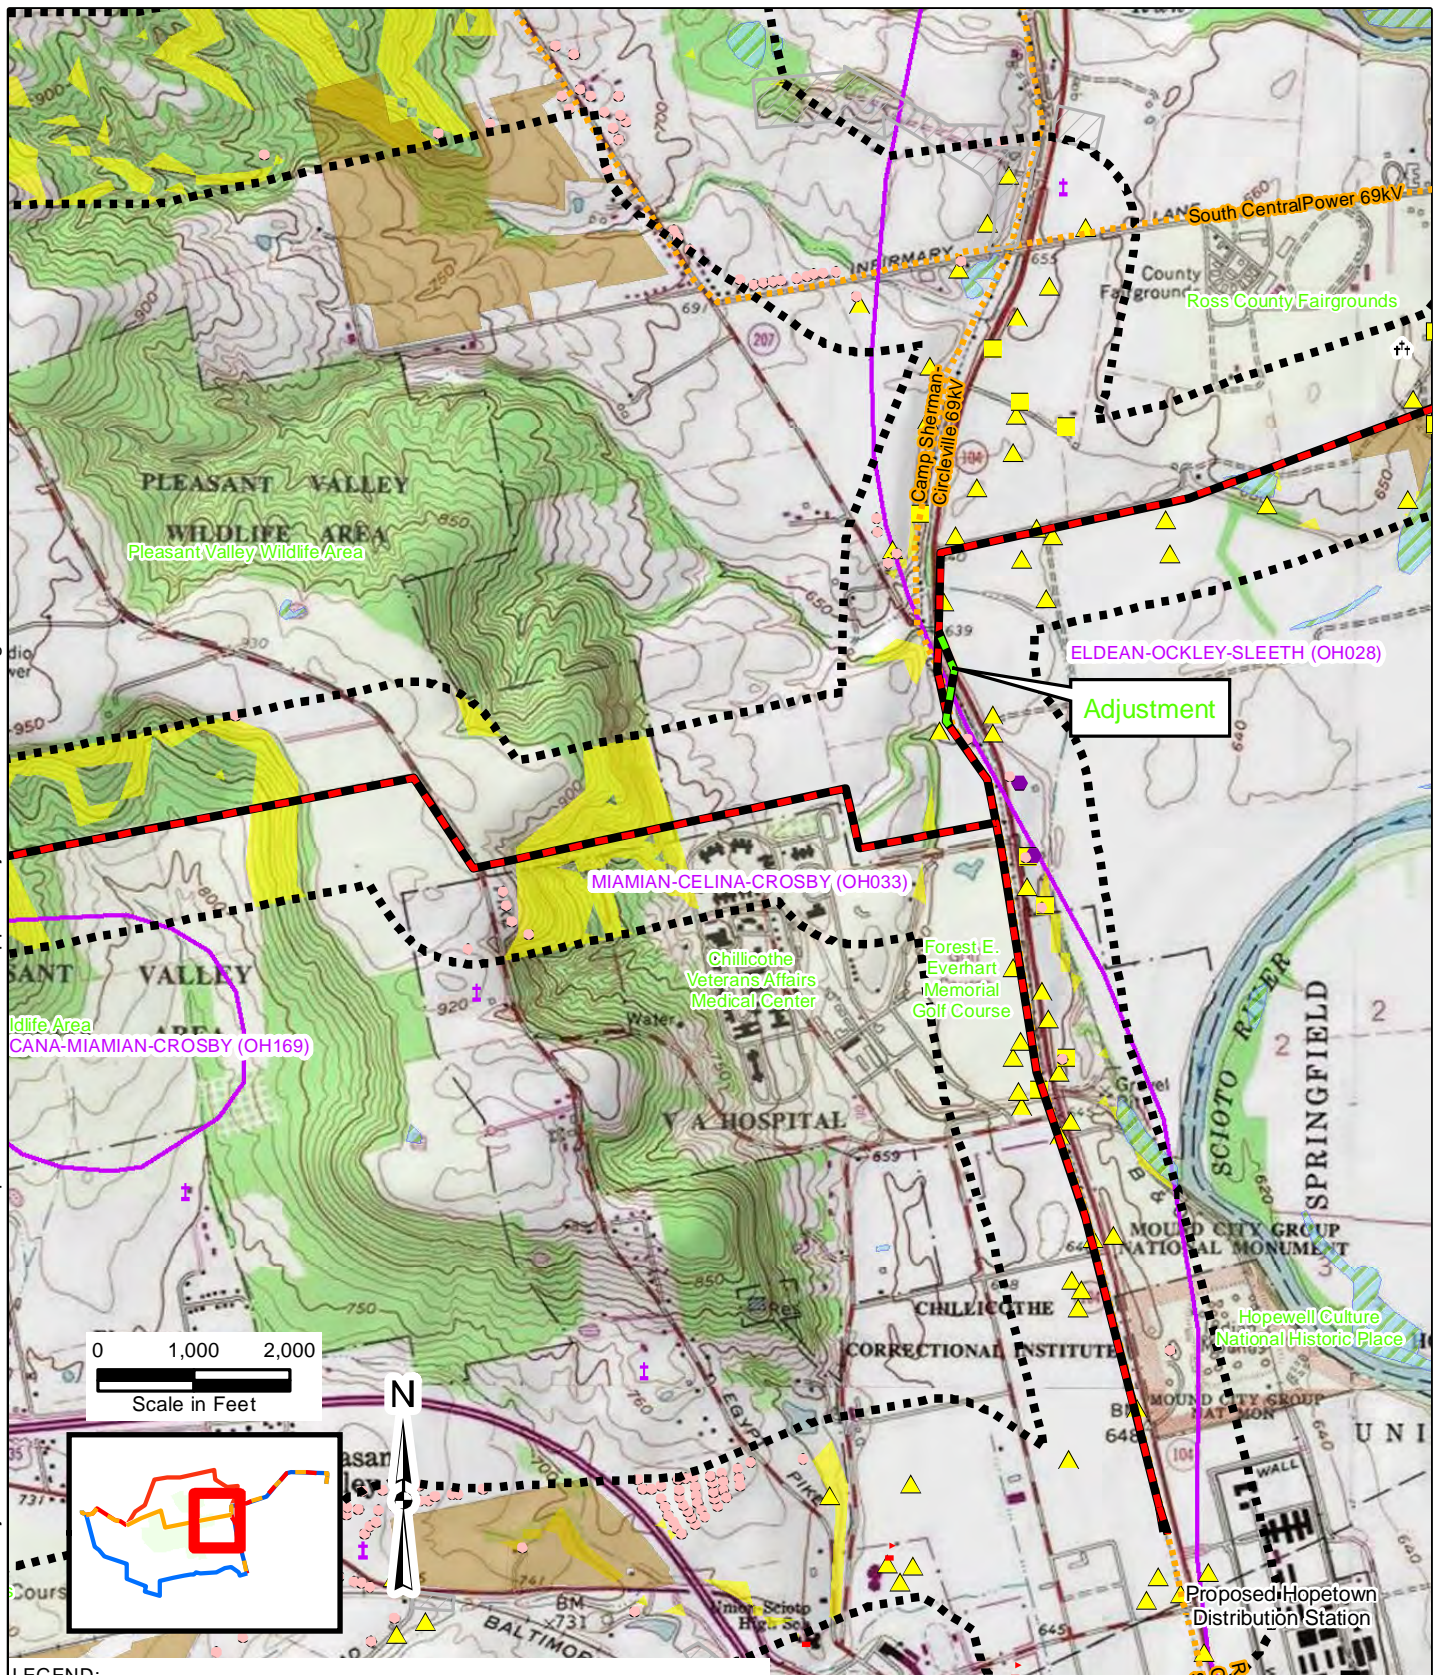

LEGEND:

- | | |
|---|-----------------------------------|
| Proposed Route Adjustment | Cemetery |
| OPSB Approved Route Centerline | Known Archaeology Site |
| 1,000-foot Buffer of Routes | Soil Association |
| Existing Transmission Line | NWI Area |
| Residence | Slope Exceeds 12% |
| School | Agricultural District Land Parcel |
| Church | Commercial/Industrial Land Use |
| Air Transportation Facility | |
| National Register of Historic Places Site | |
| Ohio Historic Inventory Structure | |




**Biers Run-Hopetown-Delano
138 kV Transmission Line**

**AMENDMENT FIGURE 04-1
CONSTRAINTS MAP**

JOB NO. 14951217

URS

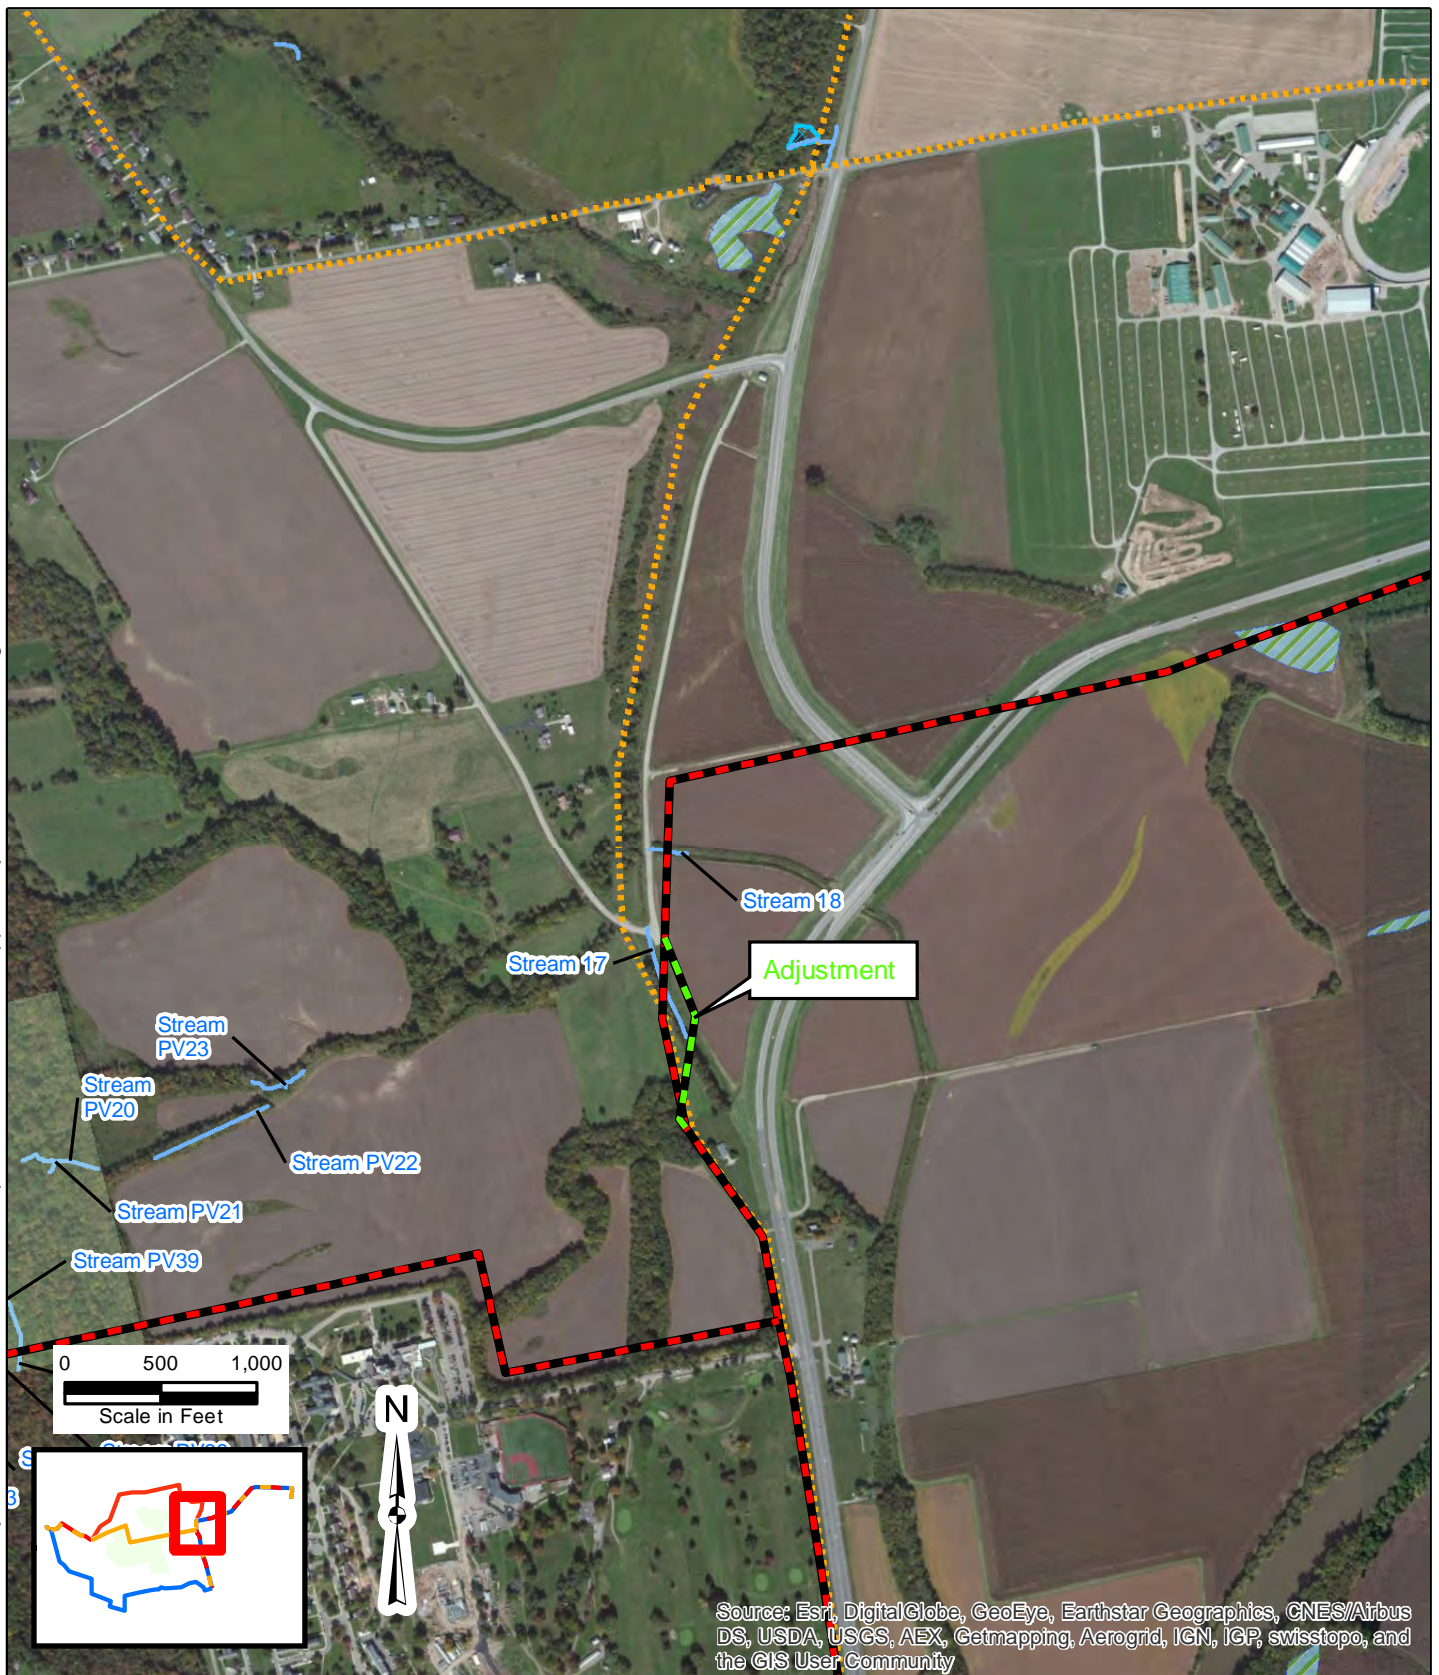

Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AEX, Getmapping, Aerogrid, IGN, IGP, swisstopo, and the GIS User Community

LEGEND:

- Proposed Route Adjustment
- OPSB Approved Route Centerline
- NWI Area
- Delineated Wetland
- Delineated Stream
- Pleasant Valley Wildlife Area
- Existing Transmission Line



Biers Run-Hopetown-Delano
138 kV Transmission Line

AMENDMENT FIGURE 07-1
ECOLOGICAL FEATURES

JOB NO. 14951217

URS

APPENDIX A

PUBLIC OFFICIALS LETTERS SERVING COPY OF LETTER OF NOTIFICATION

September 28, 2015

Chillicothe and Ross County Public Library
Mr. C. Nicholas Tepe, Director
140 South Paint Street
Chillicothe, OH 45601

RE: Biers Run-Hopetown-Delano 138-kV Transmission Line Amendment Project
Case Number: 15-1682-EL-BTA

Dear Mr. Tepe:

AEP Ohio and AEP Ohio Transmission Company, Inc. ("AEP Ohio Transco") are proposing to construct a new electric transmission line in Ross County to be known as the Biers Run-Hopetown-Delano 138-kilovolt (kV) Transmission Line. AEP Ohio Transco plans to submit this Amendment to the siting application to the Ohio Power Siting Board ("OPSB") for the Biers Run-Hopetown-Delano 138-kV Transmission Line. In accordance with Ohio Administrative Code ("OAC") 4906-5-05 (A)(1), the OPSB certified this application as supplemented complete on August 27, 2014.

Pursuant to OAC 4906-5-06, we are serving you one copy of the certified application as amended. As required by the OPSB, the application as amended includes information on justification of need, technical and financial data and a socioeconomic and ecological analysis of the project.

We ask that this Amendment to the Application be made available to the general public.

Copies of this Amendment to the Application have been distributed to local government officials and the local public library.

For additional details about the OPSB and this project, please refer to the OPSB's website at <http://opsb.ohio.gov>. To view electronic versions of the documents of this project, search for case number 13-0429-EL-BTX or 15-1682-EL-BTA.

Sincerely,



Brett E. Schmied
Project Outreach Specialist
AEP Ohio

cc: Shawn Malone, Project Manager

September 28, 2015

Ross County Board of Commissioners
Mr. James M. Caldwell
2 North Paint Street, Suite H
Chillicothe, OH 45601

RE: Biers Run-Hopetown-Delano 138-kV Transmission Line Amendment Project
Case Number: 15-1682-EL-BTA

Dear Mr. Caldwell:

AEP Ohio and AEP Ohio Transmission Company, Inc. ("AEP Ohio Transco") are proposing to construct a new electric transmission line in Ross County to be known as the Biers Run-Hopetown-Delano 138-kilovolt (kV) Transmission Line. AEP Ohio Transco plans to submit this Amendment to the siting application to the Ohio Power Siting Board ("OPSB") for the Biers Run-Hopetown-Delano 138-kV Transmission Line. In accordance with Ohio Administrative Code ("OAC") 4906-5-05 (A)(1), the OPSB certified this application as supplemented complete on August 27, 2014.

Pursuant to OAC 4906-5-06, we are serving you one copy of the certified application as amended. As required by the OPSB, the application as amended includes information on justification of need, technical and financial data and a socioeconomic and ecological analysis of the project.

We ask that this Amendment to the Application be made available to the general public.

Copies of this Amendment to the Application have been distributed to local government officials and the local public library.

For additional details about the OPSB and this project, please refer to the OPSB's website at <http://opsb.ohio.gov>. To view electronic versions of the documents of this project, search for case number 13-0429-EL-BTX or 15-1682-EL-BTA.

Sincerely,



Brett E. Schmied
Project Outreach Specialist
AEP Ohio

cc: Shawn Malone, Project Manager

September 28, 2015

Ross County Board of Commissioners
Mr. Doug Corcoran
2 North Paint Street, Suite H
Chillicothe, OH 45601

RE: Biers Run-Hopetown-Delano 138-kV Transmission Line Amendment Project
Case Number: 15-1682-EL-BTA

Dear Mr. Corcoran:

AEP Ohio and AEP Ohio Transmission Company, Inc. ("AEP Ohio Transco") are proposing to construct a new electric transmission line in Ross County to be known as the Biers Run-Hopetown-Delano 138-kilovolt (kV) Transmission Line. AEP Ohio Transco plans to submit this Amendment to the siting application to the Ohio Power Siting Board ("OPSB") for the Biers Run-Hopetown-Delano 138-kV Transmission Line. In accordance with Ohio Administrative Code ("OAC") 4906-5-05 (A)(1), the OPSB certified this application as supplemented complete on August 27, 2014.

Pursuant to OAC 4906-5-06, we are serving you one copy of the certified application as amended. As required by the OPSB, the application as amended includes information on justification of need, technical and financial data and a socioeconomic and ecological analysis of the project.

We ask that this Amendment to the Application be made available to the general public.

Copies of this Amendment to the Application have been distributed to local government officials and the local public library.

For additional details about the OPSB and this project, please refer to the OPSB's website at <http://opsb.ohio.gov>. To view electronic versions of the documents of this project, search for case number 13-0429-EL-BTX or 15-1682-EL-BTA.

Sincerely,



Brett E. Schmied
Project Outreach Specialist
AEP Ohio

cc: Shawn Malone, Project Manager

September 28, 2015

Ross County Board of Commissioners
Mr. Stephen A. Neal
2 North Paint Street, Suite H
Chillicothe, OH 45601

RE: Biers Run-Hopetown-Delano 138-kV Transmission Line Amendment Project
Case Number: 15-1682-EL-BTA

Dear Mr. Neal:

AEP Ohio and AEP Ohio Transmission Company, Inc. ("AEP Ohio Transco") are proposing to construct a new electric transmission line in Ross County to be known as the Biers Run-Hopetown-Delano 138-kilovolt (kV) Transmission Line. AEP Ohio Transco plans to submit this Amendment to the siting application to the Ohio Power Siting Board ("OPSB") for the Biers Run-Hopetown-Delano 138-kV Transmission Line. In accordance with Ohio Administrative Code ("OAC") 4906-5-05 (A)(1), the OPSB certified this application as supplemented complete on August 27, 2014.

Pursuant to OAC 4906-5-06, we are serving you one copy of the certified application as amended. As required by the OPSB, the application as amended includes information on justification of need, technical and financial data and a socioeconomic and ecological analysis of the project.

We ask that this Amendment to the Application be made available to the general public.

Copies of this Amendment to the Application have been distributed to local government officials and the local public library.

For additional details about the OPSB and this project, please refer to the OPSB's website at <http://opsb.ohio.gov>. To view electronic versions of the documents of this project, search for case number 13-0429-EL-BTX or 15-1682-EL-BTA.

Sincerely,



Brett E. Schmied
Project Outreach Specialist
AEP Ohio

cc: Shawn Malone, Project Manager

September 28, 2015

Ross County Engineer
Mr. Charles Ortman
755 Fairgrounds Road
Chillicothe, OH 45601

RE: Biers Run-Hopetown-Delano 138-kV Transmission Line Amendment Project
Case Number: 15-1682-EL-BTA

Dear Mr. Ortman:

AEP Ohio and AEP Ohio Transmission Company, Inc. ("AEP Ohio Transco") are proposing to construct a new electric transmission line in Ross County to be known as the Biers Run-Hopetown-Delano 138-kilovolt (kV) Transmission Line. AEP Ohio Transco plans to submit this Amendment to the siting application to the Ohio Power Siting Board ("OPSB") for the Biers Run-Hopetown-Delano 138-kV Transmission Line. In accordance with Ohio Administrative Code ("OAC") 4906-5-05 (A)(1), the OPSB certified this application as supplemented complete on August 27, 2014.

Pursuant to OAC 4906-5-06, we are serving you one copy of the certified application as amended. As required by the OPSB, the application as amended includes information on justification of need, technical and financial data and a socioeconomic and ecological analysis of the project.

We ask that this Amendment to the Application be made available to the general public.

Copies of this Amendment to the Application have been distributed to local government officials and the local public library.

For additional details about the OPSB and this project, please refer to the OPSB's website at <http://opsb.ohio.gov>. To view electronic versions of the documents of this project, search for case number 13-0429-EL-BTX or 15-1682-EL-BTA.

Sincerely,



Brett E. Schmied
Project Outreach Specialist
AEP Ohio

cc: Shawn Malone, Project Manager

September 28, 2015

Ross County Planning Department
Mr. Keith Putnam, Administrator
15 North Paint Street, Suite 200
Chillicothe, OH 45601

RE: Biers Run-Hopetown-Delano 138-kV Transmission Line Amendment Project
Case Number: 15-1682-EL-BTA

Dear Mr. Putnam:

AEP Ohio and AEP Ohio Transmission Company, Inc. ("AEP Ohio Transco") are proposing to construct a new electric transmission line in Ross County to be known as the Biers Run-Hopetown-Delano 138-kilovolt (kV) Transmission Line. AEP Ohio Transco plans to submit this Amendment to the siting application to the Ohio Power Siting Board ("OPSB") for the Biers Run-Hopetown-Delano 138-kV Transmission Line. In accordance with Ohio Administrative Code ("OAC") 4906-5-05 (A)(1), the OPSB certified this application as supplemented complete on August 27, 2014.

Pursuant to OAC 4906-5-06, we are serving you one copy of the certified application as amended. As required by the OPSB, the application as amended includes information on justification of need, technical and financial data and a socioeconomic and ecological analysis of the project.

We ask that this Amendment to the Application be made available to the general public.

Copies of this Amendment to the Application have been distributed to local government officials and the local public library.

For additional details about the OPSB and this project, please refer to the OPSB's website at <http://opsb.ohio.gov>. To view electronic versions of the documents of this project, search for case number 13-0429-EL-BTX or 15-1682-EL-BTA.

Sincerely,



Brett E. Schmied
Project Outreach Specialist
AEP Ohio

cc: Shawn Malone, Project Manager

September 28, 2015

Union Township Trustee
Mr. Harold W. Bennett
379 Shiloh Road
Frankfort, OH 45628

RE: Biers Run-Hopetown-Delano 138-kV Transmission Line Amendment Project
Case Number: 15-1682-EL-BTA

Dear Mr. Bennett:

AEP Ohio and AEP Ohio Transmission Company, Inc. ("AEP Ohio Transco") are proposing to construct a new electric transmission line in Ross County to be known as the Biers Run-Hopetown-Delano 138-kilovolt (kV) Transmission Line. AEP Ohio Transco plans to submit this Amendment to the siting application to the Ohio Power Siting Board ("OPSB") for the Biers Run-Hopetown-Delano 138-kV Transmission Line. In accordance with Ohio Administrative Code ("OAC") 4906-5-05 (A)(1), the OPSB certified this application as supplemented complete on August 27, 2014.

Pursuant to OAC 4906-5-06, we are serving you one copy of the certified application as amended. As required by the OPSB, the application as amended includes information on justification of need, technical and financial data and a socioeconomic and ecological analysis of the project.

We ask that this Amendment to the Application be made available to the general public.

Copies of this Amendment to the Application have been distributed to local government officials and the local public library.

For additional details about the OPSB and this project, please refer to the OPSB's website at <http://opsb.ohio.gov>. To view electronic versions of the documents of this project, search for case number 13-0429-EL-BTX or 15-1682-EL-BTA.

Sincerely,



Brett E. Schmied
Project Outreach Specialist
AEP Ohio

cc: Shawn Malone, Project Manager

September 28, 2015

Union Township Trustee
Mr. Donald W. Arledge
210 Yellowbud Road
Chillicothe, OH 45601

RE: Biers Run-Hopetown-Delano 138-kV Transmission Line Amendment Project
Case Number: 15-1682-EL-BTA

Dear Mr. Arledge:

AEP Ohio and AEP Ohio Transmission Company, Inc. ("AEP Ohio Transco") are proposing to construct a new electric transmission line in Ross County to be known as the Biers Run-Hopetown-Delano 138-kilovolt (kV) Transmission Line. AEP Ohio Transco plans to submit this Amendment to the siting application to the Ohio Power Siting Board ("OPSB") for the Biers Run-Hopetown-Delano 138-kV Transmission Line. In accordance with Ohio Administrative Code ("OAC") 4906-5-05 (A)(1), the OPSB certified this application as supplemented complete on August 27, 2014.

Pursuant to OAC 4906-5-06, we are serving you one copy of the certified application as amended. As required by the OPSB, the application as amended includes information on justification of need, technical and financial data and a socioeconomic and ecological analysis of the project.

We ask that this Amendment to the Application be made available to the general public.

Copies of this Amendment to the Application have been distributed to local government officials and the local public library.

For additional details about the OPSB and this project, please refer to the OPSB's website at <http://opsb.ohio.gov>. To view electronic versions of the documents of this project, search for case number 13-0429-EL-BTX or 15-1682-EL-BTA.

Sincerely,



Brett E. Schmied
Project Outreach Specialist
AEP Ohio

cc: Shawn Malone, Project Manager

September 28, 2015

Union Township Trustee
Ms. Wilma Ann Whitten
216 Andersonville Road
Chillicothe, OH 45601

RE: Biers Run-Hopetown-Delano 138-kV Transmission Line Amendment Project
Case Number: 15-1682-EL-BTA

Dear Ms. Whitten:

AEP Ohio and AEP Ohio Transmission Company, Inc. ("AEP Ohio Transco") are proposing to construct a new electric transmission line in Ross County to be known as the Biers Run-Hopetown-Delano 138-kilovolt (kV) Transmission Line. AEP Ohio Transco plans to submit this Amendment to the siting application to the Ohio Power Siting Board ("OPSB") for the Biers Run-Hopetown-Delano 138-kV Transmission Line. In accordance with Ohio Administrative Code ("OAC") 4906-5-05 (A)(1), the OPSB certified this application as supplemented complete on August 27, 2014.

Pursuant to OAC 4906-5-06, we are serving you one copy of the certified application as amended. As required by the OPSB, the application as amended includes information on justification of need, technical and financial data and a socioeconomic and ecological analysis of the project.

We ask that this Amendment to the Application be made available to the general public.

Copies of this Amendment to the Application have been distributed to local government officials and the local public library.

For additional details about the OPSB and this project, please refer to the OPSB's website at <http://opsb.ohio.gov>. To view electronic versions of the documents of this project, search for case number 13-0429-EL-BTX or 15-1682-EL-BTA.

Sincerely,



Brett E. Schmied
Project Outreach Specialist
AEP Ohio

cc: Shawn Malone, Project Manager

September 28, 2015

Union Township Fiscal Officer
Ms. Karen Rittinger Gossman
9254 Williamsport Pike
Chillicothe, OH 45601

RE: Biers Run-Hopetown-Delano 138-kV Transmission Line Amendment Project
Case Number: 15-1682-EL-BTA

Dear Ms. Gossman:

AEP Ohio and AEP Ohio Transmission Company, Inc. ("AEP Ohio Transco") are proposing to construct a new electric transmission line in Ross County to be known as the Biers Run-Hopetown-Delano 138-kilovolt (kV) Transmission Line. AEP Ohio Transco plans to submit this Amendment to the siting application to the Ohio Power Siting Board ("OPSB") for the Biers Run-Hopetown-Delano 138-kV Transmission Line. In accordance with Ohio Administrative Code ("OAC") 4906-5-05 (A)(1), the OPSB certified this application as supplemented complete on August 27, 2014.

Pursuant to OAC 4906-5-06, we are serving you one copy of the certified application as amended. As required by the OPSB, the application as amended includes information on justification of need, technical and financial data and a socioeconomic and ecological analysis of the project.

We ask that this Amendment to the Application be made available to the general public.

Copies of this Amendment to the Application have been distributed to local government officials and the local public library.

For additional details about the OPSB and this project, please refer to the OPSB's website at <http://opsb.ohio.gov>. To view electronic versions of the documents of this project, search for case number 13-0429-EL-BTX or 15-1682-EL-BTA.

Sincerely,



Brett E. Schmied
Project Outreach Specialist
AEP Ohio

cc: Shawn Malone, Project Manager

September 28, 2015

Green Township Trustee
Ms. Marcella J. Wolfe
10153 State Route 159
Kingston, OH 45644

RE: Biers Run-Hopetown-Delano 138-kV Transmission Line Amendment Project
Case Number: 15-1682-EL-BTA

Dear Ms. Wolfe:

AEP Ohio and AEP Ohio Transmission Company, Inc. ("AEP Ohio Transco") are proposing to construct a new electric transmission line in Ross County to be known as the Biers Run-Hopetown-Delano 138-kilovolt (kV) Transmission Line. AEP Ohio Transco plans to submit this Amendment to the siting application to the Ohio Power Siting Board ("OPSB") for the Biers Run-Hopetown-Delano 138-kV Transmission Line. In accordance with Ohio Administrative Code ("OAC") 4906-5-05 (A)(1), the OPSB certified this application as supplemented complete on August 27, 2014.

Pursuant to OAC 4906-5-06, we are serving you one copy of the certified application as amended. As required by the OPSB, the application as amended includes information on justification of need, technical and financial data and a socioeconomic and ecological analysis of the project.

We ask that this Amendment to the Application be made available to the general public.

Copies of this Amendment to the Application have been distributed to local government officials and the local public library.

For additional details about the OPSB and this project, please refer to the OPSB's website at <http://opsb.ohio.gov>. To view electronic versions of the documents of this project, search for case number 13-0429-EL-BTX or 15-1682-EL-BTA.

Sincerely,



Brett E. Schmied
Project Outreach Specialist
AEP Ohio

cc: Shawn Malone, Project Manager

September 28, 2015

Green Township Trustee
Mr. Robert A. Wakefield
10153 State Route 159
Kingston, OH 45644

RE: Biers Run-Hopetown-Delano 138-kV Transmission Line Amendment Project
Case Number: 15-1682-EL-BTA

Dear Mr. Wakefield:

AEP Ohio and AEP Ohio Transmission Company, Inc. ("AEP Ohio Transco") are proposing to construct a new electric transmission line in Ross County to be known as the Biers Run-Hopetown-Delano 138-kilovolt (kV) Transmission Line. AEP Ohio Transco plans to submit this Amendment to the siting application to the Ohio Power Siting Board ("OPSB") for the Biers Run-Hopetown-Delano 138-kV Transmission Line. In accordance with Ohio Administrative Code ("OAC") 4906-5-05 (A)(1), the OPSB certified this application as supplemented complete on August 27, 2014.

Pursuant to OAC 4906-5-06, we are serving you one copy of the certified application as amended. As required by the OPSB, the application as amended includes information on justification of need, technical and financial data and a socioeconomic and ecological analysis of the project.

We ask that this Amendment to the Application be made available to the general public.

Copies of this Amendment to the Application have been distributed to local government officials and the local public library.

For additional details about the OPSB and this project, please refer to the OPSB's website at <http://opsb.ohio.gov>. To view electronic versions of the documents of this project, search for case number 13-0429-EL-BTX or 15-1682-EL-BTA.

Sincerely,



Brett E. Schmied
Project Outreach Specialist
AEP Ohio

cc: Shawn Malone, Project Manager

September 28, 2015

Green Township Trustee
Mr. Dale A. Naas
10153 State Route 159
Kingston, OH 45644

RE: Biers Run-Hopetown-Delano 138-kV Transmission Line Amendment Project
Case Number: 15-1682-EL-BTA

Dear Mr. Naas:

AEP Ohio and AEP Ohio Transmission Company, Inc. ("AEP Ohio Transco") are proposing to construct a new electric transmission line in Ross County to be known as the Biers Run-Hopetown-Delano 138-kilovolt (kV) Transmission Line. AEP Ohio Transco plans to submit this Amendment to the siting application to the Ohio Power Siting Board ("OPSB") for the Biers Run-Hopetown-Delano 138-kV Transmission Line. In accordance with Ohio Administrative Code ("OAC") 4906-5-05 (A)(1), the OPSB certified this application as supplemented complete on August 27, 2014.

Pursuant to OAC 4906-5-06, we are serving you one copy of the certified application as amended. As required by the OPSB, the application as amended includes information on justification of need, technical and financial data and a socioeconomic and ecological analysis of the project.

We ask that this Amendment to the Application be made available to the general public.

Copies of this Amendment to the Application have been distributed to local government officials and the local public library.

For additional details about the OPSB and this project, please refer to the OPSB's website at <http://opsb.ohio.gov>. To view electronic versions of the documents of this project, search for case number 13-0429-EL-BTX or 15-1682-EL-BTA.

Sincerely,



Brett E. Schmied
Project Outreach Specialist
AEP Ohio

cc: Shawn Malone, Project Manager

September 28, 2015

Green Township Fiscal Officer
Mr. D. Brad McCorkle
3867 Sulphur Spring Road
Kingston, OH 45644

RE: Biers Run-Hopetown-Delano 138-kV Transmission Line Amendment Project
Case Number: 15-1682-EL-BTA

Dear Mr. McCorkle:

AEP Ohio and AEP Ohio Transmission Company, Inc. ("AEP Ohio Transco") are proposing to construct a new electric transmission line in Ross County to be known as the Biers Run-Hopetown-Delano 138-kilovolt (kV) Transmission Line. AEP Ohio Transco plans to submit this Amendment to the siting application to the Ohio Power Siting Board ("OPSB") for the Biers Run-Hopetown-Delano 138-kV Transmission Line. In accordance with Ohio Administrative Code ("OAC") 4906-5-05 (A)(1), the OPSB certified this application as supplemented complete on August 27, 2014.

Pursuant to OAC 4906-5-06, we are serving you one copy of the certified application as amended. As required by the OPSB, the application as amended includes information on justification of need, technical and financial data and a socioeconomic and ecological analysis of the project.

We ask that this Amendment to the Application be made available to the general public.

Copies of this Amendment to the Application have been distributed to local government officials and the local public library.

For additional details about the OPSB and this project, please refer to the OPSB's website at <http://opsb.ohio.gov>. To view electronic versions of the documents of this project, search for case number 13-0429-EL-BTX or 15-1682-EL-BTA.

Sincerely,



Brett E. Schmied
Project Outreach Specialist
AEP Ohio

cc: Shawn Malone, Project Manager

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

9/28/2015 2:26:46 PM

in

Case No(s). 15-1682-EL-BTA

Summary: Amended Application electronically filed by Mr. Hector Garcia on behalf of AEP
Ohio Transmission Company