

FILE

FirstEnergy

FILED - JUL 29 2016

84
76 South Main Street
Akron, Ohio 44308

2016 JUL 29 PM 2:45

1-800-646-0400

July 28, 2016

Ms. Barcy F. McNeal
Docketing Division
The Public Utilities Commission of Ohio
180 East Broad Street
Columbus, OH 43215-3793

PUCO

**Letter of Notification
Amendments to the Hayes-West Fremont
138 kV Transmission Line Project
Case Numbers: 16-1593-EL-BTA, 16-1594-EL-BTA, & 16-1595-EL-BTA**

Dear Ms. McNeal:

In accordance with Ohio Administrative Code ("OAC") Rule 4906-2-04(A)(3), OAC Rule 4906-3-07 and OAC Chapter 4906-3, generally, American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, transmits one (1) original and eleven (11) copies of the enclosed application for Amendment for the above captioned Project. The Amendment Application, which is attached, was completed in accordance with the requirements of OAC Rule 4906-3-07 and conforms to the format requirements for a Letter of Notification Application found generally in OAC Chapter 4906-6.

In these Project, ATSI proposes in Amendment One, the addition of a second circuit, in Amendment Two, three route adjustments, and in Amendment Three, 7 route adjustments to the route approved by the Board. This change is not expected to have any impacts to the route approved by the Board. The Project will be located in all or parts of: Sandusky, Riley, Townsend, and York Townships in Sandusky County and Groton, Oxford, and Perkins Townships in Erie County, Ohio.

Pursuant to OAC Rule 4906-2-04(A)(3), please be advised of the following:

a) Name and address of the applicants:

American Transmission Systems, Incorporated
76 South Main Street
Akron, Ohio 44308

b) Name and location of proposed facilities:

Hayes-West Fremont No.2 138 kV Transmission Line Project

The Project area is located in a new transmission corridor in Sandusky, Riley, Townsend, and York Townships in Sandusky County and Groton, Oxford, and Perkins Townships in Erie County, Ohio.

This is to certify that the images appearing are an accurate and complete reproduction of a case file document delivered in the regular course of business.
Technician SM Date Processed JUL 29 2016

c) Applicant's representative:

Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company
76 South Main Street
Akron, OH 44308-1890


d) No information that was provided in the pre-application letter required by OAC Rule 4906-6-03 has been amended or changed in the attached Letter of Notification Application.

e) A notarized statement that the information contained in the application is complete and accurate is attached as Attachment 1.

We have provided a copy of the application for the Amendment by certified mail, with return receipt requested, to each official of the political subdivisions immediately affected by the proposed Project as listed in Amendment as Appendix C. Copies of the transmittal letters addressed to the local government representatives of Sandusky, Riley, Townsend, and York Townships in Sandusky County and Groton, Oxford, and Perkins Townships in Erie County, Ohio are enclosed for your file. These materials are being provided as proof of compliance with OAC Rule 4906-6-07. A list of the property owners affected by the proposed Project and who will receive a letter describing this Project is attached to the Amendment as Appendix B. This is being provided as proof of compliance with OAC Rule 4906-3-07(C).

After docketing this filing, please return one time-stamped copy of the Letter of Notification for our records to us in the enclosed envelope. Should staff of the Ohio Power Siting Board desire further information or discussion of this submittal, please contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

Attachments

**Amendment Two to the Hayes-West Fremont 138 kV Transmission Line
Project
Case Number 16-1594-EL-BTA**

Date: July 28, 2016

**Attachment 1
Affidavit of Scott M. Humphrys**

BEFORE THE
OHIO POWER SITING BOARD


In The Matter Of:)
The Application of American Transmission)
Systems, Incorporated for a Certificate of)
Environmental Compatibility and Public)
Need for the Construction for the)
Amendment Two to the Hayes-West)
Fremont 138 kV Transmission Line Project)

Case No. 16-594-EL-BTA

AFFIDAVIT OF SCOTT M. HUMPHRYS

I, Scott M. Humphrys, state the following:


Pursuant to Ohio Administrative Code Rule 4906-2-04(A)(3)(e), I am the authorized representative of the Applicant in this case and I affirm that the enclosed application for an amendment filed in this matter is true and accurate to the best of my information and belief.

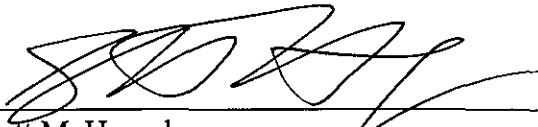


Scott M. Humphrys
FirstEnergy Service Company

State of Ohio)
)
County of Summit) ss:

Sworn and subscribed before me this 28 day of July, 2016.

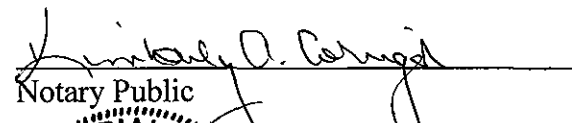

Notary Public

KIMBERLY A. CORRIGAN
NOTARY PUBLIC
STATE OF OHIO
Recorded in
Medina County
My Comm. Exp. 1/28/2020

**AMERICAN TRANSMISSION SYSTEMS,
INCORPORATED
A FIRSTENERGY COMPANY**

**AMENDMENT TWO TO THE HAYES-WEST FREMONT
138 kV TRANSMISSION LINE PROJECT**

OPSB CASE NO.: 16-1594-EL-BTA

July 28, 2016

**American Transmission Systems, Incorporated
76 South Main Street
Akron, Ohio 44308**

**AMENDMENT TWO TO THE HAYES-WEST FREMONT
138 kV TRANSMISSION LINE PROJECT
Case Number 16-1594-EL-BTA**

On August 25, 2014 the Ohio Power Siting Board ("OPSB") issued an Opinion, Order and Certificate, in Case Number 12-1636-EL-BTX, granting the Application of American Transmission Systems, Incorporated ("ATSI") ("Applicant") to construct the Hayes-West Fremont 138 kV Transmission Line Project ("Project").

The attached Letter of Notification Application is the second Amendment to the Hayes-West Fremont 138 kV Transmission Line Project and proposes three adjustments to the OPSB Approved Route. The proposed adjustments are described in detail in the Amendment application.

The Amendments being proposed in this application to the OPSB Approved Route are the result of requests from the property owners crossed by the OPSB Approved Route. The Applicant has reviewed the proposed adjustments to the OPSB Approved Route and has concluded that any impacts expected by the implementation of the Amendment are minimal to none, and may reduce the impacts to the individual property owners. Accordingly, the Applicant respectfully submits this request that the Approved Route be amended as described herein.

For the Board's convenience, and as the proposed adjustments fall within the criteria for a Letter of Notification application pursuant to the appendices to Ohio Administrative Code ("OAC") Rule 4906-3-11(B), the amendment information is presented in the Board's Letter of Notification ("LON") format. Specifically, Appendix A describes the change to the Approved Route, in the LON format. Appendix B lists the property owners and easements status per OAC Rule 4906-06-07. Appendix C lists the current public officials, libraries and parties of record of the original certificate application proceedings being provided a copy of this Amendment application as required by OAC Rule 4906-06-07.

APPENDIX A

AMENDMENT TWO TO THE HAYES-WEST FREMONT 138 kV TRANSMISSION LINE PROJECT Case Number 16-1594-EL-BTA

4906-6-05 (B) General Information

4906-6-05 (B)(1) : Name and Reference Number

Name of Project: Amendment Two to the Hayes-West Fremont 138 kV
Transmission Line Project

Reference Number: The reference to the Long Term Forecast for the Hayes-West Fremont 138 kV Transmission Line Project was addressed and considered in the previous application filing and the subsequent Ohio Power Siting Board (“OPSB”) Opinion, Order and Certificate (12-1636-EL-BTX) and can be found on page 02-30 of the application.

4906-6-05 (B)(1)(a) : Brief Description of Project

This second Amendment (“Amendment Two”) to the Hayes-West Fremont 138 kV Transmission Line Project proposes three adjustments to the route approved by the Board in Case No. 12-1636-EL-BTX for the Hayes West Fremont 138kV Transmission Line Project. Applicant, American Transmission Systems, Incorporated (“ATSI”), a FirstEnergy company, will be submitting two additional amendment applications to the Hayes West Fremont 138kV Transmission Line Project in separate filings with the Board. ATSI expects to file these additional amendment applications concurrently with the submittal of this amendment application. The locations of the adjustments proposed in Amendment Two are:

- }
1. North of Fox Road adjacent to Hayes Substation on Parcel No. 32-00507.001, 32-01604.000, 32-04578.001, and 32-29068.000;
 2. North of Portland Road on Parcel No. 27-00114.000;
 3. South of Portland Road and South of I-80 on Parcel Nos. 29-00054.000, 29-00054.001, 27-00043.003, 29-60031.001, and 27-00197.000.;

1. North of Fox Road adjacent to Hayes Substation on Parcel No. 32-00507.001, 32-01604.000, 32-04578.001, and 32-29068.000

The first proposed adjustment and corresponding alignment change is located in the area immediately east and immediately west of the Hayes Substation and north of Fox Road where the OPSB Approved Route exits the substation and where the OPSB Approved Route turns south after exiting the substation adjacent to the substation. This adjustment is located on Permanent Parcel Numbers 32-00507.001, 32-01604.000, and 32-04578.001 owned by American Transmission Systems, Incorporated, TSL Properties LLC, and Douglas and Linda Miller, respectively. Figure 4-1F Revision 1, Land Use and Constraint Map Route OPSB Approved Route, provides the alignment of the OPSB Approved Route and the proposed adjustment in this area of the Project. Figure 7-2FF Revision 1, OPSB Approved Route Wetland and Stream Map, provides an enlarged view of the OPSB Approved Route and the proposed adjustment in this area of the Project.

As shown in Figure 4-1F Revision 1, Land Use and Constraint Map Route OPSB Approved Route, the transmission line route exits the Hayes Substation and trends west then turns and trends in a southerly direction. The OPSB Approved Route exits the substation on the southwest side of the substation and continues east before heading in a southeasterly direction. As more detailed engineering has become available, the proposed adjustment to the OPSB Approved Route will now exit the northeastern side of the substation and head east to a corner dead-end structure then turn south for approximately 475 feet to another corner dead-end structure then turn west for approximately 720 feet. At this point, the proposed adjustment reconnects to the OPSB Approved Route at the intersection of the OPSB Approved Route and the

existing 345 kV transmission lines. From this point, the OPSB Approved Route continues to an angle structure that is located at the eastern edge of a wooded lot and the transmission line route continues approximately 1,500 to a point at which it trends in a southeasterly direction. The proposed adjustment of the OPSB Approved Route in this area begins at the northern angle structure due west of the Hayes Substation, north of Fox Road. Engineering of the transmission line has determined that this angle structure needs to move approximately 100 feet west to provide the proper clearance when crossing under the existing Beaver-Hayes and Beaver-Davis Besse 345 kV Transmission Lines. At this point, a guyed two pole structure is proposed to be installed and the adjusted route of the transmission line will turn at a sharp angle and trend approximately 1,500 feet southeasterly, supported on tangent poles, to another guyed two pole structure to rejoin the OPSB Approved Route. As a result of this change, the centerline of the OPSB Approved route shifts approximately 10 feet to the east of the centerline of OPSB Approved Route for approximately 7,700 feet. The slight centerline shift does not increase ecological impacts or impacts to neighboring property owners.

The property owners along this section of the OPSB Approved Route have agreed to the proposed change of the OPSB Approved Route. The Applicant believes the change does not increase ecological impacts or impacts to neighboring property owners.

2. North of Portland Road on Parcel No. 27-00114.000;

The second proposed adjustment is located approximately 2,750 feet north of the intersection of the OPSB Approved Route and Portland Road. The proposed adjustment is located on Permanent Parcel Number 27-00115.000 owned by Shane M. Jefferys, Successor, Trustee of James H. Jarrett Trust. Figure 4-1E Revision 1, Land Use and Constraint Map Route OPSB Approved Route, shows the OPSB Approved Route and the proposed adjustment in this area of the Project. Figure 7-2CC Revision 1, OPSB Approved Route Wetland and Stream Map, provides an enlarged view of the

OPSB Approved Route and the proposed adjusted alignment in this area of the Project.

As shown in Figure 4-1E Revision 1, Land Use and Constraint Map Route OPSB Approved Route, approximately 2,750 feet north of Portland Road, the OPSB Approved Route which previously entered the parcel from the east and proceeded approximately 950 feet west to a 90 degree corner dead end structure then turned south, has at the request of the property owner, been adjusted to remove the 90 degree corner dead end structure. The new alignment, upon entering the parcel, turns at an approximate 45 degree angle to the southwest and eliminates a structure in the middle of the field. Two angle structures will be installed, one adjacent to the eastern property line and one adjacent to the southern property line, with a series of tangent structures in between which is reflected in the easement. As a result of this change, the centerline of the OPSB Approved route shifts approximately 25 feet to the east of the centerline of the OPSB Approved Route for approximately 2,140 feet. The slight centerline shift does not increase ecological impacts or impacts to neighboring property owners.

3. South of Portland Road and South of I-80 on Parcel Nos. 29-00054.000, 29-00054.001, 27-00043.003, 29-60031.001, and 27-00197.000.

The third proposed adjustment is approximately 2,168 feet (0.4 mile) long and is located in the area south of Portland Road and south of I-80. The adjustment is located on Permanent Parcel Numbers 29-00054.000, 29-00054.001, 27-00043.003, 29-60031.001, and 27-00197.000 belonging to Mary Lou Hanson, Charlene D. & Douglas C. Cullen, the Ohio Turnpike Commission, and Hanson Aggregates Midwest Incorporated & Hanson Aggregates Stoneman Incorporated, respectively. Figure 04-1E Revision 1, Land Use and Constraint Map Route OPSB Approved Route, shows the OPSB Approved Route and the proposed adjustment in this area of the Project. Figure 7-2AA Revision 1 and Figure 7-2BB Revision 1, OPSB Approved Route Wetland and Stream Map, provides an enlarged view of the OPSB Approved Route and the proposed adjusted alignment in this area of the Project.

As shown in Figure 04-1E Revision 1, Land Use and Constraint Map Route OPSB Approved Route, the OPSB Approved Route trends south crossing Portland Road and continues south for approximately 740 feet, to a guyed two pole structure where it then turns southwest and continues approximately 375 feet to a guyed two pole structure. From this point, the OPSB Approved Route trends south approximately 675 feet to a guyed two pole structure. At this point, the OPSB Approved Route continues south approximately 378 feet, crossing the Ohio Turnpike/I-80, to a 90 degree corner dead-end structure then heads west. The proposed change to the OPSB Approved Route begins at the structure immediately adjacent to Portland Road, on the north side of the road. At this point, the proposed change eliminates the three light angle two pole guyed structures, previously mentioned, and straightens the approximately 2,168 section of the route. This section, crosses the Ohio Turnpike/I-80 and continues to the aforementioned 90 degree corner dead end south of the Ohio Turnpike/I-80. This corner dead end, is proposed to move approximately 110 feet southeast of the OPSB Approved location to accommodate the alignment that eliminates the three light angle structures.

The proposed adjustment has been requested by the property owners south of Portland Road. The adjustment will avoid placing three light angle two pole structures and associated guying in agricultural fields. The proposed route change will be installed from the light angle structure immediately north of Portland Road to the 90 degree corner dead-end structure south of the Ohio Turnpike/I80, with a series of tangent structures in between which is reflected in the easement. The route adjustment is not expected to have any additional impacts to the property owners.

4906-6-05 (B)(1)(b) : Why the Project Meets the Requirements for a Letter of Notification

For the Boards convenience, and in accordance with Ohio Administrative Code 4906-3-11(B), as each proposed individual adjustment meets the criteria for Letter of Notification application under the appendices to Ohio Administrative Code Rule

4906-1-01, this Amendment Two application is being submitted as a Letter of Notification ("LON"). This amendment falls under Rule 4906-3-11(B) of the Ohio Administrative Code which states: "Applications for amendments to certificates shall be submitted in the same manner as if they were applications for a certificate." The Project meets the requirements for a Letter of Notification because each of the proposed adjustments is within the types of project defined by Item (1)(b) Appendix A of Rule 4906-1-01 of the Ohio Administrative Code. This item states:

(1) New construction, extension, or relocation of single or multiple circuit electric power transmission line(s), or upgrading existing transmission or distribution line(s) for operation at a higher transmission voltage, as follows:

(b) Line(s) greater than 0.2 miles in length but not greater than two miles in length.

4906-6-05 (B)(2): Need Statement

The need for the Hayes-West Fremont 138 kV Transmission Line Project was addressed and considered in the previous application filing and the subsequent OPSB Opinion, Order and Certificate of the original Application (12-1636-EL-BTX) and can be found in Section 2 of the Application. The need for the adjustments proposed in this application to the OPSB Approved Route is to meet the requests of the impacted property owners.

4906-6-05 (B)(3): Location Relative to Existing or Proposed Lines

The location of the Project relative to existing or proposed transmission lines is described in reference to the FirstEnergy System Facilities map, included as the last page of Chapter 3 of the confidential portion of the Ohio Edison Company, The Cleveland Electric Illuminating Company, The Toledo Edison Company and American Transmission Systems, Incorporated's 2015 Long-Term Forecast Report, submitted to the Public Utility Commission of Ohio (PUCO) in Case No. 15-0649-EL-FOR under Rule 4901:5-5-04(C) of the Ohio Administrative Code. This map shows ATSI's 345 kV and 138 kV existing transmission lines and transmission substations

and does not depict the proposed location of the Project. In reference to the map, the proposed Project is located in Erie and Sandusky Counties approximately 6 inches (11 by 17 inch printed version) from the left edge of the map box and 3 inches (11 by 17 inch printed version) from the top of the map box.

4609-6-05 (B)(4): Alternatives Considered

Consideration of the proposed adjustments in the three locations were initiated at the request of property owners. At each proposed relocation area, the Project area was carefully reviewed to identify potential ecological and social impacts associated with various potential alignments including the property owner's preferred alternative route. The proposed adjusted routes represent the best solution to implementing the property owners' wishes that limit other impacts. In the event one or more of the proposed adjustments are not approved by the Board, the Applicants intend to proceed with constructing that portion of the Project on the route previously approved by the Board.

4906-6-05 (B)(5): Public Information Program

ATSI's manager of External Affairs will advise local officials of the status of the proposed Transmission Line Project as necessary.

4609-6-05 (B)(6): Construction Schedule

The Applicant is prepared to begin construction on the three areas proposed in this Amendment following OPSB approval of the Amendment. As such the Applicant will be ready to commence construction on this portion of the Project as soon as approval is granted, and expects to complete and placed in-service by October 1, 2018.

4609-6-05 (B)(7) Area Map

A map of the overall Project location was addressed and considered in the previous application filing and the subsequent OPSB Opinion, Order and Certificate of the original Application (12-1636-EL-BTX) and can be found in figures 04-1A through 04-1F. The locations of the proposed adjustments to the Approved Route are provided

in Figure 4-1E Revision 1 and Figure 4-1F Revision 1, which are included with this application.

4906-6-05 (B)(8) Property Owner List

The status of easements, options, and/or land use agreements necessary to construct the change and operate the facility are listed in Appendix B.

4906-6-05 (B)(9): Technical Features

4906-6-05 (B)(9)(a): Operating Characteristics

The change of the OPSB Approved Route will not change the operating characteristics that were addressed and considered in the OPSB Opinion, Order and Certificate in Case No. 12-1636-EL-BTX and can be found on page 04-13 of the original Application in that case.

4906-6-05 (B)(9)(b): Calculated Electric and Magnetic Fields

The change to the OPSB Approved Route will not significantly change the electro-magnetic field (EMF) calculations that were addressed and considered in the OPSB Opinion, Order and Certificate in Case No. 12-1636-EL-BTX and can be found on page 06-24 of the original Application in that case.

4906-6-05 (B)(9)(c): Estimated Costs

The change to the OPSB Approved Route will not significantly affect the estimated capital costs for the Project that were addressed and considered in the OPSB Opinion, Order and Certificate in Case No. 12-1636-EL-BTX and can be found on page 05-2 and Table 05-1 of the original Application in that case.

4906-6-05 (B)(10): Social and Ecological Impacts

4906-6-05 (B)(10)(a): Land Use

The change to the OPSB Approved Route crosses land use that was addressed and considered in the OPSB Opinion, Order and Certificate in Case No. 12-1636-EL-BTX and can be found on page 06-3 of the original Application in that case. No changes to

land use are anticipated as a result of the shift from the Approved Route to the adjusted route nor with the addition of the second circuit.

4905-6-05 (B)(10)(b): Agricultural Land

The change to the OPSB Approved Route crosses a similar percentage of agricultural land that was addressed and considered in the OPSB Opinion, Order and Certificate in Case No. 12-1636-EL-BTX and can be found on page 06-11 of the original Application in that case.

4906-6-05 (B)(10)(c): Archaeological or Cultural Resources

In accordance with the OPSB Opinion, Order and Certificate issued by OPSB in Case No. 12-1636-EL-BTX, an investigation and report of cultural resources has been prepared for the OPSB Approved Route. This investigation will be extended to include the locations along the three adjustments prior to starting construction on the adjustments.

4906-6-05 (B)(10)(d): Local, State, and Federal Requirements

There are no known local, state, or federal requirements that must be met prior to commencement of construction of the change to the OPSB Approved Route.

4906-6-05 (B)(10)(e): Endangered, Threatened, and Rare Species Investigation

An investigation of endangered or threatened species was addressed and considered in the OPSB Opinion, Order and Certificate in Case No. 12-1636-EL-BTX and can be found on page 07-18 on the original Application in that case.

4906-6-05 (B)(10)(f): Areas of Ecological Concern

An assessment of areas of ecological concern is provided below for each location of the proposed adjustment to the OPSB Approved Route:

1. North of Fox Road adjacent to Hayes Substation on Parcel Nos. 32-00507.001, 32-01604.000, and 32-04578.001.

The proposed adjustment of the OPSB Approved Route in this area is at both the line exit from the substation and the northern angle structure due west of the Hayes

Substation, north of Fox Road. Engineering of the transmission line has determined that the line must exit the northeastern side of the substation and that the northern angle structure due west of the substation needs to move approximately 100 feet west to provide the proper clearance when crossing under the existing Beaver-Hayes and Beaver-Davis Besse 345 kV Transmission Lines. The change in substation line exit is an extension of the OPSB Approved Route and will impact additional agricultural land surrounding the Hayes Substation. No wetlands or waterbodies will be crossed by this adjustment. The proposed adjustment of the angle structure west of the substation crosses one stream and requires minimal tree clearing, while the OPSB Approved Route would cross the same stream but require less tree clearing. The Applicant has carefully determined locations for the transmission line poles along the proposed adjusted route and believe that the transmission line can be installed with no significant impacts to the agricultural field while only minimally impacting the woodlot. The Applicant believes that the construction, operation, and maintenance of the transmission line along the proposed alternative route will have no significant additional impacts to ecological features.

2. South of Portland Road and East of Magill Road on Parcel No. 27-00114.000.

The location of this proposed adjustment does not include any environmental features. The adjustment limits the crossing of an agricultural field, whereas the OPSB Approved Route required a greater crossing length within the agricultural field. As previously indicated, H. Jarrett Trustee, owner of Parcel No. 27-00115.000 has requested the proposed adjustment along this section of the OPSB Approved Route. The Applicant's understanding of the property owner's request is to have the new alignment, upon entering the parcel, turn at an approximate 45 degree angle to the southwest and eliminate a structure in the middle of the field. The Applicant has determined locations for the transmission line poles along the proposed adjusted route and believe that the transmission line can be installed with no significant impacts to the agricultural field. The Applicant has no objection to

the proposed change of the OPSB Approved Route requested by the property owner at this location and believes the change does not increase ecological impacts.

3. South of Portland Road and South of I-80 on Parcel Nos. 29-00054.000, 29-00054.001, 27-00043.003, 29-60031.001, and 27-00197.000.

This proposed adjustment crosses two wetlands, and borders an existing field. Portions of the woodlots along the southern section of this adjustment will be impacted. The OPSB Approved Route in this area crossed a greater length of the agricultural field, but required less tree clearing. As previously indicated, the proposed adjustment has been requested by the property owners south of Portland Road and is beneficial as it avoids placing three light angle two pole structures and their associated guying in agricultural fields. The Applicant has carefully located the centerline and poles of this proposed adjustment to minimize the area of woodlot and agricultural fields crossed. The Applicant believes that the construction, operation, and maintenance of the transmission line along the proposed adjustment will not significantly increase the impacts to ecological features.

4906-6-05 (B)(10)(g): Other Information

Construction and operation of the proposed Project will be in accordance with the requirements specified in the latest revision of the NESC as adopted by the PUCO and will meet all applicable safety standards established by OSHA.

4906-6-07: Documentation of Letter of Notification Transmittal and Availability for Public Review

The Amendment is being provided concurrently to the current public officials and parties of record as listed in Appendix C, which accompanies the Amendment.

Information is posted

at www.firstenergycorp.com/about/transmission_project/ohio.html on how to request

an electronic or paper copy of this Letter of Notification. The link to website is being proved to meet the requirement of OAC Rule 4906-6-07 (B) and to provide the Board with proof of compliance with the notice requirements in OAC Rule 4906-6-07 (A)(3).

APPENDIX B

**AMENDMENT TWO TO THE HAYES-WEST FREMONT
138 kV TRANSMISSION LINE PROJECT
Case Number 16-1594-EL-BTA**

4906-6-05 (B)(8) Property Owner List

Adjustment Number	Parcel Number	Property Owner	Right of Way Agreement Status
1	32-01604.000	TSL Properties	Easement Acquired
1	32-04578.001	Douglas Miller	Easement Acquired
1	32-04890.000	Sandra Weilnau, Trust	Easement Acquired
1	32-02968.000	Ro-Bern Acres, Inc.	Easement Acquired
2	27-00114.000	Jarrett, James H. - Trustee	Easement Acquired
3	29-00054.000	Mary Lou Hanson	Easement Acquired
3	29-00054.001	Douglas Cullen	Easement Acquired
3	27-00043.003	Douglas Cullen	Easement Acquired
3	29-60031.001	Ohio Turnpike	Crossing Permit
3	27-00197.000	Hanson Corporation	Negotiating

APPENDIX C

**AMENDMENT TWO TO THE HAYES-WEST FREMONT
138 kV TRANSMISSION LINE PROJECT
Case Number 16-1594-EL-BTA**

4906-6-07: Documentation of Letter of Notification Transmittal

Sandusky County

The Honorable Danny Polter
Sandusky County Commissioner
622 Croghan St.
Fremont, OH 43420

Mr. James Moyer, P.E., P.S.
Sandusky County Engineer
2500 W. State St.
Fremont, OH 43420

The Honorable Terry Thatcher
Sandusky County Commissioner
622 Croghan St.
Fremont, OH 43420

Ms. Kay Reiter, Executive Director
Economic Development
2511 Countryside Dr.
Fremont, OH 43420

The Honorable Charles Schwochow
Sandusky County Commissioner
622 Croghan St.
Fremont, OH 43420

City of Fremont

The Honorable Jim Ellis
Mayor, City of Fremont
323 S. Front St.
Fremont, OH 43420

Mr. Roy E. Yeager, Chair
City of Fremont Planning Commission
323 S. Front St.
Fremont, OH 43420

Mr. Dallas Leake, President
Fremont City Council
323 S. Front St.
Fremont, OH 43420

Mr. Joe Smith
Director, Economic Development
323 S. Front St.
Fremont, OH 43420

City of Fremont
Engineering Department
323 S. Front St.
Fremont, OH 43420

Sandusky Township

Mr. Michael P. Willis
Sandusky Township Trustee
2207 Oak Harbor Road
Fremont, OH 43420

Mr. Gilbert C. Overmyer
Sandusky Township Trustee
2207 Oak Harbor Road
Fremont, OH 43420

Paul K. Lotycz
Sandusky Township Trustee
2207 Oak Harbor Road
Fremont, OH 43420

Ms. Cynthia K. Zienta
Sandusky Township Fiscal Officer
2207 Oak Harbor Road
Fremont, OH 43420

Rice Township

Mr. Tim King
Rice Township Trustee
110 County Road 119
Fremont, OH 43420

Mr. William C. Lamalie
Rice Township Trustee
110 County Road 119
Fremont, OH 43420

Mr. Don Atkinson
Rice Township Trustee
110 County Road 119
Fremont, OH 43420

Ms. Kathleen M. Roosen
Rice Township Fiscal Officer
110 County Road 119
Fremont, OH 43420

Riley Township

Mr. Gary Overmyer
Riley Township Trustee
3093 State Route 412
Fremont, OH 43420

Mr. John W. Antesberger
Riley Township Trustee
3093 State Route 412
Fremont, OH 43420

Mr. David Sachs
Riley Township Trustee
3093 State Route 412
Fremont, OH 43420

Mr. Joseph A. Halbeisen
Riley Township Fiscal Officer
3093 State Route 412
Fremont, OH 43420

Townsend Township

Mr. Paul Warner
Trustee, Townsend Township
6214 C.R. 247
Vickery, OH 43464

Ms. Jean Leber
Trustee, Townsend Township
1560 County Road 310
Clyde, OH 43410

Mr. Bruce Meggitt
Trustee, Townsend Township
5625 State Route 412
Vickery, OH 43464

Ms. Cathy Bales
Fiscal Officer, Townsend Township
2739 County Road 306
Vickery, OH 43464

York Township

Mr. Lee Watson
York Township Trustee
5964 County Road 113
Bellevue, OH 44811

Mr. Lee Patten
York Township Trustee
5964 County Road 113
Bellevue, OH 44811

Mr. Doug Keegan
York Township Trustee
5964 County Road 113
Bellevue, OH 44811

Ms. Leslie Fleming
York Township Fiscal Officer
5964 County Road 113
Bellevue, OH 44811

Green Creek Township

Mr. Matt Hofelich
Green Creek Township Trustee
410 C.R. 242
Fremont, OH 43420

Mr. Jim Newsome
Green Creek Township Trustee
2412 C.R. 185
Clyde, OH 43410

Mr. Bill Ebert
Green Creek Township Trustee
931 C.R. 212
Fremont, OH 43420

Ms. Danyelle Lantz
Green Creek Township Fiscal Officer
1990 W McPherson Hwy
Clyde, OH 43410

Erie County

The Honorable Pat Shenigo
Erie County Commissioner
2900 Columbus Ave.
Sandusky, OH 44870

Mr. John Farschman P.E., P.S.
Erie County Engineer
2900 Columbus Ave.
P.O. Box 1180
Sandusky, OH 44870

The Honorable Tom Ferrell
Erie County Commissioner
2900 Columbus Ave.
Sandusky, OH 44870

Mr. Steve Poggiali, Director
Erie County Regional Planning
Commission
2900 Columbus Ave
Sandusky, OH 44870

The Honorable William Monaghan
Erie County Commissioner
2900 Columbus Ave.
Sandusky, OH 44870

Perkins Township

Mr. Jim Lang
Perkins Township Trustee
2610 Columbus Avenue
Sandusky, OH 44870

Ms. Timothy Coleman
Perkins Township Trustee
2610 Columbus Avenue
Sandusky, OH 44870

Mr. Jeff Ferrell
Perkins Township Trustee
2610 Columbus Avenue
Sandusky, OH 44870

Ms. Jane Gildenmeister
Perkins Township Fiscal Officer
2610 Columbus Avenue
Sandusky, OH 44870

Groton Township

Mr. Roger Rowland
Groton Township Trustee
11212 Bemis Road
Bellevue, OH 44811

Mr. Ronald Brown
Groton Township Trustee
12009 Potter Road
Bellevue, OH 44811

Mr. Roger Russell
Groton Township Trustee
9916 N. State Route 269
Bellevue, OH 44811

Ms. Linda Jett
Groton Township Fiscal Officer
7215 Magill Road
Bellevue, OH 44811

Public Libraries

Ms. Pam Hoesman
Director, Birchard Public Library
423 Croghan Street
Fremont, Ohio 43420

Ms. Molly Carver
Director, Bellevue Public Library
224 E Main Street
Bellevue, 44811

Ms. Beth Leibengood
Director, Clyde Public Library
222 W Buckeye Street
Clyde, Ohio 43410

Ms. Stephanie Buchanan
Director, Sandusky Public Library
114 West Adams Street
Sandusky, Ohio 4487


Interested Parties


Dane Stinson
BRICKER & ECKLER LLP
100 South Third Street
Columbus, OH 43215-4291

John H. Jones
Assistant Section Chief
Public Utilities Section
180 E. Broad St., 6th Floor
Columbus, OH 43215-3793

American Municipal Power, Inc.:
John W. Bentine, Senior VP and
General Counsel
Lisa G. McAlister, Deputy General
Counsel
1111 Schrock Road, Suite 100
Columbus, Ohio 43229

Stokes Farm:
Glenn S. Krassen (Reg. No. 0007610)
BRICKER & ECKLER LLP
1001 Lakeside Avenue, Suite 1350
Cleveland, OH 44114

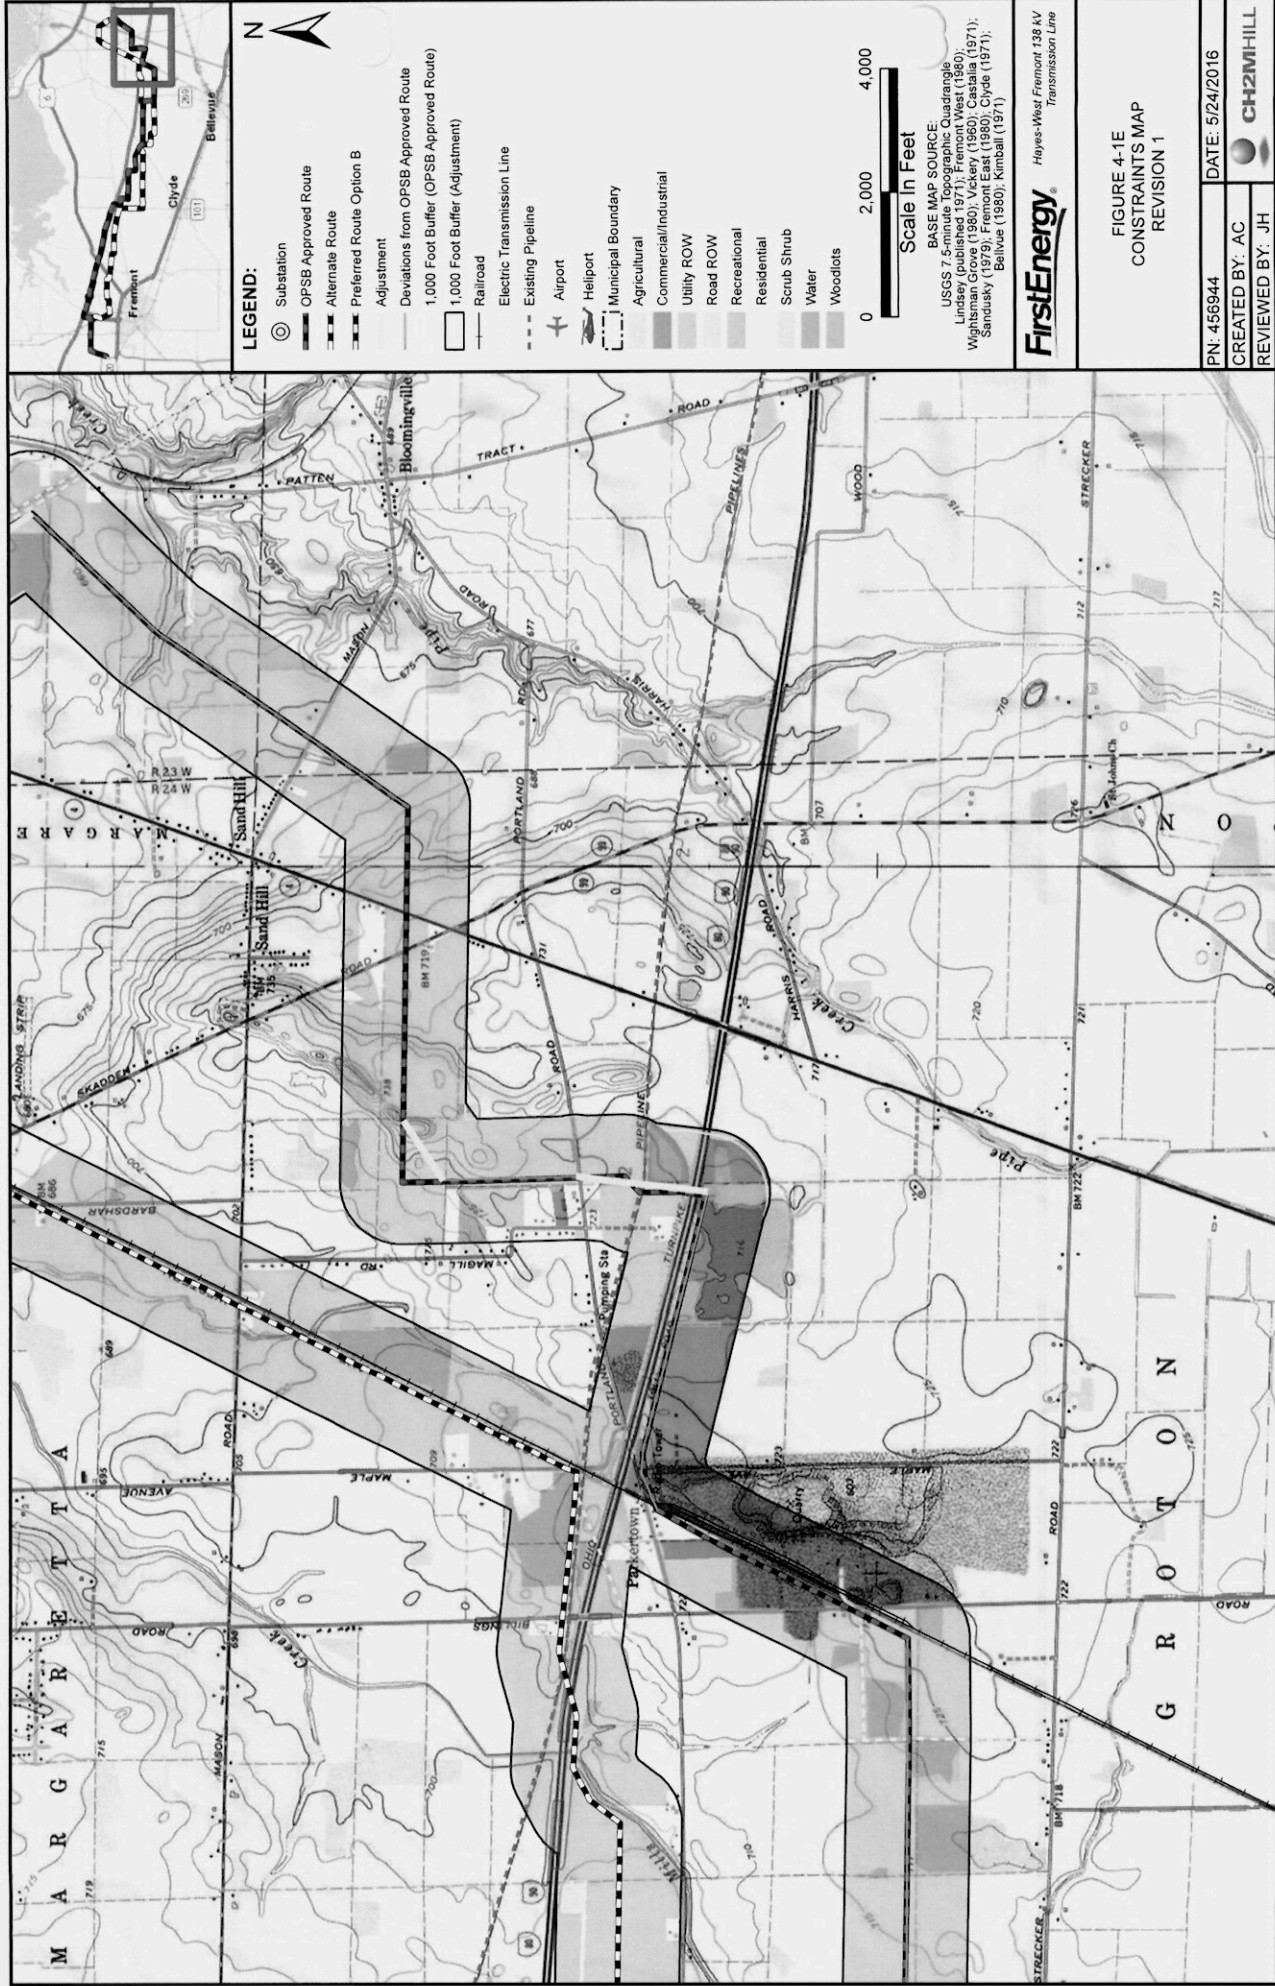

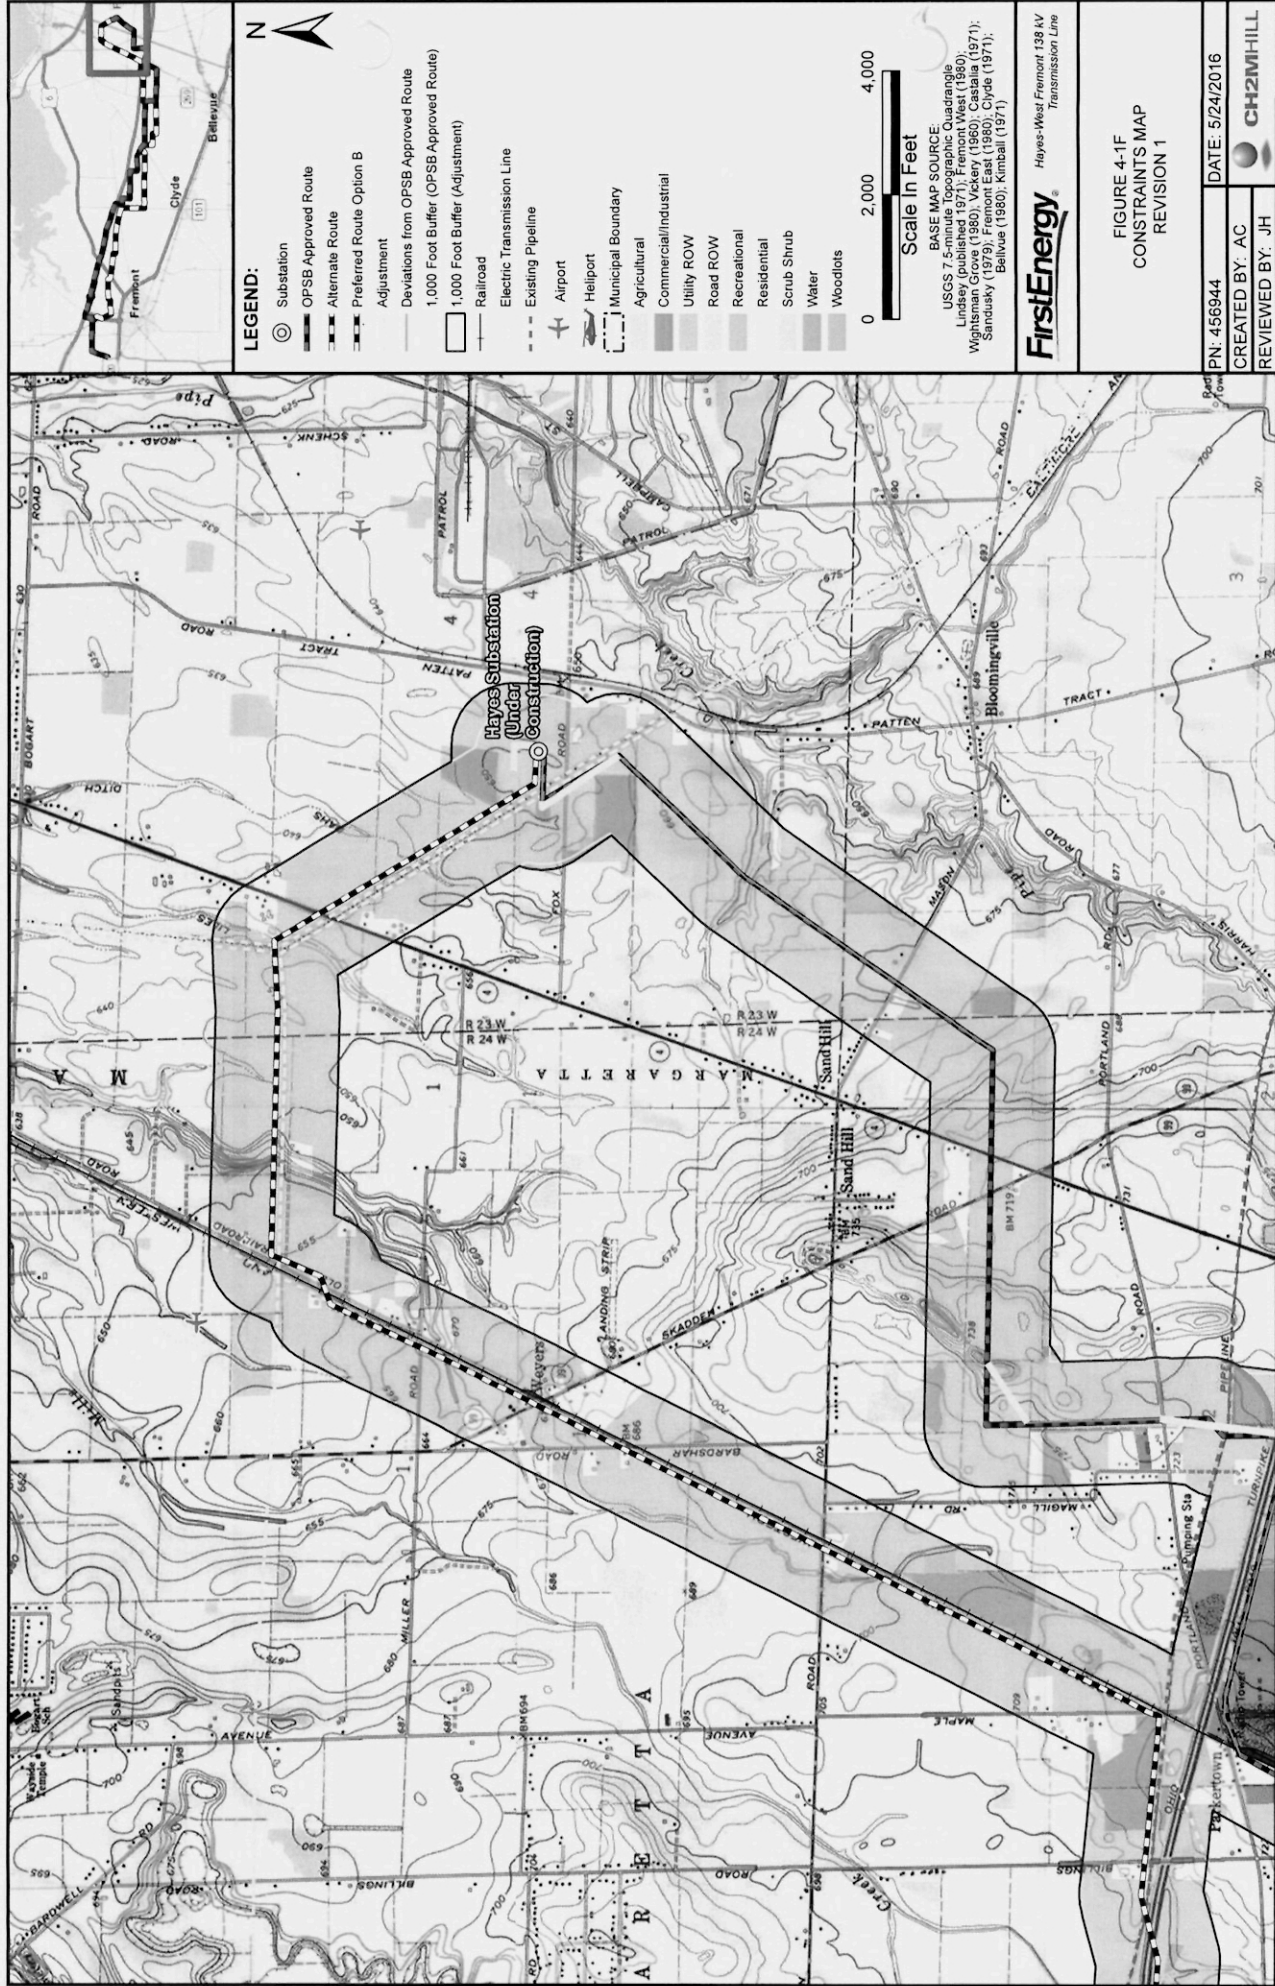



FirstEnergy

Hayes-West Fremont 138 kV Transmission Line

FIGURE 7-2AA

PREFERRED ROUTE

NWI AND DELINEATED WETLANDS

AND WATERBODIES MAP - REVISION 1

PN: 456944
DATE: 5/24/2016
CREATED BY: AC
REVIEWED BY: JH

Scale in Feet

0 400 800

BASE MAP SOURCE:
Ohio Statewide Imagery Program, 2011
Erie and Sandusky County

DATA SOURCE:
Stream (NHD) - USGS National Hydrography Dataset
NWI - US Fish and Wildlife Service

LOCATOR MAP

West/Fremont Substation
Hayes Substation (Under Construction)
Proposed Graton Distribution Substation

BASE MAP SOURCE: Esri, DeLorme, NAVTEQ, TomTom, USGS, Intermap, iPC, NRCAN

LEGEND:

- Substation
- OPSB Approved Route
- Adjustment
- Deviations from OPSB Approved Route
- Right of Way (60 Foot - OPSB Approved Route)
- Right of Way (60 Foot - Adjustment)
- Survey Corridor
- 1,000 Foot Buffer (OPSB Approved Route)
- 1,000 Foot Buffer (Adjustment)
- Stream (NHD)
- National Wetland Inventory
- Upland Drainage Ditch
- Delimited Pond
- Delimited Stream
- Delimited Wetland
- Palustrine Emergent
- Palustrine Emergent/Open Water
- Palustrine Emergent/Scrub Shrub
- Palustrine Forested
- Palustrine Forest/Scrub Shrub
- Palustrine Scrub Shrub



Hayes-West Fremont 138 kV Transmission Line

FIGURE 7-2BB
PREFERRED ROUTE
NWMI AND DELINEATED WETLANDS
AND WATERBODIES MAP - REVISION 1

PN: 456944
DATE: 5/24/2016

CREATED BY: AC
REVIEWED BY: JH

CH2MHILL

Scale In Feet

0 400 800

BASE MAP SOURCE
Ohio Statewide Imagery Program, 2011
Erie and Sandusky County

DATA SOURCE
Stream (NHD) - USGS National Hydrography Dataset
NWMI - US Fish and Wildlife Service

LOCATOR MAP

Hayes Substation (Under Construction)
West Fremont Substation
Proposed Gorton Distribution Substation

BASE MAP SOURCE: Esri, DeLorme, NAVTEQ, TomTom, USGS, Intermap, iPC, NRCAN

LEGEND:

- Substation
- OPSB Approved Route
- Adjustment
- Deviations from OPSB Approved Route
- Right of Way (60 Foot - OPSB Approved Route)
- Right of Way (60 Foot - Adjustment)
- Survey Corridor
- 1,000 Foot Buffer (OPSB Approved Route)
- 1,000 Foot Buffer (Adjustment)
- Stream (NHD)
- National Wetland Inventory
- Upland Drainage/Ditch
- Delineated Pond
- Delineated Stream
- Delineated Wetland
- Palustrine Emergent
- Palustrine Emergent/Open Water
- Palustrine Emergent/Scrub Shrub
- Palustrine Forested
- Palustrine Forest/Scrub Shrub
- Palustrine Scrub Shrub



LEGEND:

- Substation
- OPSB Approved Route
- Adjustment
- Deviations from OPSB Approved Route
- Right of Way (60 Foot - OPSB Approved Route)
- Right of Way (60 Foot - Adjustment)
- Survey Corridor
- 1,000 Foot Buffer (OPSB Approved Route)
- 1,000 Foot Buffer (Adjustment)
- Stream (NHD)
- National Wetland Inventory

- Upland Drainage Ditch
- Delineated Pond
- Delineated Stream
- Delineated Wetland
- Palustrine Emergent
- Palustrine Emergent/Open Water
- Palustrine Emergent/Scrub Shrub
- Palustrine Forested
- Palustrine Forest/Scrub Shrub
- Palustrine Scrub Shrub

LOCATOR MAP

Scale in Feet

0 400 800

BASE MAP SOURCE:

Ohio Statewide Imagery Program, 2011

Erie and Sandusky County

DATA SOURCE:

Stream (NHD) - USGS National Hydrography Dataset

NWI - US Fish and Wildlife Service

FirstEnergy

Haystack 138 kV Transmission Line

FIGURE 7-2CC

PREFERRED ROUTE

NWI AND DELINEATED WETLANDS


AND WATERBODIES MAP - REVISION 1

PN: 456944

DATE: 5/24/2016

CREATED BY: AC

REVIEWED BY: JH

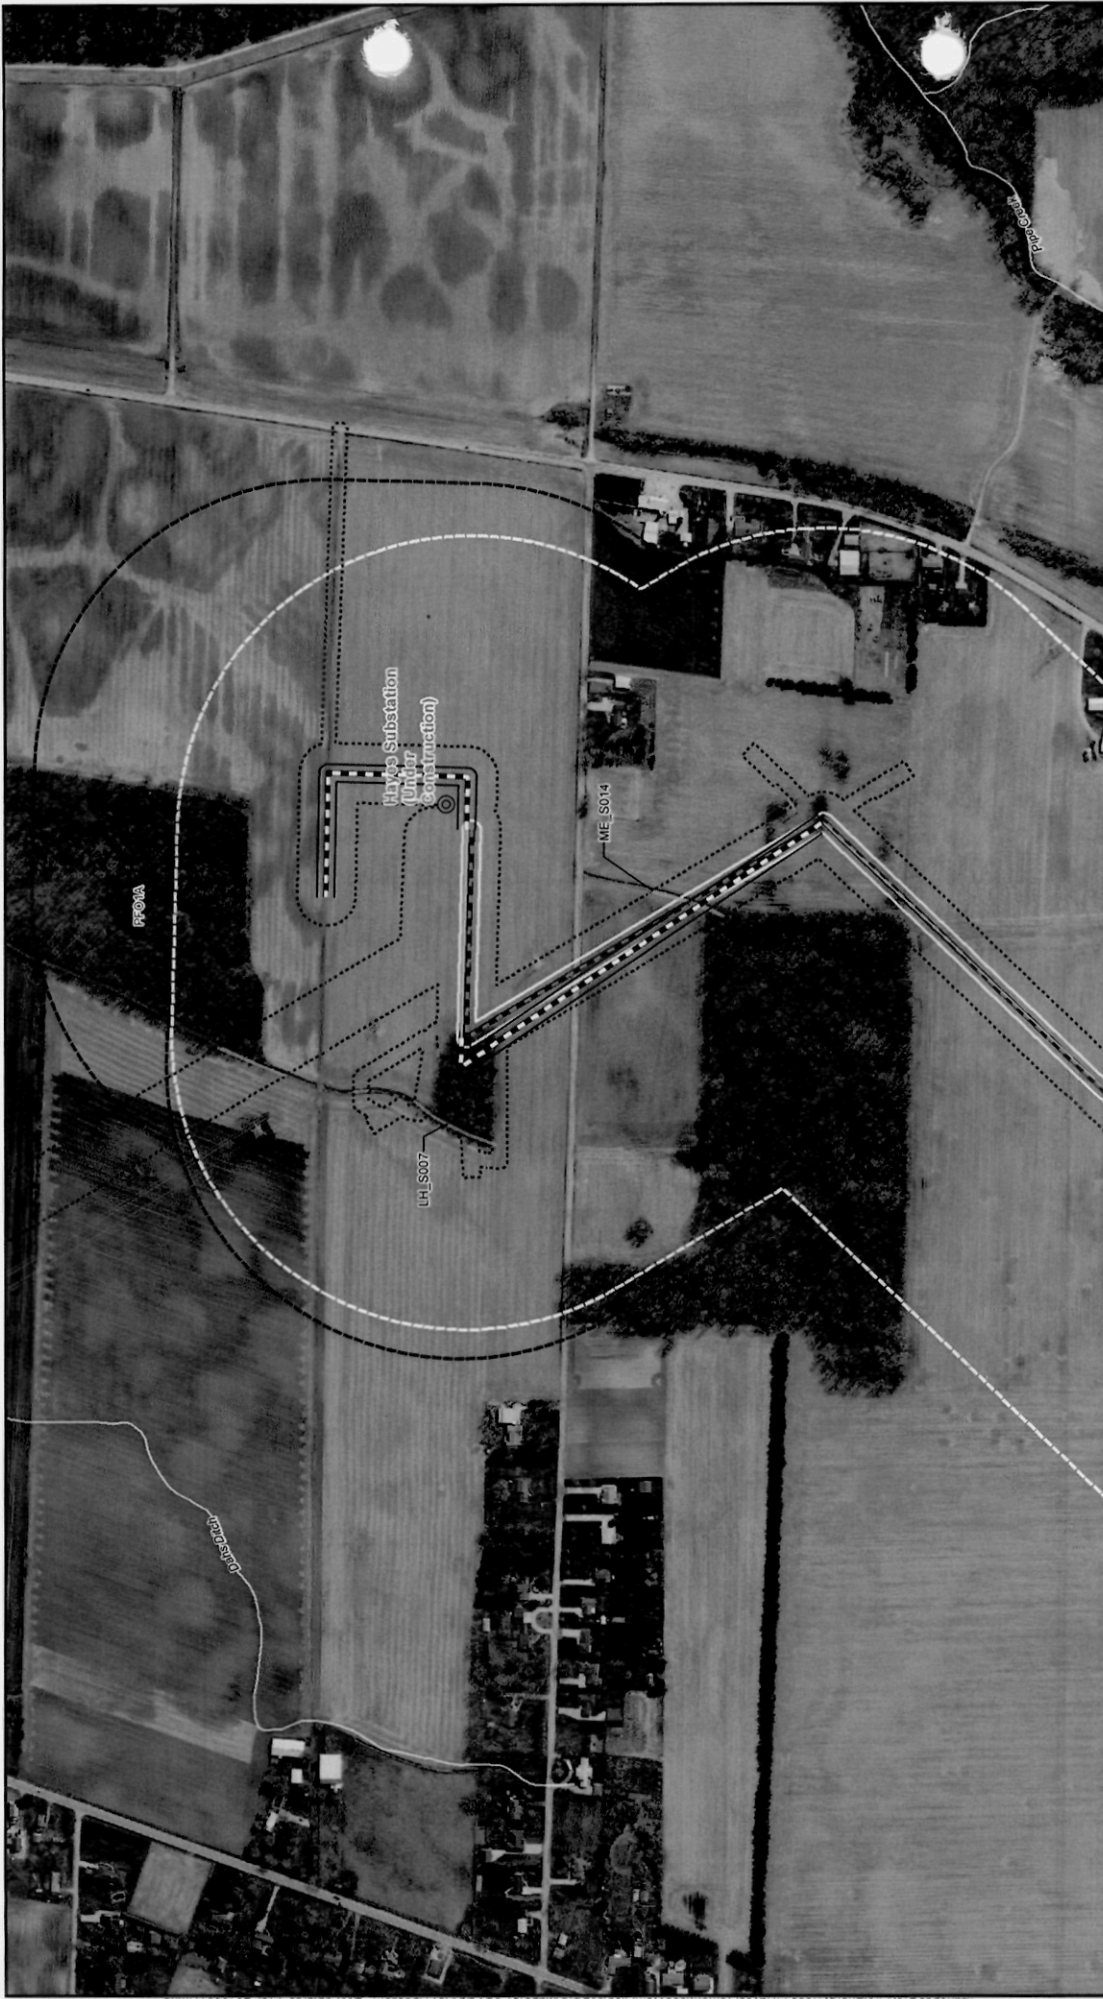

Hayes-West Fremont 138 kV Transmission Line

FIGURE 7-2FF
PREFERRED ROUTE
NWI AND DELINEATED WETLANDS
AND WATERBODIES MAP - REVISION 1

PN: 4568944
 DATE: 5/24/2016
 CREATED BY: AC
 REVIEWED BY: JH

0 400 800

Scale in Feet

BASE MAP SOURCE
 Ohio Statewide Imagery Program, 2011
 Erie and Sandusky County

DATA SOURCE
 Stream (NHD) - USGS National Hydrography Dataset
 NWI - US Fish and Wildlife Service

LOCATOR MAP

BASE MAP SOURCE: Esri, DeLorme, NAVTEQ, TomTom, USGS, Intermap, iPC, NRCAN

LEGEND:

- Substation
- OPSB Approved Route
- Adjustment
- Deviations from OPSB Approved Route
- Right of Way (60 Foot - OPSB Approved Route)
- Survey Corridor
- 1,000 Foot Buffer (OPSB Approved Route)
- Stream (NHD)
- National Wetland Inventory

- Upland Drainage/Ditch
- Delimited Pond
- Delimited Stream
- Delimited Wetland
- Palustrine Emergent
- Palustrine Emergent/Open Water
- Palustrine Emergent/Scrub Shrub
- Palustrine Forested
- Palustrine Forest/Scrub Shrub
- Palustrine Scrub Shrub

RECEIVED MARKETING DIV.

2016 JUL 29 PM 3:08

PUCO

July 28, 2016

The Honorable Charles Schwochow
Sandusky County Commissioner
622 Croghan St.
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**

Dear Commissioner Schwochow,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

FILE

FirstEnergy.

76 South Main St.
Akron, Ohio 44300
1-800-646-0400

July 28, 2016

The Honorable Danny Polter
Sandusky County Commissioner
622 Croghan Street
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Commissioner Polter,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

2016 JUL 29 PM 2:53
PUCO

RECEIVED DOCKETING

2016 JUL 29 PM 3:08

PUCO

July 28, 2016

Mr. James Moyer, P.E., P.S.
County Engineer
2500 W. State St.
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Moyer,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

2016 JUL 29 PM 3:08

PUCO

July 28, 2016

Ms. Kay Reiter
Executive Director, Economic Development
2511 Countryside Dr.
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Ms. Reiter

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

RECEIVED DOCKETING DIV

2016 JUL 29 PM 3:09

PUCO

July 28, 2016

The Honorable Jim Ellis
Mayor, City of Fremont
323 S. Front St.
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mayor Ellis,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

City of Fremont
Engineering Department
323 S. Front St.
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


To Whom It May Concern:

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Dallas Leake, President
Fremont City Council
323 S. Front St.
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Leake,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Roy E. Yeager, Chair
City of Fremont Planning Commission
323 S. Front St.
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Yeager,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Gilbert Overmyer
Sandusky Township Trustee
2207 Oak Harbor Rd.
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Overmyer,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Michael P. Willis
Sandusky Township Trustee
2207 Oak Harbor Rd.
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Willis,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Paul K. Lotycz
Sandusky Township Trustee
2207 Oak Harbor Rd.
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**

Dear Mr. Lotycz,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Ms. Cynthia K. Zienta
Sandusky Township Fiscal Officer
2207 Oak Harbor Rd.
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Ms. Zienta,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Tim King
Rice Township Trustee
110 County Road 119
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. King,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. William C. Lamalie
Rice Township Trustee
110 County Road 119
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Lamalie,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Don Atkinson
Rice Township Trustee
110 County Road 119
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Atkinson,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Ms. Kathleen M. Roosen
Rice Township Fiscal Officer
110 County Road 119
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Ms. Roosen,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Gary Overmyer
Riley Township Trustee
3093 State Route 412
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Overmyer,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. David Sachs
Riley Township Trustee
3093 State Route 412
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Sachs,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. John W. Antesberger
Riley Township Trustee
3093 State Route 412
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Antesberger,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Joseph A. Halbeisen
Riley Township Fiscal Officer
3093 State Route 412
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Halbeisen,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Paul Warner
Townsend Township Trustee
6214 C.R. 247
Vickery, OH 43464

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Warner,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Ms. Jean Leber
Townsend Township Trustee
1560 County Road 310
Clyde, OH 43410

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Ms. Leber,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Bruce Meggitt
Townsend Township Trustee
5625 State Route 412
Vickery, OH 43464

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Meggitt,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Ms. Cathy Bales
Townsend Township Fiscal Officer
2739 County Road 306
Vickery, OH 43464

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Ms. Bales,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Lee Watson
York Township Trustee
5964 County Road 113
Bellevue, OH 44811

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Watson,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Lee Patten
York Township Trustee
5964 County Road 113
Bellevue, OH 44811

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Patten,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Doug Keegan
York Township Trustee
5964 County Road 113
Bellevue, OH 44811

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Keegan,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Ms. Leslie Fleming
York Township Fiscal Officer
5964 County Road 113
Bellevue, OH 44811

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Ms. Fleming,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Matt Hofelich
Green Creek Township Trustee
410 C.R. 242
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**

Dear Mr. Hofelich,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Bill Ebert
Green Creek Township Trustee
931 C.R. 212
Fremont, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Ebert,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Jim Newsome
Green Creek Township Trustee
2412 C.R. 185
Clyde, OH 43410

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Newsome,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Ms. Danyelle Lantz
Green Creek Township Fiscal Officer
1990 W McPherson Hwy
Clyde, OH 43410

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Ms. Lantz,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

The Honorable Pat Shenigo
Erie County Commissioner
2900 Columbus Ave.
Sandusky, OH 44870

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Commissioner Shenigo,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

The Honorable Tom Ferrell
Eric County Commissioner
2900 Columbus Ave.
Sandusky, OH 44870

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Commissioner Ferrell,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

The Honorable William Monaghan
Erie County Commissioner
2900 Columbus Ave.
Sandusky, OH 44870

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Commissioner Monaghan,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. John Farschman, P.E., P.S.
Erie County Engineer
2900 Columbus Ave.
Sandusky, OH 44870

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Farschman,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Steve Poggiali, Director
Erie County Regional Planning Commission
2900 Columbus Ave.
Sandusky, OH 44870

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Poggiali,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Joe Smith, City of Fremont
Director, Economic Development
323 South Front Street
Sandusky, OH 43420

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Smith,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Jim Lang
Perkins Township Trustee
2610 Columbus Avenue
Sandusky, OH 44870

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Lang,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Jeff Ferrell
Perkins Township Trustee
2610 Columbus Avenue
Sandusky, OH 44870

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Jeff Ferrell,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Timothy Coleman
Perkins Township Trustee
2610 Columbus Avenue
Sandusky, OH 44870

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Coleman,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Ms. Jane Gildenmeister
Perkins Township Fiscal Officer
2610 Columbus Avenue
Sandusky, OH 44870

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Ms. Gildenmeister,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Gary Pooch
Margaretta Township Trustee
4518 Tiffin Ave.
Castalia, OH 44824

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Pooch,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Joe Bias Jr.
Margaretta Township Trustee
9010 Rogers Road
Castalia, OH 44824

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**

Dear Mr. Bias,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Tim Riesterer
Margaretta Township Trustee
3320 Maple Ave.
Castalia, OH 44824

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Riesterer,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Ms. Mary Ann Lindsley
Margaretta Township Fiscal Officer
PO Box 215.
Castalia, OH 44824

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Ms. Lindsley,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Roger Rowland
Groton Township Trustee
11212 Bemis Road.
Bellevue, OH 44811

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Rowland,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Ronald Brown
Groton Township Trustee
12009 Potter Rd.
Bellevue, OH 44811

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Brown,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Roger Russell
Groton Township Trustee
9916 N. State Route 269
Bellevue, OH 44811

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**

Dear Mr. Russell,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Ms. Linda Jett
Groton Township Trustee
7215 Magill Rd
Bellevue, OH 44811

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Ms. Jett,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Mike Parker
Oxford Township Trustee
5617 Taylor Rd.
Sandusky, OH 44870

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Parker,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. James Stewart
Oxford Township Trustee
8719 Ransom Road
Monroeville, OH 44847

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Stewart,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Scott Leber
Oxford Township Trustee
2512 Higbee Road
Monroeville, OH 44847

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. Leber,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments

July 28, 2016

Mr. Phillip M. David
Oxford Township Fiscal Officer
4516 Wood Road
Monroeville, OH 44847

**AMENDMENTS TO THE HAYES-WEST FREMONT 138 kV
TRANSMISSION LINE PROJECT
OPSB Case Numbers 16-1593-EL-BTA, 16-1594-EL-BTA AND 16-1595-EL-BTA**


Dear Mr. David,

In the above captioned projects, American Transmission Systems, Incorporated (the "Applicant"), a FirstEnergy company, has submitted applications for Amendments to the certificate issued in Case Number 12-1636-EL-BTX for the Hayes-West Fremont 138 kV Transmission Line Project. The attached applications Amendments to the Hayes-West Fremont 138 kV Transmission Line Project propose the addition of a second circuit and a total of ten adjustments to the route approved by the Board that is not expected to have materially greater impacts to the route approved by the Board.

The Amendment has been developed and submitted in accordance with Ohio Administrative Code section 4906-3-11(B). A copy of the Amendment is being served on you in accordance with provisions of Ohio Administrative Code sections 4906-3-11(B)(2), 4906-3-07 and 4906-6-07.

I will be happy to answer your questions concerning this matter. You can contact me at (330) 384-2526.

Sincerely,



Scott M. Humphrys
Transmission Services Specialist
Energy Delivery Transmission and
Substation Design
FirstEnergy Service Company

Attachments