



Legal Department

American Electric Power
1 Riverside Plaza
Columbus, OH 43215-2373
AEP.com

January 23, 2017

Docketing Division Chief
Public Utilities Commission of Ohio
180 East Broad Street
Columbus, Ohio 43215-3793

Re:

PUCO Case No.

16-0535-EL-BTX

Supplemental Documentation

Yager-Desert Road 138kV Transmission Line Rebuild Project

Erin C. Miller
Contract Counsel –
(614) 716-2942 (P)
(614) 716-2014 (F)
ecmiller1@aep.com

Dear Ms. McNeal:

AEP Ohio Transmission Company, Inc. ("AEP Ohio Transco") files this supplemental documentation in accordance with Rule 4906-3-11(A)(6) Ohio Administrative Code ("O.A.C."). According to this provision, modifications to a proposed route that are introduced into the record by the applicant during review of the accepted, complete application and during the hearing process shall not be considered amendments if such modifications are within the two thousand foot study corridor and do not impact additional landowners by requiring easements for construction, operation, or maintenance or create further impacts within the planned right-of-way of the proposed facility.

AEP Ohio Transco proposes to adjust the Preferred Route to the north between proposed structures 12 and 17 in order to eliminate the need to acquire a habitable structure on Mrs. Dusica Katic-Piatt's property. Right-of-Way agents are negotiating right-of-way easements with two property owners located north of Mrs. Dusica Katic-Piatt. Both of these property owners are currently being impacted by both the proposed Preferred and Alternate routes and were properly notified of the proposed project per the O.A.C. requirements. The proposed reroute is outside of the environmental survey corridor conducted by AEP Ohio Transco's consultant; an ecological and cultural review will be required once the proposed modified route is finalized with the property owners.

The attached proposed reroute map illustrates AEP Ohio Transco's desire to adjust the preferred route north onto the ridge.

Respectfully Submitted,


/s/ Erin C. Miller

Erin C. Miller

Contract Counsel

AEP Ohio Transmission Company, Inc.

cc: Jon Pawley, OPSB Staff
Werner Margard, Assistant Attorney General
Douglas Jennings, Attorney Law Judge

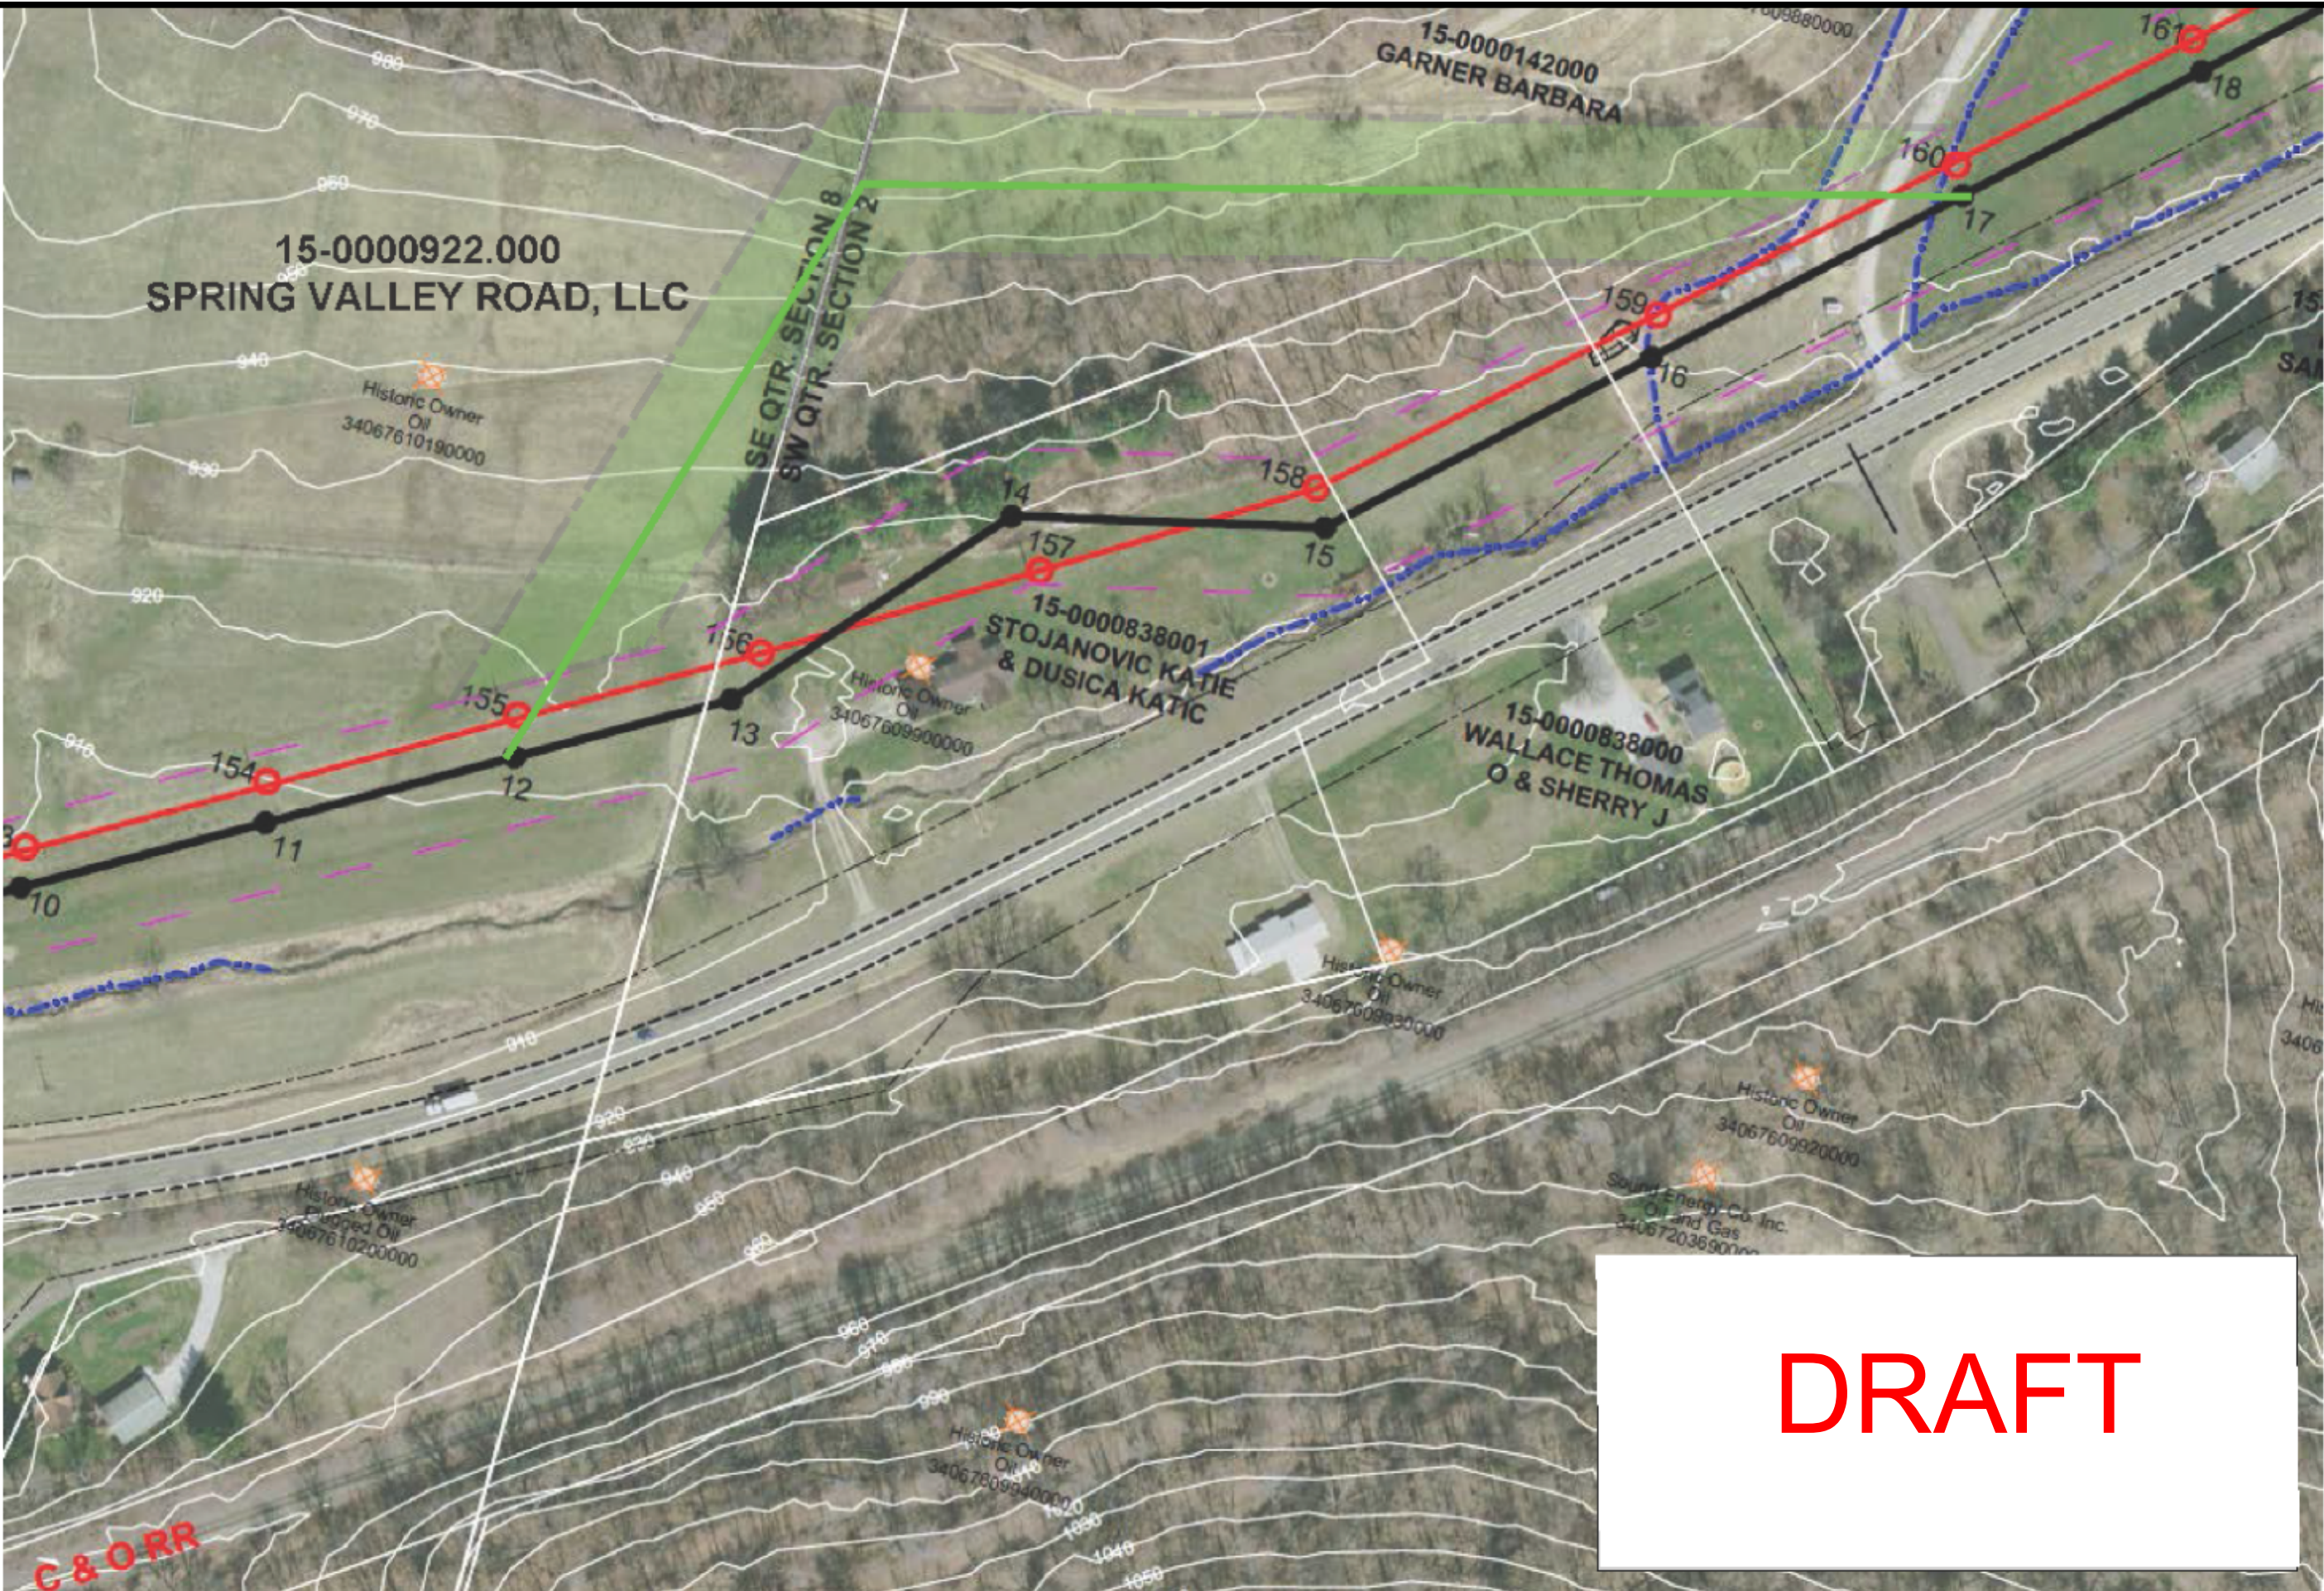

DRAFT

REV	REVISION DESCRIPTION	DATE	BY
0	PROVIDING BORDER FOR DRAWING	1/23/2017	KLM



ENG BY:	N/A	CHKD BY:	N/A
DRN BY:	N/A	APP BY:	N/A
DATE:	1/23/2017	R/W MAP NO:	N/A

*THIS DRAWING IS THE PROPERTY OF AMERICAN ELECTRIC POWER AND IS LOANED UPON CONDITION THAT IT IS NOT TO BE COPIED OR REPRODUCED, IN WHOLE OR IN PART, OR USED FOR FURNISHING INFORMATION TO ANY PERSON WITHOUT THE WRITTEN CONSENT OF AMERICAN ELECTRIC POWER, OR FOR ANY PURPOSE DETRIMENTAL TO THEIR INTEREST, AND IS TO BE RETURNED UPON REQUEST.

AEP OHIO TRANSMISSION COMPANY
YAGER - DESERT ROAD 138KV LINE

EQUIP:	TLN380:OH080
DWG:	OH080S01
SHEET:	1
REV:	0

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

1/23/2017 4:11:41 PM

in

Case No(s). 16-0535-EL-BTX

Summary: Correspondence electronically filed by Mrs. Erin C Miller on behalf of AEP Ohio
Transmission Company