

DIMENSION "A" SINGLE CIRCUIT - HOR. CONFIGURATION (STEEL POLE)
(UNDER EMERGENCY & NORMAL MAX. LINE LOADING)

DIMENSION "B" SINGLE CIRCUIT - HOR. CONFIGURATION (STEEL POLE)
(UNDER WINTER NORMAL CONDUCTOR RATING)


**AEP AMERICAN
ELECTRIC
POWER**

LEEMASTER - LICK
138kV LINE

TYPICAL PHASE ARRANGEMENT
STEEL POLE

NOT TO SCALE

FIGURE 2

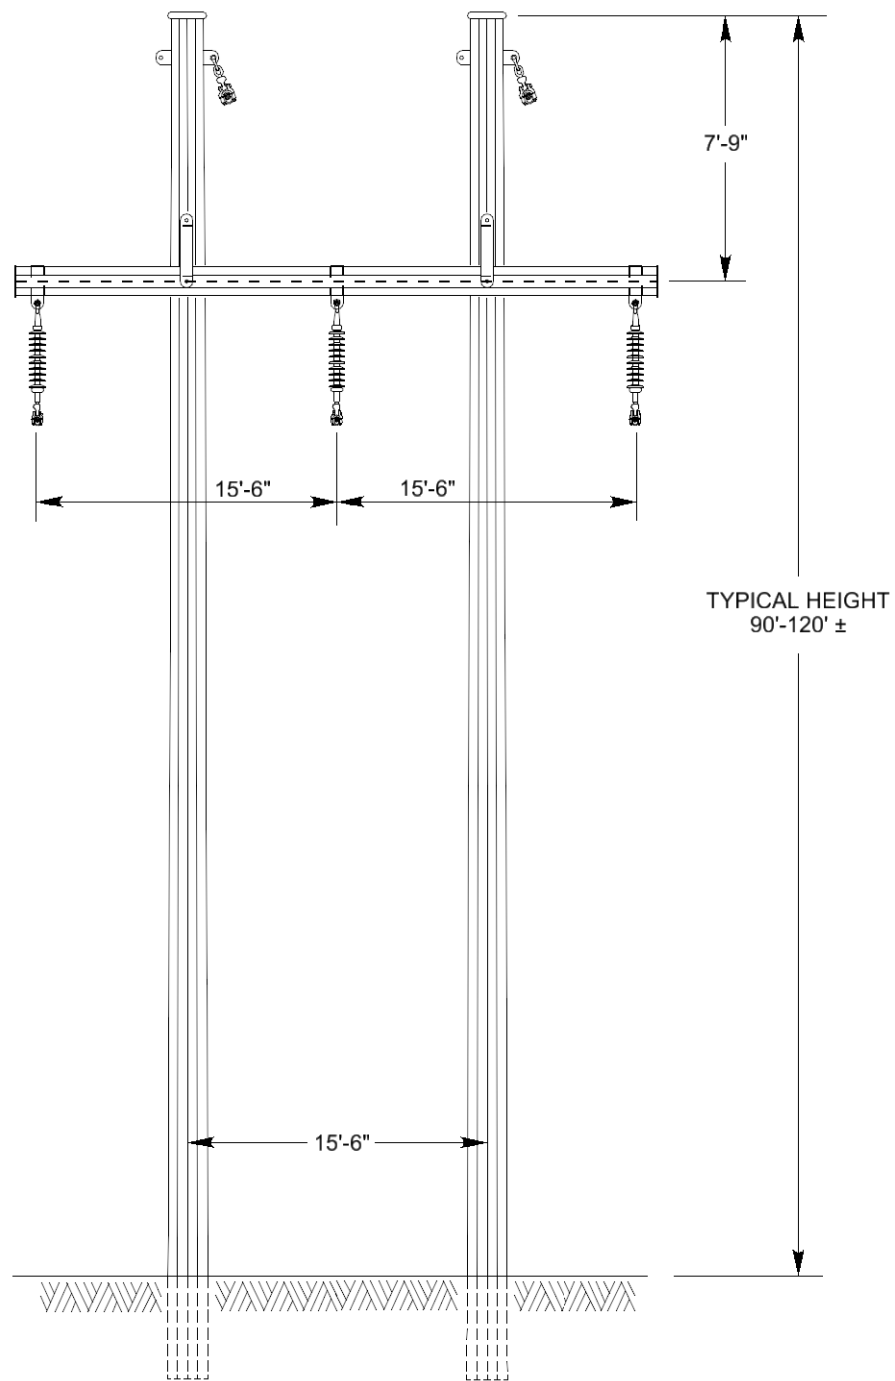

LEEMASTER - LICK
138kV LINE

TYPICAL TANGENT STRUCTURE
TUBULAR STEEL
H-FRAME SUSPENSION

NOT TO SCALE

FIGURE 1

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

4/3/2017 12:05:35 PM

in

Case No(s). 17-0633-EL-BLN

Summary: Letter of Notification 4 of 4 parts electronically filed by Mr. Hector Garcia on behalf of AEP Ohio Transmission Company