

July 19, 2017

Ms. Barcy F. McNeal  
Docketing Division  
The Public Utilities Commission of Ohio  
180 East Broad Street  
Columbus, OH 43215-3793

**Supplemental Information Letter**  
**Emily-Fox Q-14 138 kV Transmission Line**  
**Relocation Project**  
**Case No. 17-1151-EL-BNR**

Dear Ms. McNeal,

This letter provides supplemental information to the Board concerning the construction of the Emily-Fox 138 kV Transmission Line Relocation Project, Case No. 17-1151-EL-BNR. Due to issues with the proposed route on one parcel, ATSI has made a minor adjustment to the centerline of the relocated transmission line to move it off this parcel and into the public road right-of-way. The proposed centerline adjustment is depicted in Exhibit 3A, which is attached to this supplemental information letter.

In order to accommodate the centerline adjustment, the location of the tangent structure originally depicted in Exhibit 3 will be moved approximately 20 feet to the northwest. In addition, the location of the angle structure originally depicted in Exhibit 3 will be moved approximately 30 feet to the northeast from its original proposed location. Both of these changes are noted in Exhibit 3A. These changes result in both structures being located in the public road right-of-way.

ATSI remains in negotiations with the property owner for buying rights. If buying rights cannot be secured for the proposed adjustment of the centerline, ATSI will need to change the angle structure to another structure type, which is depicted in Exhibit 4A. The new structure will be a single circuit, wood laminated pole, 40-90 degree angle pulloff structure instead of the single circuit, wood pole, 40-90 degree angle deadend structure as originally proposed.

No additional changes are expected as a result of the adjustment of the centerline.


Should the Ohio Power Siting Board desire further information or discussion of this submittal, please contact me at (330) 384-2740.

Sincerely,



William R. Beutler, P.E.  
Engineer III  
Energy Delivery Transmission and Substation Design  
FirstEnergy Service Company

cc: J. O'Dell

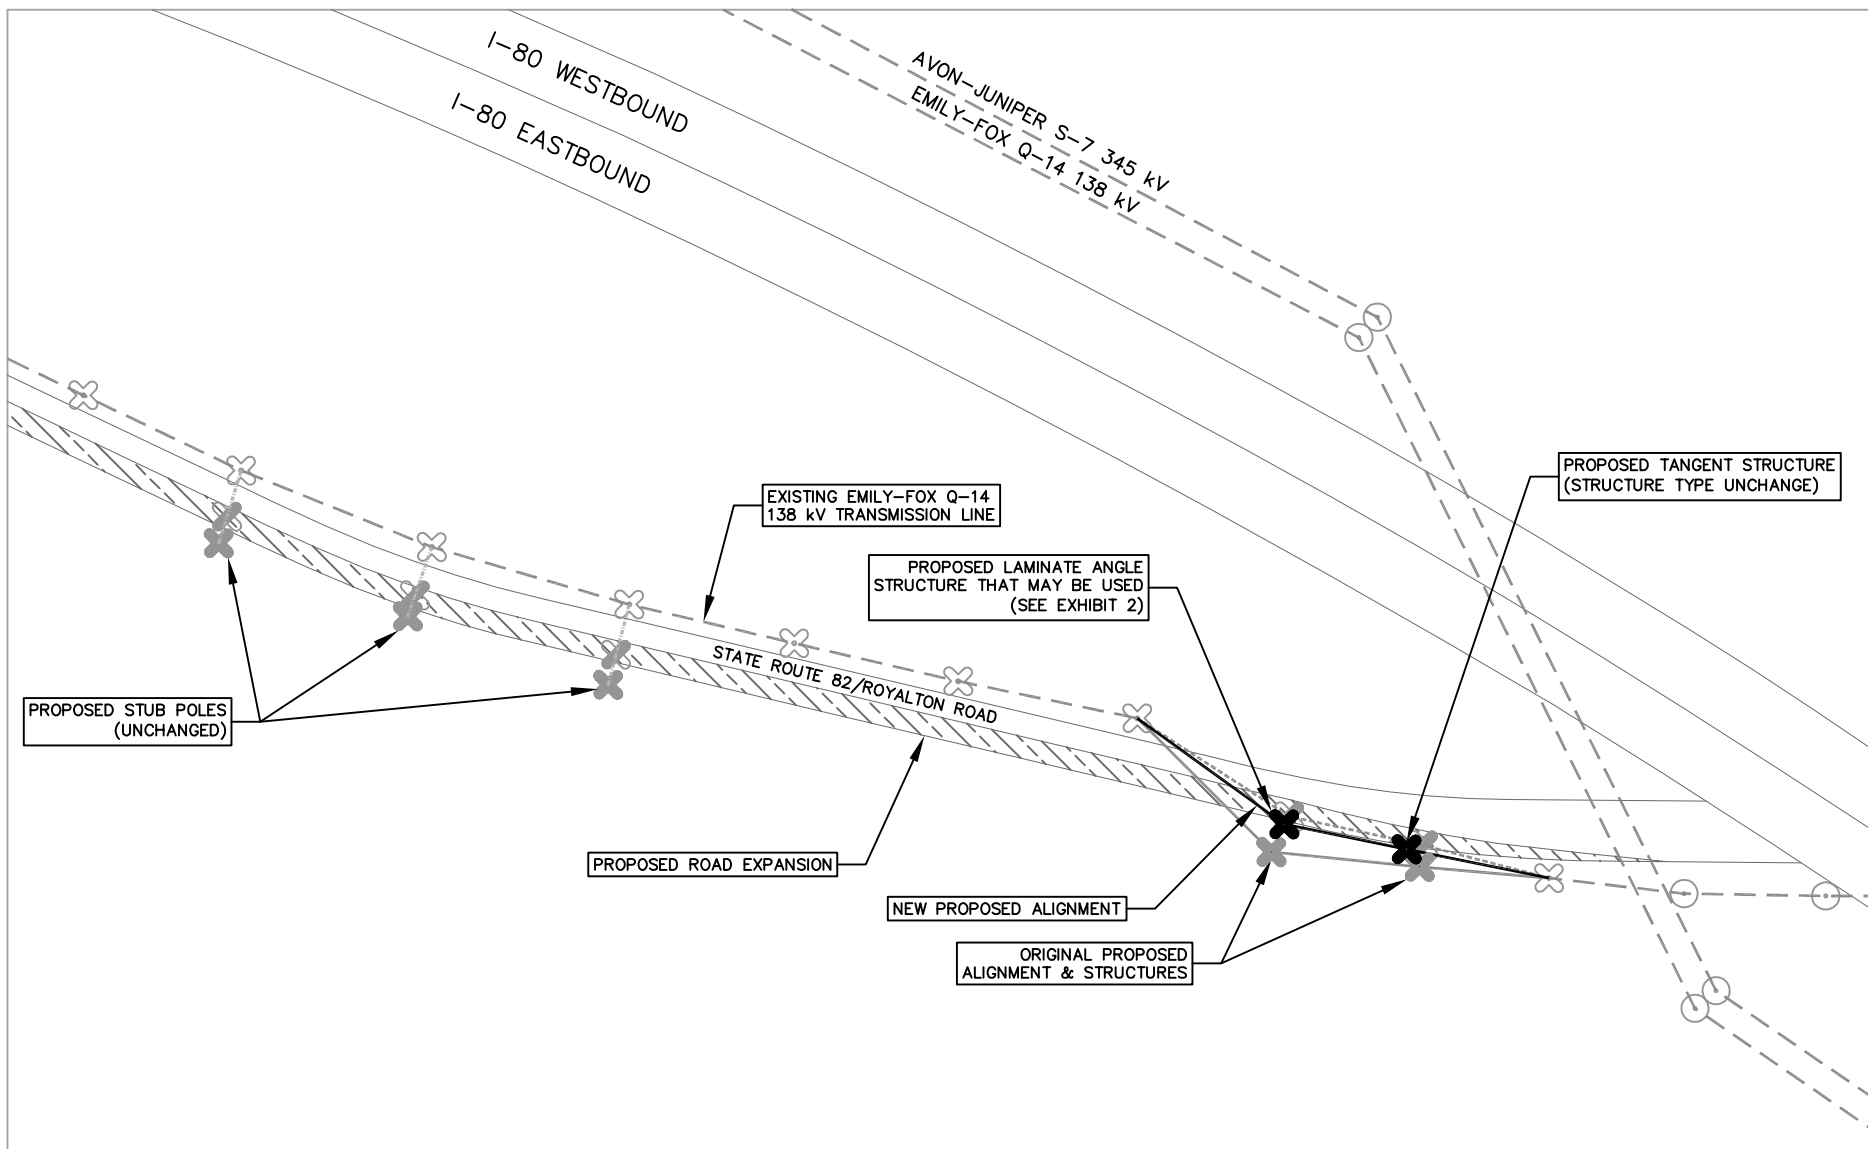

## LEGEND

---	EXISTING CONDUCTOR	⊗	EXISTING 1-POLE WOOD STRUCTURE
—	PROPOSED CONDUCTOR	⊗	EXISTING 1-POLE WOOD TO BE REMOVED
----	CONDUCTOR TO BE REMOVED	⊗	NEW 1-POLE WOOD STRUCTURE
---	PROPOSED SPAN GUY	⊙	EXISTING 1-POLE STEEL STRUCTURE
▨	PROPOSED ROAD EXPANSION	⊙	EXISTING 2-POLE STEEL STRUCTURE


**ATSI**<sup>®</sup>

American Transmission Systems, Inc.  
a subsidiary of FirstEnergy Corp.


## GENERAL LAYOUT

EMILY-FOX Q-14 138 kV TRANSMISSION  
LINE RELOCATION PROJECT

EXHIBIT 3A



SECTION A-A

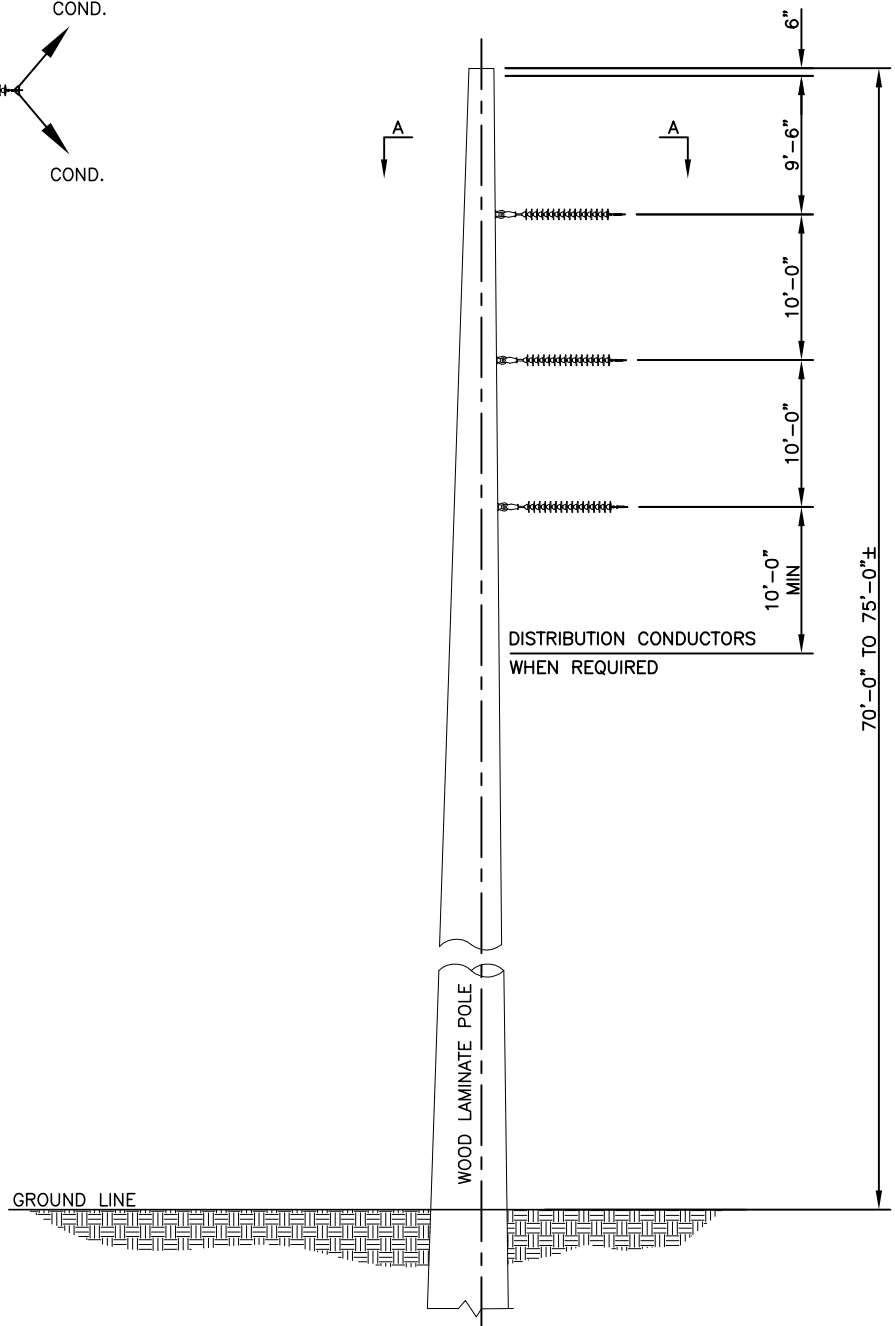

**ATSI**®

American Transmission Systems, Inc.  
a subsidiary of FirstEnergy Corp.

EMILY-FOX Q-14 138 kV  
TRANSMISSION LINE RELOCATION  
PROJECT

SINGLE CIRCUIT, WOOD LAMINATE POLE,  
40-90 DEGREE ANGLE PULL-OFF STRUCTURE

EXHIBIT 4A

NOT TO SCALE

**This foregoing document was electronically filed with the Public Utilities**

**Commission of Ohio Docketing Information System on**

**7/19/2017 4:19:03 PM**

**in**

**Case No(s). 17-1151-EL-BNR**

Summary: Notification of the Filing of Supplemental Information Concerning Project electronically filed by Mr. Robert J Schmidt on behalf of American Transmission Systems Inc.