


Case No. 17-2242-EL-REN
Barron-bob-OH-PV-11.825kw Residence
Staff Interrogatories – Initial Set

Question 1: In section N you state that you will using an Enphase meter as your meter that you will using to report generation data to GATS. Since your facility is greater than 6 kW, the meter that will used to report generation data must be “utility grade.” A utility grade meter is one that conforms to ANSI 12.1 which calls for an accuracy of +/- 2% or better. Please submit documentation that shows that the meter that measures the generation data has an accuracy of +/- 2% or better.

Answer 1: Please see below.

Question 2: In section N.1.e you state the meter reading is 9,674 kWh. The screenshot shows that the lifetime generation as 2.82 MWh Please submit a screenshot of the current meter reading.

Answer 2:

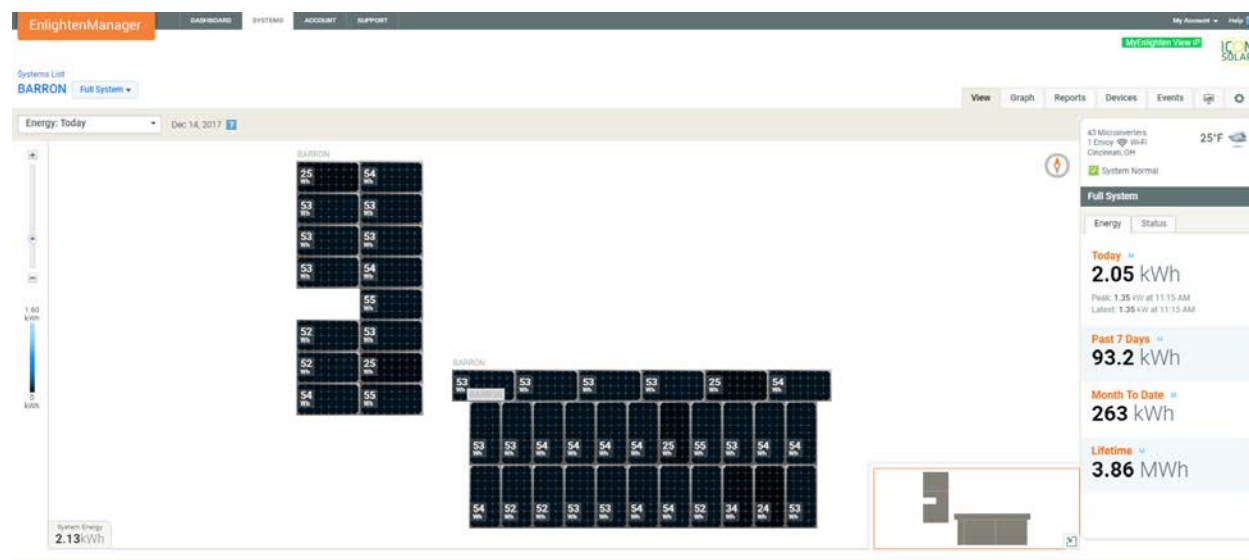

Type Examination Certification



Certificate Number : C10557514

Company Name and Location : Enphase Energy
1420 North McDowell Blvd.
Petaluma, CA 9495

Product : EnvoyS

Product Serial Nos. : Refer to UL Test Report, R10557514 (APPENDIX A)

Date of Report : October 13, 2015

Testing Location : 12 Laboratory Drive, RTP, NC 27709

Test Specifications : Enphase Test Plan
Reference Standards: ANSI C12.20-2010, ANSI C12.1-2008

Test Results : The above product was found to be compliant to ANSI C12.20-2010, Class 0.5

It is the responsibility of the company shown above that the products it produces are in compliance with the applicable requirements and identical to the sample(s) actually tested. Complete test results of the testing can be found in the report referenced above.

The name of UL LLC, any abbreviation thereof, or any symbol shall not be used on or in connection with the product unless and until specifically authorized by UL LLC.

WiSE Program Manager:

WiSE Operations Manager:

Date: 2015-10-15

Date: 2015-10-15



This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

12/14/2017 11:46:06 AM

in

Case No(s). 17-2242-EL-REN

Summary: Reply reply to staff interrogatories electronically filed by Mr. Avery Sellers on behalf of Robert Barron