



150 E. GAY STREET, 24TH FLOOR
COLUMBUS, OH 43215-3192
TELEPHONE: (614) 744-2936
FACSIMILE: (844) 670-6009
<http://www.dickinsonwright.com>

WILLIAM V. VORYS
WVorys@dickinsonwright.com

January 4, 2017

Ms. Barcy F. McNeal, Secretary
Ohio Power Siting Board
Docketing Division
180 East Broad Street, 11th Floor
Columbus, Ohio 43215

Re: Case Nos. 09-479-EL-BGN, 11-3446-EL-BGA, 16-469-EL-BGA, and 16-2404-EL-BGA
In the Matter of the Application of Hardin Wind Energy LLC for a Certificate of
Environmental Compatibility and Public Need for the Hardin Wind Farm.
**Notice of Compliance with Certificate Condition #55—Supplemental Emergency
Action Plan**

Dear Ms. McNeal:

Hardin Wind Energy LLC (“Applicant”) is certified to construct a wind-powered electric generation facility in Hardin County, Ohio, in accordance with the orders issued by the Ohio Power Siting Board (“OPSB”) in the above-referenced cases.

The Applicant is providing this letter to notify the OPSB that the Applicant is supplementing its response regarding Condition 55, which was initially filed on September 28, 2016, and November 15, 2016, with the attached Fire Protection and Medical Emergency Action Plan.

We are available to answer any questions you may have.

Respectfully submitted,

/s/William V. Vorys
William V. Vorys (0093479)
Christine M.T. Pirik (0029759)
Dickinson Wright PLLC
150 East Gay Street, Suite 2400
Columbus, Ohio 43215
Phone: (614) 744-2936
Email: wvorys@dickinsonwright.com
cpirik@dickinsonwright.com

Attorneys for Hardin Wind Energy LLC

Enclosures
COLUMBUS 39579-20 81906v2

HARDIN WIND ENERGY PROJECT SWITCHYARD EMERGENCY ACTION PLAN


Project Name: Hardin Wind Energy Project Switchyard
Hardin County Ohio

Project Address: 13657 Township Road 65, Belle Center OH 43310
GPS Coordinates: 40.6321734335 -83.7917382057

EMERGENCY CONTACTS:

EPCS Construction Manager: *To Be Determined*

- **Fire & Rescue Squad:**
 - Name: *Alger Fire Department*
 - Address: *102 Lee St., Alger OH 45812*
 - Phone: **Emergency: 9-1-1; Non-Emergency: (419) 757-2222**
- **Medical Facility – Emergency**
 - Name: *Ohio Health Hardin Memorial Hospital*
 - Address: *921 East Franklin St., Kenton OH 43326*
 - Phone: **Emergency: 9-1-1; Non-Emergency: (419) 673-0761**
- **Medical Facility – Non-Emergency / Drug/Alcohol Testing**
 - Name: *St. Rita's Occupational Health Clinic*
 - Address: *1875 S. Dixie Hwy., Lima OH 45804*
 - Phone: **Non-Emergency: (419) 226-9720**
- **Medical Facility – URGENT CARE**
 - Name: *Lima Memorial Walk-In Care – Kenton Medical Center*
 - Address: *1211 E. Columbus St., Kenton OH 43326*
 - Phone: **Non-Emergency: (419) 675-0668**
- **Local Police / Sheriff**
 - Name: *Hardin County Sheriff*
 - Address: *1025 S. Main St., Kenton OH 43326*
 - Phone: **Emergency: 9-1-1; Non-Emergency: (419) 673-1268**

	Copyright 2017 EPC Services Company	Issued: September 8, 2017	Hardin Wind Energy Project Switchyard Emergency Action Plan
		Revised:	
		Reviewed:	Page 1 of 13

HARDIN WIND ENERGY PROJECT SWITCHYARD EMERGENCY ACTION PLAN

ON-SITE COMMUNICATION METHODS:

The following may be utilized on-site to report and maintain communication during emergencies:

<input checked="" type="checkbox"/> Cell Phone	<input type="checkbox"/> Satellite Phone	<input type="checkbox"/> Hand Signals	<input checked="" type="checkbox"/> Air Horn/Siren
<input checked="" type="checkbox"/> 2-Way Radio/CB	<input checked="" type="checkbox"/> Verbal	<input type="checkbox"/> Smoke/Flares	<input type="checkbox"/> Other:

SITE LOCATIONS:

Muster Area:	EPC Services Company Main Office Trailer
Tornado Shelter:	If a Specific Tornado Shelter is NOT Identified or Available for the Project, Drive to your Hotel / Home or Shelter in Place (Please Refer to Appendix 2 Attached to this Plan)
Lightning/Severe Weather Shelter:	If a Specific Lightning / Severe Weather Shelter is NOT Identified or Available for the Project, Drive to your Hotel / Home or Shelter in Place (Please Refer to Appendix 2 Attached to this Plan)
Fire Emergency:	EPC Services Company Main Office Trailer
Bomb Threat/Violent Incidents:	EPC Services Company Main Office Trailer
Safety Data Sheets (SDS):	EPC Services Company Main Office Trailer
First Aid Supplies:	ECI/EPCS Main Site Office Trailer / Subcontractor's Main Site Office Trailer / Every EPCS Company Vehicle and Every Subcontractors Company Vehicle

EMERGENCY PROCEDURES:

Emergency:

Call 9-1-1

- Keep the person calm and as comfortable as possible.
- Do not move the person unless absolutely necessary.
- Conduct First Aid and CPR if properly trained.
- Never give liquids to an unconscious person.
- Do not remove objects that are embedded in a person's skin.
- Keep in communication with Emergency Responders.
- Make certain that the injured person is accompanied by a Supervisors or another assigned person to the emergency room.
- Always be aware of Bloodborne Pathogens and utilize First-Aid training techniques.


HARDIN WIND ENERGY PROJECT SWITCHYARD EMERGENCY ACTION PLAN

- **Blood or Bodily Fluids Clean-Up / Bloodborne Pathogens**

- Request the hazardous waste be cleaned up by the professional responders (EMT's, Police, Sheriff, etc.) responding to the incident. Give gloves and anything that was used during First Aid / CPR, etc. to the professional responders for hazardous waste disposal.
- No one is to clean up a blood/body fluid spill as part of their job until they have had initial bloodborne pathogens training from their employer which must be updated annually.
- Anyone who does not feel comfortable cleaning up a spill can call the EPCS Safety Director at (406) 869-2082 or on her cell at (406) 839-6026 or contact their Supervisor.
- Warn others in the area and isolate the contaminated area. (Prevent others from walking through or near the spill.)
- Put on personal protective equipment (PPE) appropriate for the spill size. (e.g., double set of gloves, safety goggles, etc.).
- Remove glass or sharps, if necessary, with forceps, tongs or scoop and place in a red sharps container or red bucket.
- For a wet spill, cover with disinfectant-soaked absorbent towels, wipe, and remove toweling. (This decreases the likelihood of causing a splash.) Any visible blood or body fluid must be cleaned thoroughly before proceeding to the next step.
- Apply disinfectant to the area.
- Allow adequate contact time. (Approximately 10 minutes to help ensure bloodborne pathogens are killed.)
- Wipe up and clean again with soap and water.
- Properly dispose of clean-up materials into biohazard waste bags/containers.
- Remove gloves and place gloves in the re-bagged waste, but put on a new pair of gloves before doing so.
- Bring the biohazard waste containers to the local hospital for proper disposal or call the EPCS Safety Director at (406) 869-2082 or on her cell at (406) 839-6026 or contact your Supervisor to find out where the biohazard waste can be disposed of.
- Wash your hands according to the bloodborne pathogens training and annual update you received.

- **Event Requiring More Than First Aid:**


- Keep the person calm and as comfortable as possible.
- Do not move the person unless absolutely necessary.
- Conduct First Aid and CPR if properly trained.
- Never give liquids to an unconscious person.
- Do not remove objects that are embedded in a person's skin.
- Keep in communication with Emergency Responders.

	Copyright 2017 EPC Services Company	Issued: September 8, 2017	Hardin Wind Energy Project Switchyard Emergency Action Plan
		Revised:	
		Reviewed:	Page 3 of 13

HARDIN WIND ENERGY PROJECT SWITCHYARD

EMERGENCY ACTION PLAN

- Make certain that the injured person is accompanied by a Supervisors or another assigned person to the clinic / emergency room and stay with the person until all treatment has been completed.
- Always be aware of Bloodborne Pathogens and utilize First-Aid training techniques.
 - **Blood or Bodily Fluids Clean-Up / Bloodborne Pathogens**
 - Request the hazardous waste be cleaned up by the professional responders (EMT's, Police, Sheriff, etc.) responding to the incident. Give gloves and anything that was used during First Aid / CPR, etc. to the professional responders for hazardous waste disposal.
 - No one is to clean up a blood/body fluid spill as part of their job until they have had initial bloodborne pathogens training from their employer which must be updated annually.
 - Anyone who does not feel comfortable cleaning up a spill can call the EPCS Safety Director at (406) 869-2082 or on her cell at (406) 839-6026 or contact their Supervisor.
 - Warn others in the area and isolate the contaminated area. (Prevent others from walking through or near the spill.)
 - Put on personal protective equipment (PPE) appropriate for the spill size. (e.g., double set of gloves, safety goggles, etc.).
 - Remove glass or sharps, if necessary, with forceps, tongs or scoop and place in a red sharps container or red bucket.
 - For a wet spill, cover with disinfectant-soaked absorbent towels, wipe, and remove toweling. (This decreases the likelihood of causing a splash.) Any visible blood or body fluid must be cleaned thoroughly before proceeding to the next step.
 - Apply disinfectant to the area.
 - Allow adequate contact time. (Approximately 10 minutes to help ensure bloodborne pathogens are killed.)
 - Wipe up and clean again with soap and water.
 - Properly dispose of clean-up materials into biohazard waste bags/containers.
 - Remove gloves and place gloves in the re-bagged waste, but put on a new pair of gloves before doing so.
 - Bring the biohazard waste containers to the local hospital for proper disposal or call the EPCS Safety Director at (406) 869-2082 or on her cell at (406) 839-6026 or contact your Supervisor to find out where the biohazard waste can be disposed of.
- **FIRST AID:**
 - Keep the person calm and comfortable as possible.
 - Conduct First-Aid if properly trained.
 - Always be aware of Bloodborne Pathogens and utilize First-Aid training techniques.
 - **Blood or Bodily Fluids Clean-Up / Bloodborne Pathogens**

	Copyright 2017 EPC Services Company	<i>Issued: September 8, 2017</i>	Hardin Wind Energy Project Switchyard Emergency Action Plan
		<i>Revised:</i>	
		<i>Reviewed:</i>	Page 4 of 13


HARDIN WIND ENERGY PROJECT SWITCHYARD EMERGENCY ACTION PLAN

- Request the hazardous waste be cleaned up by the professional responders (EMT's, Police, Sheriff, etc.) responding to the incident. Give gloves and anything that was used during First Aid / CPR, etc. to the professional responders for hazardous waste disposal.
- No one is to clean up a blood/body fluid spill as part of their job until they have had initial bloodborne pathogens training from their employer which must be updated annually.
- Anyone who does not feel comfortable cleaning up a spill can call the EPCS Safety Director at (406) 869-2082 or on her cell at (406) 839-6026 or contact their Supervisor.
- Warn others in the area and isolate the contaminated area. (Prevent others from walking through or near the spill.)
- Put on personal protective equipment (PPE) appropriate for the spill size. (e.g., double set of gloves, safety goggles, etc.).
- Remove glass or sharps, if necessary, with forceps, tongs or scoop and place in a red sharps container or red bucket.
- For a wet spill, cover with disinfectant-soaked absorbent towels, wipe, and remove toweling. (This decreases the likelihood of causing a splash.) Any visible blood or body fluid must be cleaned thoroughly before proceeding to the next step.
- Apply disinfectant to the area.
- Allow adequate contact time. (Approximately 10 minutes to help ensure bloodborne pathogens are killed.)
- Wipe up and clean again with soap and water.
- Properly dispose of clean-up materials into biohazard waste bags/containers.
- Remove gloves and place gloves in the re-bagged waste, but put on a new pair of gloves before doing so.
- Bring the biohazard waste containers to the local hospital for proper disposal or call the EPCS Safety Director at (406) 869-2082 or on her cell at (406) 839-6026 or contact your Supervisor to find out where the biohazard waste can be disposed of.
- Wash your hands according to the bloodborne pathogens training and annual update you received.

▪ **FIRE/EXPLOSION:**

• **FIRE**


- Sound fire/air horn alarm or call / radio all jobsite employees to evacuate.
- Evacuate / rescue people from the immediate area of smoke and/or fire. Make people aware that there is an actual fire within the jobsite.
- Extinguish the fire using the appropriate fire extinguisher for the type of fire being fought if it is ***SMALL, CONTAINED AND NOT SPREADING BEYOND THE IMMEDIATE AREA.***
- ***IF FIRE IS NOT CONTAINED AND SPREADING BEYOND THE IMMEDIATE AREA Call 9-1-1***

	Copyright 2017 EPC Services Company	Issued: September 8, 2017	Hardin Wind Energy Project Switchyard Emergency Action Plan
		Revised:	
		Reviewed:	Page 5 of 13

HARDIN WIND ENERGY PROJECT SWITCHYARD

EMERGENCY ACTION PLAN

- Provide your name, location of the emergency, telephone number from which you are calling and type of emergency you are reporting (e.g., fire, hazardous chemical spill) to the 9-1-1 Operator.
- Gather at the EPCS Main Site Office Trailer and account for all employees and to receive further information. Do not leave the EPCS Main Site Office Trailer area unless directed to do so by your supervisor or the EPCS Construction Site Manager or the EPCS Site Safety Manager.
- Report any unaccounted for employees to the Emergency Responders.
- Do not re-enter the jobsite until instructed to do so by emergency responders.
- **EXPLOSION**
 - Sound fire/air horn alarm or call / radio all jobsite employees to evacuate.
 - Evacuate / rescue people from the immediate area of smoke and/or fire. Make people aware that there is an actual explosion within the jobsite.
 - **CALL 9-1-1**
 - Provide your name, location of the emergency, telephone number from which you are calling and type of emergency you are reporting (e.g., explosion, fire, etc.) the 9-1-1 Operator.
 - Gather at the EPCS Main Site Office Trailer and account for all employees and to receive further information. Do not leave the EPCS Main Site Office Trailer area unless directed to do so by your supervisor or the EPCS Construction Site Manager or the EPCS Site Safety Manager.
 - Report any unaccounted for employees to the Emergency Responders.
 - Do not re-enter the jobsite until instructed to do so by emergency responders.
- **SEVERE WEATHER:**
WHAT TO DO . . .
 - **Before Severe Weather**
 - Listen to a weather alert radio or to commercial radio, television newscasts or <http://www.noaa.gov/wx.html> for the latest information.
 - Know how you will be warned in an emergency.
 - Know if you work in a flood prone area. Check with your local emergency management for details.
 - Know where to shelter if conditions warrant
 - Keep fire extinguishers on hand and make sure everyone knows how to use them.
 - **During Severe Weather**
 - Keep an eye on the sky. Look for darkening skies, flashes of light or increasing wind. Listen for the sound of thunder. If you can hear thunder, you are close enough to be struck by lightning.

	Copyright 2017 EPC Services Company	<i>Issued: September 8, 2017</i>	Hardin Wind Energy Project Switchyard Emergency Action Plan
		<i>Revised:</i>	
		<i>Reviewed:</i>	Page 6 of 13


HARDIN WIND ENERGY PROJECT SWITCHYARD EMERGENCY ACTION PLAN

- Blowing debris or the sound of an approaching tornado may alert you. Tornado danger signs include dark, almost greenish sky; large hail; a large, dark, low-lying cloud or a loud roar, similar to a freight train.
- Heed shelter or evacuation requests made by the officials or announcements on radio/television.
- Close outside doors and window blinds, shades or curtains. Stay away from doors, windows, and exterior walls.
- Stay in the shelter location until the danger has passed.
- During lightning, do not use wired telephones, touch electrical appliances or use running water. Cordless or cellular telephones are safe to use.
- Remember the 30/30 Lightning Safety Rule: Go indoors if, after seeing lightning, you cannot count to 30 before hearing thunder. Stay indoors for 30 minutes after hearing the last clap of thunder.
- If it has been raining hard for several hours, or steadily raining for several days, be alert to the possibility of a flood.

• After Severe Weather

- Do not walk through flowing water. Drowning is the number one cause of flood deaths. Six inches of swiftly moving water can knock you off your feet.
- Stay indoors and limit travel to only absolutely necessary trips. Listen to radio/television for updates.
- Stay off roads to allow emergency crews to clear roads and provide emergency assistance.
- Help injured or trapped persons. Do not attempt to move seriously injured persons unless they are in immediate danger of death or further injury.
- Use the telephone only for emergencies.
- Use care around downed power lines. Assume a downed wire is a live wire. Report to emergency authorities.
- Watch out for overhead hazards such as broken tree limbs, wires and other debris. Be cautious walking around.
- Avoid walking into flood waters. The water may be contaminated by oil, gasoline or raw sewage, contain downed power lines or animals.
- Look for hazards such as broken/leaking gas lines, damaged sewage systems, flooded electrical circuits, submerged appliances and structural damage. Leave the area if you smell gas or chemical fumes.
- Listen to media reports and/or local authorities about whether your community water supply is safe to drink and other instructions.

▪ TORNADO

	Copyright 2017 EPC Services Company	<i>Issued: September 8, 2017</i>	Hardin Wind Energy Project Switchyard Emergency Action Plan
		<i>Revised:</i>	
		<i>Reviewed:</i>	<i>Page 7 of 13</i>

HARDIN WIND ENERGY PROJECT SWITCHYARD EMERGENCY ACTION PLAN

WHAT TO DO

• Before A Tornado

- Listen to a weather alert radio or to commercial radio or television newscasts for the latest information.
- Be alert to changing weather conditions. Look for approaching storms.
- Look for the following danger signs:
 - Dark, often greenish sky.
 - Large hail.
 - A large, dark, low-lying cloud (particularly if rotating).
 - If you see approaching storms or any of the danger signs, be prepared to take shelter immediately.

IF YOU ARE

• At Work

- Go to the basement or to an inside hallway at the lowest level.
- Avoid places with wide-span roofs, such as auditoriums, cafeterias or large hallways.
- Get under a piece of sturdy furniture, such as a heavy table or desk, and hold on to it.
- Use your arms to protect your head and neck.
- Do not open windows.
- **In A Pole Building / Jobsite Trailer / Camper / Motorhome (The Worst Place You Can Be During a Tornado)**
 - Get out IMMEDIATELY and go to a sturdy, nearby building or a storm shelter.
 - If there is no nearby building or a storm shelter, go to the nearest low lying ditch and get on your knees making sure you put your head on your lap and cover your head and neck with your arms.

• Outdoors


- If possible, get inside a building.
- If shelter is not available or there is no time to get indoors, lie in a ditch or low-lying area or crouch near a strong building. Be aware of the potential for flooding.
- Use your arms to protect your head and neck.

• In a car

- Never try to out-drive a tornado in a car or truck. Tornadoes can change direction quickly and can lift and toss your vehicle through the air.
- Leave the car immediately, and take shelter in a nearby building.
- If there is no time to get indoors, get out of the car and lie in a ditch or low-lying area away from the vehicle. Be aware of the potential for flooding.

• After A Tornado

- Help injured or trapped persons.

	Copyright 2017 EPC Services Company	Issued: September 8, 2017	Hardin Wind Energy Project Switchyard Emergency Action Plan
		Revised:	
		Reviewed:	Page 8 of 13

HARDIN WIND ENERGY PROJECT SWITCHYARD

EMERGENCY ACTION PLAN

- Give first aid when appropriate. Don't move the seriously injured unless they are in immediate danger of further injury. Call for help.
- Turn on radio or television to get the latest information.
- Stay out of damaged buildings. Return to the building only when authorities say it is safe.
- Use the telephone only for emergency calls.

■ THUNDERSTORMS AND LIGHTNING


WHAT TO DO . . .

• BEFORE A THUNDERSTORMS AND LIGHTNING

- Remember the 30/30 Lightning Safety Rule: Go indoors if, after seeing lightning, you cannot count to 30 before hearing thunder. Stay indoors for 30 minutes after hearing the last clap of thunder.
- Secure outdoor objects that could blow away or cause damage.
- Get inside a home, building or hard top automobile (not a convertible). Although you may be injured if lightning strikes your car, you are much safer inside a vehicle than outside.
- Remember, rubber-soled shoes and rubber tires provide NO protection from lightning. However, the steel frame of a hard-topped vehicle provides increased protection if you are not touching metal.
- Shutter windows and secure outside doors. If shutters are not available, close window blinds, shades or curtains.
- Unplug any electronic equipment well before the storm arrives.

• During Thunderstorms and Lightning


- Use a battery-operated NOAA Weather Radio for updates from local officials.
- Avoid contact with corded phones. Use a corded telephone only for emergencies. Cordless and cellular telephones are safe to use.
- Avoid contact with electrical equipment or cords. Unplug appliances and other electrical items such as computers, and turn off air conditioners. Power surges from lightning can cause serious damage.
- Avoid contact with plumbing. Do not wash your hands or use water. Plumbing and bathroom fixtures can conduct electricity.
- Stay away from windows and doors, and stay off porches.
- Do not lie on concrete floors, and do not lean against concrete walls.
- Avoid natural lightning rods such as a tall, isolated tree in an open area.
- Avoid hilltops or open fields.
- Take shelter in a sturdy building. Avoid isolated sheds or other small structures in open areas.
- Avoid contact with anything metal—tractors or equipment.

	Copyright 2017 EPC Services Company	Issued: September 8, 2017	Hardin Wind Energy Project Switchyard Emergency Action Plan
		Revised:	
		Reviewed:	Page 9 of 13

HARDIN WIND ENERGY PROJECT SWITCHYARD

EMERGENCY ACTION PLAN


- If you are driving, try to safely exit the roadway and park. Stay in the vehicle and turn on the emergency flashers until the heavy rain ends. Avoid touching metal or other surfaces that conduct electricity in and outside the vehicle.
- **In a Forest**
 - Seek shelter in a low area under a thick growth of small trees.
- **In An Open Area**
 - Go to a low place such as a ravine or valley. Be alert for flash floods.
 - Get to land and find shelter immediately.
 - Anywhere you feel your hair stands on end (which indicates that lightning is about to strike) Squat low to the ground on the balls of your feet. Place your hands over your ears and your head between your knees. Make yourself the smallest target possible. DO NOT lie flat on the ground.
- **After a Thunderstorm or Lightning Strike**
 - If lightning strikes you or someone you know, call **9-1-1** for medical assistance as soon as possible.
 - The following are things you should check when you attempt to give aid to a victim of lightning:
 - Breathing - If breathing has stopped, begin mouth-to-mouth resuscitation.
 - Heartbeat - If the heart has stopped, administer CPR.
 - Pulse - If the victim has a pulse and is breathing, look for other possible injuries. Check for burns where the lightning entered and left the body. Also be alert for nervous system damage, broken bones, and loss of hearing and eyesight.
 - Never drive through a flooded roadway.
 - Stay away from storm-damaged areas to keep from putting yourself at risk from the effects of severe thunderstorms.
 - Continue to listen to a NOAA Weather Radio or to local radio and television stations for updated information or instructions, as access to roads or some parts of the community may be blocked.
 - Help people who may require special assistance or those with access or functional needs.
 - Stay away from downed power lines and report them immediately.
- **FALL RESCUE PLAN:**
 - **Self-Rescue**
 - Climb back up to the level from which he/she fell.
 - Return to the ground to be evaluated for possible medical attention per OSHA.
 - Remove all components of fall arrest system impacted by the fall event from service and document (bag and tag) the components with name, date and activity at time of fall and give the equipment to your Supervisor.
 - **Assisted Self Rescue with Mechanically Aided Hauling/Rope System**
 - A haul-line may be swung over or lowered to the fallen worker, who will grab the rescue lifeline snap hook and secure it to the appropriate D-ring on his body support. A positive connection to the D-ring must be verified by one of the rescue team members.

	Copyright 2017 EPC Services Company	Issued: September 8, 2017	Hardin Wind Energy Project Switchyard Emergency Action Plan
		Revised:	
		Reviewed:	Page 10 of 13

HARDIN WIND ENERGY PROJECT SWITCHYARD


EMERGENCY ACTION PLAN

- The rescue team will raise or lower the fallen employee to the appropriate work platform or ground and provide medical aid as required by OSHA.
- Remove all components of fall arrest system impacted by the fall event from service and document (bag and tag) the components with name, date and activity at time of fall and give the equipment to management.
- In the unlikely event that a fall arrest occurs on-site, personnel with the use of an articulating man lift or ladders where feasible, will rescue all employees. Alternate rescue would be through the local emergency services.
- If the worker's injuries prevent the worker from attaching to the rescue system, both self-rescue and assisted self-rescue are not options, and a fully Assisted Rescue is necessary.
- A rescue team member must attach the haul line to the worker's fall arrest system. This can be performed by accessing the fallen worker and then attaching the rescue system directly to a D-ring on the worker's harness, or by using a rescue pole for the attachment. The rescue team could also attach a rescue grab to the lanyard or vertical lifeline.
- The rescue team must raise or lower the fallen worker to the appropriate work platform or ground and provide medical aid as required by OSHA.
- Remove all components of fall arrest system impacted by the fall event from service and document (bag and tag) the components with name, date and activity at time of fall and give the equipment to management.
- **Assisted Rescue with Mechanically Aided Aerial Lift**
 - A rescuer will get into an aerial lift and make sure there is a second fall protection device, such as a shock absorbing lanyard or self-retracting lifeline available for the fallen worker.
 - The aerial lift must be maneuvered into position (raised up underneath the fallen worker) so that the rescuer can perform the rescue.
 - Attach the second lanyard or self-retracting lifeline in the aerial lift to the fallen worker.
 - Disconnect the rescued worker from the impacted fall arrest equipment.
 - Lower the worker to the ground and provide medical aid as required by OSHA.
 - Remove all components of fall arrest system impacted by the fall event from service and document (bag and tag) the components with name, date and activity at time of fall and give the equipment to management.
- **DIG-IN**
 - If you damage a natural gas line and gas is released, evacuate the area immediately and **Call 9-1-1**.
 - In the event that you smell natural gas, damage an underground facility or witness a damaged underground facility, encounter a downed power line or come across any situation that you feel may cause imminent danger, please **Call 9-1-1** or contact the utility company directly.
- **SPILL**
 - If you are ABLE to clean up the spill without assistance, adhere to the following steps:

	Copyright 2017 EPC Services Company	Issued: September 8, 2017	Hardin Wind Energy Project Switchyard Emergency Action Plan
		Revised:	
		Reviewed:	Page 11 of 13

HARDIN WIND ENERGY PROJECT SWITCHYARD EMERGENCY ACTION PLAN

- If the chemical spilled is a **LIQUID**, respond as follows:
 - Identify the chemical spilled to determine if you are capable of cleaning up the spill safely.
 - Refer to the container label and Safety Data Sheet (SDS) for instructions on cleaning up the spill.
 - Don (put on) the appropriate personal protective equipment before cleaning up the spill.
 - Apply absorbent material as follows:
 - Encircle the chemical spill with absorbing material.
 - Once spill has been encircled, apply absorbing material to center of spill.
 - Sweep/shovel up spilled material and ensure area is completely clean.
 - Dispose of all materials (e.g., gloves, brooms, paper towels) used to clean up the spill inside a sealed, leak proof bag or container (e.g., zip lock bag, taped plastic bag).
 - Label and dispose of all bags or containers as hazardous waste.
 - Contact the EPCS Construction Site Manager or Site Safety Manager to arrange for hazardous waste collection/disposal.
- If chemical spilled is a **POWDER**, respond as follows:
 - Identify the chemical spilled to determine if you are capable of cleaning up the spill safely.
 - Refer to the container label and Safety Data Sheet (SDS) for instructions on cleaning up the spill.
 - Don the appropriate personal protective equipment before cleaning up the spill.
 - Sweep up spilled material carefully to prevent generation of dust.
 - Place in a sealed container (e.g., zip lock gab, taped plastic bag) and label container with its contents;
 - Dispose of all materials (e.g., gloves, brooms, paper towels) used to clean up the spill inside a sealed, leak proof bag or container (e.g., zip lock bag, taped plastic bag);
 - Label and dispose of all bags or containers as hazardous waste;
 - Contact the EPCS Construction Site Manager or Site Safety Manager to arrange for hazardous waste collection.

	Copyright 2017 EPC Services Company	Issued: September 8, 2017	Hardin Wind Energy Project Switchyard Emergency Action Plan
		Revised:	
		Reviewed:	Page 12 of 13

HARDIN WIND ENERGY PROJECT SWITCHYARD EMERGENCY ACTION PLAN

EMERGENCY ACTION PLAN REVIEW LOG:

The following employees have reviewed the Emergency Action Plan for this site and verify that they understand and will abide by all the policies and procedures outlined.

[illegible]


From: **Hardin Wind Energy Project Switchyard**
13657 Township Rd. 65
Belle Center OH 43310
GPS Coord.: 40.6321734335 -83.7917382057

Drive Time: 13.9 Miles - 22 Minutes

To: **Ohio Health Hardin Memorial Hospital**
921 E. Franklin St.
Kenton OH 43326

Hours of Operation
24 Hours A Day
7 Days A Week

Phone: **Emergency: 9-1-1; Non-Emergency: (419) 673-0761**

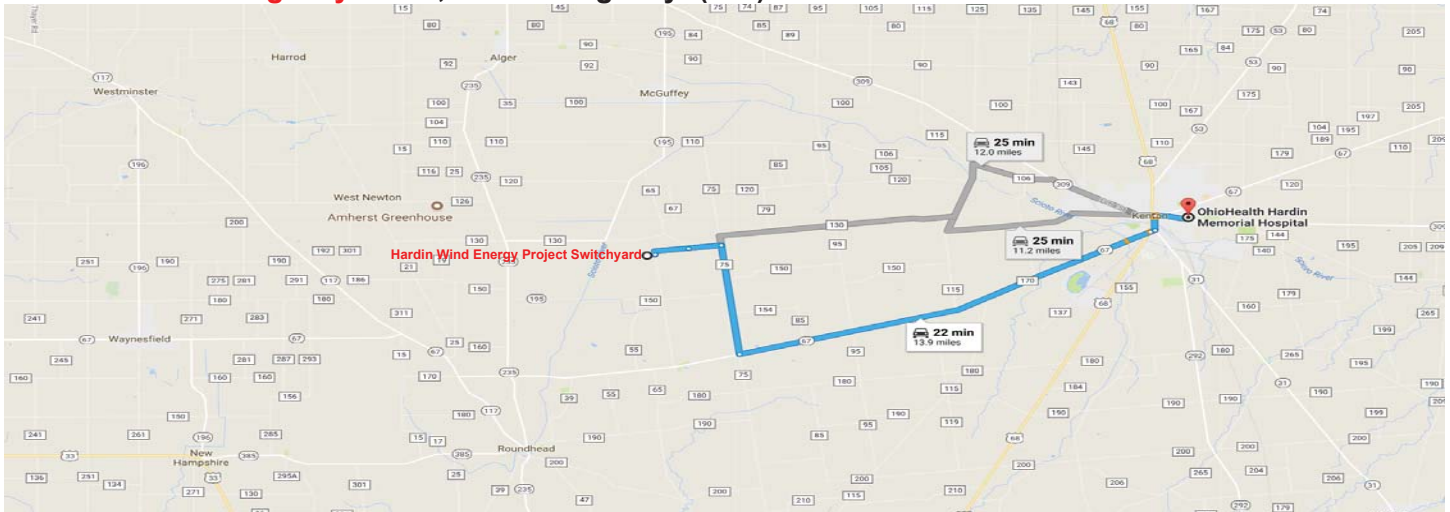

40.632173, -83.791738

Take Co Rd 75 to OH-67 E

8 min (4.2 mi)

↑ 1. Head north on Dodds Rd toward Co Rd 130

0.7 mi

↑ 2. Continue onto Co Rd 130

0.6 mi

➤ 3. Turn right onto Co Rd 130/Co Rd 75

[Continue to follow Co Rd 75](#)

2.8 mi

Continue on OH-67 E to Kenton

13 min (9.6 mi)

↶ 4. Turn left onto OH-67 E

8.5 mi

↑ 5. Continue straight onto W Espy St

0.1 mi

↶ 6. Turn left onto S Main St


0.4 mi

➤ 7. Turn right onto E Franklin St


0.6 mi

Continue on Memorial Ave to your destination

45 s (0.1 mi)

 8. Turn left onto Memorial Ave

459 ft

 9. Turn right

161 ft

OhioHealth Hardin Memorial Hospital


921 E Franklin St, Kenton, OH 43326

From: **Hardin Wind Energy Project Switchyard**
13657 Township Rd. 65
Belle Center OH 43310
GPS Coord.: 40.6321734335 -83.7917382057

Drive Time: 22.4 Miles - 35 Minutes

To: **St. Rita's Occupational Health Clinic**
1875 S. Dixie Hwy.
Lima OH 45804
Phone: **Non-Emergency: (419) 226-9720**

Hours of Operation
Monday - Friday
7:30 a.m. - 4 p.m.

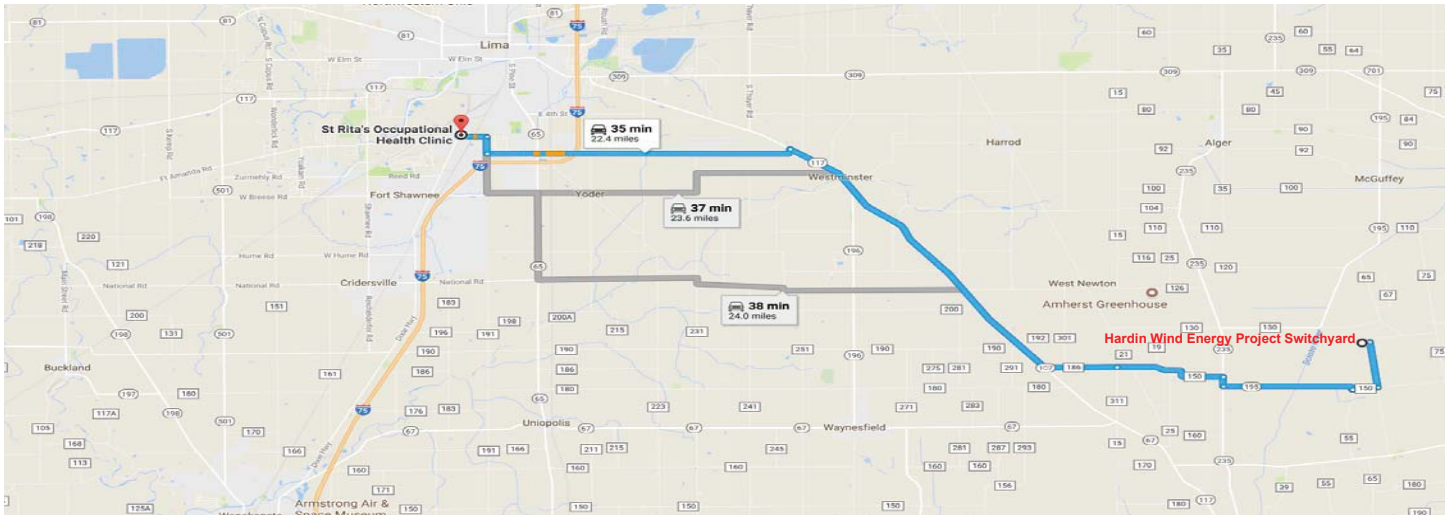

40.632173, -83.791738

Take Co Rd 150 to OH-235 N in Roundhead Township

- ↑ 1. Head south on Dodds Rd toward Co Rd 150
9 min (4.2 mi)
- ➡ 2. Turn right at the 1st cross street onto Co Rd 150
1.2 mi
- ➡ 3. Turn right to stay on Co Rd 150
0.5 mi
- ➡ 4. Turn right onto OH-235 N
2.5 mi
- ➡ 5. Turn right onto OH-235 N
25 s (0.2 mi)

Continue on Co Rd 150 to Wayne Township

- ⬅ 5. Turn left onto Co Rd 150/Township Rd 150
6 min (3.5 mi)
[Continue to follow Co Rd 150](#)
- ↑ 6. Continue onto Gossard East Rd
2.2 mi
- ↑ 7. Continue onto Gossard East Rd
1.4 mi

- 7. Turn right onto OH-117 W
8 min (7.5 mi)
- ↶ 8. Turn left onto E Hanthorn Rd
10 min (5.9 mi)

Take Buckeye Rd to S Dixie Hwy

- 9. Turn right onto McClain Rd
2 min (1.0 mi)
- ↶ 10. Turn left onto Buckeye Rd
0.4 mi
- 11. Turn right at the 1st cross street onto S Dixie Hwy
[Destination will be on the right](#)
0.5 mi
- 11 s (292 ft)

St Rita's Occupational Health Clinic

1875 S Dixie Hwy, Lima, OH 45804


From: **Hardin Wind Energy Project Switchyard**
13657 Township Rd. 65
Belle Center OH 43310
GPS Coord.: 40.6321734335 -83.7917382057

Drive Time: 14.3 Miles - 24 Minutes

To: **Lima Memorial Walk-In Care - Kenton Medical Center**
1211 E. Columbus St.
Kenton OH 43326
Phone: **Non-Emergency: (419) 675-0668**

Hours of Operation

Monday - Friday: 8 a.m. - 8 p.m.
Saturday: 8 a.m. - 2 p.m.

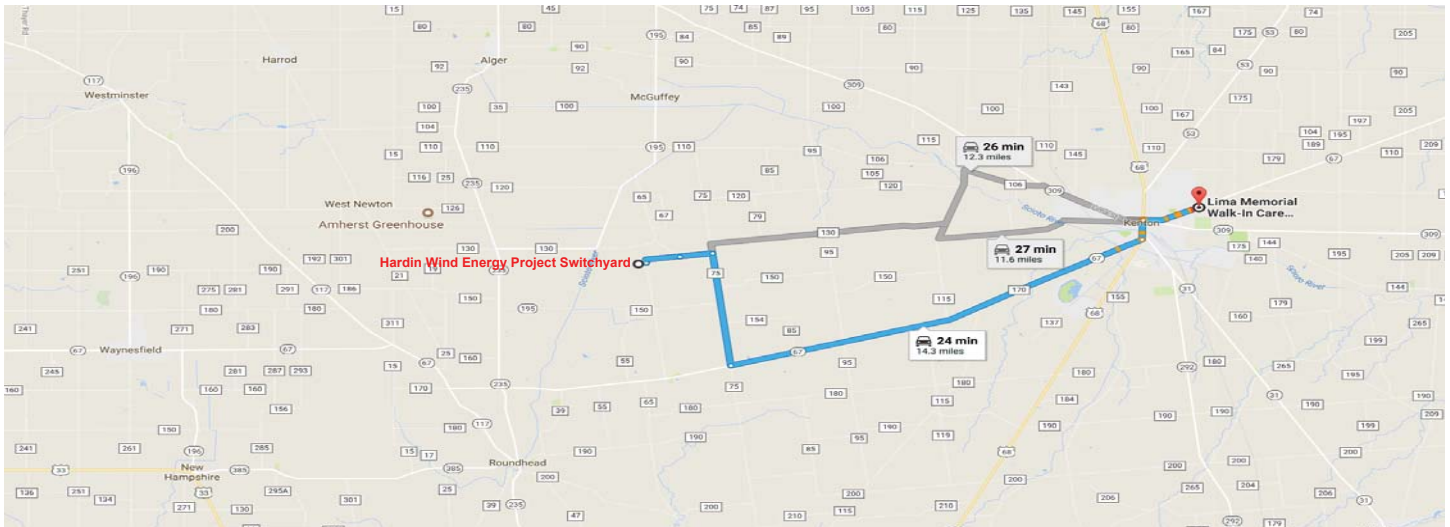

40.632173, -83.791738

- ↑ 1. Head north on Dodds Rd toward Co Rd 130
0.7 mi
- ↑ 2. Continue onto Co Rd 130
0.6 mi
- 3. Turn right onto Co Rd 130/Co Rd 75
Continue to follow Co Rd 75
2.8 mi
- ↶ 4. Turn left onto OH-67 E
8.5 mi
- ↶ 5. Turn left onto S Detroit St/Fontaine St
Continue to follow S Detroit St
0.5 mi
- 6. Turn right onto W Columbus St/Courthouse Square
Continue to follow W Columbus St
1.1 mi

Lima Memorial Walk-In Care - Kenton Medical Center
1211 E Columbus St, Kenton, OH 43326

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

1/4/2018 4:30:26 PM

in

Case No(s). 09-0479-EL-BGN, 11-3446-EL-BGA, 16-0469-EL-BGA, 16-2404-EL-BGA

Summary: Notice of Compliance with Certificate Condition #55—Supplemental Emergency
Action Plan
electronically filed by Mr. William V Vorys on behalf of Hardin Wind Energy LLC