



COLUMBUS | CLEVELAND
CINCINNATI | DAYTON
MARIETTA

BRICKER & ECKLER LLP
100 South Third Street
Columbus, OH 43215-4291
MAIN: 614.227.2300
FAX: 614.227.2390

www.bricker.com
info@bricker.com

Sally W. Bloomfield
614.227.2368
sbloomfield@bricker.com

March 1, 2018

Via Electronic Filing

Ms. Barcy McNeal
Administration/Docketing
Ohio Power Siting Board
180 East Broad Street, 11th Floor
Columbus, Ohio 43215-3793

**Re: Dominion Energy Ohio Letter of Notification for the
Chippewa Station Installation and Replacement Project,
Case No. 18-113-GA-BLN**

Dear Ms. McNeal:

On February 1, 2018, Dominion Energy Ohio ("DEO") filed a Letter of Notification for the Chippewa Station Installation and Replacement Project, Chippewa Township, Wayne County, Ohio. Attached is a copy of the letter that was sent pursuant to Ohio Administrative Code Rule 4906-6-11(C) on February 7, 2018, via first class mail to each property owner and affected tenant within the project area.

Please contact me if you have any questions.

Sincerely,

Sally W. Bloomfield

Attachment

February 7, 2018

Via First Class U.S. Mail

<NAME>

<ADDRESS>

Doylestown, OH 44230

**Re: Application of Dominion Energy Ohio
Chippewa Compressor Station Replacement Pipeline Installation Project (2018)**

OPSB Case No. 18-113-GA-BLN


Dear <NAME>:

New Pipeline Project

As we indicated to you in a prior letter, Dominion Energy Ohio (DEO) is preparing to construct a project to add two 3750hp compressor units and appurtenances to Chippewa Compressor Station located at 17045 Galehouse Road, in Doylestown, OH. In preparation for the addition of the compressor units, DEO is planning to construct eight new pipelines and relocate four existing pipelines. All relocated pipelines will be the same diameters as the original pipe. All new and relocated pipelines and compressor units will be installed on DEO property.

DEO is planning to complete the project in two phases. Phase 1 will consist of the relocation of the four existing pipelines. Phase 2 will consist of the installation of the eight new pipelines and the addition of the compressor units and appurtenances.

Map of Location of Proposed Project

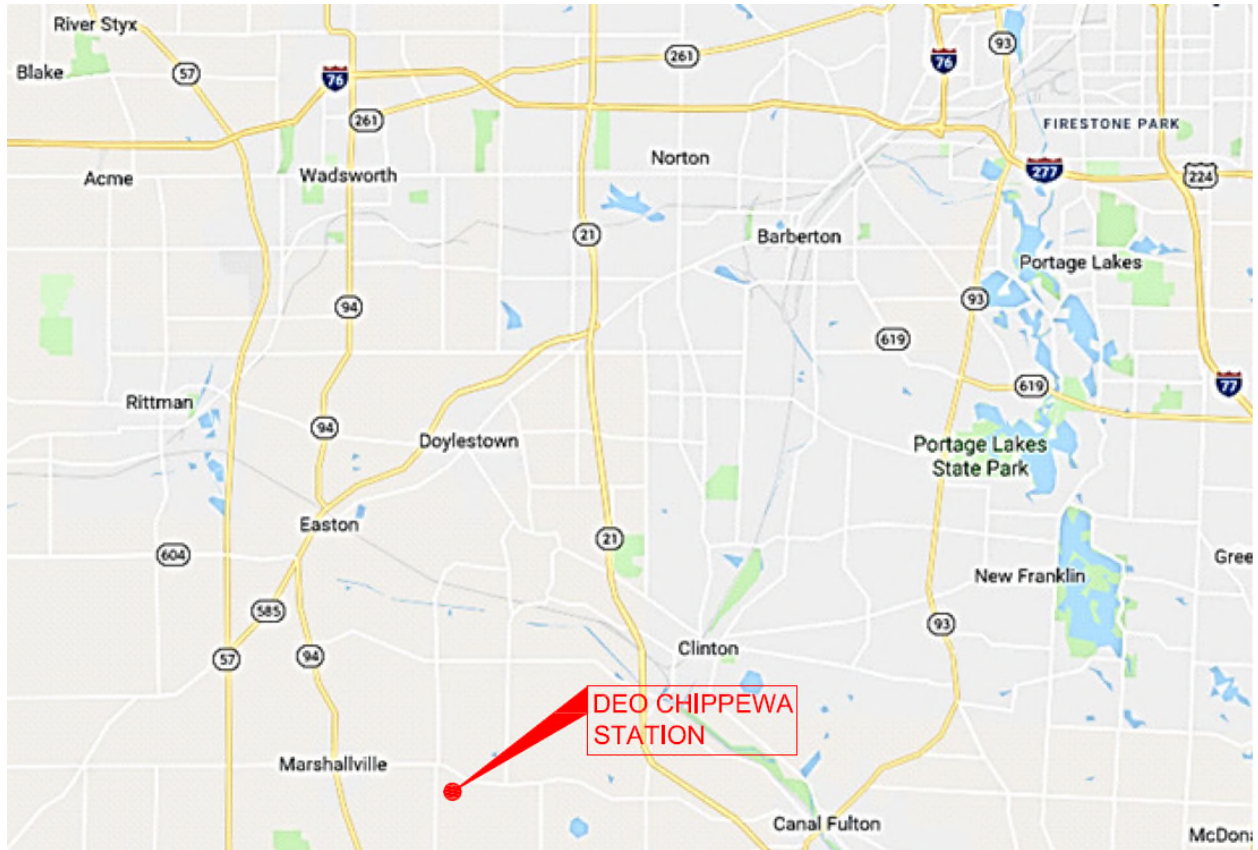

DEO Letter of Notification Pending before the Ohio Power Siting Board (OPSB)

The Letter of Notification has been filed with, and is pending before, the OPSB. It asks for authority to construct the pipeline project described above. It was assigned **Case No. 18-113-GA-BLN**.

List of Locations Where Copy of the Letter of Notification Can Be Viewed

DEO office: 320 Springside Drive, Akron, Ohio 44333

Library: Wayne County Public Library, Doylestown Branch

169 N. Portage Street, Doylestown, Ohio 44230

DEO Website: [www.dominionenergy.com/siting board](http://www.dominionenergy.com/siting%20board)

Once on that page make sure that the location at the top of the page is Ohio and then click on the case number for this case.

OPSB Website: www.opsb.ohio.gov

Scroll down to “Pending Cases” and selecting the case by name or docket number.

Filing to Participate and Comment in this Case

If you would like to participate in this proceeding, you may file a motion to intervene and/or file comments in this matter within ten (10) days from February 7, 2018. For motions to intervene, please follow the requirements of Ohio Administrative Code Rule 4906-2-12. The intervention rule is available on line at www.opsb.ohio.gov.

Tenants

If you have tenants occupying this property, please advise them of this pipeline project.

Questions

Should you have any questions concerning this pipeline project, please contact Dominion Energy Ohio’s Land Services Department at 1-855-226-6022.

Sincerely,

DOMINION ENERGY OHIO

Land Services Department

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

3/1/2018 12:14:25 PM

in

Case No(s). 18-0113-GA-BLN

Summary: Text Proof of Compliance electronically filed by Teresa Orahod on behalf of Sally W. Bloomfield