

**From:** crf450077 [<mailto:crf450077@gmail.com>]

**Sent:** Tuesday, September 25, 2018 7:45 PM

**To:** Puco ContactOPSB <[contactopsb@puco.ohio.gov](mailto:contactopsb@puco.ohio.gov)>

**Subject:** Proposed Wood County 138KV Reinforcement Project Lemoyne-Midway-Brim

My name is Rudolph Agosti Jr.

Address: 20440 Haskins Rd Bowling Green, Ohio 43402.

I'm writing in reference to Proposed Wood County 138KV Reinforcement Project Lemoyne-Midway-Brim.

I will not be able to attend the meeting on September 26th at the Middleton Township building, but I wanted to submit my opinions for the proposed project locations.

The existing transmission lines on Hull Prairie Road, and the Alternative #1 are both in residential areas, with many homes that will be negatively impacted by this project. It will reduce the value of these residential properties and ruin their view of the countryside. In addition, the community of Haskins Ohio is growing, and this would be bordering on that growth.

It seems more logical to utilize the proposed Alternative #2. This area is made of of farm fields and commercial properties, which will not be negatively impacted by a pole line running through them.

Thank you.

Rudolph Agosti Jr

Sent from my Verizon, Samsung Galaxy smartphone

LEGEND:


△ SUBSTATION

- - - ALTERNATIVE 1

- · - · - ALTERNATIVE 2

— EXISTING 138 KV TRANSMISSION LINE

0 0.5 1 MILES

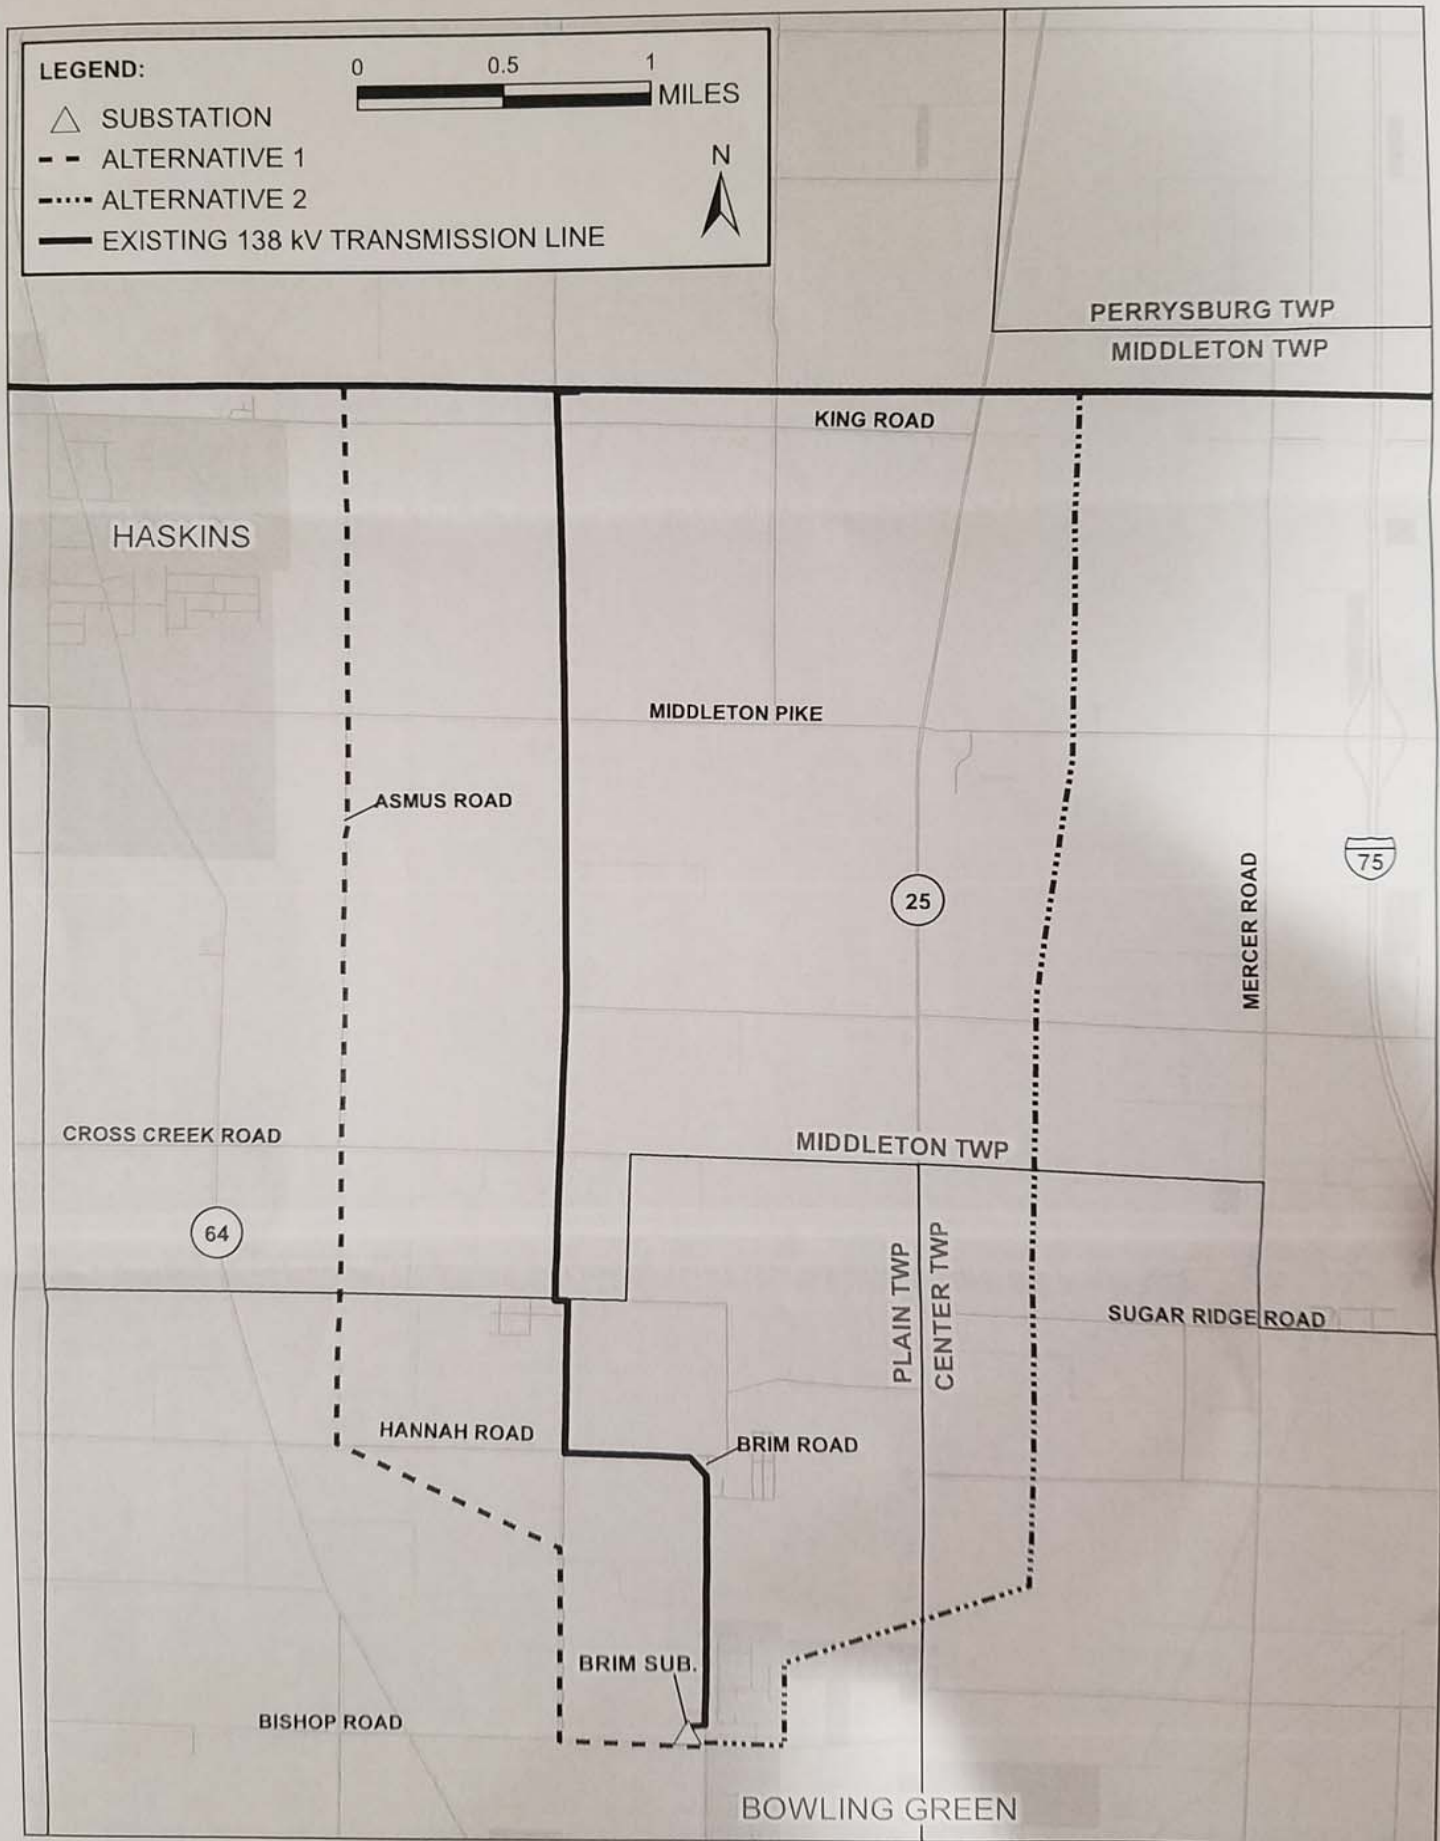

**This foregoing document was electronically filed with the Public Utilities**

**Commission of Ohio Docketing Information System on**

**9/26/2018 11:57:04 AM**

**in**

**Case No(s). 18-1335-EL-BTX**

Summary: Public Comment electronically filed by Docketing Staff on behalf of Docketing.