
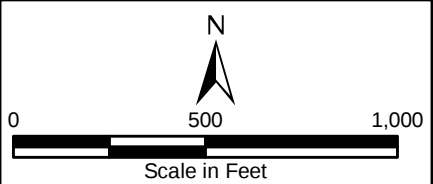


GPD Group
Path: C:\Users\laschweizen\Desktop\GIS\Amn\FirstEnergy\FE_LemoyneBrim_Aquatic_Features.mxd

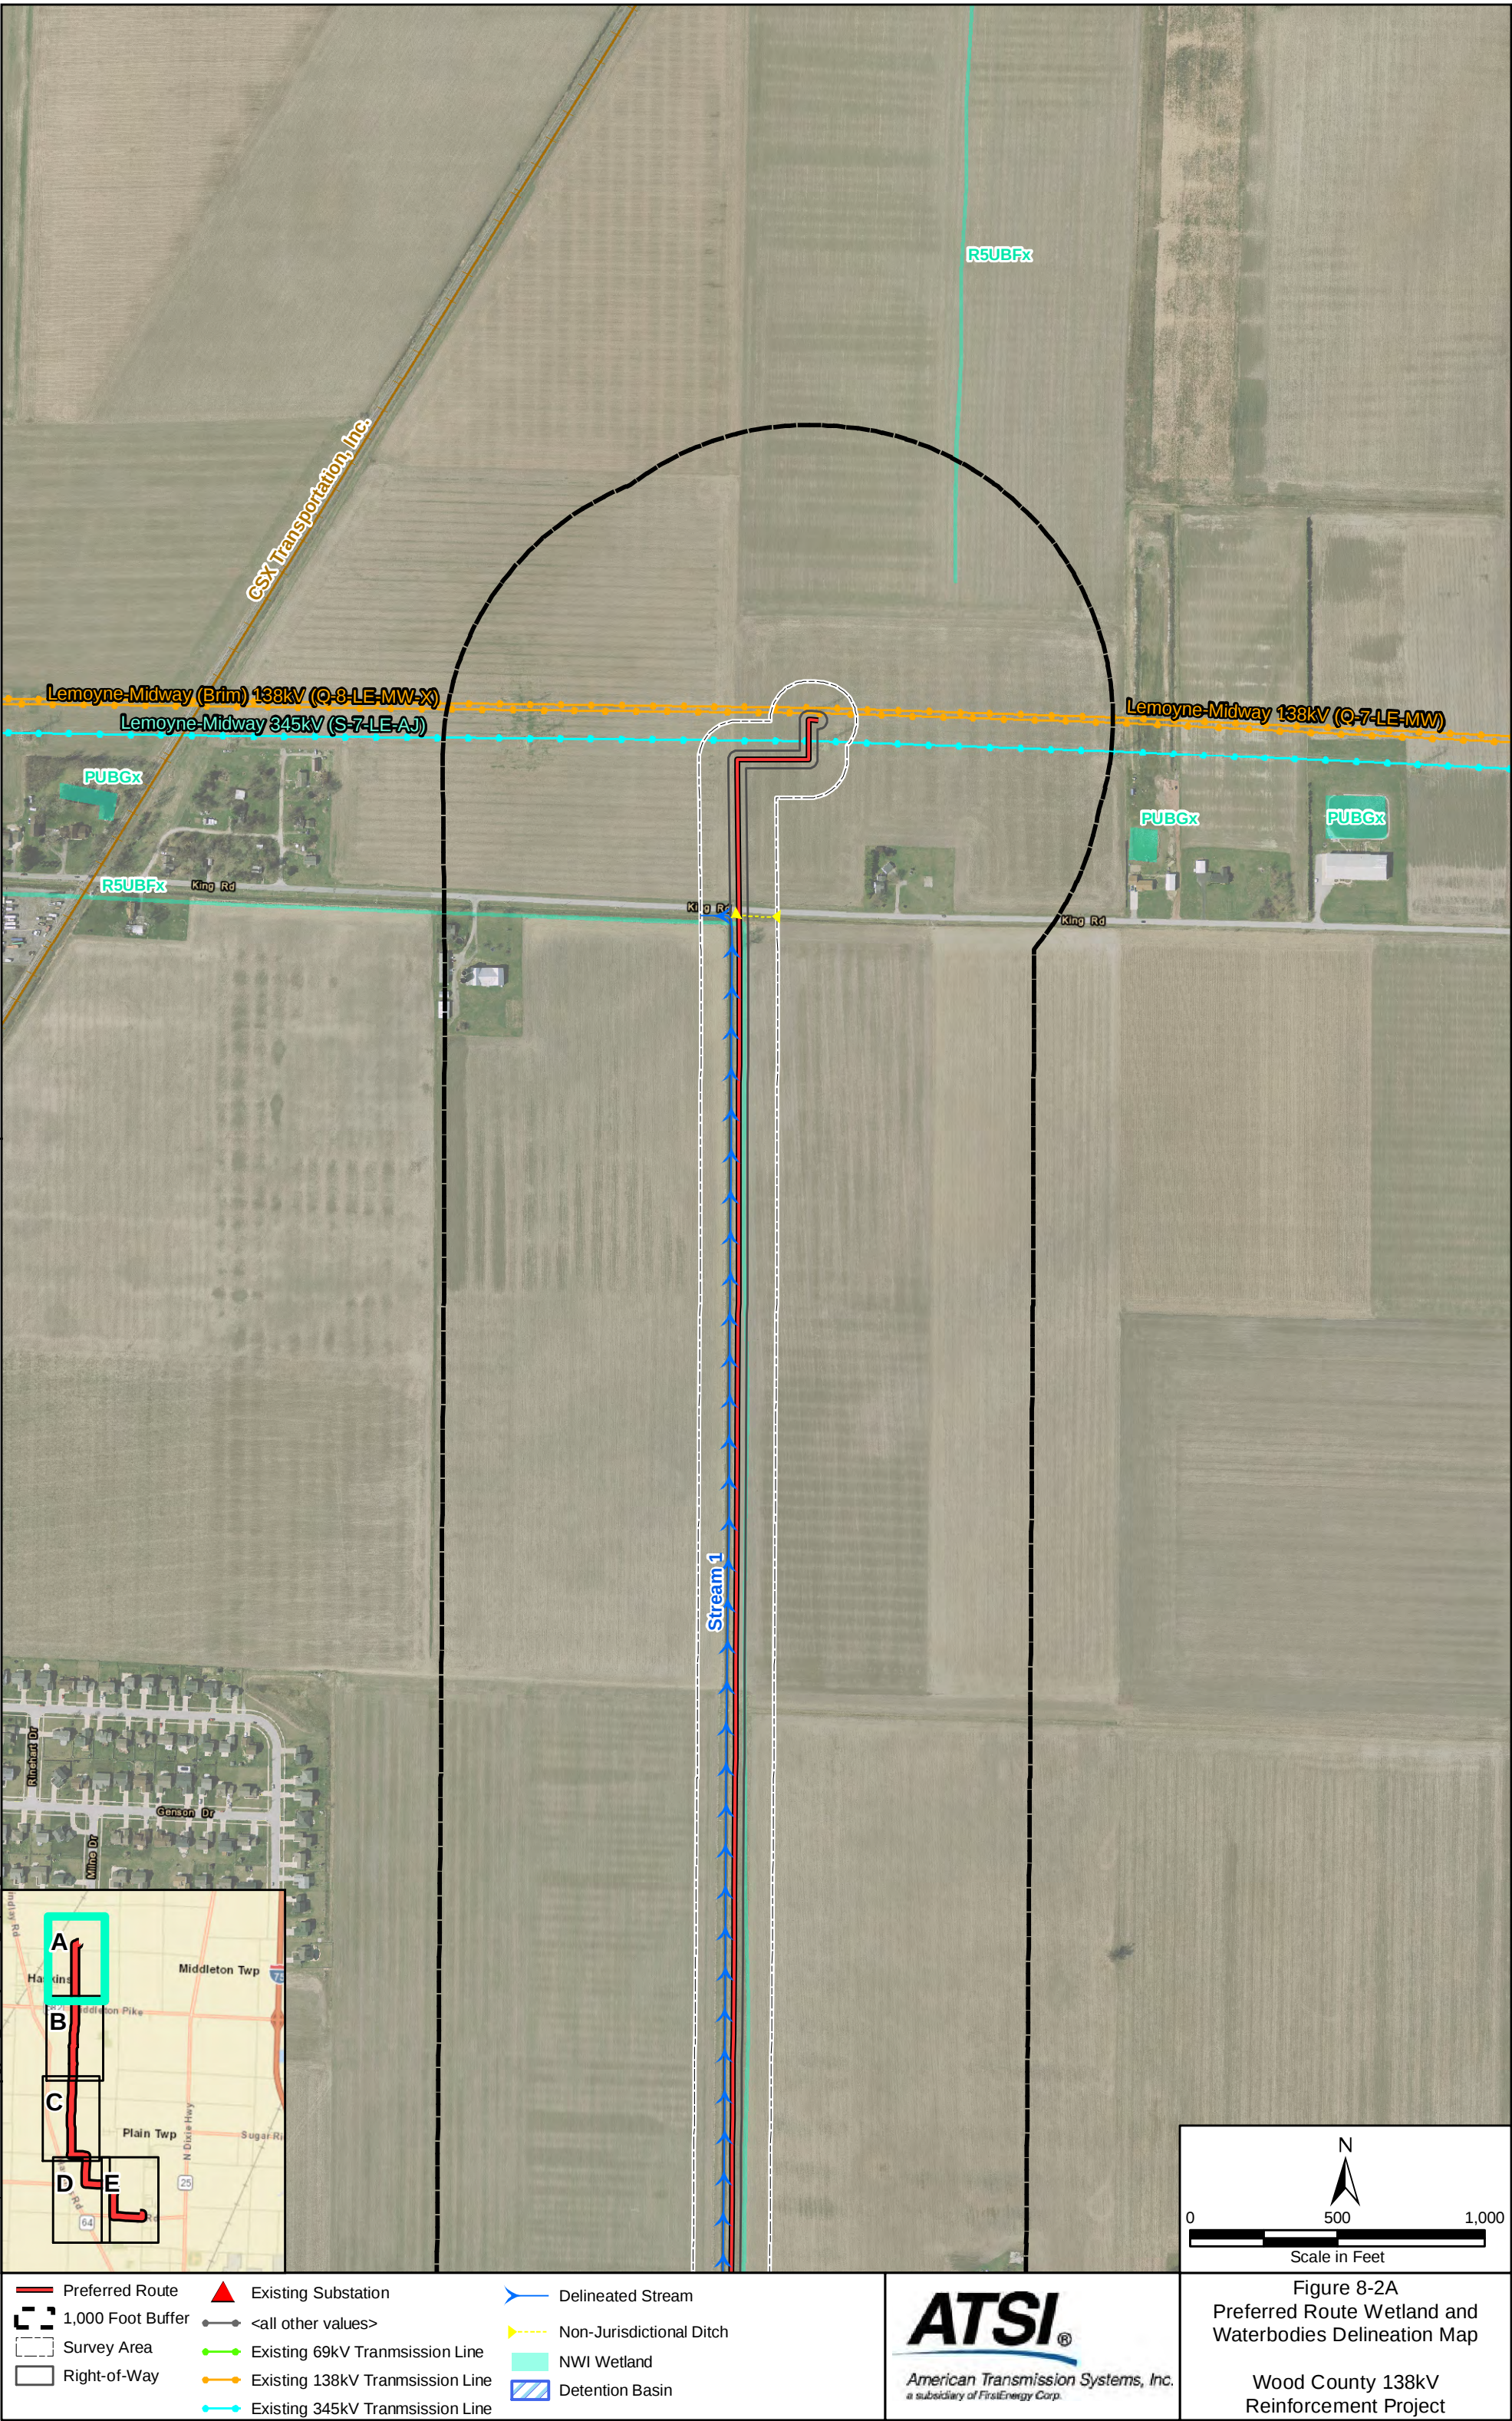


- | | | |
|-------------------|----------------------------------|--------------------------|
| Preferred Route | Existing Substation | Delineated Stream |
| 1,000 Foot Buffer | <all other values> | Non-Jurisdictional Ditch |
| Survey Area | Existing 69kV Transmission Line | NWI Wetland |
| Right-of-Way | Existing 138kV Transmission Line | Detention Basin |
| | Existing 345kV Transmission Line | |




Figure 8-2A
Preferred Route Wetland and
Waterbodies Delineation Map

Wood County 138kV
Reinforcement Project


GPD Group
Path: C:\Users\lascw@lenovo\OneDrive\GIS\Amn\FirstEnergy\FE_Lenovo\Brim_Aquatic_Features.mxd

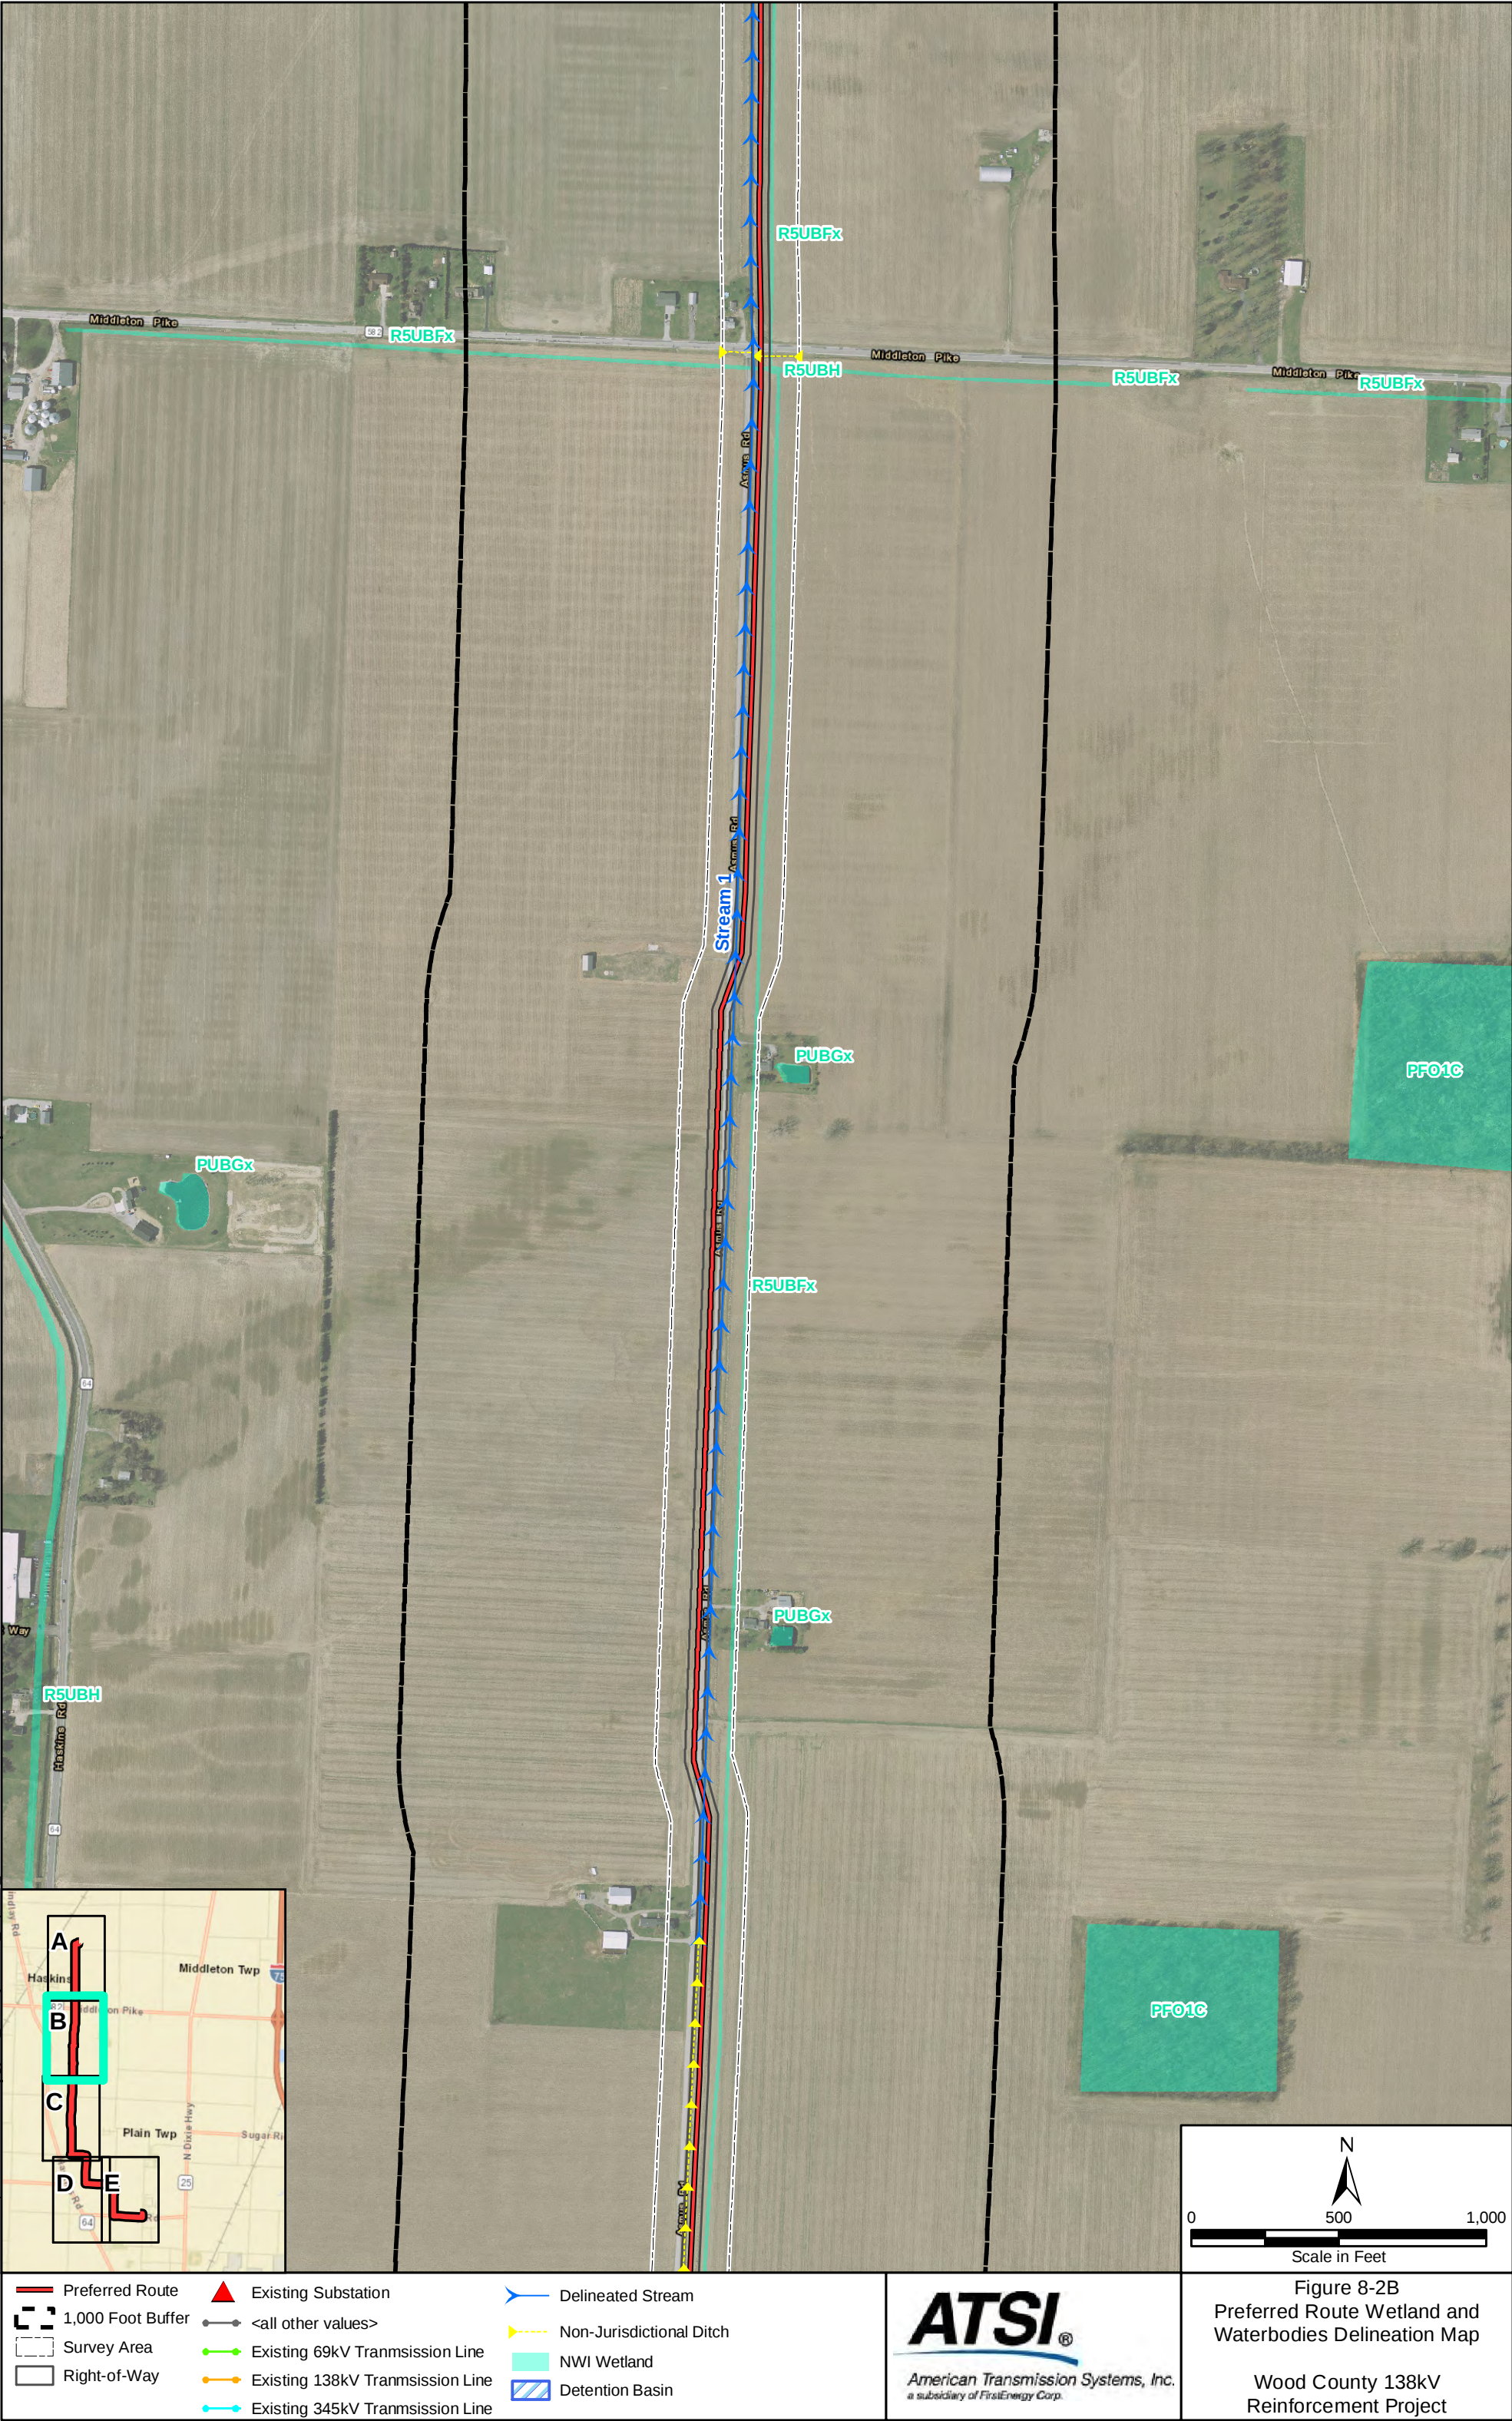

- | | | |
|-------------------|----------------------------------|--------------------------|
| Preferred Route | Existing Substation | Delineated Stream |
| 1,000 Foot Buffer | <all other values> | Non-Jurisdictional Ditch |
| Survey Area | Existing 69kV Transmission Line | NWI Wetland |
| Right-of-Way | Existing 138kV Transmission Line | Detention Basin |
| | Existing 345kV Transmission Line | |

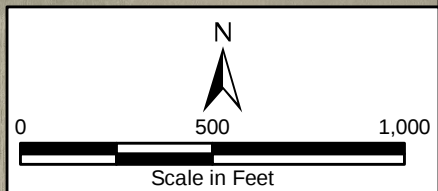

GPD Group
Path: C:\Users\laschweizer\Desktop\GIS\AmFirstEnergy\FE_LenoireBrim_Aquatic_Features.mxd

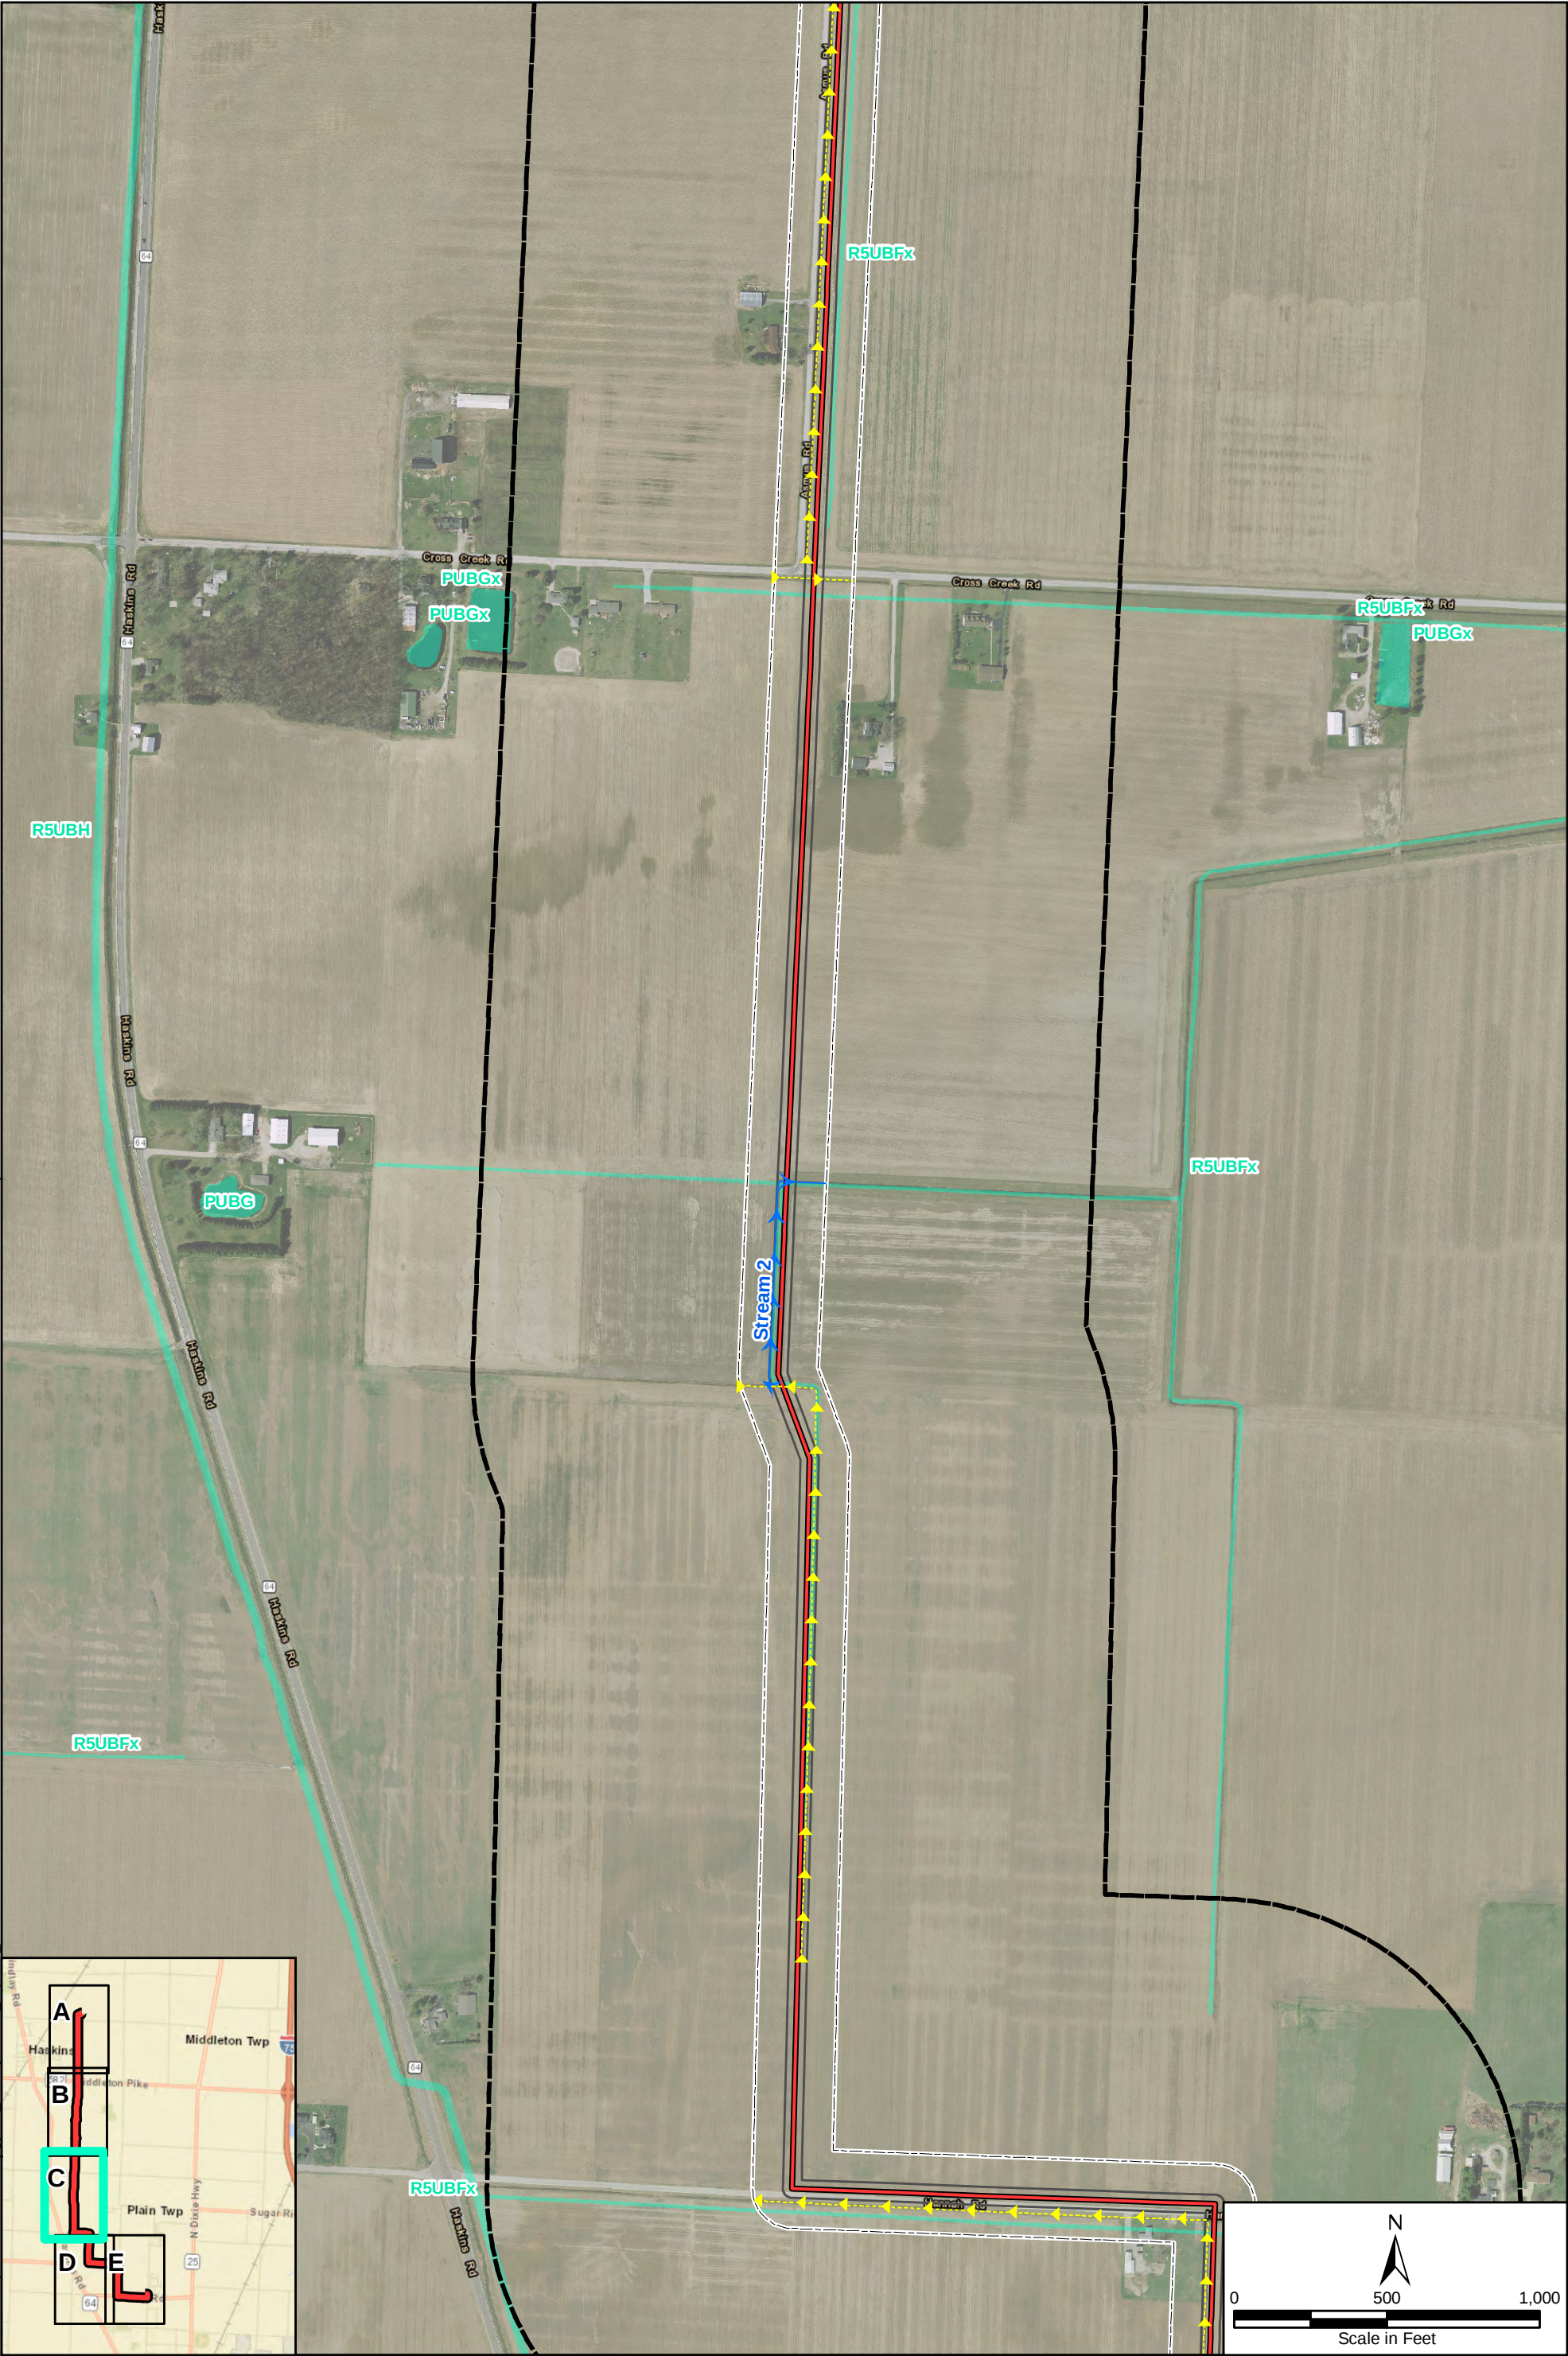

- Preferred Route
- 1,000 Foot Buffer
- Survey Area
- Right-of-Way

- Existing Substation
- <all other values>
- Existing 69kV Transmission Line
- Existing 138kV Transmission Line
- Existing 345kV Transmission Line


- Delineated Stream
- Non-Jurisdictional Ditch
- NWI Wetland
- Detention Basin



Figure 8-2C
Preferred Route Wetland and
Waterbodies Delineation Map

Wood County 138kV
Reinforcement Project

GPD Group
Path: C:\Users\laschweizer\Desktop\GIS\Amn\FirstEnergy\FE_LemoynBrim_Aquatic_Features.mxd

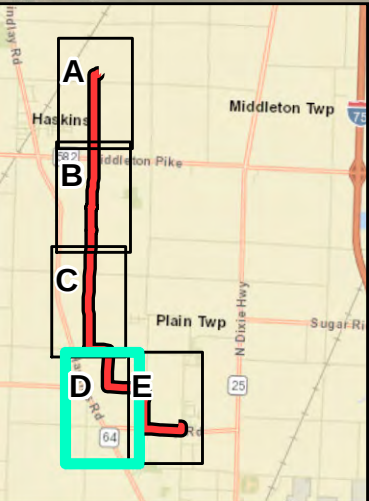

	Preferred Route		Existing Substation		Delineated Stream
	1,000 Foot Buffer		<all other values>		Non-Jurisdictional Ditch
	Right-of-Way		Existing 69kV Transmission Line		NWI Wetland
			Existing 138kV Transmission Line		Detention Basin
			Existing 345kV Transmission Line		



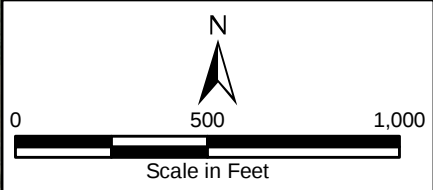


Figure 8-2D
Preferred Route Wetland and
Waterbodies Delineation Map

Wood County 138kV
Reinforcement Project

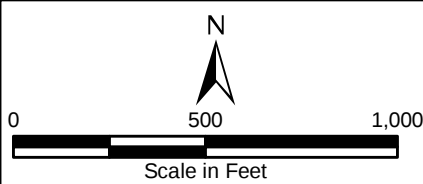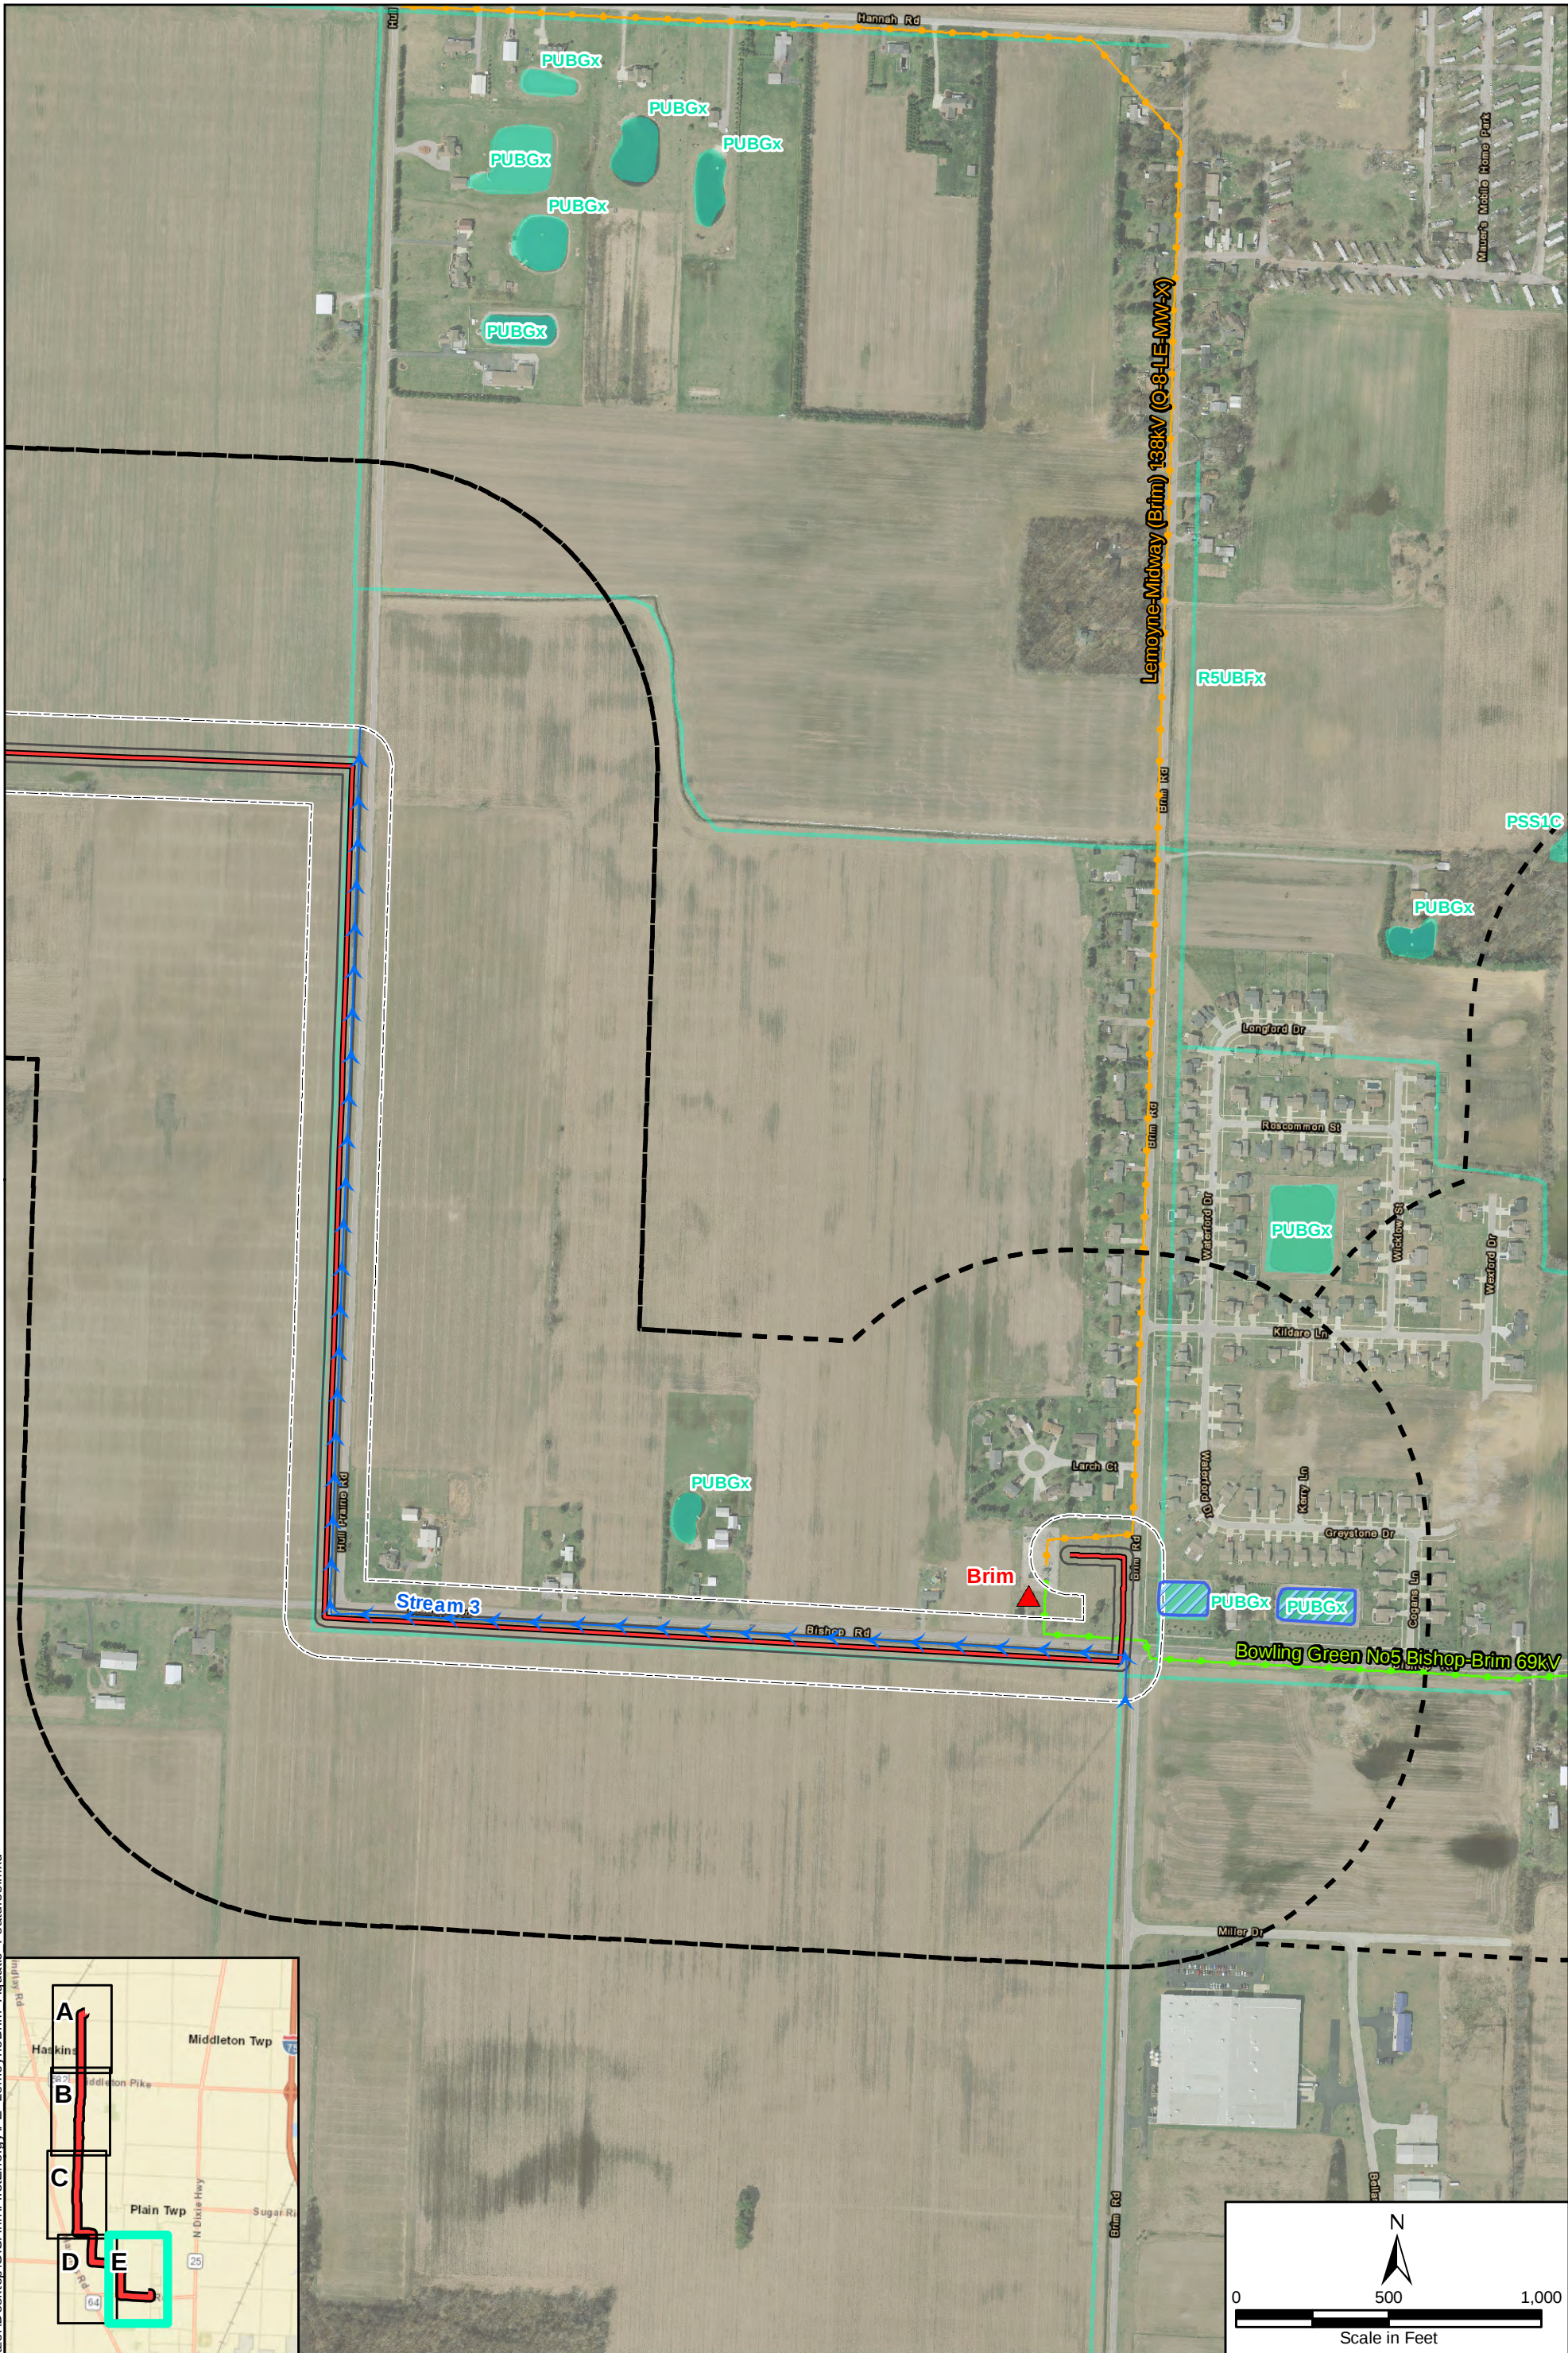

- | | | |
|-------------------|----------------------------------|--------------------------|
| Preferred Route | Existing Substation | Delineated Stream |
| 1,000 Foot Buffer | <all other values> | Non-Jurisdictional Ditch |
| Survey Area | Existing 69kV Transmission Line | NWI Wetland |
| Right-of-Way | Existing 138kV Transmission Line | Detention Basin |
| | Existing 345kV Transmission Line | |

ATSI
American Transmission Systems, Inc.
a subsidiary of FirstEnergy Corp.

Figure 8-2E
Preferred Route Wetland and
Waterbodies Delineation Map

Wood County 138kV
Reinforcement Project

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

12/19/2018 12:23:41 PM

in

Case No(s). 18-1335-EL-BTX

Summary: Application for a Certificate of Environmental Compatibility and Public Need (Part 3 of 8) electronically filed by Mr. Robert J Schmidt on behalf of American Transmission Systems Inc.