


PUCO 19-0198-EL-REN

Section N

Question 1: The information provided in section N.1 is not consistent with the photograph provided in section N.1.e. Meter Manufacturer, Meter Serial Number, and Meter Reading do not match. Please correct the information in section N.1, or upload the correct photograph of the meter.

Answer1: Please find an updated meter photo below:

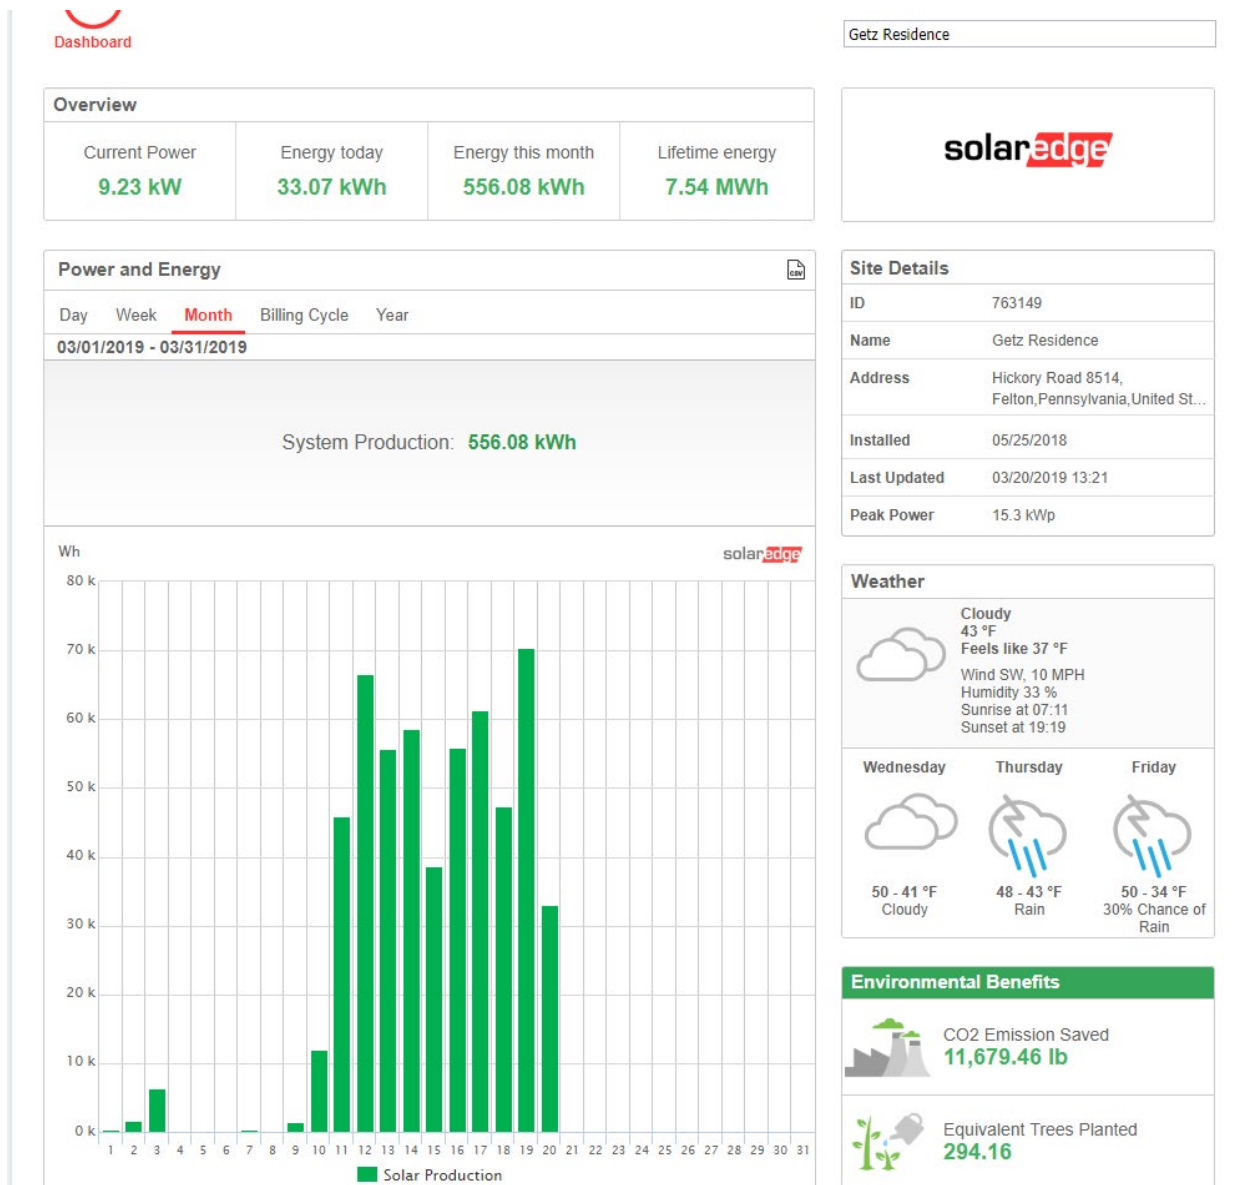

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

3/20/2019 3:54:04 PM

in

Case No(s). 19-0198-EL-REN

Summary: Reply Reply to staff interrogatories electronically filed by Mr. Avery Sellers on behalf of Leonard Getz