

October 17, 2019

Ms. Barcy F. McNeal
Secretary
Docketing Division
The Public Utilities Commission of Ohio
180 East Broad Street
Columbus, OH 43215-3793

**Application for a Certificate of Environmental Compatibility and Public Need
Wood County 138 kV Reinforcement Project
Case No. 18-1335-EL-BTX**

Dear Ms. McNeal:

Attached please find copies of the notice letters to public officials and libraries and each owner of a property crossed and/or adjacent to the preferred and alternative routes. These letters are being docketed in accordance with OAC Rule 4906-3-10(B) as proof of publication of the second public notice required by OAC Rule 4906-3-9(A)(2).

The letters were mailed via US Postal Service First Class Mail on October 7, 2109 to each of the addressees listed in the attached Exhibit 1 and Exhibit 2.

In addition, the proof of publication on October 7, 2019, in Bowling Green Sentinel newspaper is enclosed.

Should the Ohio Power Siting Board desire further information or discussion of this submittal, please contact me at 330-384-2526.

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

cc: J. O'Dell

AFFP

Affidavit of Publication

STATE OF OHIO } SS
COUNTY OF WOOD }

Laura Hertzfeld, being duly sworn, says:

That she is classifieds/legals of the B-G SENTINEL TRIBUNE, a Daily newspaper of general circulation, printed and published in BOWLING GREEN, WOOD County, OHIO; that the publication, a copy of which is attached hereto, was published in the said newspaper on the following dates:

Oct 7, 2019

That said newspaper was regularly issued and circulated on those dates.

SIGNED:

Laura Hertzfeld

Subscribed to and sworn to me this 7th day of Oct 2019

Lucinda S. Bennett

Lucinda S. Bennett, WOOD County, OHIO

My commission expires: February 6, 2024

\$ 593.00

February 6, 2024
My Commission Expires
Notary Public, State of Ohio
Lucinda S. Bennett




8166 70151482 330-467-3707

FIRST ENERGY MEDIA

154 EAST AURORA ROAD
SUITE 174
NORTHFIELD, OH 44067

NOTICE OF PROPOSED MAJOR UTILITY FACILITY

American Transmission Systems, Incorporated ("ATSI"), a First company, proposes to construct the Wood County 138 kV Reinf Project ("Project") in an Application submitted to the Ohio Power Siting Board (OPSB) for a Certificate of Environmental Compatibility and Public Need. The Project proposes to construct a new 138 kV transmission line that will extend from the existing Lemoyne-Mid kV Transmission Line to Brim Substation. An Application to construct, operate and maintain this facility is now pending before the Ohio Power Siting Board and has been assigned Case Number 18-1335-EL. The Project's proposed Route alternatives under consideration traverse Middleton, Center, Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio, and the general locations of the Preferred and Alternate Routes for the Project are shown on the accompanying map of

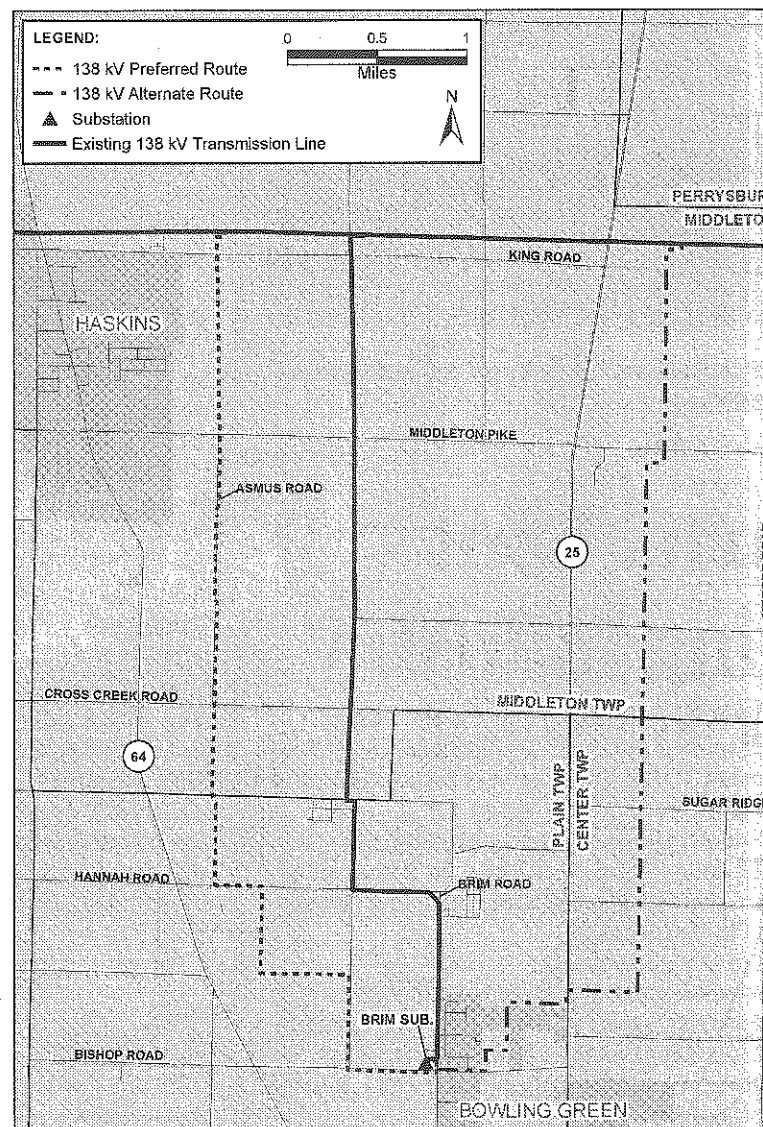

As scheduled by Board, the public hearing of this case consists of

A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony

Health

From page 1

discarded when required; improper storage of poisonous or toxic materials (corrected during inspection); and presence of live insects, rodents, and other pests.

Non-critical included employee had an open beverage (corrected during inspection); outer opening not protected; improper use and/or maintenance of wiping cloths; re-use of single-service or single-use articles (repeat); non-food contact surfaces not easily cleanable; non-durable equipment observed (repeat); and facility not maintained clean (repeat).

The following inspections were done Sept. 16: **Fricker’s Perrysburg 103**, 27390 Helen Drive, had two non-critical violations during a follow-up inspections. They were physical facilities not maintained in good repair; and facility not maintained clean.

Crossroads Café, 127 S. Main St., North Baltimore, had two critical and six non-critical violations.

Both critical were corrected during inspection and included employees are not informed in a verifiable manner of their responsibility to report information about their health (repeat); and temperature-controlled foods not being cold held at the proper temperature.

Non-critical included in-use utensils improperly stored (corrected during inspection); non-food contact surfaces/material mishandled (repeat, corrected during inspection); non-food contact surface(s) not cleaned at the required frequency; excessive clutter in dry storage area and office (repeat); physical facilities not maintained in good repair (repeat); and food service operations did not submit facility layout and equipment specifications

North Baltimore Subway, 113 N. Main St., had one critical and two non-critical offenses.

Critical was quaternary ammonium sanitizing solution at incorrect concentration (corrected during inspection).

Non-critical included non-food contact surfaces of equipment are unclean; and food service operation did not submit facility layout and equipment specifications

The following inspections were done Sept. 17:

Fraternal Order of Eagles Aerie 2322, 658 Lime City Road, Rossford, had three non-critical violations during a follow-up inspection. They were facility does not have an employee with level two certification in food protection; non-food contact surface(s) not cleaned at the required frequency; and physical facilities not maintained in good repair.

Lily Cafe LLC, 1616 W. Wooster St., Bowling Green, had one critical offense, which was equipment food-contact surfaces or utensils are unclean.

The following inspections were done Sept. 18: **Pagliari’s Pizza Inc.**, 945 S. Main St., Bowling Green, had two critical and five non-critical violations.

Critical included food not properly protected from contamination by separation, packaging, and segregation (corrected during inspection); and temperature-controlled foods not being

hot held at the proper temperature (repeat). Non-critical included food employees wearing jewelry on arms or hands during food preparation; improper use and/or maintenance of wiping cloths; in-use utensils improperly stored (corrected during inspection); non-food contact surfaces not easily cleanable (repeat); and physical facilities not maintained in good repair (repeat).

Golden House Restaurant, 130 E. South Boundary St., Perrysburg, had four critical and six non-critical offenses.

Three of the four critical were corrected during inspection and included food in contact with an unclean surface or linens; food not properly protected from contamination by separation, packaging, and segregation; and chlorine sanitizing solution at incorrect temperature and/or concentration. The fourth critical violation was temperature-controlled foods not being cold held at the proper temperature (repeat).

Non-critical included improper method for cooling temperature-controlled foods (repeat, corrected during inspection); improper storage of single-service and single-use articles (repeat); re-use of single-service or single-use articles (repeat); non-food contact surfaces constructed of unapproved materials; non-food contact surfaces of equipment are unclean (repeat); and physical facilities not maintained in good repair (repeat).

Jed’s Perrysburg Inc., 7010 Lighthouse Way, Perrysburg, had two critical and 10 non-critical offenses.

Critical were employees are not informed in a verifiable manner of their responsibility to report information about their health (corrected during inspection); and equipment food-contact surfaces or utensils are unclean.

Non-critical included employee food/drink and personal items in non-designated area; improper method for cooling temperature-controlled foods (corrected during inspection); working food containers not properly labeled; improper storage of food items; in-use utensils improperly stored; non-food contact surfaces not easily cleanable; non-food contact surface(s) not cleaned at the required frequency (bar keg cooler had odor present); non-food contact surface(s) not cleaned at the required frequency (repeat, dry stock shelving and areas behind fryers and grills need to be washed frequently); non-food contact surfaces of equipment are unclean; and facility not maintained clean (repeat).

International House of Pancakes, 10151 Fremont Pike, Perrysburg, had one non-critical offense, which was non-food contact surfaces not easily cleanable (repeat).

The following inspections were done Sept 19: **Tomaselli’s**, 24099 E. Front St., Grand Rapids, had four critical and four non-critical violations.

Critical were employees are not informed in a verifiable manner of their responsibility to report information about their health; temperature-controlled foods not being cold held at the proper temperature (repeat); ready-to-eat, temperature-controlled foods not properly date

marked; and the presence of pests (ants were observed under the prep sink and flies near the dough-rolling area)

Non-critical included no written procedures for vomiting or diarrheal events; inadequate equipment available for cooling, heating or holding food; non-food contact surfaces not easily cleanable; and plumbing system not maintained in good repair.

Riverby Hills Golf Club (pro), 16571 W. River Road, Bowling Green, had one critical and one non-critical offense.

Critical was insufficient air gap between the flood rim and the water supply inlet.

Non-critical was non-food contact surfaces not easily cleanable.

Riverby Hills Golf Club (CH), 16571 W. River Road, Bowling Green, had one non-critical offense, which was improper use and/or maintenance of wiping cloths.

Heritage Corner Nursing Home, 1069 Klotz Road, Suite B, Bowling Green, had three critical and one non-critical violation during a follow-up inspection.

All three critical were corrected during inspection and included food not properly protected from contamination by separation, packaging, and segregation; refrigerated, ready-to-eat, temperature-controlled foods not properly date marked; and ready-to-eat, temperature-controlled food not properly discarded when required (repeat).


Non-critical was no written procedures for vomiting or diarrheal events.

Ziggy Zoombas, 300 E. Wooster St., Bowling Green, had two non-critical violations during a follow-up inspection. They were non-food contact surfaces not easily cleanable; and irreversible registering temperature indicator not readily accessible for hot water mechanical warewashing operations.

No violations were found at **Iron Bean Coffee Company**, 25561 Fort Meigs Road, Perrysburg; **Birch Run Golf Club**, 14451 Deshler Road, North Baltimore; and **Rossford PK-5 School**, 28500 Lime City Road, Rossford.

NOTICE OF PROPOSED MAJOR UTILITY FACILITY

American Transmission Systems, Incorporated (“ATSI”), a FirstEnergy company, proposes to construct the Wood County 138 kV Reinforcement Project (“Project”) in an Application submitted to the Ohio Power Siting Board (OPSB) for a Certificate of Environmental Compatibility and Public Need. The Project proposes to construct a new 138 kV transmission line that will extend from the existing Lemoyne-Midway 138 kV Transmission Line to Brim Substation. An Application to construct, operate and maintain this facility is now pending before the Ohio Power Siting Board and has been assigned Case Number 18-1335-EL-BTX. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio, and the general locations of the Preferred and Alternate Routes for the Project are shown on the accompanying map of the area.

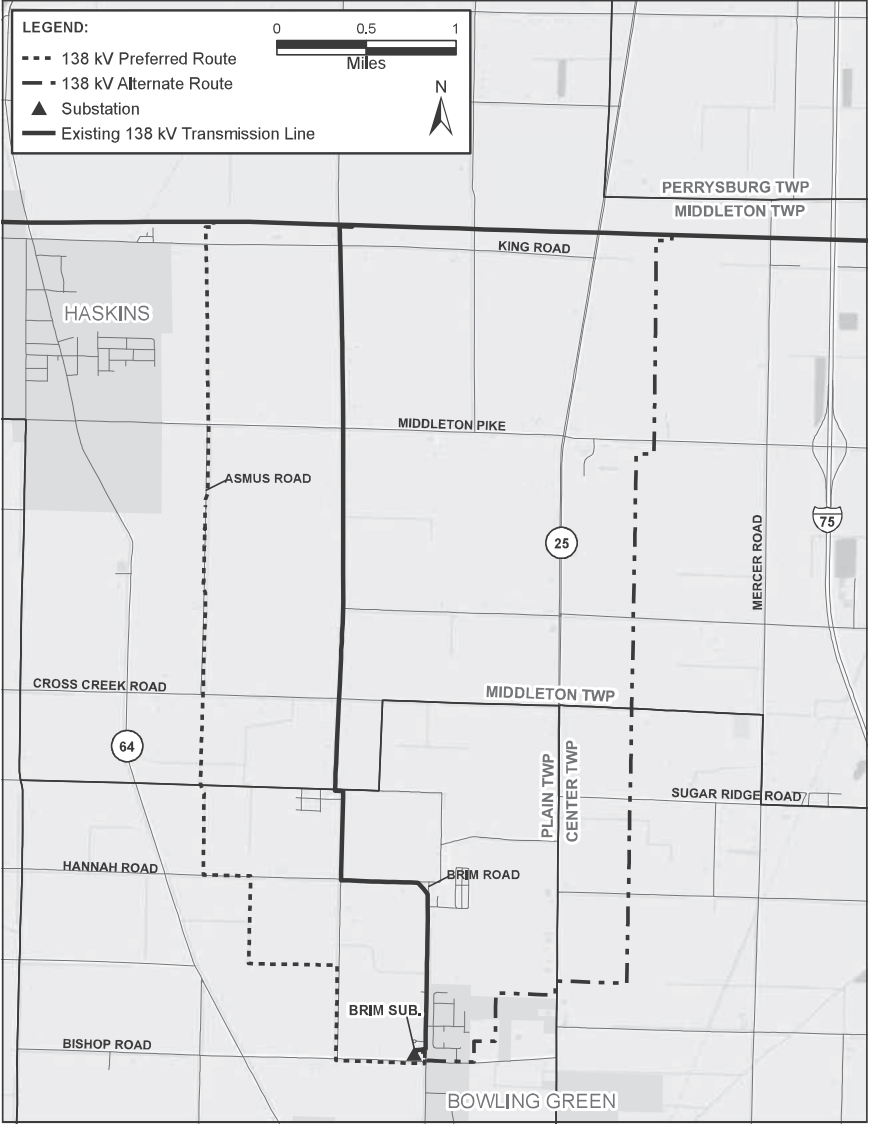

As scheduled by Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on October 24, 2019, at 6:00 p.m., at the Ohio Department of Transportation - District 2, 317 East Poe Road, Bowling Green, Ohio 43402.
- B. An evidentiary hearing commencing on November 7, 2019, at 10:00 a.m., in Hearing Room 11-D at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.

4906.08(C). Parties – testimony

(C) The board shall accept written or oral testimony from any person at the public hearing, but the right to call and examine witnesses shall be reserved for parties. However, the board may adopt rules to exclude repetitive, immaterial, or irrelevant testimony.

This marks the second, and final, public notice regarding public hearings for the Project. The first notice was mailed to those persons that received service of a copy of the application and each owner of a property crossed and/or adjacent to the preferred and alternate routes, on April 23, 2019.

OH-70151482

MIDDLETON TOWNSHIP FIRE & EMS
DIAL 911

“EMS Providing Advanced Life Support 24/7”

WAYNE FIRE & RESCUE
Wayne, Ohio

DIAL 911

Business office: 419-288-2819
www.waynefire.net

PEMBERVILLE-FREEDOM FIRE DEPT.
Pemberville, Ohio
“Serving Pemberville & the Freedom & Webster Townships”
DIAL 911
Business office: 419-287-4593

PERRYSBURG TOWNSHIP FIRE & EMS
Full-Time EMS & Fire
Serving Perrysburg Township Since 1961
Dial: 911 or 419-874-3551
www.perrysburgtownship.us

Troy Township Fire & EMS

For Emergency Dial 911
Non-Emergency 419-833-5422
www.troytownship.us

OH-70148333

OH-70148329

OH-70148318

OH-70148325

OH-70148323

OH-70148391

Exhibit 1
Officials to Be Served a Copy of the Certified Application
Wood County 138-kV Reinforcement Project
Case No. 18-1335-EL-BTX

Wood County

Board of County Commissioners
Dr. Theodore Bowlus
One Courthouse Square, 5th Floor
Bowling Green, OH 43402

Wood County Engineer's Office
Mr. John Musteric
One Courthouse Square, 5th Floor
Bowling Green, OH 43402

Board of County Commissioners
Ms. Doris Herringshaw
One Courthouse Square, 5th Floor
Bowling Green, OH 43402

Wood County Planning Commission
Mr. Dave Steiner, Director
One Courthouse Square, 5th Floor
Bowling Green, OH 43402

Board of County Commissioners
Mr. Craig LaHote
One Courthouse Square, 5th Floor
Bowling Green, OH 43402

Wood County Soil & Water District
Mr. Jim Carter, District Admin.
1616 E. Wooster St.
Suite 32
Bowling Green, OH 43402

Middleton Township

Middleton Township Officials
Mr. Jim Bostdorff, Trustee Chairman
19210 Haskins Road
Bowling Green, OH 43402

Middleton Township Officials
Mr. Fred Vetter, Trustee
11440 Devils Hole Road
Bowling Green, OH 43402

Middleton Township Officials
Ms. Penny Getz, Trustee
216 E. Greenwood Dr.
Haskins, OH 43525

Middleton Township Officials
Ms. Laurie Limes, Fiscal Officer
15228 Cross Creek Road
Bowling Green, OH 43402

Plain Township

Plain Township Officials
Mr. Donald Bechstein, Trustee
16375 Sand Ridge Road
Bowling Green, OH 43402

Plain Township Officials
Mr. Jim Rossow, Trustee
15821 Green Road
Bowling Green, OH 43402

Plain Township Officials
Mr. Gary Cromley, Trustee
13370 Union Hill Road
Bowling Green, OH 43402

Plain Township Officials
Ms. Elizabeth Bostdorff, Fiscal Officer
18617 Brim Road
Bowling Green, OH 43402

Center Township

Center Township Officials
Mr. Dale Brown, Trustee
17441 Carter Road
Bowling Green, OH 43402

Center Township Officials
Mr. Doug Wulff, Trustee
11300 E Kramer Road
Bowling Green, OH 43402

Center Township Officials
Mr. Rick Engle, Trustee
17123 Barr Road
Bowling Green, OH 43402

Center Township Officials
Ms. Jill Foos, Fiscal Officer
17100 Carter Road
Bowling Green, OH 43402

City of Bowling Green

City of Bowling Green Mayor's Office
Mayor Richard Edwards
304 North Church Street
Bowling Green, OH 43402

Bowling Green City Council - Public
Utilities Committee
Mr. Michael Aspacher
25 Parkwood Drive
Bowling Green, OH 43402

Bowling Green City Council
Mr. Bruce Jeffers
304 North Church Street
Bowling Green, OH 43402

Bowling Green Engineering Division
Mr. Jason Sisco, City Engineer
304 North Church Street
Bowling Green, OH 43402

Bowling Green City Council - Ward 4
Mr. William Herald
1030 Conneaut Ave
Bowling Green, OH 43402

Bowling Green Planning Commission
Attn: Planning Commission
304 North Church Street
Bowling Green, OH 43402

Libraries

Wood County District Public Library
Mr. Michael Penrod, Director
251 N. Main Street
Bowling Green, OH 43402

October 7, 2019

Dr Theodore Bowlus
Wood County Board of Commissioners
One Courthouse Square, 5th Floor
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Dr. Bowlus:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

NOTICE OF PROPOSED MAJOR UTILITY FACILITY

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, proposes to construct the Wood County 138 kV Reinforcement Project ("Project") in an Application submitted to the Ohio Power Siting Board (OPSB) for a Certificate of Environmental Compatibility and Public Need. The Project proposes to construct a new 138 kV transmission line that will extend from the existing Lemoine-Midway 138 kV Transmission Line to Brim Substation. An Application to construct, operate and maintain this facility is now pending before the Ohio Power Siting Board and has been assigned Case Number 18-1335-EL-BTX. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio, and the general locations of the Preferred and Alternate Routes for the Project are shown on the accompanying map of the area.



As scheduled by Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on October 24, 2019, at 6:00 p.m., at the Ohio Department of Transportation - District 2, 317 East Poe Road, Bowling Green, Ohio 43402.
- B. An evidentiary hearing commencing on November 7, 2019, at 10:00 a.m., in Hearing Room 11-D at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.

4906.08(C). Parties – testimony

(C) The board shall accept written or oral testimony from any person at the public hearing, but the right to call and examine witnesses shall be reserved for parties. However, the board may adopt rules to exclude repetitive, immaterial, or irrelevant testimony.

This marks the second, and final, public notice regarding public hearings for the Project. The first notice was mailed to those persons that received service of a copy of the application and each owner of a property crossed and/or adjacent to the preferred and alternate routes, on April 23, 2019.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Ms. Doris Herringshaw
Wood County Board of Commissioners
One Courthouse Square, 5th Floor
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Ms. Herringshaw:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

LEGEND:

- 138 kV Preferred Route
- 138 kV Alternate Route
- ▲ Substation
- Existing 138 kV Transmission Line

Scale: 0 0.5 1 Miles

North Arrow

Map Labels:

- HASKINS
- KINGS ROAD
- ADAMS ROAD
- CROSS CREEK ROAD
- HASKINS ROAD
- BISHOP ROAD
- BRIM SUB.
- BOWLING GREEN
- PERRYBURG TWP
- MIDDLETOWN TWP
- PLAIN TWP
- CENTER TWP
- RUSKIN ROAD
- MEMPHIS ROAD
- 36
- 24
- 24

This marks the second, and final, public notice regarding public hearings for the Project. The first notice was mailed to those persons that received service of a copy of the application and each owner of a property crossed and/or adjacent to the preferred and alternate routes, on April 23, 2019.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Mr. Craig LaHote
Wood County Board of Commissioners
One Courthouse Square, 5th Floor
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Mr. LaHote:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Mr. John Musteric
Wood County Engineer's Office
One Courthouse Square, 5th Floor
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Mr. Musteric:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Mr. David Steiner, Director
Wood County Planning Commission
One Courthouse Square, 5th Floor
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Mr. Steiner:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Mr. Jim Carter, District Admin.
Wood County Soil & Water District
1616 E Wooster St, Suite 32
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Mr. Carter:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

NOTICE OF PROPOSED MAJOR UTILITY FACILITY

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, proposes to construct the Wood County 138 kV Reinforcement Project ("Project") in an Application submitted to the Ohio Power Siting Board (OPSB) for a Certificate of Environmental Compatibility and Public Need. The Project proposes to construct a new 138 kV transmission line that will extend from the existing Lemoine-Midway 138 kV Transmission Line to Brim Substation. An Application to construct, operate and maintain this facility is now pending before the Ohio Power Siting Board and has been assigned Case Number 18-1335-EL-BTX. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio, and the general locations of the Preferred and Alternate Routes for the Project are shown on the accompanying map of the area.



As scheduled by Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on October 24, 2019, at 6:00 p.m., at the Ohio Department of Transportation - District 2, 317 East Poe Road, Bowling Green, Ohio 43402.
- B. An evidentiary hearing commencing on November 7, 2019, at 10:00 a.m., in Hearing Room 11-D at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.

4906.08(C). Parties – testimony

(C) The board shall accept written or oral testimony from any person at the public hearing, but the right to call and examine witnesses shall be reserved for parties. However, the board may adopt rules to exclude repetitive, immaterial, or irrelevant testimony.

This marks the second, and final, public notice regarding public hearings for the Project. The first notice was mailed to those persons that received service of a copy of the application and each owner of a property crossed and/or adjacent to the preferred and alternate routes, on April 23, 2019.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Mr. Jim Bostdorff, Trustee Chairman
Middletown Township Officials
19210 Haskins Rd
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Mr. Bostdorff:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Ms. Penny Getz, Trustee
Middletown Township Officials
216 E Greenwood Dr
Haskins OH 43525

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Ms. Getz:


American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

NOTICE OF PROPOSED MAJOR UTILITY FACILITY

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, proposes to construct the Wood County 138 kV Reinforcement Project ("Project") in an Application submitted to the Ohio Power Siting Board (OPSB) for a Certificate of Environmental Compatibility and Public Need. The Project proposes to construct a new 138 kV transmission line that will extend from the existing Lemoine-Midway 138 kV Transmission Line to Brim Substation. An Application to construct, operate and maintain this facility is now pending before the Ohio Power Siting Board and has been assigned Case Number 18-1335-EL-BTX. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio, and the general locations of the Preferred and Alternate Routes for the Project are shown on the accompanying map of the area.

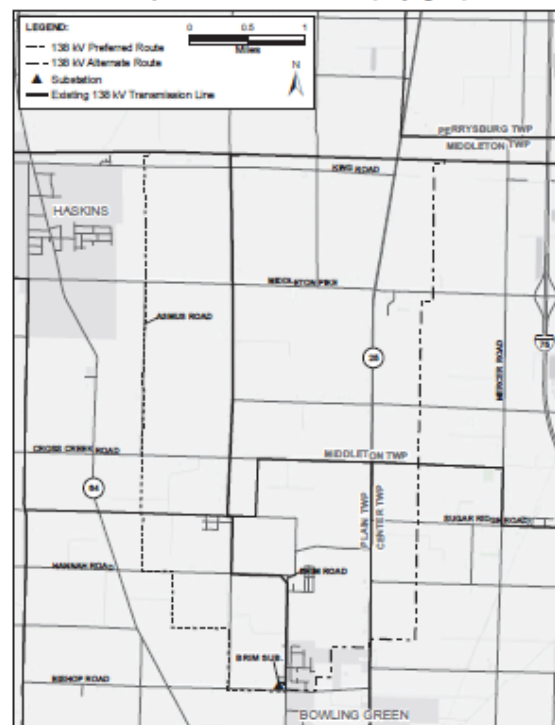

As scheduled by Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on October 24, 2019, at 6:00 p.m., at the Ohio Department of Transportation - District 2, 317 East Poe Road, Bowling Green, Ohio 43402.
- B. An evidentiary hearing commencing on November 7, 2019, at 10:00 a.m., in Hearing Room 11-D at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.

4906.08(C). Parties – testimony

(C) The board shall accept written or oral testimony from any person at the public hearing, but the right to call and examine witnesses shall be reserved for parties. However, the board may adopt rules to exclude repetitive, immaterial, or irrelevant testimony.

This marks the second, and final, public notice regarding public hearings for the Project. The first notice was mailed to those persons that received service of a copy of the application and each owner of a property crossed and/or adjacent to the preferred and alternate routes, on April 23, 2019.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Mr. Fred Vetter, Trustee
Middletown Township Officials
11440 Devils Hole Rd
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Mr. Vetter:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

NOTICE OF PROPOSED MAJOR UTILITY FACILITY

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, proposes to construct the Wood County 138 kV Reinforcement Project ("Project") in an Application submitted to the Ohio Power Siting Board (OPSB) for a Certificate of Environmental Compatibility and Public Need. The Project proposes to construct a new 138 kV transmission line that will extend from the existing Lemoine-Midway 138 kV Transmission Line to Brim Substation. An Application to construct, operate and maintain this facility is now pending before the Ohio Power Siting Board and has been assigned Case Number 18-1335-EL-BTX. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio, and the general locations of the Preferred and Alternate Routes for the Project are shown on the accompanying map of the area.



As scheduled by Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on October 24, 2019, at 6:00 p.m., at the Ohio Department of Transportation - District 2, 317 East Poe Road, Bowling Green, Ohio 43402.
- B. An evidentiary hearing commencing on November 7, 2019, at 10:00 a.m., in Hearing Room 11-D at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.

4906.08(C). Parties – testimony

(C) The board shall accept written or oral testimony from any person at the public hearing, but the right to call and examine witnesses shall be reserved for parties. However, the board may adopt rules to exclude repetitive, immaterial, or irrelevant testimony.

This marks the second, and final, public notice regarding public hearings for the Project. The first notice was mailed to those persons that received service of a copy of the application and each owner of a property crossed and/or adjacent to the preferred and alternate routes, on April 23, 2019.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Ms. Laurie Limes, Fiscal Officer
Middletown Township Officials
15228 Cross Creek Rd
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Ms. Limes:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

NOTICE OF PROPOSED MAJOR UTILITY FACILITY

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, proposes to construct the Wood County 138 kV Reinforcement Project ("Project") in an Application submitted to the Ohio Power Siting Board (OPSB) for a Certificate of Environmental Compatibility and Public Need. The Project proposes to construct a new 138 kV transmission line that will extend from the existing Lemoine-Midway 138 kV Transmission Line to Brim Substation. An Application to construct, operate and maintain this facility is now pending before the Ohio Power Siting Board and has been assigned Case Number 18-1335-EL-BTX. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio, and the general locations of the Preferred and Alternate Routes for the Project are shown on the accompanying map of the area.



As scheduled by Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on October 24, 2019, at 6:00 p.m., at the Ohio Department of Transportation - District 2, 317 East Poe Road, Bowling Green, Ohio 43402.
- B. An evidentiary hearing commencing on November 7, 2019, at 10:00 a.m., in Hearing Room 11-D at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.

4906.08(C). Parties – testimony

(C) The board shall accept written or oral testimony from any person at the public hearing, but the right to call and examine witnesses shall be reserved for parties. However, the board may adopt rules to exclude repetitive, immaterial, or irrelevant testimony.

This marks the second, and final, public notice regarding public hearings for the Project. The first notice was mailed to those persons that received service of a copy of the application and each owner of a property crossed and/or adjacent to the preferred and alternate routes, on April 23, 2019.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Mr. Donald Bechstein, Trustee
Plain Township Officials
16375 Sand Ridge Rd
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Mr. Bechstein:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

NOTICE OF PROPOSED MAJOR UTILITY FACILITY

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, proposes to construct the Wood County 138 kV Reinforcement Project ("Project") in an Application submitted to the Ohio Power Siting Board (OPSB) for a Certificate of Environmental Compatibility and Public Need. The Project proposes to construct a new 138 kV transmission line that will extend from the existing Lemoine-Midway 138 kV Transmission Line to Brim Substation. An Application to construct, operate and maintain this facility is now pending before the Ohio Power Siting Board and has been assigned Case Number 18-1335-EL-BTX. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio, and the general locations of the Preferred and Alternate Routes for the Project are shown on the accompanying map of the area.



As scheduled by Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on October 24, 2019, at 6:00 p.m., at the Ohio Department of Transportation - District 2, 317 East Poe Road, Bowling Green, Ohio 43402.
- B. An evidentiary hearing commencing on November 7, 2019, at 10:00 a.m., in Hearing Room 11-D at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.

4906.08(C). Parties – testimony

(C) The board shall accept written or oral testimony from any person at the public hearing, but the right to call and examine witnesses shall be reserved for parties. However, the board may adopt rules to exclude repetitive, immaterial, or irrelevant testimony.

This marks the second, and final, public notice regarding public hearings for the Project. The first notice was mailed to those persons that received service of a copy of the application and each owner of a property crossed and/or adjacent to the preferred and alternate routes, on April 23, 2019.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Mr. Gary Cromley, Trustee
Plain Township Officials
13370 Union Hill Rd
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Mr. Cromley:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Mr. Jim Rossow, Trustee
Plain Township Officials
15821 Green Rd
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Mr. Rossow:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Ms. Elizabeth Bostdorff, Fiscal Officer
Plain Township Officials
18617 Brim Rd
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Ms. Bostdorff:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

NOTICE OF PROPOSED MAJOR UTILITY FACILITY

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, proposes to construct the Wood County 138 kV Reinforcement Project ("Project") in an Application submitted to the Ohio Power Siting Board (OPSB) for a Certificate of Environmental Compatibility and Public Need. The Project proposes to construct a new 138 kV transmission line that will extend from the existing Lemoine-Midway 138 kV Transmission Line to Brim Substation. An Application to construct, operate and maintain this facility is now pending before the Ohio Power Siting Board and has been assigned Case Number 18-1335-EL-BTX. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio, and the general locations of the Preferred and Alternate Routes for the Project are shown on the accompanying map of the area.



As scheduled by Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on October 24, 2019, at 6:00 p.m., at the Ohio Department of Transportation - District 2, 317 East Poe Road, Bowling Green, Ohio 43402.
- B. An evidentiary hearing commencing on November 7, 2019, at 10:00 a.m., in Hearing Room 11-D at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.

4906.08(C). Parties – testimony

(C) The board shall accept written or oral testimony from any person at the public hearing, but the right to call and examine witnesses shall be reserved for parties. However, the board may adopt rules to exclude repetitive, immaterial, or irrelevant testimony.

This marks the second, and final, public notice regarding public hearings for the Project. The first notice was mailed to those persons that received service of a copy of the application and each owner of a property crossed and/or adjacent to the preferred and alternate routes, on April 23, 2019.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company



76 S. Main St.
Akron, OH 44308

October 7, 2019

Mr. Dale Brown, Trustee
Center Township Officials
17441 Carter Rd
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Mr. Brown:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Mr. Rick Engle, Trustee
Center Township Officials
17123 Barr Rd
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Mr. Engle:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

NOTICE OF PROPOSED MAJOR UTILITY FACILITY

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, proposes to construct the Wood County 138 kV Reinforcement Project ("Project") in an Application submitted to the Ohio Power Siting Board (OPSB) for a Certificate of Environmental Compatibility and Public Need. The Project proposes to construct a new 138 kV transmission line that will extend from the existing Lemoine-Midway 138 kV Transmission Line to Brim Substation. An Application to construct, operate and maintain this facility is now pending before the Ohio Power Siting Board and has been assigned Case Number 18-1335-EL-BTX. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio, and the general locations of the Preferred and Alternate Routes for the Project are shown on the accompanying map of the area.



As scheduled by Board, the public hearing of this case consists of two parts:

- A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on October 24, 2019, at 6:00 p.m., at the Ohio Department of Transportation - District 2, 317 East Poe Road, Bowling Green, Ohio 43402.
- An evidentiary hearing commencing on November 7, 2019, at 10:00 a.m., in Hearing Room 11-D at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.

4906.08(C). Parties – testimony

(C) The board shall accept written or oral testimony from any person at the public hearing, but the right to call and examine witnesses shall be reserved for parties. However, the board may adopt rules to exclude repetitive, immaterial, or irrelevant testimony.

This marks the second, and final, public notice regarding public hearings for the Project. The first notice was mailed to those persons that received service of a copy of the application and each owner of a property crossed and/or adjacent to the preferred and alternate routes, on April 23, 2019.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Mr. Doug Wulff, Trustee
Center Township Officials
11300 E Kramer Rd
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Mr. Wulff:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Ms. Jill Foos, Fiscal Officer
Center Township Officials
17100 Carter Rd
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Ms. Foos:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Mayor Richard Edwards
City of Bowling Green Mayor's Office
304 N Church St
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Mr. Edwards:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Mr. Bruce Jeffers
Bowling Green City Council
304 N Church St
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Mr. Jeffers:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company



76 S. Main St.
Akron, OH 44308

October 7, 2019

Mr. William Herald
Bowling Green City Council - Ward 4
1030 Conneaut Ave
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Mr. Herald:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company



76 S. Main St.
Akron, OH 44308

October 7, 2019

Mr. Michael Anspacher
Bowling Green City Council - Public Utilities Commission
25 Parkwood Dr
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Mr. Anspacher:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

NOTICE OF PROPOSED MAJOR UTILITY FACILITY

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, proposes to construct the Wood County 138 kV Reinforcement Project ("Project") in an Application submitted to the Ohio Power Siting Board (OPSB) for a Certificate of Environmental Compatibility and Public Need. The Project proposes to construct a new 138 kV transmission line that will extend from the existing Lemoine-Midway 138 kV Transmission Line to Brim Substation. An Application to construct, operate and maintain this facility is now pending before the Ohio Power Siting Board and has been assigned Case Number 18-1335-EL-BTX. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio, and the general locations of the Preferred and Alternate Routes for the Project are shown on the accompanying map of the area.



As scheduled by Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on October 24, 2019, at 6:00 p.m., at the Ohio Department of Transportation - District 2, 317 East Poe Road, Bowling Green, Ohio 43402.
- B. An evidentiary hearing commencing on November 7, 2019, at 10:00 a.m., in Hearing Room 11-D at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.

4906.08(C). Parties – testimony

(C) The board shall accept written or oral testimony from any person at the public hearing, but the right to call and examine witnesses shall be reserved for parties. However, the board may adopt rules to exclude repetitive, immaterial, or irrelevant testimony.

This marks the second, and final, public notice regarding public hearings for the Project. The first notice was mailed to those persons that received service of a copy of the application and each owner of a property crossed and/or adjacent to the preferred and alternate routes, on April 23, 2019.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

October 7, 2019

Mr. Jason Sisco, City Engineer
Bowling Green Engineering Division
304 N Church St
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Mr. Sisco:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

NOTICE OF PROPOSED MAJOR UTILITY FACILITY

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, proposes to construct the Wood County 138 kV Reinforcement Project ("Project") in an Application submitted to the Ohio Power Siting Board (OPSB) for a Certificate of Environmental Compatibility and Public Need. The Project proposes to construct a new 138 kV transmission line that will extend from the existing Lemoine-Midway 138 kV Transmission Line to Brim Substation. An Application to construct, operate and maintain this facility is now pending before the Ohio Power Siting Board and has been assigned Case Number 18-1335-EL-BTX. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio, and the general locations of the Preferred and Alternate Routes for the Project are shown on the accompanying map of the area.



As scheduled by Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on October 24, 2019, at 6:00 p.m., at the Ohio Department of Transportation - District 2, 317 East Poe Road, Bowling Green, Ohio 43402.
- B. An evidentiary hearing commencing on November 7, 2019, at 10:00 a.m., in Hearing Room 11-D at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.

4906.08(C). Parties – testimony

(C) The board shall accept written or oral testimony from any person at the public hearing, but the right to call and examine witnesses shall be reserved for parties. However, the board may adopt rules to exclude repetitive, immaterial, or irrelevant testimony.

This marks the second, and final, public notice regarding public hearings for the Project. The first notice was mailed to those persons that received service of a copy of the application and each owner of a property crossed and/or adjacent to the preferred and alternate routes, on April 23, 2019.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company



76 S. Main St.
Akron, OH 44308

October 7, 2019

Bowling Green Planning Commission
Attn: Planning Commission
304 N Church St
Bowling Green OH 43402

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Sirs:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

Exhibit 2
Property Owners Served Notice on the Application
Wood County 138 kV Reinforcement Project
Case No. 18-1335-EL-BTX

PID	PROPERTY OWNER	ADDRESS
J34-611-190000006000	A SCHALLER LIMITED PARTNERSHIP	850 STRAWBERRY HILL RD COLUMBUS, OH 43213
J34-610-270000014000	AGOSTI RUDOLPH D JR & CATHERINE L	20440 HASKINS RD BOWLING GREEN, OH 43402
J36-611-310000002500	AMBASSADORS LIGHT LP	650 HASKINS RD BOWLING GREEN, OH 43402
J34-611-190000025000	AMOS BRADLEY D & JACQUELYN ANN	21186 N DIXIE HWY BOWLING GREEN, OH 43402
J36-611-300000008503	ARC RMBLGOH001 LLC	PO BOX 54467 LEXINGTON, KY 40555
J34-610-270000002000, J34-610-260000020000	ASMUS RONALD & SUZANNE M TRUSTEES	328 MOTTS FOREST RD WILMINGTON, NC 28412
C11-511-060000029000, C11-511-070000005500	AVERY JEFFREY T & JAMES ALAN & BECHSTEIN JENNIFER L	14361 GREENSBURG PIKE PORTAGE, OH 43451
J37-611-180000010000	BAKER WILLIAM S	22263 N DIXIE HWY PERRYSBURG, OH 43551
R63-510-120102027000	BALLEZ RAMONA P & RINA M	13755 LARCH CT BOWLING GREEN, OH 43402
B08-510-120103125000	BEAVERSON DUSTIN D & KRISTEN N	1720 WEXFORD BOWLING GREEN, OH 43402
B08-510-120103017000	BEODDY THOMAS	755 GREYSTONE DR BOWLING GREEN, OH 43402
B08-510-120103021000	BIHN MICHAEL A & DARLENE	803 GREYSTONE DR BOWLING GREEN, OH 43402
J36-611-300000014000	BLACK SWAMP FARMERS LLC	20590 HULL PRAIRIE RD BOWLING GREEN, OH 43402
B08-510-120101003500	BLUE CREEK LLC	6255 SUGAR RIDGE RD PEMBERVILLE, OH 43450
R63-510-110000017000, R63-510-110000018000	BOMELI JASON C & RIFE EMILY	14634 BISHOP RD BOWLING GREEN, OH 43402
R63-510-020000003001	BOSTDORFF CHARLES L	18745 BRIM ROAD BOWLING GREEN, OH 43402
R62-510-030001001000	BOSTDORFF JAMES D, SELENE M & JAMES F	19210 HASKINS RD BOWLING GREEN, OH 43402
J34-610-270000016000, J34-610-340000022002, R62-510-020000007001, R62-510-030001014000, R62-510-020000006000, R62-510-030001015002	BOSTDORFF JAMES F	19210 HASKINS RD BOWLING GREEN, OH 43402
C11-511-060000019000, R63-510-010301018000	BOSTDORFF RICHARD S & MARY ANN	18150 BRIM RD BOWLING GREEN, OH 43402
R62-510-030001002000	BOSTDORFF ROGER & BARBARA	18622 ST RT 199 PEMBERVILLE, OH 43450
R63-510-110000015000, R63-510-110000016000	BRADFORD MARY E	14592 BISHOP RD BOWLING GREEN, OH 43402
R63-510-120000014000	BUCKINGHAM RUAH E TRUSTEE	221 BIDDLE ST BOWLING GREEN, OH 43402
R63-510-120000024000, R63-510-120000027000	BURKHART DOUGLAS L & FLORENCE E	14654 POWELL RD PORTAGE, OH 43451

PID	PROPERTY OWNER	ADDRESS
J34-611-190000021000	BUSCH RICHARD NORMAN	13130 MIDDLETON PIKE BOWLING GREEN, OH 43402
J34-611-190000029000, J34-611-190000020000	BUSCH VICTORIA LYNN ATTN: NORMAN BUSCH	2710 MCCORD RD TOLEDO, OH 43615
R63-510-120000001000	BUSHMAN BARBARA A	5317 ALEXANDER RD PEMBERVILLE, OH 43450
R63-510-120102031000	CARMONA ROBERT & DARLENE	13882 BISHOP RD BOWLING GREEN, OH 43402
B08-510-120103023000	COCKE KAY L	811 GREYSTONE DR BOWLING GREEN, OH 43402
R63-510-010000030000	COE RANDALL S	7004 E 207TH ST BRADENTON, FL 34211
B08-510-120103002000, B08-510-120103001000, B08-510-120103003000	COGAN'S CROSSING HOMEOWNERS ASSOCIATION	PO BOX 323 BOWLING GREEN, OH 43402
R63-510-020000001000	COLCORD ROGER D & DONNA J	14510 HANNAH RD BOWLING GREEN, OH 43402
R63-510-020206014000	COPE JAMES M & PAHL-COPE KAITLYN C	14470 HANNAH RD BOWLING GREEN, OH 43402
B08-510-120101002500	CROMLEY GERALD R & DOROTHY E	720 BISHOP RD BOWLING GREEN, OH 43402
B08-510-120103024000	DANIELS SHARON K	815 GREYSTONE DR BOWLING GREEN, OH 43402
B08-510-120103022000	DAUTERMAN KAREN G	115 N ENTERPRISE BOWLING GREEN, OH 43402
B08-510-120103025000	DIEGEL WILLIAM J & PAMELA J	817 GREYSTONE DR BOWLING GREEN, OH 43402
B08-510-120103009000	DISHOP TERESA KAY	1513 COGANS LN BOWLING GREEN, OH 43402
B08-510-120000021000, B08-510-120000004500, B08-510-120000020000	DIXIE COMMERCIAL BUILDING LLC	445 WOOSTER E ST BOWLING GREEN, OH 43402
J36-611-310000004000	DSJN PLL	28300 WHITE RD PERRYSBURG, OH 43551
C11-511-060000018000, C11-611-310000039000, C11-611-310000018000	DUNIPACE MICHAEL J & MARY L	12587 CROSS CREEK RD BOWLING GREEN, OH 43402
C11-611-310000036000, C11-611-310000035000	DUNIPACE MICHAEL JAMES TRUSTEE ET AL	12587 CROSS CREEK RD BOWLING GREEN, OH 43402
J36-611-300000016000, J34-610-150000001000	ECKEL BERNARD C & MARGARET A	2192 OLD TRAIL RD PERRYSBURG, OH 43551
J36-611-310000011000	EMCH MICHAEL & EMCH PATTI	21450 DUNBRIDGE RD BOWLING GREEN, OH 43402
R62-510-020000011500	EULER JANEEN L	14853 HANNAH RD BOWLING GREEN, OH 43402
R63-510-110000044000, R63-510-110000043000	FIEBELKORN BARBARA A	14401 BISHOP RD BOWLING GREEN, OH 43402
R63-510-110000045000, R63-510-110000046000, R63-510-110000047000, R63-510-110000042000	FIEBELKORN BARBARA A TRUSTEE @ (2)	15505 BISHOP RD BOWLING GREEN, OH 43402
R63-510-110000006500, R63-510-110000006501	FIEBELKORN DOUGLAS A & SUSAN K	14212 BISHOP RD BOWLING GREEN, OH 43402

PID	PROPERTY OWNER	ADDRESS
C11-511-070000003000	FOOS BERNARD F & ANGIE L	10637 SUGAR RIDGE RD BOWLING GREEN, OH 43402
J34-611-190000019000	FULFORD GREGORY E & BURKE LORIE A	21378 DIXIE HY N BOWLING GREEN, OH 43402
J34-610-350000013500	FULLENKAMP ADAM	14909 CROSS CREEK RD BOWLING GREEN, OH 43402
B08-510-120103020000	GARCIA DAVID J TRUSTEE	767 GREYSTONE DR BOWLING GREEN, OH 43402
R63-510-120102025000	GARN KAREN L	13795 LARCH CT BOWLING GREEN, OH 43402
R63-510-120000031000	GERETY DAVID D & SANDRA J	13423 BISHOP RD BOWLING GREEN, OH 43402
C11-611-310000020000	GETZ PENELOPE S TRUSTEE	216 E GREENWOOD DR HASKINS, OH 43525
C11-611-310000019000	GONZALEZ ALBERTO & JOANNE E	12615 CROSS CREEK RD BOWLING GREEN, OH 43402
C11-511-060000023500	GRAY SHARON L TRUSTEE	18516 DIXIE N HWY BOWLING GREEN, OH 43402
R63-510-020000002000	GREEN KENZI & CLOUSE MICHAEL	14582 HANNAH RD BOWLING GREEN, OH 43402
J34-611-190000023500	HAAS JAMES	420 WALNUT ST PERRYSBURG, OH 43551
J34-611-190000023501	HAAS JAMES A & HELEN S	420 WALNUT ST PERRYSBURG, OH 43551
J34-610-140000005001	HALL JEFFREY A & CATHY D	14746 KING RD BOWLING GREEN, OH 43402
R63-510-120102028000	HAMMON JAMES R & MARILYN L	17573 BRIM RD BOWLING GREEN, OH 43402
R62-510-020000004000, C11-511-060000023502, R62-510-020000005000	HANNA DREW A TRUSTEE	700 N MAIN ST BOWLING GREEN, OH 43402
R63-510-020000017002	HARRIS BRUCE E & KRISTINA L	14227 HANNAH RD BOWLING GREEN, OH 43402
R63-510-020000017004	HARRIS MICHAEL W & LISA C	18404 HULL PRAIRIE RD BOWLING GREEN, OH 43402
C11-611-310000037000, C11-611-310000038000	HART CLIFFORD L JR & KRISTIN A	12680 SUGAR RIDGE RD BOWLING GREEN, OH 43402
J37-611-180000011000	HARTMAN LORETTA M & PETERS CHERYL S TRUSTEES	14423 OVITT RD PERRYSBURG, OH 43551
R63-510-020000015000	HELLER JANEEN L	14583 HANNAH RD BOWLING GREEN, OH 43402
C11-511-060000024000	HENRY MARY DELLA	10105 ROACHTON RD PERRYSBURG, OH 43551
C11-511-060000025000, C11-511-070000006000	HENRY PHYLLIS E TRUSTEE	25102 LIME CITY RD PERRYSBURG, OH 43551
B08-510-120101005500	HINTZ KIRK W & CAROL A	13518 BISHOP RD BOWLING GREEN, OH 43402
P60-400-310000018003, P60-400-310000018002	HINTZ NORBERT A & CONNIE L	12824 DOWLING RD BOWLING GREEN, OH 43402
B08-510-120103005000	HOCKLEY SHIRLEY J	1514 COGANS LN BOWLING GREEN, OH 43402
B08-510-120103008000	HOVER RONALD L & JANET S	1509 COGANS LN BOWLING GREEN, OH 43402

PID	PROPERTY OWNER	ADDRESS
J36-611-310000009000, J36-611-310000008000	HOWGIN LLC	19953 TWP RD 66 ARLINGTON, OH 45814
R63-510-110000001000	HUDSON SHAWN J & TERESA M	14260 BISHOP RD BOWLING GREEN, OH 43402
J36-611-3000000012000	JOHNSON RODERICK J	20354 DIXIE N HWY BOWLING GREEN, OH 43402
J37-611-180000009000	JOHNSON SHERROD H TRUSTEE	12698 NEWTON E RD BOWLING GREEN, OH 43402
R63-510-120101001000	JORGENSEN DONALD R	17942 BRIM RD BOWLING GREEN, OH 43402
C11-511-0600000020000	KARR ROBERT A	18778 DIXIE N HWY BOWLING GREEN, OH 43402
R63-610-3600000027002, R63-510-010000001000	KAZMAIER TERRY L & CHARLES	975 ROCA PALCE CHULA VISTA, CA 91910
R63-610-3600000025000	KAZMAIER TERRY LEE	975 ROCA PLACE CHULA VISTA, CA 91910
R63-510-1100000012000	KIEFER JOSHUA J & AMANDA M	14510 BISHOP RD BOWLING GREEN, OH 43402
R63-510-0100000026000	KIEFFER CHRISTINE M TRUSTEE	13207 UNION HILL RD BOWLING GREEN, OH 43402
R63-610-3600000027000	KIEFFER RUSSELL W	4910 TIEDEMAN RD BROOKLYN, OH 44144
B08-510-120103019000	KLINK DANIEL L	763 GREYSTONE BOWLING GREEN, OH 43402
R63-510-1100000014000, R63-510-1100000013000	KONECNY CHARLES F & MARTHA J	14526 BISHOP RD BOWLING GREEN, OH 43402
J34-610-2600000020001	KUBACKI MATTHEW S	20190 ASMUS RD BOWLING GREEN, OH 43402
R63-510-1100000024000	LEGALLEY DOUGLAS R	812 CHERRY HILL DR BOWLING GREEN, OH 43402
R63-510-0200000016000, R63-510-1100000010000	LEGALLEY DOUGLAS R & TONI M	812 CHERRY HILL DR BOWLING GREEN, OH 43402
J34-610-2600000004000	RENEE LEWIS SORCKIK	29160 CHARLOTTE SW LN WILSONVILLE, OR 97070
R63-510-1200000030000	LEWIS PATRICIA A	13451 BISHOP RD BOWLING GREEN, OH 43402
J34-610-2600000006000	LIMES DONALD WAYNE & KATHY LYNN TRUSTEES	20590 HULL PRAIRIE RD BOWLING GREEN, OH 43402
J34-610-3500000002500, J34-610-3500000008001	LIMES GALEN E & NANCY L	19867 HULL PRAIRIE RD BOWLING GREEN, OH 43402
J34-610-3500000009000, J34-610-3500000008000, J34-610-3500000013000, J34-610-3500000018000, J34-610-3500000017000, J34-610-3400000002000, J34-610-3500000019000, J34-610-3400000003000, J34-610-3500000015000, J34-610-3500000016000, J34-610-3500000014000, J34-610-22000	LIMES RODNEY A ETAL	19625 ASMUS RD BOWLING GREEN, OH 43402
R63-510-1200000025000, R63-510-1200000026000	LINDAHL BURKHART R TRUSTEE	5116 ABEL MERRIL RD COLUMBUS, OH 43221

PID	PROPERTY OWNER	ADDRESS
C11-611-310000032000, C11-611-310000031000	LORENZEN ROBERT A & PATRICIA	19316 N DIXIE HWY BOWLING GREEN, OH 43402
C11-511-060000023000	LUIDHARDT JON	9738 NELSON RD BOWLING GREEN, OH 43402
J36-611-300000013000, J36-611-310000003000	LW INVESTMENT GROUP LLC	20590 HULL PRAIRIE RD BOWLING GREEN, OH 43402
C11-611-310000022000	MARSHALL STEVEN J & PAMELA L	19486 N DIXIE HWY BOWLING GREEN, OH 43402
B08-510-120103026000	MARTINEZ JAVIER HOYOS & HOYOS LAURIE A	1603 WATERFORD DR BOWLING GREEN, OH 43402
J34-611-190000017000	MASON CLARENCE W	19486 N DIXIE HWY BOWLING GREEN, OH 43402
C11-511-070000007000	MAURER JAMES A	17910 N DIXIE HWY BOWLING GREEN, OH 43402
R63-510-010000030500	MAURER MOBILE HOME COURT INC	17910 N DIXIE HWY BOWLING GREEN, OH 43402
R63-510-120102032000	MAURER ROBERT W	445 E WOOSTER ST BOWLING GREEN, OH 43402
R63-510-120102030000	MAURER ROBERT W & GREEN ALLEN A	445 E WOOSTER ST BOWLING GREEN, OH 43402
B08-510-120000002001, B08-510-120000002000	MAURER ROBERT W & PATRICIA A	445 WOOSTER E ST BOWLING GREEN, OH 43402
C11-611-310000023000	MCCARTHY CINDY A TRUSTEE	19454 DIXIE N HWY BOWLING GREEN, OH 43402
B08-510-120103018000	MCCREERY DANIEL S & DIANE M	759 GREYSTONE DR BOWLING GREEN, OH 43402
J36-611-190000003000, J36-611-190000005000, J36-611-190000002500, J36-611-190000004000, J34-611-190000007000	MEIER SALLY H MEIER SALLY H TRUSTEE	21793 MERCER RD BOWLING GREEN, OH 43402
C11-611-310000029000	MEYER AARON	19350 DIXIE N HWY BOWLING GREEN, OH 43402
J34-611-190000015000	MILLER ERIC A & BETH ANN	21542 DIXIE N HWY BOWLING GREEN, OH 43402
R63-510-010000033000	MJ MCHAFFIE LLC	18237 DIXIE N HWY BOWLING GREEN, OH 43402
J34-610-140000009000, J34-610-260000017000, J34-610-260000018000	MOSER K DALE	17388 HANNAH RD BOWLING GREEN, OH 43402
J34-610-260000019000	MOSER LAURA MAE	20540 ASMUS RD BOWLING GREEN, OH 43402
B08-510-120103127000	MURPHY DANIEL W	1712 WEXFORD DR BOWLING GREEN, OH 43402
R63-510-010000031000	NEWTON LANDING LLC	445 WOOSTER E ST BOWLING GREEN, OH 43402

PID	PROPERTY OWNER	ADDRESS
R63-510-110000009500, R63-510-110000033001, R63-510-120102033000, R63-510-110000003000, R63-510-110000041000, R63-510-110000009501, R63-510-120102035000, R63-510-110000008001, R63-510-110000032000, R63-510-110000002000, R63-510-110000033000, R63-510-11000	NIETZ CHRISTIANA K TRUSTEE	15505 BISHOP RD BOWLING GREEN, OH 43402
R63-510-110000042001	NIETZ JOHN C & BETSY L	14435 BISHOP RD BOWLING GREEN, OH 43402
R63-510-110000020000, R63-510-110000019000	NIETZ RONALD C & MESSENGER JILL S	15505 BISHOP RD BOWLING GREEN, OH 43402
J36-611-300000003000	O C INDUSTRIAL PROPERTIES LTD	25730 FIRST ST WESTLAKE, OH 44145
J36-611-300000004500	OC INDUSTRIAL PROPERTIES LTD	12763 MIDDLETON PIKE BOWLING GREEN, OH 43402
B08-510-120103132000	OVERTON ALLEN D & KIRBY	1692 WEXFORD DR BOWLING GREEN, OH 43402
R63-510-120000001001, R63-510-010000039500, R63-510-010000038000, R63-510-010000037000, J34-611-190000026000, J34-611-190000027000, J34-611-190000028000	P & J THAYER FAMILY LIMITED PARTNERSHIP	PO BOX 365 BOWLING GREEN, OH 43402
C11-611-310000021000	PELTON SUZETTE M	19496 N DIXIE HWY BOWLING GREEN, OH 43402
J37-611-180000012000	PETERS CHERYL	13030 KING RD BOWLING GREEN, OH 43402
P60-400-310000016000, J34-610-230000005000	PETTEYS DAVID P & BARBARA S TRUSTEES	12420 DOWLING RD BOWLING GREEN, OH 43402
J34-611-190000022000	PINE APARTMENTS LTD	121 EAST WOOSTER ST BOWLING GREEN, OH 43402
B08-510-120103004000	REED PAUL E	1510 COGANS LANE BOWLING GREEN, OH 43402
R63-510-020206011501	RIFFNER MEGAN D & BRETT W	14338 HANNAH RD BOWLING GREEN, OH 43402
R63-510-010000036000, R63-510-010000035000	RIKER LESLEY A TRUSTEE	10334 POE ROAD E BOWLING GREEN, OH 43402
C11-511-060000023501	RINGLER DOUGLAS TRUSTEE	18702 DIXIE N HWY BOWLING GREEN, OH 43402
R63-510-120000022500	RPM COMMERCIAL LLC	445 WOOSTER E ST BOWLING GREEN, OH 43402
C11-511-060000028000, C11-611-310000016500, C11-611-310000016501, C11-611-310000015000	SABO SHERYL A	12515 CROSS CREEK RD BOWLING GREEN, OH 43402
C11-611-310000041000	SAVAGE ERNEST N TRUSTEE	12502 SUGAR RIDGE RD BOWLING GREEN, OH 43402

PID	PROPERTY OWNER	ADDRESS
C11-611-310000040000, C11-611-310000041002	SAVAGE LOUISE A TRUSTEE	12502 SUGAR RIDGE RD BOWLING GREEN, OH 43402
B08-510-120103131000, B08-510-120103130000, B08-510-120103129000, B08-510-120103128000	SAYLER TODD M & HEATHER D	1700 WEXFORD DR BOWLING GREEN, OH 43402
J34-611-1900000016500	SCHMIDT JOHN T & AMY E	28581 DIXIE HIGHWAY N BOWLING GREEN, OH 43402
J34-610-3500000013001, J34-610-3500000014001	SCHULTE DAVID L & DARLA L	14955 CROSS CREEK RD BOWLING GREEN, OH 43402
C11-611-310000034000, C11-611-310000033000	SHEEKS RANDY & TERRILL	19302 N DIXIE HWY BOWLING GREEN, OH 43402
R62-510-020000008000	SHELDRIK RODNEY A & TAWNA S	14787 HANNAH RD BOWLING GREEN, OH 43402
J34-610-230000004000	SHORT RICHARD E & MONA L	1155 GLEN LEVEN ANN ARBOR, MI 48103
C11-611-310000027000, C11-611-310000026000	SIDIQ MOHAMMAD & JOSEFINA TRUSTEES	19386 N DIXIE HWY BOWLING GREEN, OH 43402
R63-510-020000017003	SIDLE STEPHEN M & DAUN M	18340 HULL PRAIRIE RD BOWLING GREEN, OH 43402
R63-510-020000017000	SKIRVIN MARC W & MARCY A	18280 HULL PRAIRIE RD BOWLING GREEN, OH 43402
P60-400-310000018000, J34-100-360000021000, P60-400-310000019000	SLOWINSKI FRANK JR & MARLENE M	26350 THOMPSON RD PERRYSBURG, OH 43551
C11-511-060000017000	SMELTZER DALE L & MARY J TRUSTEES	12500 SUGAR RIDGE RD BOWLING GREEN, OH 43402
R63-510-020206011500	SMITH DANIEL A & DONNA M TRUSTEES	9828 E PUEBLO AVE LOT 112 MESA, AZ 85208
R63-510-120000002500	SMITH FRANK L	PO BOX 266 BOWLING GREEN, OH 43402
B08-510-120103007000	SMITH JARED H & WILHELM LAUREN	1522 COGANS LN BOWLING GREEN, OH 43402
R63-510-020000014000, R63-510-020201002001	SMITH PATRICIA ELAINE	4292 US HIGHWAY 224 W TIFFIN, OH 44883
B08-510-120103126000	SNYDER BRUCE T & VICKI J	30072 WATERFORD RD PERRYSBURG, OH 43551
R63-510-120000029000, R63-510-120000022501	SNYDER RICK L	13481 BISHOP RD BOWLING GREEN, OH 43402
R63-510-120000022502	SNYDER STEVEN JAY & KIMBERLY A	11851 NEWTON RD BOWLING GREEN, OH 43402
R63-510-110000022000	SOUTHWICK CHRISTOPHER D KAUFMAN BETHANY N	14750 BISHOP RD BOWLING GREEN, OH 43402
J34-610-220000012001	SPAULDING SCOTT A & CHERI L	15002 MIDDLETON PIKE BOWLING GREEN, OH 43402
J36-611-300000021000	SPECK FAMILY TRUST	17746 N DIXIE HWY BOWLING GREEN, OH 43402
C11-511-070000008000	SPECK TERRY L & BRUCE W	17746 N DIXIE HWY BOWLING GREEN, OH 43402
B08-510-120103006000	SRD	1518 COGANS LN BOWLING GREEN, OH 43402
R63-510-020206012000, R63-510-020206013000	STOUT ROBERT M & PENELOPE S	14286 HANNAH RD BOWLING GREEN, OH 43402

PID	PROPERTY OWNER	ADDRESS
R63-510-020000003000	STUBBLE FIELD LLC	18150 BRIM RD BOWLING GREEN, OH 43402
J36-611-300000002000	SULLIVAN KEVIN P TRUSTEE	11908 E GYPSY LANE E RD BOWLING GREEN, OH 43402
C11-611-310000030000	SZYMANSKI THOMAS & BRITANEY	19330 N DIXIE HWY BOWLING GREEN, OH 43402
J34-610-2300000010000	THAMES FARMS INC	P O BOX 187 PERRYSBURG, OH 43552
C11-611-310000025000, C11-611-310000024000	THOMAS WAYNE & CONNIE S	19442 N DIXIE HWY BOWLING GREEN, OH 43402
C11-511-060000019001	TIMM ERIC D & DENISE E	18832 DIXIE N HWY BOWLING GREEN, OH 43402
C11-511-060000011000	TOBER DENNIS G & BARBARA A	12436 SIMONDS RD BOWLING GREEN, OH 43402
R63-510-010000034000	TRACTOR SUPPLY CO	PO BOX 7002 BRENTWOOD, TN 37027
J36-611-300001001000	USF HOLLAND LLC	20820 MIDSTAR DR BOWLING GREEN, OH 43402
J37-611-180000007000, J37-611-180000008000	VAN CLEVE VERNON E & JO A	12349 DOWLING RD BOWLING GREEN, OH 43402
J36-611-300000019000	VOLLMAR STEVEN J & JANA A	12502 DEVILS HOLE RD BOWLING GREEN, OH 43402
J36-611-310000005000	WEAKLEY LESLEY & JISKOOT JODY	900 DEERPATH RD DOTHAN, AL 36303
J34-610-230000003000	WEIHL HAROLD W & MARY L TRUSTEES	14282 KING RD BOWLING GREEN, OH 43402
J34-610-350000011000, J34-610-260000023000, J34-610-340000004000, J34-610-350000010000, J34-610-270000015000, J34-610-350000012000, J34-610-270000001000, J34-610-340000001000	WENIG BETTY J & WENIG BETTY J LE @ 3	19993 ASMUS ROAD BOWLING GREEN, OH 43402
J34-610-230000008000	WENIG GORDON A	14666 ST RT 582 BOWLING GREEN, OH 43402
J34-610-260000016000, R62-510-020000013000, R62-510-020000010000, R62-510-020000009000, R62-510-020000012000	WENIG GORDON A TRUSTEE	14666 MIDDLETON PIKE BOWLING GREEN, OH 43402
J34-610-270000003000, J39-610-270000006000, J34-610-270000005000, J34-610-270000004000	WENIG JUNE TR 1/2 LE 1/2 WENIG DOUGLAS & DIANE RM	20760 HASKINS RD BOWLING GREEN, OH 43402
J34-610-270000014002	WENIG JUNE TRUSTEE	20760 HASKINS RD BOWLING GREEN, OH 43402
J34-610-260000022000, J34-610-260000021000	WENIG PHILLIP B	15493 MIDDLETON PIKE BOWLING GREEN, OH 43402
J34-610-220000001000	WENIG PHILLIP B & JULIE J	15493 MIDDLETON PIKE BOWLING GREEN, OH 43402
R63-510-120102026000	WIEBER BRANDON & KATIE	13777 LARCH COURT BOWLING GREEN, OH 43402

PID	PROPERTY OWNER	ADDRESS
R63-510-110000004500	WILLMAN ROBERT F & JANETTE F TRUSTEES	14118 BISHOP RD BOWLING GREEN, OH 43402
J34-610-140000008000	WILSON JAMES	14900 KING ROAD BOWLING GREEN, OH 43402
R63-510-010000027000	WULFF RENTALS LTD	13891 POWELL RD PORTAGE, OH 43451
R63-510-110000021000	YARGER KEVIN L & COLLEEN M	14710 BISHOP RD BOWLING GREEN, OH 43402
J34-611-190000018000	YEARY JOSEPH H & NANCY K TRUSTEES	11227 RIVER S RD GRAND RAPIDS, OH 43522
C11-611-310000028000	YODER BRADLEY J & EMILY B	19368 DIXIE N HWY BOWLING GREEN, OH 43402
J36-611-300000017000, J36-611-300000018000	ZAUTNER TODD & JOANNE M	12610 DEVILS HOLE RD BOWLING GREEN, OH 43402
J36-611-300000001000	ZISS CONNIE & ZISS JAMES	1052 W WOOSTER ST BOWLING GREEN, OH 43402



76 S. Main St.
Akron, OH 44308

October 7, 2019

[Property Owner Name]
[Address Line 1]
[Address Line 2]

Re: OPSB Case No. 18-1335-EL-BTX, Application to the Ohio Power Siting Board for a Certificate of Environmental Compatibility and Public Need For the Wood County 138 kV Reinforcement Project ("Project")

Dear Sirs:

American Transmission Systems, Incorporated (ATSI), a FirstEnergy company, is proposing to construct the Wood County 138 kV Reinforcement Project ("Project"). Before ATSI can proceed with construction of this Project, it must obtain the approval of the Ohio Power Siting Board ("OPSB"). An application for a Certificate of Environmental Compatibility and Public Need to construct, operate and maintain the facility is currently pending at the OPSB. This letter briefly describes the Project, the OPSB certification process and provides you with notice of the date, time and location of an upcoming public hearing on the Project.

This letter is being prepared and sent in accordance with Ohio Administrative Code ("OAC") Rule 4906-3-09(A)(2) which requires ATSI to send a notice to local government officials in the Project area and property owners on, or adjacent to, the routes under consideration for the Project. This notice letter further complies with the specific instructions of the Administrative Law Judge who issued an order on September 4, 2019, setting the date and time for the public hearing on this Project.

In this Project, ATSI is proposing to construct an approximately 6.1 mile-long transmission line from the existing Lemoyne-Midway 138 kV Transmission Line to the Brim Substation. The proposed Project is needed to mitigate thermal loading issues, improve area voltage stability, allow for future load growth, and will help ensure safe and reliable service to the area. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio.

NOTICE OF PROPOSED MAJOR UTILITY FACILITY

American Transmission Systems, Incorporated ("ATSI"), a FirstEnergy company, proposes to construct the Wood County 138 kV Reinforcement Project ("Project") in an Application submitted to the Ohio Power Siting Board (OPSB) for a Certificate of Environmental Compatibility and Public Need. The Project proposes to construct a new 138 kV transmission line that will extend from the existing Lemoine-Midway 138 kV Transmission Line to Brim Substation. An Application to construct, operate and maintain this facility is now pending before the Ohio Power Siting Board and has been assigned Case Number 18-1335-EL-BTX. Route alternatives under consideration traverse Middleton, Center and Plain Townships and a portion of the City of Bowling Green in Wood County, Ohio, and the general locations of the Preferred and Alternate Routes for the Project are shown on the accompanying map of the area.



As scheduled by Board, the public hearing of this case consists of two parts:

- A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on October 24, 2019, at 6:00 p.m., at the Ohio Department of Transportation - District 2, 317 East Poe Road, Bowling Green, Ohio 43402.
- An evidentiary hearing commencing on November 7, 2019, at 10:00 a.m., in Hearing Room 11-D at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.

4906.08(C). Parties – testimony

(C) The board shall accept written or oral testimony from any person at the public hearing, but the right to call and examine witnesses shall be reserved for parties. However, the board may adopt rules to exclude repetitive, immaterial, or irrelevant testimony.

This marks the second, and final, public notice regarding public hearings for the Project. The first notice was mailed to those persons that received service of a copy of the application and each owner of a property crossed and/or adjacent to the preferred and alternate routes, on April 23, 2019.

As part of the procedural requirements associated with the OPSB review of the application, ATSI sent notification letters of the submittal of the application on April 18, 2019 to local public officials in the Project area and on April 23, 2019 to all property owners on, or adjacent to, the transmission line routes being considered for the Project. On May 23, 2019, the original public hearing for this Project was cancelled to give the OPSB more time to collect information on the Project. On September 4, 2019, the Administrative Law Judge rescheduled the public hearing. We are providing this notice to you in response to the setting of the public hearing and in accordance with the Administrative Law Judge's Order. More information on the OPSB can be found on their website at <http://www.opsb.ohio.gov/opsb.cfm>. The Application for the Project can also be found at this website, under the OPSB assigned case number of 18-1335-EL-BTX.

As rescheduled by the Board, the public hearing of this case consists of two parts:

- A. A local public hearing, pursuant to Section 4906.08(C), Revised Code, where the Board shall accept written or oral testimony from any person on Thursday, October 24, 2019, at 6:00 p.m. at the Ohio Department of Transportation – District 2, 317 East Poe Road, Bowling Green, Ohio 43402, and**
- B. An evidentiary hearing commencing on Thursday, November 7, 2019, at 10:00 a.m., in Hearing Room 11-D, at the offices of the Public Utilities Commission of Ohio, 180 East Broad Street, Columbus, Ohio 43215-3793.**

At the local public hearing, members of the public will be given an opportunity to comment on the proposed Project. The OPSB will issue a final decision after the conclusion of the hearings. If the OPSB approves the Project, construction is tentatively scheduled to begin in February 2020. ATSI representatives will contact property owners prior to starting any construction work on their property.

Please note that the case number, Case No. 18-1335-EL-BTX, should include in any correspondence with the OPSB on this Project to ensure that comments are included in the record of the proceeding.

Finally, up-to-date Project information can be found online at:

https://www.firstenergycorp.com/about/transmission_projects/ohio/wood-county-reinforcement.html

Sincerely,



Scott M. Humphrys
Transmission Siting Supervisor
Energy Delivery Transmission and Substation Design
FirstEnergy Service Company

This foregoing document was electronically filed with the Public Utilities

Commission of Ohio Docketing Information System on

10/15/2019 11:22:21 AM

in

Case No(s). 18-1335-EL-BTX

Summary: Proof of Pub of Second Public Notice and Notice of Mailing of Public Official, Library and Property Owner Notification Letters. electronically filed by Mr. Robert J Schmidt on behalf of American Transmission Systems Inc.